


APPENDIX A

Detailed Water Quality Reports
of Samples Collected in 2022

APPENDIX B

Metro Vancouver Water Quality Control
Annual Report for 2022

DRINKING WATER QUALITY 2022 ANNUAL REPORT

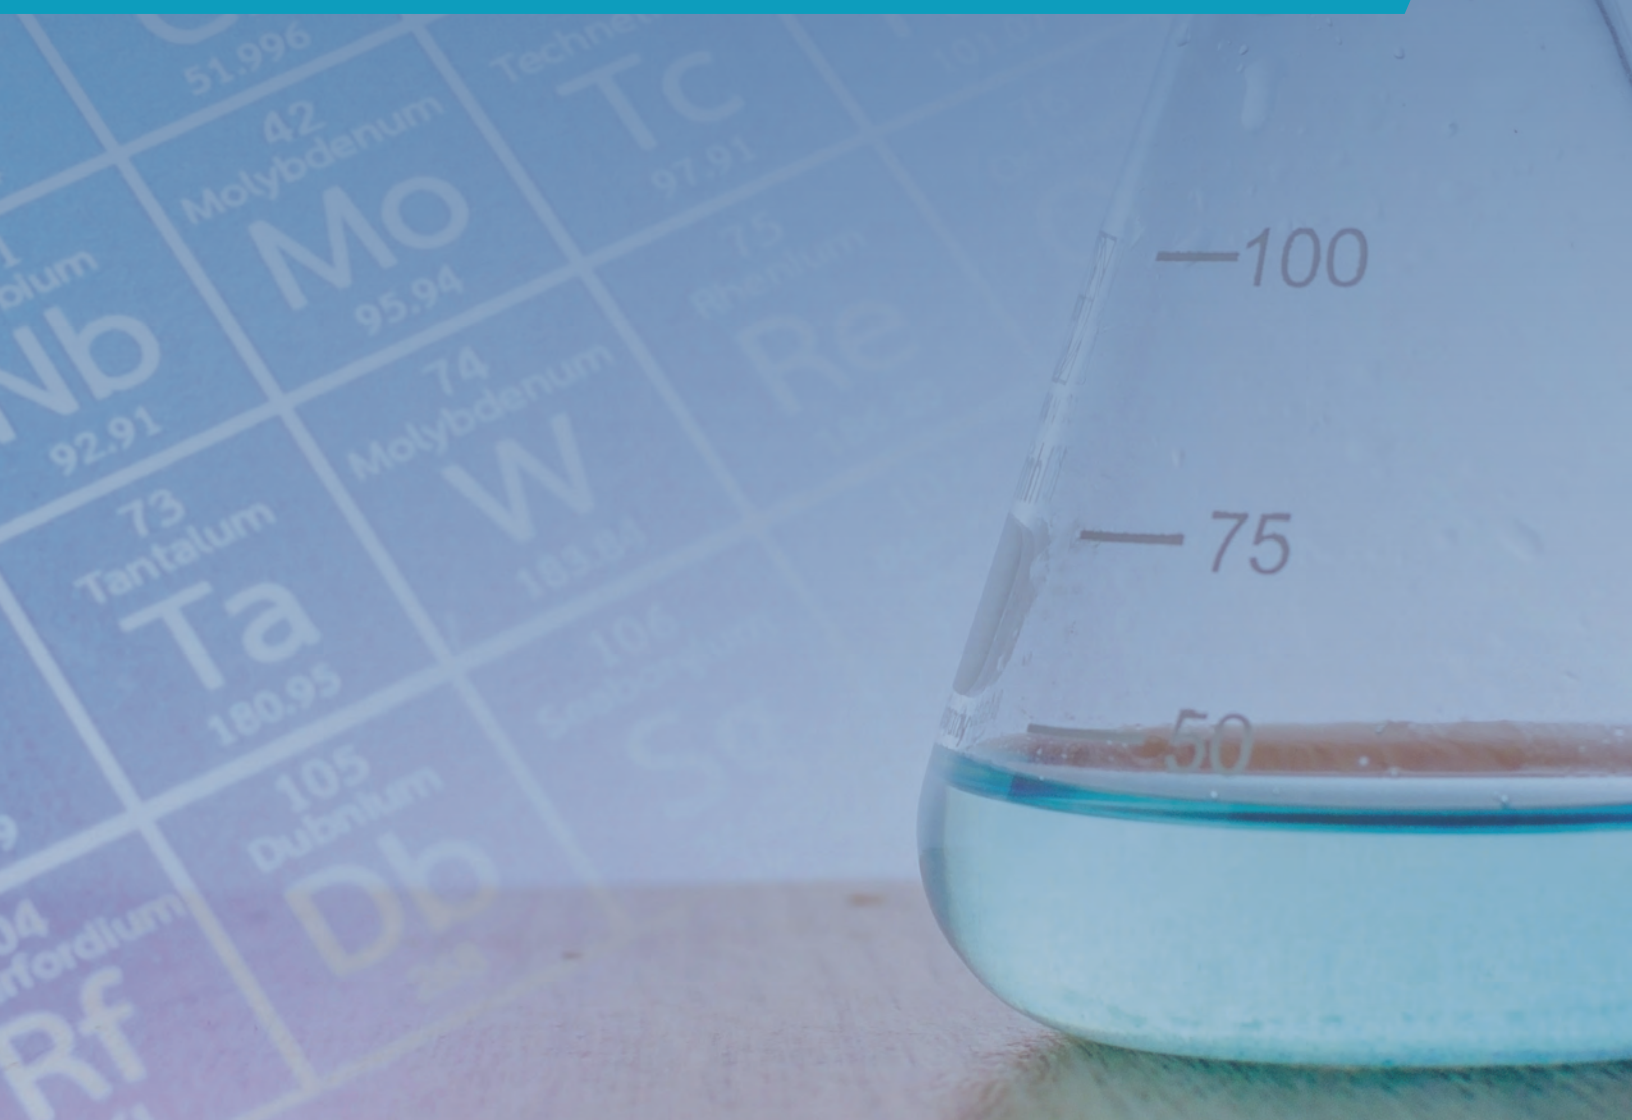

APPENDIX A

Detailed Water Quality Reports
of Samples Collected in 2022

DRINKING WATER QUALITY 2022 ANNUAL REPORT



Appendix A: Drinking Water Station Locations- City of Burnaby Sites (2022)

Site Code	Location	Water Source	Pressure Zone	Flow Type	Main Composition	Main Size (mm)	Parameters Analyzed
BUR-490K	8550 Barnet Highway	SEY	Barnet	D	AC/ST/DI	250/300/200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-491K	7400 Block Fraser Park Drive	SEY/COQ	Big Bend	L	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-492K	5700 Block Marine Drive	SEY/COQ	Big Bend	M	CI	250	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-493K	7740 20th St. (10th Ave. Res.)	SEY	Big Bend	D	DI	500	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-494K	3700 Block Banting Place	SEY/COQ	Big Bend	D	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-495K	8400 Block Nelson Avenue	SEY/COQ	Big Bend	L	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-496K	8200 Block Wiggins Street	SEY/COQ	Big Bend	D	DI	250	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-497K	8300 Block Willard Street	SEY/COQ	Big Bend	D	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-498K	9001 Riverway Place	SEY/COQ	Big Bend	L	DI	250	Bacteriology, Turbidity, Temp., Free Chlorine, DBP, Metals
BUR-499K	3800 Block North Fraser Way	SEY/COQ	Big Bend	M	DI	250	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-500K	5400 Block Dundas Street	SEY	Capitol Hill	M	AC	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-529K	5200 Block Penzance	SEY	Hastings	L	CI	250	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-530K	400 Block Northcliffe Crescent	SEY	Hastings	L	Polybutylene	50	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-560K	3600 Brighton Avenue	SEY/CAP	Central Valley	M	DI	300	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-561K	6100 Block Deer Lake Parkway	SEY/CAP	Central Valley	M	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine, DBP, Metals
BUR-562K	1300 Block Gilmore Street	SEY/CAP	Central Valley	D	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-563K	6200 Block Lougheed Hwy	SEY/CAP	Central Valley	M	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-564K	4410 Still Creek Drive	SEY/CAP	Central Valley	L	DI	250	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-565K	5500 Block Laurel Street	SEY/CAP	Central Valley	M	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine

Appendix A: Drinking Water Station Locations- City of Burnaby Sites (2022)

Site Code	Location	Water Source	Pressure Zone	Flow Type	Main Composition	Main Size (mm)	Parameters Analyzed
BUR-566K	4200 Block Garden Grove Drive	SEY/CAP	Central Valley	M	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-567K	SS of CG Brown Pool, Sprrott St	SEY/CAP	Central Valley	M	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-568K	3800 Block Phillips Street	SEY/CAP	Central Valley	M	AC	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-569K	3200 Block Smith Avenue	SEY	Hospital	L	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-570K	6000 Buckingham Drive	SEY	Stanley	M	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine, Metals
BUR-572K	8500 Block Forest Grove Drive	SEY	Forest Grove	M	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-573K	4400 Block Dundas St	SEY	North Burnaby	M	HDPE	350	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-574K	200 Block Gilmore	SEY	North Burnaby	L	DI	300	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-575K	1100 Block Madison	SEY	North Burnaby	M	CI	150	Bacteriology, Turbidity, Temp., Free Chlorine, DBP
BUR-576K	6100 Block Curtis Street	SEY	North Burnaby	L	AC	300	Bacteriology, Turbidity, Temp., Free Chlorine, Metals
BUR-577K	1471 Heathdale Drive	SEY	North Burnaby	L	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-578K	1600 Block Burnwood Drive	SEY	North Burnaby	M	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-579K	3800 Block Ingleton	SEY	Hospital	M	CI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-580K	4400 Block Moscrop Street	SEY	Hospital	L	CI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-581K	7900 Block Kaymar Street	SEY/COQ	Joffre-Patterson	M	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-582K	8100 Block 16th Avenue	SEY/COQ	Kingsway	M	AC	200	Bacteriology, Turbidity, Temp., Free Chlorine, Metals
BUR-583K	7500 Block Edmonds Street	SEY/COQ	Kingsway	M	AC	300	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-584K	7200 Block Edmonds Street	SEY/COQ	Kingsway	M	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine, DBP, pH
BUR-585K	5400 Block Rumble Street	SEY/COQ	Kingsway	L	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine

Appendix A: Drinking Water Station Locations- City of Burnaby Sites (2022)

Site Code	Location	Water Source	Pressure Zone	Flow Type	Main Composition	Main Size (mm)	Parameters Analyzed
BUR-586K	3800 Block Rumble Street	SEY/COQ	Kingsway	M	CI	200	Bacteriology, Turbidity, Temp., Free Chlorine, DBP, Metals
BUR-587K	4400 Block Kingsway	SEY/COQ	Kingsway	L	CI	250	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-588K	7500 Block Cumberland Street	SEY/COQ	Kingsway	M	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-589K	6500 Block Marlborough Street	SEY/COQ	Kingsway	M	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-590K	6100 Block Imperial Street	SEY/COQ	Kingsway	L	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-592K	9800 Block Lyndhurst Street	SEY	Lake City	L	CI	150	Bacteriology, Turbidity, Temp., Free Chlorine, Metals
BUR-593K	3390 Lake City Way	SEY	Lake City	L	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-594K	9000 Centaurus Circle	SEY	Lake City	L	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine, DBP
BUR-595K	Rochester West of North Road	SEY	Lake City	M	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-596K	561 Duthie Avenue	SEY	North Burnaby	M	CI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-597K	Univ. High St. & Univ. Cresc.	SEY	Simon Fraser	D	DI	450	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-660K	North Road Across from Hume Park	SEY/CAP/COQ	Lake City	L	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-661K	5300 Block Kira Court	SEY/CAP/COQ	Hospital	L	CI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-668K	1000 Block Ayshire Drive	SEY/CAP/COQ	Curtis-Duthie	L	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-669K	Gatenby & Monarch	SEY/CAP/COQ	Kincaid	L	AC	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-800K	7400 Block Mulberry Place	SEY/CAP/COQ	Cariboo	L	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-850K	4300 Block Vipond Place	SEY/CAP/COQ	Kingsway	D	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-851K	9200 Block Holmes Street	SEY/CAP/COQ	Kingsway	L	DI	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-852K	7200 Block Gibson Street	SEY/CAP/COQ	North Burnaby	L	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine

Appendix A: Drinking Water Station Locations- City of Burnaby Sites (2022)

Site Code	Location	Water Source	Pressure Zone	Flow Type	Main Composition	Main Size (mm)	Parameters Analyzed
BUR-853K	1500 Block Sperling Avenue	SEY/CAP/COQ	North Burnaby	L	AC	200	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-854K	5500 Block Carson Street	SEY/CAP/COQ	South Slope	L	DI	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-855K	5000 Block Manor Street	SEY/CAP/COQ	Central Valley	L	AC	150	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-856K	Centennial Reservoir	SEY	Centennial		CI	200	Bacteriology, Turbidity, Temp., Free Chlorine, DBP
BUR-857K	Curtis Reservoir	SEY	Curtis-Duthie		DI	250	Bacteriology, Turbidity, Temp., Free Chlorine
BUR-858K	Sanderson Way	SEY/CAP	Central Valley	M	PVC	200	Vinyl Chloride

Explanatory Notes:

Flow Types:	M= medium Flow	SEY:	Seymour reservoir	Bacteriology: E. Coli, Total Coliform, Heterotrophic Plate Count
	L= low flow	COQ:	Coquitlam Reservoir	DPB: Disinfection byproducts
	D = unlooped lines with very low flow	CAP:	Capilano Reservoir	

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-491K	GRAB	Foot of Byrne Road	20-Jul-22	0.49	<1	<1	0.15	<2	
			03-Aug-22	0.57	<1	<1	0.19	<2	
			17-Aug-22	0.48	<1	<1	0.22	<2	
			31-Aug-22	0.44	<1	<1	0.19	<2	
			13-Sep-22	0.36	<1	<1	0.15	<2	
			27-Sep-22	0.52	<1	<1	0.25	<2	
			11-Oct-22	0.38	<1	<1	0.29	16	
			26-Oct-22	0.29	<1	<1	0.35	6	
			09-Nov-22	0.44	<1	<1	0.15	<2	
			22-Nov-22	0.43	<1	<1	0.14	<2	
			05-Dec-22	0.68	<1	<1	0.14	<2	
			29-Dec-22	0.7	<1	<1	0.26	NA	
			05-Jan-22	0.88	<1	<1	0.46	2	
BUR-492K	GRAB	5700 Blk Marine Drive	19-Jan-22	0.47	<1	<1	0.16	<2	
			02-Feb-22	0.94	<1	<1	0.15	<2	
			14-Feb-22	0.89	<1	<1	0.17	<2	
			02-Mar-22	0.43	<1	<1	0.12	<2	
			16-Mar-22	0.73	<1	<1	0.25	2	
			31-Mar-22	0.76	<1	<1	0.13	2	
			13-Apr-22	0.72	<1	<1	0.13	<2	
			27-Apr-22	0.65	<1	<1	0.1	<2	
			11-May-22	0.84	<1	<1	0.15	<2	
			25-May-22	0.65	<1	<1	0.13	<2	
			09-Jun-22	0.93	<1	<1	2.8	2	
			22-Jun-22	0.44	<1	<1	0.13	2	
			05-Jul-22	0.77	<1	<1	0.19	4	
BUR-493K	GRAB	7740 20th St. (10th Ave. Res.)	20-Jul-22	0.62	<1	<1	0.24	<2	
			03-Aug-22	0.76	<1	<1	0.22	<2	
			17-Aug-22	0.53	<1	<1	0.21	<2	
			31-Aug-22	0.5	<1	<1	0.21	2	
			13-Sep-22	0.51	<1	<1	0.16	<2	
			27-Sep-22	0.61	<1	<1	0.35	<2	
			11-Oct-22	0.41	<1	<1	0.25	<2	
			26-Oct-22	0.25	<1	<1	0.37	<2	
			09-Nov-22	0.3	<1	<1	0.21	<2	
			22-Nov-22	0.43	<1	<1	0.45	<2	
			05-Dec-22	0.7	<1	<1	0.14	<2	
			29-Dec-22	0.55	<1	<1	0.23	NA	
			05-Jan-22	0.82	<1	<1	0.58	<2	

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-493K	GRAB	7740 20th St. (10th Ave. Res.)	19-Jan-22	0.72	<1	<1	0.36	4	
			02-Feb-22	0.99	<1	<1	0.19	10	
			14-Feb-22	0.63	<1	<1	0.21	4	
			16-Mar-22	0.64	<1	<1	0.24	<2	
			31-Mar-22	0.93	<1	<1	0.13	2	
			13-Apr-22	0.99	<1	<1	0.12	14	
			27-Apr-22	0.83	<1	<1	0.12	16	
			11-May-22	0.69	<1	<1	0.17	18	
			25-May-22	0.64	<1	<1	0.15	8	
			09-Jun-22	0.88	<1	<1	0.19	10	
			22-Jun-22	0.55	<1	<1	0.13	6	
			05-Jul-22	0.6	<1	<1	0.16	10	
			20-Jul-22	0.7	<1	<1	0.26	8	
			03-Aug-22	0.77	<1	<1	0.21	2	
			17-Aug-22	0.62	<1	<1	0.21	4	
			31-Aug-22	0.51	<1	<1	0.29	6	
			13-Sep-22	0.56	<1	<1	0.21	LA	
			27-Sep-22	0.95	<1	<1	0.32	10	
			11-Oct-22	0.73	<1	<1	0.4	12	
			26-Oct-22	0.67	<1	<1	0.53	6	
09-Nov-22	0.61	<1	<1	0.23	14				
22-Nov-22	0.55	<1	<1	0.13	<2				
05-Dec-22	0.76	<1	<1	0.17	<2				
29-Dec-22	0.67	<1	<1	0.17	NA				
05-Jan-22	0.47	<1	<1	0.36	6				
BUR-494K	GRAB	3700 Blk Banting Place	19-Jan-22	0.72	<1	<1	0.31	2	
			02-Feb-22	0.46	<1	<1	0.16	<2	
			14-Feb-22	0.64	<1	<1	0.15	<2	
			02-Mar-22	0.3	<1	<1	0.31	<2	
			16-Mar-22	0.66	<1	<1	0.27	4	
			31-Mar-22	0.47	<1	<1	0.13	<2	
			13-Apr-22	0.49	<1	<1	0.17	2	
			27-Apr-22	0.42	<1	<1	0.12	10	
			11-May-22	0.34	<1	<1	0.13	12	
			25-May-22	0.41	<1	<1	0.12	18	
09-Jun-22	0.84	<1	<1	0.16	84				
22-Jun-22	0.67	<1	<1	0.13	340				
05-Jul-22	0.13	<1	<1	0.14	82				
20-Jul-22	0.16	<1	<1	0.13	780				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-494K	GRAB	3700 Blk Banting Place	26-Jul-22	0.26	<1	<1	0.25	1700	
			03-Aug-22	0.3	<1	<1	0.17	180	
			17-Aug-22	0.28	<1	<1	0.19	370	
			31-Aug-22	0.23	<1	<1	0.18	280	
			13-Sep-22	0.14	<1	<1	0.15	410	
			27-Sep-22	0.1	<1	<1	0.22	580	
			11-Oct-22	0.44	<1	<1	0.19	42	
			26-Oct-22	0.11	<1	<1	0.32	480	
			09-Nov-22	0.07	<1	<1	0.18	120	
			22-Nov-22	0.21	<1	<1	0.15	28	
			05-Dec-22	0.3	<1	<1	0.17	2	
			29-Dec-22	0.59	<1	<1	0.24	NA	
			05-Jan-22	0.92	<1	<1	0.4	<2	
BUR-495K	GRAB	8400 Blk Nelson	19-Jan-22	0.95	<1	<1	0.15	<2	
			02-Feb-22	0.89	<1	<1	0.15	<2	
			14-Feb-22	0.58	<1	<1	0.14	<2	
			02-Mar-22	0.73	<1	<1	0.17	<2	
			16-Mar-22	0.74	<1	<1	0.23	<2	
			31-Mar-22	0.91	<1	<1	0.12	<2	
			13-Apr-22	0.96	<1	<1	0.11	<2	
			27-Apr-22	0.62	<1	<1	0.09	2	
			11-May-22	0.83	<1	<1	0.11	16	
			25-May-22	0.62	<1	<1	0.12	<2	
			09-Jun-22	0.86	<1	<1	0.17	2	
			22-Jun-22	0.55	<1	<1	0.09	<2	
			05-Jul-22	0.62	<1	<1	0.15	<2	
20-Jul-22	0.55	<1	<1	0.16	<2				
BUR-496K	GRAB	8255 Wiggins St.	03-Aug-22	0.61	<1	<1	0.21	<2	
			17-Aug-22	0.54	<1	<1	0.17	<2	
			31-Aug-22	0.35	<1	<1	0.19	<2	
			13-Sep-22	0.27	<1	<1	0.16	4	
			27-Sep-22	0.19	<1	<1	0.25	<2	
			11-Oct-22	0.11	<1	<1	0.31	38	
			26-Oct-22	0.24	<1	<1	0.37	66	
			09-Nov-22	0.19	<1	<1	0.16	14	
			22-Nov-22	0.43	<1	<1	0.16	2	
			05-Dec-22	0.57	<1	<1	0.17	<2	
			29-Dec-22	0.54	<1	<1	0.13	NA	
			05-Jan-22	0.63	<1	<1	0.46	<2	

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-496K	GRAB	8255 Wiggins St.	19-Jan-22	0.64	<1	<1	0.16	6	
			02-Feb-22	0.71	<1	<1	0.11	<2	
			14-Feb-22	0.61	<1	<1	0.2	4	
			02-Mar-22	0.54	<1	<1	0.2	NA	
			16-Mar-22	0.63	<1	<1	0.14	<2	
			31-Mar-22	0.59	<1	<1	0.12	4	
			13-Apr-22	0.75	<1	<1	0.14	2	
			27-Apr-22	0.52	<1	<1	0.08	4	
			11-May-22	0.64	<1	<1	0.12	<2	
			25-May-22	0.43	<1	<1	0.1	<2	
			09-Jun-22	0.52	<1	<1	0.13	4	
			22-Jun-22	0.33	<1	<1	0.1	2	
			05-Jul-22	0.33	<1	<1	0.16	28	
			20-Jul-22	0.3	<1	<1	0.14	20	
			03-Aug-22	0.32	<1	<1	0.21	4	
			17-Aug-22	0.21	<1	<1	0.17	72	
			31-Aug-22	0.42	<1	<1	0.19	4	
			13-Sep-22	0.2	<1	<1	0.16	22	
			27-Sep-22	0.24	<1	<1	0.3	960	
			11-Oct-22	0.22	<1	<1	0.37	1300	
26-Oct-22	0.29	<1	<1	0.55	1200				
01-Nov-22	0.26	<1	<1	0.5	1400				
09-Nov-22	0.46	<1	<1	0.22	20				
22-Nov-22	0.52	<1	<1	0.14	8				
05-Dec-22	0.42	<1	<1	0.21	10				
29-Dec-22	0.58	<1	<1	0.15	NA				
05-Jan-22	0.52	<1	<1	0.41	<2				
19-Jan-22	0.4	<1	<1	0.19	4				
02-Feb-22	0.59	<1	<1	0.22	<2				
14-Feb-22	0.87	<1	<1	0.13	<2				
02-Mar-22	0.57	<1	<1	0.22	<2				
16-Mar-22	0.52	<1	<1	0.25	<2				
31-Mar-22	0.56	<1	<1	0.14	<2				
13-Apr-22	0.82	<1	<1	0.17	<2				
27-Apr-22	0.47	<1	<1	0.1	<2				
11-May-22	0.55	<1	<1	0.12	2				
25-May-22	0.38	<1	<1	0.13	<2				
09-Jun-22	0.5	<1	<1	0.18	8				
22-Jun-22	0.36	<1	<1	0.12	2				
BUR-497K	GRAB	8300 Blk Willard St. (Spur & Wiggins)							

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-497K	GRAB	8300 Blk Willard St. (Spur & Wiggins)	05-Jul-22	0.54	<1	<1	0.24	<2	
			20-Jul-22	0.34	<1	<1	0.12	6	
			03-Aug-22	0.34	<1	<1	0.18	6	
			17-Aug-22	0.39	<1	<1	0.22	14	
			31-Aug-22	0.53	<1	<1	0.18	92	
			13-Sep-22	0.2	<1	<1	0.15	46	
			27-Sep-22	0.54	<1	<1	0.24	420	
			11-Oct-22	0.25	<1	<1	0.3	66	
			26-Oct-22	0.06	<1	<1	0.29	56	
			09-Nov-22	0.15	<1	<1	0.17	4	
			22-Nov-22	0.31	<1	<1	0.14	2	
			29-Dec-22	0.33	<1	<1	0.22	NA	
			05-Jan-22	0.71	<1	<1	0.34	<2	
BUR-498K	GRAB	9001 Riverway Place	19-Jan-22	0.94	<1	<1	0.19	<2	
			02-Feb-22	0.69	<1	<1	0.11	<2	
			14-Feb-22	0.79	<1	<1	0.16	<2	
			02-Mar-22	1.01	<1	<1	0.16	<2	
			16-Mar-22	0.68	<1	<1	0.74	<2	
			31-Mar-22	0.83	<1	<1	0.12	<2	
			13-Apr-22	0.82	<1	<1	0.1	<2	
			27-Apr-22	0.59	<1	<1	0.08	<2	
			11-May-22	0.82	<1	<1	0.12	2	
			25-May-22	0.57	<1	<1	0.19	<2	
			09-Jun-22	1.01	<1	<1	0.14	<2	
			22-Jun-22	0.35	<1	<1	0.11	2	
			05-Jul-22	0.51	<1	<1	0.14	<2	
BUR-499K	GRAB	3900 Blk North Fraser Way	20-Jul-22	0.54	<1	<1	0.16	<2	
			03-Aug-22	0.65	<1	<1	0.23	12	
			17-Aug-22	0.56	<1	<1	0.23	<2	
			31-Aug-22	0.64	<1	<1	0.19	<2	
			13-Sep-22	0.53	<1	<1	0.16	2	
			27-Sep-22	0.8	<1	<1	0.23	10	
			11-Oct-22	0.36	<1	<1	0.24	8	
			26-Oct-22	0.49	<1	<1	0.39	6	
			09-Nov-22	0.48	<1	<1	0.21	6	
			22-Nov-22	0.61	<1	<1	0.38	<2	
			05-Dec-22	0.66	<1	<1	0.21	6	
			29-Dec-22	0.84	<1	<1	0.13	NA	
			05-Jan-22	0.81	<1	<1	0.35	<2	

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-499K	GRAB	3900 Blk North Fraser Way	19-Jan-22	1.01	<1	<1	0.13	2	
			02-Feb-22	0.95	<1	<1	0.11	<2	
			14-Feb-22	1.05	<1	<1	0.13	2	
			02-Mar-22	0.8	<1	<1	0.16	<2	
			16-Mar-22	0.69	<1	<1	0.11	<2	
			31-Mar-22	0.98	<1	<1	0.11	2	
			13-Apr-22	0.78	<1	<1	0.13	<2	
			27-Apr-22	0.84	<1	<1	0.09	2	
			11-May-22	0.69	<1	<1	0.11	<2	
			25-May-22	0.54	<1	<1	0.16	<2	
			09-Jun-22	0.66	<1	<1	0.15	12	
			22-Jun-22	0.72	<1	<1	0.11	<2	
			05-Jul-22	0.52	<1	<1	0.15	8	
			20-Jul-22	0.51	<1	<1	0.19	<2	
			03-Aug-22	0.65	<1	<1	0.32	<2	
			17-Aug-22	0.48	<1	<1	0.24	<2	
			31-Aug-22	0.47	<1	<1	0.3	36	
			13-Sep-22	0.34	<1	<1	0.21	2	
			27-Sep-22	0.58	<1	<1	0.31	170	
BUR-500K	GRAB	5400 Blk Dundas St.	11-Oct-22	0.38	<1	<1	0.4	<2	
			26-Oct-22	0.21	<1	<1	0.47	16	
			09-Nov-22	0.2	<1	<1	0.22	<2	
			22-Nov-22	0.38	<1	<1	0.13	<2	
			05-Dec-22	0.58	<1	<1	0.23	<2	
			29-Dec-22	0.75	<1	<1	0.21	NA	
			04-Jan-22	0.68	<1	<1	0.14	<2	
			18-Jan-22	0.65	<1	<1	0.2	<2	
			01-Feb-22	0.76	<1	<1	0.15	2	
			15-Feb-22	0.63	<1	<1	0.18	16	
			01-Mar-22	0.63	<1	<1	0.14	2	
15-Mar-22	0.59	<1	<1	0.13	2				
29-Mar-22	0.67	<1	<1	0.12	2				
14-Apr-22	0.7	<1	<1	0.15	4				
26-Apr-22	0.65	<1	<1	0.09	2				
10-May-22	0.62	<1	<1	0.18	2				
24-May-22	0.58	<1	<1	0.23	<2				
07-Jun-22	0.57	<1	<1	0.29	10				
21-Jun-22	0.61	<1	<1	0.13	<2				
07-Jul-22	0.43	<1	<1	0.13	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-500K	GRAB	5400 Blk Dundas St.	19-Jul-22	0.52	<1	<1	0.66	4	
			02-Aug-22	0.43	<1	<1	0.23	8	
			16-Aug-22	0.49	<1	<1	0.19	6	
			30-Aug-22	0.59	<1	<1	0.1	<2	
			14-Sep-22	0.62	<1	<1	0.1	4	
			28-Sep-22	0.4	<1	<1	0.31	6	
			12-Oct-22	0.44	<1	<1	0.18	8	
			25-Oct-22	0.52	<1	<1	0.24	<2	
			08-Nov-22	0.6	<1	<1	0.19	<2	
			23-Nov-22	0.55	<1	<1	0.14	2	
			06-Dec-22	0.73	<1	<1	0.13	<2	
			30-Dec-22	0.69	<1	<1	0.15	NA	
			04-Jan-22	0.7	<1	<1	0.34	40	
			18-Jan-22	0.84	<1	<1	0.39	16	
BUR-529K	GRAB	5200 Blk Penzance	01-Feb-22	0.76	<1	<1	1.8	20	
			15-Feb-22	0.7	<1	<1	0.27	14	
			01-Mar-22	0.75	<1	<1	0.33	28	
			15-Mar-22	0.83	<1	<1	0.13	2	
			29-Mar-22	0.83	<1	<1	0.16	6	
			14-Apr-22	0.88	<1	<1	0.13	2	
			26-Apr-22	0.65	<1	<1	0.12	4	
			10-May-22	0.75	<1	<1	0.15	4	
			24-May-22	0.71	<1	<1	0.17	<2	
			07-Jun-22	0.74	<1	<1	0.28	4	
			21-Jun-22	0.69	<1	<1	0.15	<2	
			07-Jul-22	0.74	<1	<1	0.31	<2	
			19-Jul-22	0.71	<1	<1	0.18	4	
			02-Aug-22	0.52	<1	<1	0.97	8	
BUR-530K	GRAB	400 Blk Northcliffe	16-Aug-22	0.69	<1	<1	0.17	14	
			30-Aug-22	0.71	<1	<1	0.14	40	
			14-Sep-22	0.7	<1	<1	0.15	4	
			28-Sep-22	0.65	<1	<1	0.3	16	
			12-Oct-22	0.86	<1	<1	1	60	
			25-Oct-22	0.69	<1	<1	0.3	14	
			08-Nov-22	0.71	<1	<1	0.17	<2	
			23-Nov-22	0.83	<1	<1	0.22	<2	
			06-Dec-22	0.77	<1	<1	0.14	<2	
			30-Dec-22	0.64	<1	<1	0.41	NA	
			04-Jan-22	0.53	<1	<1	0.13	2	

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-530K	GRAB	400 Blk Northcliffe	18-Jan-22	0.62	<1	<1	0.17	2	
			01-Feb-22	0.71	<1	<1	0.35	<2	
			15-Feb-22	0.42	<1	<1	0.1	2	
			01-Mar-22	0.7	<1	<1	0.16	<2	
			15-Mar-22	0.66	<1	<1	0.09	<2	
			29-Mar-22	0.59	<1	<1	0.1	2	
			14-Apr-22	0.56	<1	<1	0.1	<2	
			26-Apr-22	0.54	<1	<1	0.08	<2	
			10-May-22	0.52	<1	<1	0.11	4	
			24-May-22	0.53	<1	<1	0.14	<2	
			07-Jun-22	0.5	<1	<1	0.2	8	
			21-Jun-22	0.45	<1	<1	0.1	4	
			07-Jul-22	0.63	<1	<1	0.1	2	
			19-Jul-22	0.46	<1	<1	0.09	14	
			02-Aug-22	0.53	<1	<1	0.08	6	
			16-Aug-22	0.61	<1	<1	0.11	2	
			30-Aug-22	0.53	<1	<1	0.1	2	
			14-Sep-22	0.5	<1	<1	0.1	14	
			28-Sep-22	0.22	<1	<1	0.23	82	
			12-Oct-22	0.41	<1	<1	0.28	30	
25-Oct-22	0.59	<1	<1	0.1	62				
08-Nov-22	0.59	<1	<1	0.14	10				
23-Nov-22	0.61	<1	<1	0.18	<2				
06-Dec-22	0.74	<1	<1	0.18	2				
30-Dec-22	0.43	<1	<1	0.14	NA				
BUR-560K	GRAB	3600 Blk Brighton	12-Jan-22	0.76	<1	<1	0.42	<2	
			25-Jan-22	0.78	<1	<1	0.17	<2	
			09-Feb-22	0.93	<1	<1	0.11	<2	
			23-Feb-22	0.6	<1	<1	0.11	<2	
			10-Mar-22	0.85	<1	<1	0.25	<2	
			24-Mar-22	0.58	<1	<1	0.11	<2	
			06-Apr-22	0.65	<1	<1	0.1	<2	
			20-Apr-22	0.83	<1	<1	0.08	2	
			26-Apr-22	0.65	<1	<1	0.08	<2	
			04-May-22	0.81	<1	<1	0.09	2	
18-May-22	0.74	<1	<1	0.11	<2				
31-May-22	0.69	<1	<1	0.12	<2				
15-Jun-22	0.78	<1	<1	0.31	8				
29-Jun-22	0.5	<1	<1	0.14	4				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-560K	GRAB	3600 Blk Brighton	13-Jul-22	0.61	<1	<1	0.31	<2	
			26-Jul-22	0.86	<1	<1	0.28	<2	
			10-Aug-22	0.67	<1	<1	0.32	<2	
			24-Aug-22	0.59	<1	<1	0.43	16	
			07-Sep-22	0.35	<1	<1	0.17	<2	
			20-Sep-22	0.45	<1	<1	0.34	6	
			05-Oct-22	0.57	<1	<1	0.37	<2	
			18-Oct-22	0.36	<1	<1	<0.06	4	
			01-Nov-22	0.42	<1	<1	0.17	<2	
			16-Nov-22	0.65	<1	<1	0.13	<2	
			01-Dec-22	0.61	<1	<1	0.12	2	
			15-Dec-22	0.85	<1	<1	0.64	4	
29-Dec-22	0.59	<1	<1	0.18	NA				
BUR-561K	GRAB	Deer Lake Parkway & Gilpin	12-Jan-22	0.87	<1	<1	0.36	2	
			25-Jan-22	0.31	<1	<1	0.16	<2	
			09-Feb-22	0.81	<1	<1	0.12	<2	
			23-Feb-22	0.71	<1	<1	0.1	<2	
			10-Mar-22	1.14	<1	<1	0.3	<2	
			24-Mar-22	0.86	<1	<1	0.1	2	
			06-Apr-22	0.7	<1	<1	0.15	<2	
			20-Apr-22	0.74	<1	<1	0.1	<2	
			04-May-22	0.74	<1	<1	0.1	<2	
			18-May-22	0.79	<1	<1	0.13	<2	
			31-May-22	0.61	<1	<1	0.21	2	
			15-Jun-22	0.7	<1	<1	0.19	<2	
29-Jun-22	0.85	<1	<1	0.13	<2				
13-Jul-22	0.65	<1	<1	0.19	<2				
26-Jul-22	0.77	<1	<1	0.22	<2				
10-Aug-22	0.58	<1	<1	0.33	14				
24-Aug-22	0.46	<1	<1	0.14	<2				
07-Sep-22	0.62	<1	<1	0.16	<2				
20-Sep-22	0.53	<1	<1	0.33	2				
05-Oct-22	0.72	<1	<1	0.28	36				
18-Oct-22	0.39	<1	<1	0.32	<2				
01-Nov-22	0.68	<1	<1	0.15	2				
16-Nov-22	0.73	<1	<1	0.15	<2				
01-Dec-22	0.63	<1	<1	0.12	<2				
15-Dec-22	0.77	<1	<1	0.15	<2				
29-Dec-22	0.74	<1	<1	0.15	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-563K	GRAB	6200 Lougheed Hwy (Kingsland Ct. cds)	13-Jul-22	0.67	<1	<1	0.11	<2	
			26-Jul-22	0.88	<1	<1	0.1	6	
			10-Aug-22	0.7	<1	<1	0.17	<2	
			24-Aug-22	0.59	<1	<1	0.23	<2	
			07-Sep-22	0.63	<1	<1	0.1	14	
			20-Sep-22	0.64	<1	<1	0.08	12	
			05-Oct-22	0.85	<1	<1	0.1	16	
			18-Oct-22	0.53	<1	<1	0.18	16	
			01-Nov-22	0.71	<1	<1	0.11	4	
			16-Nov-22	0.66	<1	<1	0.16	2	
			01-Dec-22	0.7	<1	<1	0.14	<2	
			15-Dec-22	0.61	<1	<1	0.13	<2	
29-Dec-22	0.62	<1	<1	0.15	NA				
BUR-564K	GRAB	4400 Still Creek	12-Jan-22	0.96	<1	<1	0.22	6	
			25-Jan-22	0.93	<1	<1	0.14	<2	
			09-Feb-22	0.83	<1	<1	0.13	<2	
			23-Feb-22	0.69	<1	<1	0.14	<2	
			10-Mar-22	0.88	<1	<1	0.61	<2	
			24-Mar-22	0.82	<1	<1	0.14	<2	
			06-Apr-22	0.65	<1	<1	0.2	<2	
			20-Apr-22	0.95	<1	<1	0.17	<2	
			04-May-22	0.77	<1	<1	0.11	2	
			18-May-22	1.07	<1	<1	0.12	<2	
			31-May-22	1.14	<1	<1	0.17	<2	
			15-Jun-22	0.76	<1	<1	0.27	<2	
29-Jun-22	0.83	<1	<1	0.15	<2				
13-Jul-22	0.75	<1	<1	0.23	4				
26-Jul-22	0.87	<1	<1	0.4	<2				
10-Aug-22	0.87	<1	<1	0.22	6				
24-Aug-22	0.62	<1	<1	0.43	8				
07-Sep-22	0.71	<1	<1	0.1	<2				
20-Sep-22	0.74	<1	<1	0.12	6				
05-Oct-22	0.72	<1	<1	0.14	6				
18-Oct-22	0.68	<1	<1	0.15	<2				
01-Nov-22	0.79	<1	<1	0.13	<2				
16-Nov-22	0.92	<1	<1	0.14	<2				
01-Dec-22	0.87	<1	<1	0.15	<2				
15-Dec-22	0.77	<1	<1	0.16	<2				
29-Dec-22	0.73	<1	<1	0.15	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-565K	GRAB	5700 Blk Laurel St.	12-Jan-22	0.8	<1	<1	0.25	<2	
			25-Jan-22	0.61	<1	<1	0.18	<2	
			09-Feb-22	0.8	<1	<1	0.12	<2	
			23-Feb-22	0.7	<1	<1	0.1	<2	
			10-Mar-22	0.94	<1	<1	0.17	<2	
			24-Mar-22	0.88	<1	<1	0.1	<2	
			06-Apr-22	0.64	<1	<1	0.17	<2	
			20-Apr-22	0.79	<1	<1	0.09	<2	
			04-May-22	0.78	<1	<1	0.09	<2	
			18-May-22	0.68	<1	<1	0.09	<2	
			31-May-22	0.65	<1	<1	0.12	<2	
			15-Jun-22	0.65	<1	<1	0.13	<2	
			29-Jun-22	0.67	<1	<1	0.1	38	
			13-Jul-22	0.67	<1	<1	0.11	40	
			26-Jul-22	0.77	<1	<1	0.26	38	
			10-Aug-22	0.7	<1	<1	0.2	66	
			24-Aug-22	0.53	<1	<1	0.29	130	
			07-Sep-22	0.66	<1	<1	0.9	64	
			20-Sep-22	0.6	<1	<1	0.57	82	
			05-Oct-22	0.85	<1	<1	0.09	58	
18-Oct-22	0.56	<1	<1	0.68	130				
01-Nov-22	0.58	<1	<1	0.17	34				
16-Nov-22	0.4	<1	<1	0.14	18				
01-Dec-22	0.72	<1	<1	0.11	4				
15-Dec-22	0.67	<1	<1	0.12	14				
29-Dec-22	0.66	<1	<1	0.14	NA				
12-Jan-22	0.63	<1	<1	0.5	<2				
25-Jan-22	0.81	<1	<1	0.24	<2				
09-Feb-22	0.82	<1	<1	0.22	<2				
23-Feb-22	0.72	<1	<1	0.1	<2				
10-Mar-22	0.79	<1	<1	0.14	<2				
24-Mar-22	0.76	<1	<1	0.16	2				
06-Apr-22	0.66	<1	<1	0.09	<2				
20-Apr-22	0.85	<1	<1	0.09	<2				
04-May-22	0.69	<1	<1	0.09	<2				
18-May-22	0.71	<1	<1	0.09	<2				
31-May-22	0.66	<1	<1	0.12	<2				
15-Jun-22	0.62	<1	<1	0.13	<2				
29-Jun-22	0.71	<1	<1	0.09	<2				
BUR-566K	GRAB	4100 Blk Garden Grove Dr.							

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-566K	GRAB	4100 Blk Garden Grove Dr.	13-Jul-22	0.71	<1	<1	0.11	6	
			26-Jul-22	0.82	<1	<1	0.1	4	
			10-Aug-22	0.94	<1	<1	0.17	<2	
			24-Aug-22	0.49	<1	<1	1.1	2	
			07-Sep-22	0.43	<1	<1	0.09	4	
			20-Sep-22	0.56	<1	<1	0.09	<2	
			05-Oct-22	0.78	<1	<1	0.12	<2	
			18-Oct-22	0.57	<1	<1	0.24	6	
			01-Nov-22	0.62	<1	<1	0.22	2	
			16-Nov-22	0.59	<1	<1	0.13	2	
			01-Dec-22	0.68	<1	<1	0.16	<2	
			15-Dec-22	0.79	<1	<1	0.16	2	
29-Dec-22	0.68	<1	<1	0.12	NA				
BUR-567K	GRAB	SS of CG Brown Pool, Sprott St.	12-Jan-22	0.67	<1	<1	0.46	<2	
			25-Jan-22	0.84	<1	<1	0.13	<2	
			09-Feb-22	0.74	<1	<1	0.16	<2	
			23-Feb-22	0.67	<1	<1	0.1	<2	
			10-Mar-22	0.85	<1	<1	0.19	<2	
			24-Mar-22	0.71	<1	<1	0.1	<2	
			06-Apr-22	0.52	<1	<1	0.11	<2	
			20-Apr-22	0.73	<1	<1	0.1	<2	
			04-May-22	0.91	<1	<1	0.13	<2	
			18-May-22	0.8	<1	<1	0.09	2	
			31-May-22	0.93	<1	<1	0.21	<2	
			15-Jun-22	0.68	<1	<1	0.2	<2	
29-Jun-22	0.74	<1	<1	0.14	10				
13-Jul-22	0.66	<1	<1	0.19	4				
26-Jul-22	0.81	<1	<1	0.1	<2				
10-Aug-22	0.68	<1	<1	0.28	<2				
24-Aug-22	0.45	<1	<1	0.38	56				
07-Sep-22	0.24	<1	<1	0.17	52				
20-Sep-22	0.3	<1	<1	0.14	42				
05-Oct-22	0.38	<1	<1	0.24	120				
18-Oct-22	0.44	<1	<1	0.12	30				
01-Nov-22	0.64	<1	<1	0.12	6				
16-Nov-22	0.72	<1	<1	0.12	<2				
01-Dec-22	0.86	<1	<1	0.17	<2				
15-Dec-22	0.73	<1	<1	0.15	<2				
29-Dec-22	0.63	<1	<1	0.15	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-568K	GRAB	3900 Blk Philips	12-Jan-22	0.66	<1	<1	0.18	2	
			25-Jan-22	0.89	<1	<1	0.13	<2	
			09-Feb-22	0.77	<1	<1	0.12	<2	
			23-Feb-22	0.67	<1	<1	0.11	<2	
			10-Mar-22	0.9	<1	<1	0.14	<2	
			24-Mar-22	0.79	<1	<1	0.1	2	
			06-Apr-22	0.58	<1	<1	0.1	<2	
			20-Apr-22	0.8	<1	<1	0.09	<2	
			04-May-22	0.96	<1	<1	0.13	<2	
			18-May-22	0.86	<1	<1	0.08	4	
			31-May-22	0.82	<1	<1	0.11	<2	
			15-Jun-22	0.68	<1	<1	0.17	<2	
			29-Jun-22	0.72	<1	<1	0.11	16	
			13-Jul-22	0.62	<1	<1	0.35	8	
			26-Jul-22	0.86	<1	<1	0.21	LA	
			10-Aug-22	0.9	<1	<1	0.17	10	
			24-Aug-22	0.32	<1	<1	1.2	32	
			07-Sep-22	0.22	<1	<1	0.31	4	
			20-Sep-22	0.17	<1	<1	0.37	4	
			05-Oct-22	0.15	<1	<1	0.23	18	
18-Oct-22	0.53	<1	<1	0.2	16				
01-Nov-22	0.66	<1	<1	0.15	38				
16-Nov-22	0.6	<1	<1	0.18	22				
01-Dec-22	0.74	<1	<1	0.18	6				
15-Dec-22	0.63	<1	<1	0.15	4				
29-Dec-22	0.63	<1	<1	0.19	NA				
BUR-569K	GRAB	3200 Blk Smith	11-Jan-22	0.58	<1	<1	0.19	<2	
			24-Jan-22	1.01	<1	<1	0.18	<2	
			08-Feb-22	0.82	<1	<1	0.22	<2	
			22-Feb-22	1.8	<1	<1	0.15	<2	
			08-Mar-22	0.84	<1	<1	0.38	<2	
			21-Mar-22	0.95	<1	<1	0.11	<2	
			05-Apr-22	0.72	<1	<1	0.11	<2	
			19-Apr-22	0.44	<1	<1	0.12	2	
			03-May-22	0.76	<1	<1	0.1	2	
			17-May-22	0.82	<1	<1	0.18	2	
30-May-22	0.65	<1	<1	0.13	2				
14-Jun-22	0.7	<1	<1	0.19	<2				
28-Jun-22	0.79	<1	<1	0.2	<2				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-569K	GRAB	3200 Blk Smith	12-Jul-22	0.7	<1	<1	0.11	<2	
			27-Jul-22	0.47	<1	<1	0.12	<2	
			11-Aug-22	0.75	<1	<1	0.15	<2	
			23-Aug-22	0.5	<1	<1	0.2	<2	
			06-Sep-22	0.61	<1	<1	0.17	<2	
			21-Sep-22	0.63	<1	<1	0.19	62	
			04-Oct-22	0.73	<1	<1	0.13	10	
			19-Oct-22	0.75	<1	<1	0.12	6	
			02-Nov-22	0.9	<1	<1	0.12	2	
			14-Nov-22	0.88	<1	<1	0.15	<2	
			28-Nov-22	0.86	<1	<1	0.11	<2	
			13-Dec-22	0.68	<1	<1	0.13	<2	
			30-Dec-22	0.7	<1	<1	0.27	NA	
			05-Jan-22	0.65	<1	<1	0.31	<2	
			19-Jan-22	0.81	<1	<1	0.14	14	
02-Feb-22	1.05	<1	<1	0.12	2				
14-Feb-22	0.93	<1	<1	0.11	<2				
02-Mar-22	0.83	<1	<1	0.12	<2				
16-Mar-22	0.82	<1	<1	0.11	<2				
31-Mar-22	0.9	<1	<1	0.13	<2				
13-Apr-22	0.69	<1	<1	0.12	2				
27-Apr-22	0.67	<1	<1	0.09	<2				
11-May-22	0.94	<1	<1	0.1	<2				
25-May-22	0.7	<1	<1	0.12	<2				
09-Jun-22	0.75	<1	<1	0.26	<2				
22-Jun-22	0.64	<1	<1	0.1	<2				
05-Jul-22	0.68	<1	<1	0.17	<2				
20-Jul-22	0.65	<1	<1	0.18	<2				
03-Aug-22	0.62	<1	<1	0.27	2				
17-Aug-22	0.53	<1	<1	0.11	6				
31-Aug-22	0.69	<1	<1	0.27	<2				
13-Sep-22	0.56	<1	<1	0.1	<2				
27-Sep-22	0.93	<1	<1	0.27	<2				
11-Oct-22	0.54	<1	<1	0.26	120				
26-Oct-22	0.69	<1	<1	0.37	190				
09-Nov-22	0.66	<1	<1	0.17	56				
22-Nov-22	0.71	<1	<1	0.11	<2				
05-Dec-22	0.8	<1	<1	0.2	<2				
29-Dec-22	0.57	<1	<1	0.19	NA				
BUR-570K	GRAB	6000 Blk Buckingham Dr.	12-Jul-22	0.7	<1	<1	0.11	<2	
			27-Jul-22	0.47	<1	<1	0.12	<2	
			11-Aug-22	0.75	<1	<1	0.15	<2	
			23-Aug-22	0.5	<1	<1	0.2	<2	
			06-Sep-22	0.61	<1	<1	0.17	<2	
			21-Sep-22	0.63	<1	<1	0.19	62	
			04-Oct-22	0.73	<1	<1	0.13	10	
			19-Oct-22	0.75	<1	<1	0.12	6	
			02-Nov-22	0.9	<1	<1	0.12	2	
			14-Nov-22	0.88	<1	<1	0.15	<2	
			28-Nov-22	0.86	<1	<1	0.11	<2	
			13-Dec-22	0.68	<1	<1	0.13	<2	
			30-Dec-22	0.7	<1	<1	0.27	NA	
			05-Jan-22	0.65	<1	<1	0.31	<2	
			19-Jan-22	0.81	<1	<1	0.14	14	
02-Feb-22	1.05	<1	<1	0.12	2				
14-Feb-22	0.93	<1	<1	0.11	<2				
02-Mar-22	0.83	<1	<1	0.12	<2				
16-Mar-22	0.82	<1	<1	0.11	<2				
31-Mar-22	0.9	<1	<1	0.13	<2				
13-Apr-22	0.69	<1	<1	0.12	2				
27-Apr-22	0.67	<1	<1	0.09	<2				
11-May-22	0.94	<1	<1	0.1	<2				
25-May-22	0.7	<1	<1	0.12	<2				
09-Jun-22	0.75	<1	<1	0.26	<2				
22-Jun-22	0.64	<1	<1	0.1	<2				
05-Jul-22	0.68	<1	<1	0.17	<2				
20-Jul-22	0.65	<1	<1	0.18	<2				
03-Aug-22	0.62	<1	<1	0.27	2				
17-Aug-22	0.53	<1	<1	0.11	6				
31-Aug-22	0.69	<1	<1	0.27	<2				
13-Sep-22	0.56	<1	<1	0.1	<2				
27-Sep-22	0.93	<1	<1	0.27	<2				
11-Oct-22	0.54	<1	<1	0.26	120				
26-Oct-22	0.69	<1	<1	0.37	190				
09-Nov-22	0.66	<1	<1	0.17	56				
22-Nov-22	0.71	<1	<1	0.11	<2				
05-Dec-22	0.8	<1	<1	0.2	<2				
29-Dec-22	0.57	<1	<1	0.19	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-572K	GRAB	8200 Blk Forest Grove	05-Jan-22	0.67	<1	<1	0.29	<2	
			19-Jan-22	0.79	<1	<1	0.15	<2	
			02-Feb-22	0.51	<1	<1	0.22	<2	
			14-Feb-22	0.67	<1	<1	0.11	6	
			02-Mar-22	0.63	<1	<1	0.13	<2	
			16-Mar-22	0.76	<1	<1	0.14	2	
			31-Mar-22	0.79	<1	<1	0.11	<2	
			13-Apr-22	0.83	<1	<1	0.11	<2	
			27-Apr-22	0.66	<1	<1	0.08	<2	
			11-May-22	0.82	<1	<1	0.11	<2	
			25-May-22	0.63	<1	<1	0.12	<2	
			09-Jun-22	0.79	<1	<1	0.32	<2	
			22-Jun-22	0.65	<1	<1	0.11	2	
			05-Jul-22	0.6	<1	<1	0.15	<2	
			20-Jul-22	0.55	<1	<1	0.14	<2	
			03-Aug-22	0.65	<1	<1	0.2	2	
			17-Aug-22	0.58	<1	<1	0.18	<2	
			31-Aug-22	0.68	<1	<1	0.2	6	
			13-Sep-22	0.52	<1	<1	0.16	2	
			27-Sep-22	0.82	<1	<1	0.28	8	
11-Oct-22	0.55	<1	<1	0.14	2				
26-Oct-22	0.42	<1	<1	0.41	16				
09-Nov-22	0.76	<1	<1	0.18	<2				
22-Nov-22	0.79	<1	<1	0.15	<2				
05-Dec-22	0.71	<1	<1	0.25	10				
29-Dec-22	1	<1	<1	0.17	NA				
BUR-573K	GRAB	4400 Blk Dundas	04-Jan-22	0.79	<1	<1	0.12	2	
			18-Jan-22	0.71	<1	<1	0.25	<2	
			01-Feb-22	0.66	<1	<1	0.57	<2	
			15-Feb-22	0.67	<1	<1	0.12	<2	
			01-Mar-22	0.76	<1	<1	0.17	<2	
			15-Mar-22	0.88	<1	<1	0.12	<2	
			29-Mar-22	0.82	<1	<1	0.1	<2	
			14-Apr-22	0.67	<1	<1	0.08	<2	
			26-Apr-22	0.71	<1	<1	0.08	<2	
			10-May-22	0.76	<1	<1	0.14	<2	
24-May-22	0.67	<1	<1	0.12	<2				
07-Jun-22	0.69	<1	<1	0.25	6				
21-Jun-22	0.65	<1	<1	0.12	<2				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-573K	GRAB	4400 Blk Dundas	07-Jul-22	0.63	<1	<1	0.14	<2	
			19-Jul-22	0.69	<1	<1	0.11	LA	
			02-Aug-22	0.69	<1	<1	0.1	<2	
			16-Aug-22	0.61	<1	<1	0.12	<2	
			30-Aug-22	0.62	<1	<1	0.11	12	
			14-Sep-22	0.74	<1	<1	0.15	6	
			28-Sep-22	0.44	<1	<1	0.17	20	
			12-Oct-22	0.63	<1	<1	0.15	2	
			25-Oct-22	0.7	<1	<1	0.1	10	
			08-Nov-22	0.69	<1	<1	0.14	<2	
			23-Nov-22	0.75	<1	<1	0.17	<2	
			06-Dec-22	0.66	<1	<1	0.15	6	
			30-Dec-22	0.65	<1	<1	0.17	NA	
			04-Jan-22	1.16	<1	<1	0.26	<2	
18-Jan-22	0.86	<1	<1	0.15	<2				
01-Feb-22	0.77	<1	<1	0.19	<2				
15-Feb-22	0.9	<1	<1	0.11	10				
01-Mar-22	0.7	<1	<1	0.28	<2				
15-Mar-22	0.78	<1	<1	0.16	<2				
29-Mar-22	0.61	<1	<1	0.12	<2				
14-Apr-22	0.91	<1	<1	0.08	<2				
26-Apr-22	0.71	<1	<1	0.1	<2				
10-May-22	0.92	<1	<1	0.14	<2				
24-May-22	0.67	<1	<1	0.14	2				
07-Jun-22	0.66	<1	<1	0.15	<2				
21-Jun-22	0.7	<1	<1	0.14	<2				
07-Jul-22	0.74	<1	<1	0.14	4				
19-Jul-22	0.74	<1	<1	0.16	<2				
02-Aug-22	0.72	<1	<1	0.12	<2				
16-Aug-22	0.54	<1	<1	0.11	<2				
30-Aug-22	0.46	<1	<1	0.11	4				
14-Sep-22	0.75	<1	<1	0.14	12				
28-Sep-22	0.5	<1	<1	0.23	<2				
12-Oct-22	0.63	<1	<1	0.17	<2				
25-Oct-22	0.63	<1	<1	0.38	20				
08-Nov-22	0.76	<1	<1	0.17	<2				
23-Nov-22	0.8	<1	<1	0.25	<2				
06-Dec-22	0.77	<1	<1	0.17	<2				
30-Dec-22	0.73	<1	<1	0.21	NA				
BUR-574K	GRAB	200 Blk N. Gilmore	07-Jul-22	0.63	<1	<1	0.14	<2	
			19-Jul-22	0.69	<1	<1	0.11	LA	
			02-Aug-22	0.69	<1	<1	0.1	<2	
			16-Aug-22	0.61	<1	<1	0.12	<2	
			30-Aug-22	0.62	<1	<1	0.11	12	
			14-Sep-22	0.74	<1	<1	0.15	6	
			28-Sep-22	0.44	<1	<1	0.17	20	
			12-Oct-22	0.63	<1	<1	0.15	2	
			25-Oct-22	0.7	<1	<1	0.1	10	
			08-Nov-22	0.69	<1	<1	0.14	<2	
			23-Nov-22	0.75	<1	<1	0.17	<2	
			06-Dec-22	0.66	<1	<1	0.15	6	
			30-Dec-22	0.65	<1	<1	0.17	NA	
			04-Jan-22	1.16	<1	<1	0.26	<2	
18-Jan-22	0.86	<1	<1	0.15	<2				
01-Feb-22	0.77	<1	<1	0.19	<2				
15-Feb-22	0.9	<1	<1	0.11	10				
01-Mar-22	0.7	<1	<1	0.28	<2				
15-Mar-22	0.78	<1	<1	0.16	<2				
29-Mar-22	0.61	<1	<1	0.12	<2				
14-Apr-22	0.91	<1	<1	0.08	<2				
26-Apr-22	0.71	<1	<1	0.1	<2				
10-May-22	0.92	<1	<1	0.14	<2				
24-May-22	0.67	<1	<1	0.14	2				
07-Jun-22	0.66	<1	<1	0.15	<2				
21-Jun-22	0.7	<1	<1	0.14	<2				
07-Jul-22	0.74	<1	<1	0.14	4				
19-Jul-22	0.74	<1	<1	0.16	<2				
02-Aug-22	0.72	<1	<1	0.12	<2				
16-Aug-22	0.54	<1	<1	0.11	<2				
30-Aug-22	0.46	<1	<1	0.11	4				
14-Sep-22	0.75	<1	<1	0.14	12				
28-Sep-22	0.5	<1	<1	0.23	<2				
12-Oct-22	0.63	<1	<1	0.17	<2				
25-Oct-22	0.63	<1	<1	0.38	20				
08-Nov-22	0.76	<1	<1	0.17	<2				
23-Nov-22	0.8	<1	<1	0.25	<2				
06-Dec-22	0.77	<1	<1	0.17	<2				
30-Dec-22	0.73	<1	<1	0.21	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-575K	GRAB	1100 Blk Madison	04-Jan-22	0.91	<1	<1	0.22	<2	
			18-Jan-22	0.76	<1	<1	0.14	<2	
			01-Feb-22	0.59	<1	<1	0.14	<2	
			15-Feb-22	0.81	<1	<1	0.15	2	
			01-Mar-22	0.79	<1	<1	0.2	2	
			15-Mar-22	0.78	<1	<1	0.13	<2	
			29-Mar-22	0.7	<1	<1	0.18	<2	
			14-Apr-22	0.88	<1	<1	0.14	<2	
			26-Apr-22	0.95	<1	<1	0.08	<2	
			10-May-22	0.66	<1	<1	0.11	2	
			24-May-22	0.64	<1	<1	0.11	<2	
			07-Jun-22	0.63	<1	<1	0.21	<2	
			15-Jun-22	0.64	<1	<1	0.87	4	
			21-Jun-22	0.58	<1	<1	0.1	4	
			07-Jul-22	0.64	<1	<1	0.11	<2	
			19-Jul-22	0.6	<1	<1	0.09	<2	
			02-Aug-22	0.61	<1	<1	0.2	2	
			16-Aug-22	0.57	<1	<1	0.14	6	
			30-Aug-22	0.63	<1	<1	0.09	8	
			14-Sep-22	0.59	<1	<1	0.18	6	
28-Sep-22	0.57	<1	<1	0.21	6				
12-Oct-22	0.55	<1	<1	0.3	4				
25-Oct-22	0.58	<1	<1	0.11	4				
08-Nov-22	0.53	<1	<1	0.14	2				
23-Nov-22	0.68	<1	<1	0.23	<2				
06-Dec-22	0.82	<1	<1	0.24	<2				
30-Dec-22	0.75	<1	<1	0.19	NA				
04-Jan-22	0.85	<1	<1	0.18	<2				
18-Jan-22	0.92	<1	<1	0.16	<2				
01-Feb-22	0.74	<1	<1	0.14	<2				
15-Feb-22	0.75	<1	<1	0.31	2				
01-Mar-22	0.82	<1	<1	0.17	<2				
15-Mar-22	0.75	<1	<1	0.12	2				
29-Mar-22	0.6	<1	<1	0.12	2				
14-Apr-22	1.04	<1	<1	0.11	2				
26-Apr-22	0.77	<1	<1	0.11	<2				
10-May-22	0.87	<1	<1	0.15	6				
24-May-22	0.7	<1	<1	0.15	2				
07-Jun-22	0.93	<1	<1	0.19	<2				
BUR-576K	GRAB	6200 Blk Curtis							

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-576K	GRAB	6200 Blk Curtis	15-Jun-22	0.76	<1	<1	0.15	<2	
			21-Jun-22	0.75	<1	<1	0.17	<2	
			07-Jul-22	0.84	<1	<1	0.14	<2	
			19-Jul-22	0.72	<1	<1	0.12	<2	
			02-Aug-22	0.65	<1	<1	0.19	2	
			16-Aug-22	0.58	<1	<1	0.13	<2	
			30-Aug-22	0.7	<1	<1	0.11	6	
			14-Sep-22	0.76	<1	<1	0.12	8	
			28-Sep-22	0.69	<1	<1	0.19	<2	
			12-Oct-22	0.65	<1	<1	0.25	2	
			25-Oct-22	0.63	<1	<1	0.23	8	
			08-Nov-22	0.66	<1	<1	0.11	4	
			23-Nov-22	0.72	<1	<1	0.28	2	
			06-Dec-22	0.88	<1	<1	0.14	<2	
			30-Dec-22	0.74	<1	<1	0.17	NA	
			04-Jan-22	0.82	<1	<1	0.19	<2	
			18-Jan-22	0.77	<1	<1	0.21	<2	
			BUR-577K	GRAB	1400 Heathdale Dr.	01-Feb-22	0.68	<1	<1
15-Feb-22	0.65	<1				<1	0.14	<2	
01-Mar-22	0.66	<1				<1	0.16	<2	
15-Mar-22	0.77	<1				<1	0.1	2	
29-Mar-22	0.68	<1				<1	0.09	2	
14-Apr-22	0.73	<1				<1	0.1	2	
26-Apr-22	0.66	<1				<1	0.07	<2	
10-May-22	0.66	<1				<1	0.11	2	
24-May-22	0.59	<1				<1	0.13	<2	
07-Jun-22	0.62	<1				<1	0.17	2	
15-Jun-22	0.63	<1				<1	0.25	4	
21-Jun-22	0.54	<1				<1	0.09	<2	
07-Jul-22	0.55	<1				<1	0.1	<2	
19-Jul-22	0.46	<1				<1	0.14	<2	
02-Aug-22	0.53	<1				<1	0.1	10	
16-Aug-22	0.59	<1				<1	0.14	14	
30-Aug-22	0.59	<1				<1	0.14	24	
14-Sep-22	0.56	<1				<1	0.09	<2	
28-Sep-22	0.41	<1	<1	0.23	66				
12-Oct-22	0.66	<1	<1	0.11	56				
25-Oct-22	0.68	<1	<1	0.1	52				
08-Nov-22	0.41	<1	<1	0.09	6				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-577K	GRAB	1400 Heathdale Dr.	23-Nov-22	0.55	<1	<1	0.15	<2	
			06-Dec-22	0.69	<1	<1	0.14	<2	
			30-Dec-22	1.53	<1	<1	0.12	NA	
			04-Jan-22	0.7	<1	<1	0.14	<2	
			18-Jan-22	0.84	<1	<1	0.16	<2	
			01-Feb-22	0.73	<1	<1	0.17	<2	
			15-Feb-22	0.85	<1	<1	0.18	<2	
			01-Mar-22	0.75	<1	<1	0.13	<2	
			15-Mar-22	0.78	<1	<1	0.12	<2	
			29-Mar-22	0.86	<1	<1	0.1	<2	
			14-Apr-22	0.93	<1	<1	0.11	<2	
			26-Apr-22	0.7	<1	<1	0.08	<2	
			10-May-22	0.63	<1	<1	0.14	2	
			24-May-22	0.66	<1	<1	0.12	<2	
			07-Jun-22	0.81	<1	<1	0.12	<2	
			21-Jun-22	0.69	<1	<1	0.1	<2	
			07-Jul-22	0.86	<1	<1	0.1	<2	
BUR-578K	GRAB	North side of IGA, Greystone Ave.	19-Jul-22	0.65	<1	<1	0.11	<2	
			02-Aug-22	0.65	<1	<1	0.13	10	
			16-Aug-22	0.63	<1	<1	0.09	4	
			30-Aug-22	0.56	<1	<1	0.08	<2	
			14-Sep-22	0.66	<1	<1	0.11	<2	
			28-Sep-22	0.57	<1	<1	0.29	2	
			12-Oct-22	0.59	<1	<1	0.15	<2	
			25-Oct-22	0.66	<1	<1	0.2	<2	
			08-Nov-22	0.72	<1	<1	0.13	2	
			23-Nov-22	0.75	<1	<1	0.19	<2	
			06-Dec-22	0.8	<1	<1	0.12	<2	
			30-Dec-22	0.85	<1	<1	0.21	NA	
			11-Jan-22	0.62	<1	<1	0.2	2	
			24-Jan-22	0.86	<1	<1	0.2	<2	
			08-Feb-22	1.01	<1	<1	0.59	4	
			22-Feb-22	1.6	<1	<1	0.21	<2	
			08-Mar-22	0.73	<1	<1	0.77	<2	
BUR-579K	GRAB	WS of BGH, on Ingleton	21-Mar-22	0.83	<1	<1	0.15	<2	
			05-Apr-22	0.67	<1	<1	0.1	<2	
			19-Apr-22	0.74	<1	<1	0.09	<2	
			03-May-22	0.71	<1	<1	0.11	22	
			17-May-22	0.69	<1	<1	0.15	2	

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-579K	GRAB	WS of BGH, on Ingleton	30-May-22	0.66	<1	<1	0.13	4	
			14-Jun-22	0.66	<1	<1	0.17	<2	
			28-Jun-22	0.74	<1	<1	0.75	8	
			12-Jul-22	0.7	<1	<1	0.12	<2	
			27-Jul-22	0.71	<1	<1	0.15	<2	
			11-Aug-22	0.62	<1	<1	0.17	<2	
			23-Aug-22	0.66	<1	<1	0.15	4	
			06-Sep-22	0.69	<1	<1	0.17	2	
			21-Sep-22	0.58	<1	<1	0.13	200	
			04-Oct-22	0.73	<1	<1	0.1	10	
			19-Oct-22	0.72	<1	<1	0.15	12	
			02-Nov-22	0.76	<1	<1	0.13	30	
			14-Nov-22	0.78	<1	<1	0.13	10	
			28-Nov-22	0.69	<1	<1	0.11	38	
			13-Dec-22	0.71	<1	<1	0.12	40	
			30-Dec-22	0.7	<1	<1	0.17	NA	
BUR-580K	GRAB	4400 Blk Moscrop	11-Jan-22	0.52	<1	<1	0.23	4	
			24-Jan-22	0.87	<1	<1	0.26	<2	
			08-Feb-22	0.83	<1	<1	0.17	24	
			08-Mar-22	0.63	<1	<1	1.4	4	
			21-Mar-22	0.84	<1	<1	0.12	<2	
			05-Apr-22	0.51	<1	<1	0.12	<2	
			19-Apr-22	0.7	<1	<1	0.08	2	
			03-May-22	0.62	<1	<1	0.11	4	
			17-May-22	0.62	<1	<1	0.1	<2	
			30-May-22	0.62	<1	<1	0.17	2	
			14-Jun-22	0.59	<1	<1	0.11	6	
			28-Jun-22	0.59	<1	<1	0.14	<2	
			12-Jul-22	0.63	<1	<1	0.11	2	
			27-Jul-22	0.64	<1	<1	0.17	<2	
			11-Aug-22	0.53	<1	<1	0.12	<2	
			23-Aug-22	0.58	<1	<1	0.16	<2	
06-Sep-22	0.41	<1	<1	0.11	4				
21-Sep-22	0.57	<1	<1	0.16	<2				
04-Oct-22	0.58	<1	<1	0.11	4				
19-Oct-22	0.65	<1	<1	0.11	2				
02-Nov-22	0.5	<1	<1	0.14	12				
14-Nov-22	0.58	<1	<1	0.12	4				
28-Nov-22	0.69	<1	<1	0.15	2				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-580K	GRAB	4400 Blk Moscrop	13-Dec-22	0.7	<1	<1	0.23	2	
			30-Dec-22	0.59	<1	<1	0.15	NA	
			05-Jan-22	0.76	<1	<1	0.15	<2	
			19-Jan-22	0.86	<1	<1	0.21	<2	
			02-Feb-22	0.79	<1	<1	0.14	<2	
			14-Feb-22	0.83	<1	<1	0.11	<2	
			02-Mar-22	1.02	<1	<1	0.15	2	
			16-Mar-22	0.68	<1	<1	0.22	<2	
			31-Mar-22	0.87	<1	<1	0.11	<2	
			13-Apr-22	0.64	<1	<1	0.1	2	
BUR-581K	GRAB	7900 Blk Kaymar	27-Apr-22	0.64	<1	<1	0.08	<2	
			11-May-22	0.94	<1	<1	0.11	<2	
			25-May-22	0.62	<1	<1	0.1	<2	
			09-Jun-22	0.65	<1	<1	0.14	18	
			22-Jun-22	0.61	<1	<1	0.12	48	
			05-Jul-22	0.55	<1	<1	0.12	60	
			20-Jul-22	0.67	<1	<1	0.25	170	
			03-Aug-22	0.62	<1	<1	0.12	340	
			17-Aug-22	0.62	<1	<1	0.1	390	
			31-Aug-22	0.74	<1	<1	0.14	280	
BUR-582K	GRAB	2nd St. School, 16th Ave.	13-Sep-22	0.56	<1	<1	0.08	380	
			27-Sep-22	0.68	<1	<1	0.16	340	
			11-Oct-22	0.57	<1	<1	0.13	130	
			26-Oct-22	0.61	<1	<1	0.21	84	
			09-Nov-22	0.77	<1	<1	0.12	6	
			22-Nov-22	0.63	<1	<1	0.22	<2	
			05-Dec-22	0.73	<1	<1	0.15	<2	
			29-Dec-22	0.77	<1	<1	0.18	NA	
			11-Jan-22	0.65	<1	<1	0.29	2	
			24-Jan-22	0.8	<1	<1	0.16	<2	
BUR-582K	GRAB	2nd St. School, 16th Ave.	08-Feb-22	0.82	<1	<1	0.13	<2	
			22-Feb-22	1.6	<1	<1	0.64	<2	
			08-Mar-22	0.78	<1	<1	0.41	<2	
			21-Mar-22	0.91	<1	<1	0.12	2	
			05-Apr-22	0.8	<1	<1	0.1	<2	
			19-Apr-22	0.68	<1	<1	0.08	<2	
			03-May-22	0.69	<1	<1	0.15	<2	
			17-May-22	0.72	<1	<1	0.27	<2	
			30-May-22	0.65	<1	<1	0.13	<2	

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-582K	GRAB	2nd St. School, 16th Ave.	14-Jun-22	0.62	<1	<1	0.19	<2	
			28-Jun-22	0.59	<1	<1	0.27	<2	
			12-Jul-22	0.43	<1	<1	0.25	36	
			27-Jul-22	0.97	<1	<1	0.24	<2	
			11-Aug-22	0.58	<1	<1	0.21	<2	
			23-Aug-22	0.59	<1	<1	0.24	14	
			06-Sep-22	0.66	<1	<1	0.24	<2	
			21-Sep-22	0.88	<1	<1	0.34	<2	
			04-Oct-22	1.02	<1	<1	0.31	2	
			19-Oct-22	0.85	<1	<1	0.25	<2	
			02-Nov-22	0.49	<1	<1	0.14	<2	
			14-Nov-22	0.83	<1	<1	0.14	2	
			28-Nov-22	0.8	<1	<1	0.1	<2	
			13-Dec-22	0.65	<1	<1	0.14	<2	
30-Dec-22	0.63	<1	<1	0.14	NA				
BUR-583K	GRAB	New Vista Place	11-Jan-22	0.77	<1	<1	0.23	<2	
			24-Jan-22	0.62	<1	<1	0.19	2	
			08-Feb-22	0.87	<1	<1	0.14	<2	
			21-Mar-22	0.83	<1	<1	0.11	<2	
			05-Apr-22	0.46	<1	<1	0.11	<2	
			19-Apr-22	0.73	<1	<1	0.08	<2	
			03-May-22	0.52	<1	<1	0.08	<2	
			17-May-22	0.75	<1	<1	0.3	<2	
			30-May-22	0.71	<1	<1	0.13	<2	
			14-Jun-22	0.64	<1	<1	0.15	<2	
			28-Jun-22	0.57	<1	<1	0.12	<2	
			12-Jul-22	0.62	<1	<1	0.12	2	
			27-Jul-22	1.06	<1	<1	0.25	<2	
			11-Aug-22	0.79	<1	<1	0.22	2	
23-Aug-22	0.56	<1	<1	0.2	<2				
06-Sep-22	0.51	<1	<1	0.27	2				
21-Sep-22	0.9	<1	<1	0.37	8				
04-Oct-22	0.93	<1	<1	0.25	12				
19-Oct-22	0.84	<1	<1	0.28	2				
02-Nov-22	0.66	<1	<1	0.12	<2				
14-Nov-22	0.88	<1	<1	0.12	<2				
28-Nov-22	0.8	<1	<1	0.13	2				
13-Dec-22	0.66	<1	<1	0.16	2				
30-Dec-22	0.76	<1	<1	0.54	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-584K	GRAB	7200 Blk Edmonds St.	11-Jan-22	0.62	<1	<1	0.16	<2	
			24-Jan-22	0.8	<1	<1	0.18	<2	
			08-Feb-22	0.82	<1	<1	0.54	<2	
			22-Feb-22	1.7	<1	<1	0.11	<2	
			08-Mar-22	0.86	<1	<1	0.75	<2	
			21-Mar-22	0.77	<1	<1	0.1	<2	
			05-Apr-22	0.46	<1	<1	0.11	<2	
			19-Apr-22	0.33	<1	<1	0.08	2	
			03-May-22	0.57	<1	<1	0.11	<2	
			17-May-22	0.7	<1	<1	0.26	<2	
			30-May-22	0.41	<1	<1	0.14	<2	
			14-Jun-22	0.67	<1	<1	0.13	<2	
			28-Jun-22	0.59	<1	<1	0.19	<2	
			12-Jul-22	0.47	<1	<1	0.15	14	
			27-Jul-22	0.88	<1	<1	0.3	<2	
			11-Aug-22	0.76	<1	<1	0.34	8	
			23-Aug-22	0.61	<1	<1	0.29	6	
			06-Sep-22	0.7	<1	<1	0.25	12	
			21-Sep-22	0.75	<1	<1	0.32	8	
			04-Oct-22	0.78	<1	<1	0.23	<2	
19-Oct-22	0.67	<1	<1	0.25	<2				
02-Nov-22	0.62	<1	<1	0.13	<2				
14-Nov-22	0.77	<1	<1	0.11	<2				
28-Nov-22	0.7	<1	<1	0.13	<2				
13-Dec-22	0.69	<1	<1	0.15	<2				
30-Dec-22	0.6	<1	<1	0.2	NA				
BUR-585K	GRAB	5400 Blk Rumble St.	11-Jan-22	0.64	<1	<1	0.39	2	
			24-Jan-22	0.79	<1	<1	0.2	<2	
			08-Feb-22	0.91	<1	<1	0.14	92	
			22-Feb-22	1.8	<1	<1	0.15	170	
			08-Mar-22	0.84	<1	<1	1.4	4	
			21-Mar-22	0.79	<1	<1	0.09	2	
			05-Apr-22	0.59	<1	<1	0.1	120	
			19-Apr-22	0.64	<1	<1	0.08	14	
			03-May-22	0.75	<1	<1	0.17	12	
			17-May-22	0.76	<1	<1	0.26	8	
30-May-22	0.71	<1	<1	0.14	4				
14-Jun-22	0.55	<1	<1	0.14	18				
28-Jun-22	0.89	<1	<1	0.13	<2				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-585K	GRAB	5400 Blk Rumble St.	12-Jul-22	0.66	<1	<1	0.15	2	
			27-Jul-22	0.92	<1	2	0.3	6	
			11-Aug-22	0.63	<1	<1	0.23	2	
			23-Aug-22	0.64	<1	<1	0.21	<2	
			06-Sep-22	0.64	<1	<1	0.2	2	
			21-Sep-22	0.71	<1	<1	0.3	<2	
			04-Oct-22	0.91	<1	<1	0.25	<2	
			19-Oct-22	0.77	<1	<1	0.25	6	
			02-Nov-22	0.51	<1	<1	0.13	4	
			14-Nov-22	0.77	<1	<1	0.11	<2	
			28-Nov-22	0.87	<1	<1	0.1	<2	
			13-Dec-22	0.3	<1	<1	0.15	2	
30-Dec-22	0.76	<1	<1	0.13	NA				
BUR-586K	GRAB	3800 Blk Rumble St. (Greenall & Rumble)	11-Jan-22	0.6	<1	<1	0.2	<2	
			24-Jan-22	0.6	<1	<1	0.15	<2	
			08-Feb-22	0.7	<1	<1	0.12	8	
			22-Feb-22	1.7	<1	<1	0.24	<2	
			08-Mar-22	0.51	<1	<1	0.58	<2	
			21-Mar-22	0.7	<1	<1	0.14	4	
			05-Apr-22	0.46	<1	<1	0.09	<2	
			19-Apr-22	0.42	<1	<1	0.07	12	
			03-May-22	0.37	<1	<1	0.13	8	
			17-May-22	0.42	<1	<1	0.08	12	
			30-May-22	0.32	<1	<1	0.09	46	
			14-Jun-22	0.3	<1	<1	0.1	8	
28-Jun-22	0.52	<1	<1	0.14	4				
12-Jul-22	0.5	<1	<1	0.09	6				
27-Jul-22	0.42	<1	<1	0.18	32				
11-Aug-22	0.32	<1	<1	0.14	22				
23-Aug-22	0.36	<1	<1	0.26	52				
06-Sep-22	0.32	<1	<1	0.12	16				
21-Sep-22	0.2	<1	<1	0.18	160				
04-Oct-22	0.19	<1	<1	0.16	150				
19-Oct-22	0.19	<1	<1	0.24	560				
02-Nov-22	0.12	<1	<1	0.14	250				
14-Nov-22	0.33	<1	<1	0.11	70				
28-Nov-22	0.1	<1	<1	0.09	14				
13-Dec-22	0.5	<1	<1	0.18	4				
30-Dec-22	0.52	<1	<1	0.12	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-587K	GRAB	4400 Blk Kingsway	11-Jan-22	0.55	<1	<1	0.27	<2	
			24-Jan-22	0.77	<1	<1	0.29	<2	
			08-Feb-22	0.71	<1	<1	0.19	2	
			22-Feb-22	1.4	<1	<1	0.12	<2	
			08-Mar-22	0.77	<1	<1	0.3	<2	
			21-Mar-22	0.93	<1	<1	0.1	<2	
			05-Apr-22	0.39	<1	<1	0.09	2	
			19-Apr-22	0.62	<1	<1	0.09	4	
			03-May-22	0.65	<1	<1	0.1	16	
			17-May-22	0.68	<1	<1	0.19	4	
			30-May-22	0.61	<1	<1	0.12	<2	
			14-Jun-22	0.64	<1	<1	0.2	<2	
			28-Jun-22	0.58	<1	<1	0.16	2	
			12-Jul-22	0.58	<1	<1	0.13	<2	
			27-Jul-22	0.58	<1	<1	0.14	<2	
			11-Aug-22	0.55	<1	<1	0.12	2	
			23-Aug-22	0.55	<1	<1	0.19	<2	
			06-Sep-22	0.52	<1	<1	0.15	<2	
			21-Sep-22	0.33	<1	<1	0.23	20	
			04-Oct-22	0.58	<1	<1	4.2	22	
19-Oct-22	0.51	<1	<1	0.14	4				
02-Nov-22	0.54	<1	<1	0.14	<2				
14-Nov-22	0.65	<1	<1	0.13	4				
28-Nov-22	0.87	<1	<1	0.11	6				
13-Dec-22	0.67	<1	<1	0.17	4				
30-Dec-22	0.72	<1	<1	0.15	NA				
BUR-588K	GRAB	7500 Blk Cumberland St.	11-Jan-22	0.71	<1	<1	0.29	<2	
			24-Jan-22	0.6	<1	<1	0.13	<2	
			08-Feb-22	0.74	<1	<1	0.12	<2	
			22-Feb-22	1.5	<1	<1	0.18	4	
			08-Mar-22	0.73	<1	<1	0.29	2	
			21-Mar-22	0.73	<1	<1	0.14	<2	
			05-Apr-22	0.63	<1	<1	0.15	<2	
			19-Apr-22	0.65	<1	<1	0.08	<2	
			03-May-22	0.64	<1	<1	0.14	<2	
			17-May-22	0.69	<1	<1	0.12	<2	
30-May-22	0.64	<1	<1	0.1	4				
14-Jun-22	0.66	<1	<1	0.1	<2				
28-Jun-22	0.51	<1	<1	0.36	<2				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-588K	GRAB	7500 Blk Cumberland St.	12-Jul-22	0.47	<1	<1	0.21	24	
			27-Jul-22	0.84	<1	<1	0.29	10	
			11-Aug-22	0.59	<1	<1	0.18	10	
			23-Aug-22	0.46	<1	<1	0.22	12	
			06-Sep-22	0.52	<1	<1	0.24	12	
			21-Sep-22	0.85	<1	<1	0.3	<2	
			04-Oct-22	0.53	<1	<1	0.28	4	
			19-Oct-22	0.42	<1	<1	0.23	12	
			02-Nov-22	0.46	<1	<1	0.18	10	
			14-Nov-22	0.65	<1	<1	0.11	<2	
			28-Nov-22	0.62	<1	<1	0.09	2	
			13-Dec-22	0.58	<1	<1	0.11	<2	
30-Dec-22	0.56	<1	<1	0.19	NA				
BUR-589K	GRAB	6500 Blk Marlborough St.	11-Jan-22	0.46	<1	<1	0.3	2	
			24-Jan-22	0.75	<1	<1	0.2	4	
			08-Feb-22	0.74	<1	<1	0.15	2	
			22-Feb-22	1.8	<1	<1	0.42	6	
			08-Mar-22	0.49	<1	<1	0.31	<2	
			21-Mar-22	0.83	<1	<1	0.22	2	
			05-Apr-22	0.58	<1	<1	0.11	2	
			19-Apr-22	0.6	<1	<1	0.1	<2	
			03-May-22	0.58	<1	<1	0.11	<2	
			17-May-22	0.66	<1	<1	0.13	2	
			31-May-22	0.62	<1	<1	0.24	2	
			14-Jun-22	0.49	<1	<1	0.15	2	
28-Jun-22	0.46	<1	<1	0.2	6				
12-Jul-22	0.6	<1	<1	0.17	2				
27-Jul-22	0.88	<1	<1	0.38	54				
11-Aug-22	0.54	<1	<1	0.26	8				
23-Aug-22	0.27	<1	<1	0.66	32				
06-Sep-22	0.45	<1	<1	0.11	8				
21-Sep-22	0.64	<1	<1	0.34	12				
04-Oct-22	0.71	<1	<1	0.3	2				
19-Oct-22	0.51	<1	<1	0.24	4				
02-Nov-22	0.39	<1	<1	0.26	<2				
14-Nov-22	0.56	<1	<1	0.16	<2				
28-Nov-22	0.63	<1	<1	0.15	10				
13-Dec-22	0.65	<1	<1	0.13	2				
30-Dec-22	0.6	<1	<1	0.14	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-590K	GRAB	6100 Blk Imperial St.	11-Jan-22	0.66	<1	<1	0.54	22	
			24-Jan-22	0.48	<1	<1	0.18	4	
			08-Feb-22	0.67	<1	<1	0.13	28	
			22-Feb-22	1.3	<1	<1	0.15	46	
			08-Mar-22	0.89	<1	<1	1.8	14	
			21-Mar-22	0.91	<1	<1	0.19	18	
			05-Apr-22	0.89	<1	<1	0.1	2	
			19-Apr-22	0.54	<1	<1	0.09	40	
			03-May-22	0.54	<1	<1	0.13	36	
			17-May-22	0.6	<1	<1	0.11	32	
			30-May-22	0.65	<1	<1	0.14	36	
			14-Jun-22	0.62	<1	<1	0.11	8	
			28-Jun-22	0.57	<1	<1	0.23	62	
			12-Jul-22	0.46	<1	<1	0.21	30	
			27-Jul-22	0.67	<1	<1	0.32	12	
			11-Aug-22	0.54	<1	<1	0.18	<2	
			23-Aug-22	0.23	<1	<1	0.27	6	
			06-Sep-22	0.38	<1	<1	0.15	28	
			21-Sep-22	0.72	<1	<1	0.27	14	
			04-Oct-22	0.53	<1	<1	0.24	140	
19-Oct-22	0.33	<1	<1	0.21	44				
02-Nov-22	0.41	<1	<1	0.14	4				
14-Nov-22	0.48	<1	<1	0.11	2				
28-Nov-22	0.76	<1	<1	0.1	8				
13-Dec-22	0.8	<1	<1	0.15	4				
30-Dec-22	0.66	<1	<1	0.16	NA				
12-Jan-22	0.8	<1	<1	0.17	<2				
25-Jan-22	0.73	<1	<1	0.2	<2				
09-Feb-22	0.71	<1	<1	0.13	<2				
23-Feb-22	0.69	<1	<1	0.12	<2				
10-Mar-22	0.9	<1	<1	0.18	<2				
24-Mar-22	0.85	<1	<1	0.12	<2				
06-Apr-22	0.68	<1	<1	0.1	2				
20-Apr-22	0.87	<1	<1	0.08	<2				
04-May-22	0.55	<1	<1	0.1	<2				
18-May-22	0.68	<1	<1	0.13	<2				
31-May-22	0.64	<1	<1	0.1	<2				
15-Jun-22	0.52	<1	<1	0.18	<2				
29-Jun-22	0.59	<1	<1	0.14	2				
BUR-592K	GRAB	9800 Lynhurst St.							

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-592K	GRAB	9800 Lynhurst St.	13-Jul-22	0.51	<1	<1	0.18	<2	
			26-Jul-22	0.67	<1	<1	0.18	<2	
			10-Aug-22	0.54	<1	<1	0.23	4	
			24-Aug-22	0.47	<1	<1	0.18	<2	
			07-Sep-22	0.54	<1	<1	0.15	<2	
			20-Sep-22	0.59	<1	<1	0.61	8	
			05-Oct-22	0.72	<1	<1	0.17	<2	
			18-Oct-22	0.43	<1	<1	0.17	<2	
			01-Nov-22	0.65	<1	<1	0.13	<2	
			16-Nov-22	0.71	<1	<1	0.17	<2	
			01-Dec-22	0.71	<1	<1	0.18	4	
			15-Dec-22	0.61	<1	<1	0.13	2	
29-Dec-22	0.72	<1	<1	0.18	NA				
BUR-593K	GRAB	3300 Blk Lakecity	12-Jan-22	0.7	<1	<1	0.27	10	
			25-Jan-22	0.56	<1	<1	0.12	<2	
			09-Feb-22	0.89	<1	<1	0.1	2	
			23-Feb-22	0.64	<1	<1	0.09	<2	
			10-Mar-22	0.58	<1	<1	0.15	<2	
			24-Mar-22	0.6	<1	<1	0.1	<2	
			06-Apr-22	0.56	<1	<1	0.11	<2	
			20-Apr-22	0.61	<1	<1	0.08	6	
			04-May-22	0.67	<1	<1	0.08	<2	
			18-May-22	0.61	<1	<1	0.16	<2	
			31-May-22	0.57	<1	<1	0.09	4	
			15-Jun-22	0.69	<1	<1	0.14	2	
29-Jun-22	0.52	<1	<1	0.12	2				
13-Jul-22	0.5	<1	<1	0.11	<2				
26-Jul-22	0.37	<1	<1	0.15	4				
10-Aug-22	0.3	<1	<1	0.19	8				
24-Aug-22	0.46	<1	<1	0.13	2				
07-Sep-22	0.41	<1	<1	0.11	12				
20-Sep-22	0.27	<1	<1	0.21	6				
05-Oct-22	0.45	<1	<1	0.14	24				
18-Oct-22	0.21	<1	<1	0.19	42				
01-Nov-22	0.44	<1	<1	0.15	10				
16-Nov-22	0.7	<1	<1	0.13	2				
01-Dec-22	0.56	<1	<1	0.14	6				
15-Dec-22	0.65	<1	<1	0.17	<2				
29-Dec-22	0.53	<1	<1	0.13	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-595K	GRAB	Rochester St.	13-Jul-22	0.56	<1	<1	0.13	<2	
			26-Jul-22	0.54	<1	<1	0.19	<2	
			10-Aug-22	0.62	<1	<1	0.18	6	
			24-Aug-22	0.46	<1	<1	0.24	10	
			07-Sep-22	0.51	<1	<1	0.2	4	
			20-Sep-22	0.41	<1	<1	0.34	2	
			05-Oct-22	0.52	<1	<1	0.19	6	
			18-Oct-22	0.3	<1	<1	0.23	10	
			01-Nov-22	0.59	<1	<1	0.12	6	
			16-Nov-22	0.63	<1	<1	0.18	<2	
			01-Dec-22	0.6	<1	<1	0.15	<2	
			15-Dec-22	0.69	<1	<1	0.13	2	
			29-Dec-22	0.73	<1	<1	0.15	NA	
			04-Jan-22	0.61	<1	<1	0.22	<2	
			18-Jan-22	0.78	<1	<1	0.15	6	
01-Feb-22	0.76	<1	<1	0.17	<2				
BUR-596K	GRAB	561 Duthie	15-Feb-22	0.78	<1	<1	0.13	50	
			01-Mar-22	0.65	<1	<1	0.13	<2	
			15-Mar-22	0.7	<1	<1	0.12	4	
			29-Mar-22	0.66	<1	<1	0.12	4	
			14-Apr-22	1.29	<1	<1	0.1	<2	
			26-Apr-22	0.58	<1	<1	0.09	<2	
			10-May-22	0.67	<1	<1	0.11	4	
			24-May-22	0.6	<1	<1	0.11	4	
			07-Jun-22	0.74	<1	<1	0.12	12	
			21-Jun-22	0.62	<1	<1	0.13	<2	
			07-Jul-22	0.66	<1	<1	0.13	12	
			19-Jul-22	0.71	<1	<1	0.2	<2	
			02-Aug-22	0.61	<1	<1	0.13	<2	
			16-Aug-22	0.54	<1	<1	0.13	6	
			30-Aug-22	0.59	<1	<1	0.14	2	
14-Sep-22	0.54	<1	<1	0.14	<2				
28-Sep-22	0.46	<1	<1	0.35	<2				
12-Oct-22	0.48	<1	<1	0.14	4				
25-Oct-22	0.65	<1	<1	0.14	2				
08-Nov-22	0.43	<1	<1	0.2	<2				
23-Nov-22	0.62	<1	<1	0.14	4				
06-Dec-22	0.67	<1	<1	0.11	2				
30-Dec-22	0.74	<1	<1	0.14	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-660K	GRAB	North Rd. across from Hume Park	13-Jul-22	0.55	<1	<1	0.15	4	
			26-Jul-22	0.58	<1	<1	0.2	2	
			10-Aug-22	0.46	<1	<1	0.17	2	
			24-Aug-22	0.3	<1	<1	0.11	10	
			07-Sep-22	0.34	<1	<1	0.11	12	
			20-Sep-22	0.19	<1	<1	0.19	2	
			05-Oct-22	0.36	<1	<1	0.15	32	
			18-Oct-22	0.16	<1	<1	0.24	10	
			01-Nov-22	0.38	<1	<1	0.18	10	
			16-Nov-22	0.63	<1	<1	0.12	4	
			01-Dec-22	0.59	<1	<1	0.12	<2	
			15-Dec-22	0.63	<1	<1	0.14	<2	
29-Dec-22	0.68	<1	<1	0.23	NA				
11-Jan-22	0.46	<1	<1	0.36	<2				
24-Jan-22	0.72	<1	<1	0.17	<2				
08-Feb-22	0.79	<1	<1	0.15	<2				
22-Feb-22	1.3	<1	<1	0.1	<2				
08-Mar-22	0.8	<1	<1	1.9	<2				
21-Mar-22	0.75	<1	<1	0.1	<2				
05-Apr-22	0.54	<1	<1	0.09	<2				
19-Apr-22	0.68	<1	<1	0.07	<2				
03-May-22	0.62	<1	<1	0.09	<2				
17-May-22	0.67	<1	<1	0.09	<2				
30-May-22	0.62	<1	<1	0.11	<2				
14-Jun-22	0.65	<1	<1	0.11	2				
28-Jun-22	0.61	<1	<1	0.17	<2				
12-Jul-22	0.62	<1	<1	0.12	<2				
27-Jul-22	0.61	<1	<1	0.15	2				
11-Aug-22	0.54	<1	<1	0.1	<2				
23-Aug-22	0.56	<1	<1	0.24	<2				
06-Sep-22	0.55	<1	<1	0.15	4				
21-Sep-22	0.57	<1	<1	0.11	2				
04-Oct-22	0.63	<1	<1	0.24	6				
19-Oct-22	0.74	<1	<1	0.15	2				
02-Nov-22	0.53	<1	<1	0.12	<2				
14-Nov-22	0.87	<1	<1	0.15	<2				
28-Nov-22	0.58	<1	<1	0.1	<2				
13-Dec-22	0.67	<1	<1	0.19	<2				
30-Dec-22	0.64	<1	<1	0.21	NA				
BUR-661K	GRAB	5300 Kira Court	13-Jul-22	0.55	<1	<1	0.15	4	
			26-Jul-22	0.58	<1	<1	0.2	2	
			10-Aug-22	0.46	<1	<1	0.17	2	
			24-Aug-22	0.3	<1	<1	0.11	10	
			07-Sep-22	0.34	<1	<1	0.11	12	
			20-Sep-22	0.19	<1	<1	0.19	2	
			05-Oct-22	0.36	<1	<1	0.15	32	
			18-Oct-22	0.16	<1	<1	0.24	10	
			01-Nov-22	0.38	<1	<1	0.18	10	
			16-Nov-22	0.63	<1	<1	0.12	4	
			01-Dec-22	0.59	<1	<1	0.12	<2	
			15-Dec-22	0.63	<1	<1	0.14	<2	
29-Dec-22	0.68	<1	<1	0.23	NA				
11-Jan-22	0.46	<1	<1	0.36	<2				
24-Jan-22	0.72	<1	<1	0.17	<2				
08-Feb-22	0.79	<1	<1	0.15	<2				
22-Feb-22	1.3	<1	<1	0.1	<2				
08-Mar-22	0.8	<1	<1	1.9	<2				
21-Mar-22	0.75	<1	<1	0.1	<2				
05-Apr-22	0.54	<1	<1	0.09	<2				
19-Apr-22	0.68	<1	<1	0.07	<2				
03-May-22	0.62	<1	<1	0.09	<2				
17-May-22	0.67	<1	<1	0.09	<2				
30-May-22	0.62	<1	<1	0.11	<2				
14-Jun-22	0.65	<1	<1	0.11	2				
28-Jun-22	0.61	<1	<1	0.17	<2				
12-Jul-22	0.62	<1	<1	0.12	<2				
27-Jul-22	0.61	<1	<1	0.15	2				
11-Aug-22	0.54	<1	<1	0.1	<2				
23-Aug-22	0.56	<1	<1	0.24	<2				
06-Sep-22	0.55	<1	<1	0.15	4				
21-Sep-22	0.57	<1	<1	0.11	2				
04-Oct-22	0.63	<1	<1	0.24	6				
19-Oct-22	0.74	<1	<1	0.15	2				
02-Nov-22	0.53	<1	<1	0.12	<2				
14-Nov-22	0.87	<1	<1	0.15	<2				
28-Nov-22	0.58	<1	<1	0.1	<2				
13-Dec-22	0.67	<1	<1	0.19	<2				
30-Dec-22	0.64	<1	<1	0.21	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-669K	GRAB	Monarch & Gatenby (@ of 4405 Gatenby)	13-Jul-22	0.54	<1	<1	0.27	<2	
			26-Jul-22	0.38	<1	<1	0.22	4	
			10-Aug-22	0.4	<1	<1	0.59	10	
			24-Aug-22	0.47	<1	<1	0.13	28	
			07-Sep-22	0.85	<1	<1	0.15	58	
			20-Sep-22	0.42	<1	<1	0.21	160	
			05-Oct-22	0.29	<1	<1	0.23	230	
			18-Oct-22	0.19	<1	<1	0.33	64	
			01-Nov-22	0.34	<1	<1	0.17	16	
			16-Nov-22	0.49	<1	<1	0.16	2	
			01-Dec-22	0.62	<1	<1	0.13	2	
			15-Dec-22	0.59	<1	<1	0.16	4	
29-Dec-22	0.62	<1	<1	0.14	NA				
BUR-800K	GRAB	7400 Blk Mulberry Place	05-Jan-22	0.81	<1	<1	0.31	2	
			19-Jan-22	0.87	<1	<1	0.12	4	
			02-Feb-22	0.82	<1	<1	0.61	<2	
			14-Feb-22	0.69	<1	<1	0.16	<2	
			02-Mar-22	0.64	<1	<1	0.18	<2	
			16-Mar-22	0.53	<1	<1	0.1	<2	
			31-Mar-22	0.85	<1	<1	0.12	<2	
			13-Apr-22	1.1	<1	<1	0.11	<2	
			27-Apr-22	0.59	<1	<1	0.09	2	
			11-May-22	0.87	<1	<1	0.11	<2	
			25-May-22	0.64	<1	<1	0.14	<2	
			09-Jun-22	0.87	<1	<1	0.14	2	
22-Jun-22	0.57	<1	<1	0.09	4				
05-Jul-22	0.61	<1	<1	0.1	2				
20-Jul-22	0.49	<1	<1	0.13	4				
03-Aug-22	0.52	<1	<1	0.22	6				
17-Aug-22	0.44	<1	<1	0.12	4				
31-Aug-22	0.56	<1	<1	0.19	4				
13-Sep-22	0.46	<1	<1	0.16	2				
27-Sep-22	0.82	<1	<1	0.23	<2				
11-Oct-22	0.5	<1	<1	0.21	8				
26-Oct-22	0.28	<1	<1	0.39	<2				
09-Nov-22	0.54	<1	<1	0.15	4				
22-Nov-22	0.51	<1	<1	0.14	<2				
05-Dec-22	0.81	<1	<1	0.21	<2				
29-Dec-22	0.81	<1	<1	0.15	NA				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-850K	GRAB	Near Vipond and McKay	11-Jan-22	0.73	<1	<1	0.24	<2	
			24-Jan-22	0.75	<1	<1	0.38	4	
			08-Feb-22	0.98	<1	<1	0.17	2	
			22-Feb-22	1.8	<1	<1	0.17	<2	
			08-Mar-22	0.8	<1	<1	0.81	<2	
			21-Mar-22	0.97	<1	<1	0.75	10	
			05-Apr-22	0.57	<1	<1	0.19	<2	
			19-Apr-22	0.71	<1	<1	0.1	2	
			03-May-22	0.6	<1	<1	0.11	<2	
			17-May-22	0.96	<1	<1	0.21	6	
			30-May-22	0.82	<1	<1	0.14	2	
			14-Jun-22	0.47	<1	<1	0.3	<2	
			28-Jun-22	0.73	<1	<1	0.29	6	
			12-Jul-22	0.78	<1	<1	0.22	4	
			27-Jul-22	0.88	<1	<1	0.48	2	
			11-Aug-22	0.56	<1	<1	0.19	8	
			06-Sep-22	0.46	<1	<1	0.11	4	
			21-Sep-22	0.6	<1	<1	0.37	<2	
			04-Oct-22	0.68	<1	<1	0.32	16	
			19-Oct-22	0.67	<1	<1	0.38	4	
02-Nov-22	0.51	<1	<1	0.14	12				
14-Nov-22	0.7	<1	<1	0.15	2				
28-Nov-22	0.68	<1	<1	0.13	<2				
13-Dec-22	0.76	<1	<1	0.22	<2				
30-Dec-22	0.78	<1	<1	0.26	NA				
BUR-851K	GRAB	9225 Holmes St.	11-Jan-22	0.3	<1	<1	0.12	2	
			24-Jan-22	0.4	<1	<1	0.11	<2	
			08-Feb-22	0.55	<1	<1	0.13	<2	
			22-Feb-22	1	<1	<1	0.16	<2	
			08-Mar-22	0.56	<1	<1	0.12	<2	
			21-Mar-22	0.57	<1	<1	0.14	<2	
			05-Apr-22	0.41	<1	<1	0.09	<2	
			19-Apr-22	0.41	<1	<1	0.07	<2	
			03-May-22	0.37	<1	<1	0.11	<2	
			17-May-22	0.42	<1	<1	0.1	<2	
			30-May-22	0.4	<1	<1	0.14	<2	
			14-Jun-22	0.42	<1	<1	0.11	<2	
28-Jun-22	0.18	<1	<1	0.27	4				
12-Jul-22	0.28	<1	<1	0.38	40				

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-851K	GRAB	9225 Holmes St.	27-Jul-22	0.58	<1	<1	0.29	2	
			11-Aug-22	0.57	<1	<1	0.24	<2	
			23-Aug-22	0.34	<1	<1	0.35	<2	
			06-Sep-22	0.29	<1	<1	0.17	6	
			21-Sep-22	0.42	<1	<1	0.25	12	
			04-Oct-22	0.15	<1	<1	0.25	10	
			19-Oct-22	0.1	<1	<1	0.25	46	
			02-Nov-22	0.07	<1	<1	0.18	34	
			14-Nov-22	0.26	<1	<1	0.14	<2	
			28-Nov-22	0.24	<1	<1	0.11	<2	
			13-Dec-22	0.39	<1	<1	0.14	<2	
			30-Dec-22	0.41	<1	<1	0.13	NA	
			04-Jan-22	0.76	<1	<1	0.15	<2	
			18-Jan-22	1.04	<1	<1	0.14	2	
			01-Feb-22	0.75	<1	<1	0.19	2	
15-Feb-22	0.82	<1	<1	0.12	<2				
01-Mar-22	0.88	<1	<1	0.15	2				
15-Mar-22	0.7	<1	<1	0.1	<2				
29-Mar-22	0.63	<1	<1	0.13	<2				
14-Apr-22	0.75	<1	<1	0.2	<2				
26-Apr-22	0.67	<1	<1	0.08	<2				
10-May-22	0.8	<1	<1	0.12	6				
24-May-22	0.62	<1	<1	0.12	2				
07-Jun-22	0.77	<1	<1	0.2	<2				
21-Jun-22	0.63	<1	<1	0.11	<2				
07-Jul-22	0.71	<1	<1	0.17	2				
19-Jul-22	0.68	<1	<1	0.12	<2				
02-Aug-22	0.64	<1	<1	0.1	6				
16-Aug-22	0.61	<1	<1	0.09	8				
30-Aug-22	0.66	<1	<1	0.1	10				
14-Sep-22	0.68	<1	<1	0.1	30				
28-Sep-22	0.31	<1	<1	0.19	22				
12-Oct-22	0.49	<1	<1	3.3	160				
25-Oct-22	0.77	<1	<1	0.5	30				
08-Nov-22	0.64	<1	<1	0.21	20				
23-Nov-22	0.71	<1	<1	0.16	2				
06-Dec-22	0.82	<1	<1	0.16	<2				
30-Dec-22	0.91	<1	<1	0.16	NA				
04-Jan-22	0.84	<1	<1	0.14	<2				
BUR-852K	GRAB	West of 7027 Gibson							
BUR-853K	GRAB	1531 Sperling							

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-854K	GRAB	5569 Carson	20-Jul-22	0.59	<1	<1	0.21	10	
			03-Aug-22	0.69	<1	<1	0.29	12	
			17-Aug-22	0.52	<1	<1	0.14	<2	
			31-Aug-22	0.51	<1	<1	0.26	12	
			13-Sep-22	0.38	<1	<1	0.14	10	
			27-Sep-22	0.5	<1	<1	0.21	48	
			11-Oct-22	0.59	<1	<1	0.63	20	
			26-Oct-22	0.51	<1	<1	0.3	22	
			09-Nov-22	0.57	<1	<1	0.12	<2	
			22-Nov-22	0.59	<1	<1	0.13	<2	
			05-Dec-22	0.72	<1	<1	0.15	2	
			29-Dec-22	0.58	<1	<1	0.16	NA	
			12-Jan-22	0.82	<1	<1	0.18	<2	
BUR-855K	GRAB	5009 Manor	25-Jan-22	0.9	<1	<1	0.21	<2	
			09-Feb-22	0.75	<1	<1	0.14	<2	
			23-Feb-22	0.68	<1	<1	0.09	<2	
			10-Mar-22	0.92	<1	<1	0.11	<2	
			24-Mar-22	0.99	<1	<1	0.1	<2	
			06-Apr-22	0.65	<1	<1	0.13	2	
			20-Apr-22	0.8	<1	<1	0.11	<2	
			04-May-22	0.76	<1	<1	0.11	<2	
			18-May-22	0.88	<1	<1	0.09	<2	
			31-May-22	1.02	<1	<1	0.11	8	
			15-Jun-22	0.69	<1	<1	0.14	18	
			29-Jun-22	0.79	<1	<1	0.1	20	
			13-Jul-22	0.89	<1	<1	0.15	12	
26-Jul-22	0.87	<1	<1	0.21	4				
10-Aug-22	0.96	<1	<1	0.15	2				
24-Aug-22	0.57	<1	<1	0.17	12				
07-Sep-22	0.72	<1	<1	0.11	10				
20-Sep-22	0.7	<1	<1	0.08	6				
05-Oct-22	0.79	<1	<1	0.1	12				
18-Oct-22	0.65	<1	<1	0.12	<2				
01-Nov-22	0.79	<1	<1	0.11	6				
16-Nov-22	0.71	<1	<1	0.14	2				
01-Dec-22	0.85	<1	<1	0.12	<2				
15-Dec-22	0.88	<1	<1	0.13	16				
29-Dec-22	0.72	<1	<1	0.15	NA				
18-Jan-22	0.35	<1	<1	0.2	2				
BUR-856K	GRAB	Centennial Reservoir							

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-856K	GRAB	Centennial Reservoir	01-Feb-22	0.34	<1	<1	0.21	16	
			15-Feb-22	0.47	<1	<1	0.17	6	
			01-Mar-22	0.34	<1	<1	0.32	<2	
			15-Mar-22	0.34	<1	<1	0.21	<2	
			29-Mar-22	0.24	<1	<1	0.23	12	
			14-Apr-22	0.44	<1	<1	0.2	34	
			26-Apr-22	0.1	<1	<1	0.16	20	
			24-May-22	0.34	<1	<1	0.36	20	
			07-Jun-22	0.52	<1	<1	0.17	58	
			21-Jun-22	0.34	<1	<1	0.14	88	
			07-Jul-22	0.71	<1	<1	0.13	86	
			19-Jul-22	0.54	<1	<1	0.12	100	
			02-Aug-22	0.48	<1	<1	0.16	130	
			16-Aug-22	0.45	<1	<1	0.2	210	
			30-Aug-22	0.45	<1	<1	0.16	190	
			14-Sep-22	0.51	<1	<1	0.12	250	
			28-Sep-22	0.36	<1	<1	0.3	560	
			12-Oct-22	0.39	CG	CG	0.13	270	
			17-Oct-22	0.46	-	-	0.21	520	
25-Oct-22	0.35	<1	<1	0.21	1600				
08-Nov-22	0.32	<1	<1	0.13	340				
23-Nov-22	0.1	<1	<1	0.29	750				
06-Dec-22	0.22	<1	<1	0.28	1100				
30-Dec-22	0.35	<1	<1	0.67	NA				
04-Jan-22	0.8	<1	<1	0.12	<2				
18-Jan-22	0.7	<1	<1	0.21	4				
01-Feb-22	0.66	<1	<1	0.15	2				
15-Feb-22	0.84	<1	<1	0.11	<2				
01-Mar-22	0.75	<1	<1	0.16	2				
15-Mar-22	0.81	<1	<1	0.13	<2				
29-Mar-22	0.63	<1	<1	0.1	<2				
14-Apr-22	0.9	<1	<1	0.12	<2				
26-Apr-22	0.7	<1	<1	0.09	<2				
10-May-22	0.82	<1	<1	0.12	2				
24-May-22	0.64	<1	<1	0.14	<2				
07-Jun-22	0.68	<1	<1	0.15	4				
21-Jun-22	0.6	<1	<1	0.12	<2				
07-Jul-22	0.63	<1	<1	0.14	<2				
19-Jul-22	0.65	<1	<1	0.14	2				
BUR-857K	GRAB	Curtis Reservoir	01-Feb-22	0.34	<1	<1	0.21	16	
			15-Feb-22	0.47	<1	<1	0.17	6	
			01-Mar-22	0.34	<1	<1	0.32	<2	
			15-Mar-22	0.34	<1	<1	0.21	<2	
			29-Mar-22	0.24	<1	<1	0.23	12	
			14-Apr-22	0.44	<1	<1	0.2	34	
			26-Apr-22	0.1	<1	<1	0.16	20	
			24-May-22	0.34	<1	<1	0.36	20	
			07-Jun-22	0.52	<1	<1	0.17	58	
			21-Jun-22	0.34	<1	<1	0.14	88	
			07-Jul-22	0.71	<1	<1	0.13	86	

Drinking Water Reports By Station - City of Burnaby Sites (2022)									
Sample Name	Sample Type	Sample Description	Sampled Date	Chlorine Free (mg/L)	Ecoli (CFU/100mLs)	Total Coliform (CFU/100mLs)	Turbidity (NTU)	HPC (CFU/mL)	
BUR-857K	GRAB	Curtis Reservoir	02-Aug-22	0.6	<1	<1	0.14	<2	
			16-Aug-22	0.49	<1	<1	0.17	<2	
			30-Aug-22	0.62	<1	<1	0.12	6	
			14-Sep-22	0.65	<1	<1	0.14	4	
			28-Sep-22	0.58	<1	<1	0.32	<2	
			12-Oct-22	0.51	<1	<1	0.15	6	
			25-Oct-22	0.73	<1	<1	0.13	4	
			08-Nov-22	0.63	<1	<1	0.16	<2	
			23-Nov-22	0.61	<1	<1	0.14	<2	
			06-Dec-22	0.91	<1	<1	0.13	<2	
			30-Dec-22	0.56	<1	<1	0.18	NA	
			04-Jan-22	0.68	<1	<1	0.13	8	
BUR-859K	GRAB	192 North Warwick	18-Jan-22	0.72	<1	<1	0.15	120	
			01-Feb-22	0.55	<1	<1	0.19	12	
			15-Feb-22	0.46	<1	<1	0.12	90	
			01-Mar-22	0.6	<1	<1	0.14	<2	
			15-Mar-22	0.58	<1	<1	0.14	2	
			29-Mar-22	0.58	<1	<1	0.17	4	
			14-Apr-22	0.69	<1	<1	0.13	34	
			26-Apr-22	0.55	<1	<1	0.09	4	
			10-May-22	0.57	<1	<1	0.15	8	
			24-May-22	0.48	<1	<1	0.22	18	
			07-Jun-22	0.49	<1	<1	0.16	14	
			21-Jun-22	0.5	<1	<1	0.11	14	
07-Jul-22	0.45	<1	<1	0.13	10				
19-Jul-22	0.5	<1	<1	0.1	20				
02-Aug-22	0.49	<1	<1	0.15	6				
16-Aug-22	0.33	<1	<1	0.43	24				
30-Aug-22	0.47	<1	<1	0.32	170				
14-Sep-22	0.51	<1	<1	0.13	20				
28-Sep-22	0.23	<1	<1	0.37	130				
12-Oct-22	0.49	<1	<1	0.21	42				
25-Oct-22	0.38	<1	<1	0.16	84				
08-Nov-22	0.39	<1	<1	0.1	10				
23-Nov-22	0.41	<1	<1	0.25	28				
06-Dec-22	0.54	<1	<1	0.17	2				
30-Dec-22	0.49	<1	<1	0.2	NA				

APPENDIX B

Metro Vancouver Water Quality Control
Annual Report for 2022

DRINKING WATER QUALITY 2022 ANNUAL REPORT





Greater Vancouver Water District
2022 Water Quality Annual Report
Volume 1 of 2

March 2023

57690220

This page has been intentionally left blank

Table of Contents

Table of Contents	i
List of Tables	ii
List of Figures	ii
List of Appendices	ii
ACRONYMS.....	3
EXECUTIVE SUMMARY.....	4
1.0 SOURCE WATER QUALITY	5
1.1. Bacteriological Quality of the Source Water	5
1.2. Source Water Monitoring for <i>Giardia</i> and <i>Cryptosporidium</i>	6
1.3. Turbidity	7
1.4. Chemistry	8
1.4.1. Chemical and Physical Characteristics of the Source Water	8
1.4.2. Analysis of Water for Organic Components and Radionuclides.....	8
1.4.3. PFOS and PFOA	9
1.4.4. Limnology	9
2.0 QUALITY CONTROL ASSESSMENT OF WATER TREATMENT	11
2.1. Seymour Capilano Filtration Plant	11
2.1.1. Filtration.....	11
2.1.2. Ultraviolet Treatment	14
2.1.3. Chlorination.....	15
2.2. Coquitlam Water Treatment Plant.....	15
2.2.1. Ozonation.....	16
2.2.2. Ultraviolet Treatment	16
2.2.3. Chlorination.....	17
2.3. Secondary Disinfection.....	17
2.4. Corrosion Control.....	18
3.0 TRANSMISSION/DISTRIBUTION SYSTEM WATER QUALITY	20
3.1. Microbiological Water Quality in the GVWD System.....	21
3.1.1. GVWD Water Mains.....	21
3.1.2. GVWD In-System Reservoirs	22
3.2. Microbiological Water Quality in Member Jurisdiction Systems	24
3.3. Disinfection By-Products in the Transmission/Distribution Systems	25
4.0 Quality Control/Quality Assurance	28

List of Tables

Table 1: Percent of Samples in Six Continual Months with <i>E. coli</i> /100 mL Exceeding 20.....	5
Table 2: Percent of Samples Positive for <i>Giardia</i>	7
Table 3: Percent of Samples Positive of <i>Cryptosporidium</i>	7
Table 4: Monitoring of Source Waters for PFOS and PFOA	9
Table 5: Comparison of Water Quality in GVWD Water Supply Sources to Standard Water Quality Classifications..	10
Table 6: Monthly Filter Effluent Turbidity Summary	14
Table 7: Percent of Volume Meeting Ultraviolet Dosage Requirements at SCFP	15
Table 8: Percent of Volume Meeting Ultraviolet Dosage Requirements at CWTP	16
Table 9: Performance of Secondary Disinfection Facilities.....	18
Table 10: Performance of Corrosion Control Facilities	19
Table 11: Status of GVWD Reservoirs (2019-2022)	24
Table 12: Member Jurisdiction Water Quality Compared to the Provincial Bacteriological Standards	25

List of Figures

Figure 1: Percent of Samples Exceeding 20 <i>E. coli</i> /100 mL at all Three Sources (2019 to 2022)	6
Figure 2: Average Daily Turbidity of Source Water (From In-line Readings)	8
Figure 3: Trophic State Index of Source Waters	10
Figure 4: Apparent Colour Levels Before and After Filtration	12
Figure 5: Average Daily Turbidity Levels Before and After Filtration	13
Figure 6: Bacteriological Quality of Water in GVWD Water Mains	21
Figure 7: Bacteriological Quality of Water in GVWD In-System Reservoirs.....	22
Figure 8: Percent of Samples per Month Positive for Total Coliform Bacteria (2019 to 2022)	24
Figure 9: Average Total Trihalomethane Levels	26
Figure 10: Average Total Haloacetic Acid Levels	27

List of Appendices

Appendix A — Water Sampling Frequency.....	29
Appendix B — Chemical and Physical Analysis Summaries.....	31
Appendix C — Analysis of Water for Organic Components and Radionuclides	35
Appendix D — Metro Vancouver Detection of Waterborne <i>Cryptosporidium</i> and <i>Giardia</i> January - December 2022 Annual Report	41

ACRONYMS

ACU	Apparent Colour Unit
ALARA	As Low As Reasonably Achievable
AO	Aesthetic Objective (characteristics such as taste, colour, appearance, temperature that are not health related)
BTEX	Benzene, Ethylbenzene, Toluene, Xylene
CALA	Canadian Association for Laboratory Accreditation
CO ₂	Carbon Dioxide
CWTP	Coquitlam Water Treatment Plant
DBP	Disinfection By-product
DWTO	<i>Drinking Water Treatment Objectives (Microbiological) for Surface Water Supplies in British Columbia</i>
<i>E. coli</i>	<i>Escherichia coli</i>
GCDWQ	<i>Guidelines for Canadian Drinking Water Quality</i>
GVWD	Greater Vancouver Water District
HAA	Haloacetic Acid
HPC	Heterotrophic Plate Count
IFE	Individual Filter Effluent
MAC	Maximum Acceptable Concentration
mg/L	Milligram per litre (0.001 g/L)
µg/L	Microgram per litre (0.000001 g/L)
mL	Milliliter
MF	Membrane Filtration
mJ/cm ²	Millijoule per centimeter squared
MPN	Most Probable Number
N/A	Not Applicable
NTU	Nephelometric Turbidity Unit
PAH	Polycyclic Aromatic Hydrocarbons
PFOA	Perfluorooctanoic Acid
PFOS	Perfluorooctane Sulfonate
pH	Measure of acidity or basicity of water; pH 7 is neutral
SCFP	Seymour Capilano Filtration Plant
THAA	Total Haloacetic Acids
THM	Trihalomethane
TSI	Trophic State Index
TTHM	Total Trihalomethanes
UV ₂₅₄	Ultraviolet Absorbance at 254 nm
VOC	Volatile Organic Compounds
WQMRP	<i>Water Quality Monitoring and Reporting Plan for Metro Vancouver (GVWD) and Local Government Members</i>

EXECUTIVE SUMMARY

Source Water Quality

- In 2022, the turbidity levels of the delivered water met the requirements of the *Guidelines for Canadian Drinking Water Quality* (GCDWQ).
- The Capilano supply was in service for the entire year. Heavy rainfall events in January resulted in Capilano source water turbidity peaking just over 6.5 Nephelometric Turbidity Unit (NTU). Even with the higher turbidity, the delivered filtered Capilano water was less than 0.15 NTU as measured by online instruments for the entire year.
- The Seymour supply was in service for the entire year. Heavy rainfall events in late December resulted in Seymour source water turbidity peaking at 5.4 NTU. The delivered filtered Seymour water was less than 0.15 NTU as measured by online instruments for the entire year.
- The Coquitlam supply was in service for the entire year. The unfiltered Coquitlam source water was greater than 1.0 NTU for 10 days in 2022 and did not exceed 5.0 NTU throughout the year in accordance with Greater Vancouver Water District's (GVWD) Permit to Operate.
- The microbiological quality of the three source waters was excellent in 2022. The levels of bacteria and protozoa detected were low and indicative of high quality source water.
- Coquitlam source water quality met the bacteriological requirements for avoiding filtration outlined in the turbidity section of the GCDWQ.
- Analytical results of the source water for herbicides, pesticides, volatile organic compounds and radionuclides were all found to be below the recommended limits as listed in the GCDWQ.

Water Treatment

- The Seymour Capilano Filtration Plant (SCFP) performance, as measured by the quality of the delivered water, was excellent in 2022. The daily average turbidity of water leaving the Clearwells to enter the GVWD transmission system was an average of 0.15 NTU in 2022.
- Turbidity levels for Individual Filter Effluent (IFE) met the turbidity requirements of the GCDWQ.
- Filtration consistently removed iron, colour and organics from the Capilano and Seymour source waters.
- Levels of total aluminum in filtered water were consistently below the GCDWQ operational guideline value of 0.1 mg/L for direct filtration plants using aluminum-based coagulants. The maximum value for 2022 was 0.055mg/L.
- There were no outages of ultraviolet treatment at the SCFP and the Coquitlam Water Treatment Plant (CWTP).
- The SCFP and CWTP operated the full year using sodium hypochlorite for chlorination.
- The secondary disinfection stations boosted chlorine when required.

Transmission/Distribution System Water Quality

- Bacteriological water quality was excellent in the GVWD transmission mains and in-system storage reservoirs. The number of *E. coli* detected in both GVWD and member jurisdiction drinking water samples is typically very low. More than 28,700 samples were collected and analyzed for GVWD and member jurisdiction systems in 2022, of which one sample was positive for *E. coli*.
- The running average levels of the Trihalomethane (THM) group of chlorine disinfection by-products detected in the delivered water in the GVWD and member jurisdiction systems were below the Maximum Acceptable Concentration (MAC) in the GCDWQ of 100 µg/L (0.1 mg/L). The running average levels for the Haloacetic Acid (HAA) group of chlorine disinfection by-products were below the GCDWQ Maximum Acceptable Concentration (MAC) of 80 µg/L (0.08 mg/L).

1.0 SOURCE WATER QUALITY

The first barrier in place to protect the quality of the drinking water supply is the protection of the Water Supply Area to ensure the best quality source water. Source water monitoring provides ongoing confirmation that the barrier is effective, identifies seasonal changes and provides the monitoring information necessary to adjust the level of water treatment that is in place. Regular monitoring of the water sources is a requirement of the *Water Quality Monitoring and Reporting Plan for Metro Vancouver (GVWD) and Local Government Members (WQMRP)*. Refer to Appendix A for details regarding the water sampling frequency.

1.1. Bacteriological Quality of the Source Water

The bacteriological quality of the source water is an important indicator of the degree of contamination, and the treatment required to ensure a safe water supply. *The Drinking Water Treatment Objectives (Microbiological) for Surface Water Supplies in British Columbia (DWTO)* Section 4.3 states “The number of *E. coli* in raw water does not exceed 20/100 mL (or if *E. coli* data are not available less than 100/100 mL of total coliform) in at least 90% of the weekly samples from the previous six months. Treatment target for all water systems is to contain no detectable *E. coli* or fecal coliform per 100 mL.”

Table 1 summarizes *E. coli* data for all three GVWD water supply sources. The levels of *E. coli* for all three sources were below the 10% limit in the provincial DWTO.

Month	Percent of samples (daily) in a six month period ending on the last day of the month named where <i>E. coli</i> greater than 20/100 mL		
	Capilano	Seymour	Coquitlam
Jan	3.8%	7.7%	3.8%
Feb	3.9%	7.8%	3.9%
Mar	0.0%	3.3%	0.6%
Apr	0.0%	0.0%	0.0%
May	0.0%	0.0%	0.0%
Jun	0.0%	0.0%	0.0%
Jul	0.0%	0.0%	0.0%
Aug	0.0%	0.0%	0.0%
Sep	0.0%	0.0%	0.0%
Oct	2.2%	1.6%	1.1%
Nov	3.3%	4.4%	1.1%
Dec	3.3%	4.5%	1.1%

Table 1: Percent of Samples in Six Continual Months with *E. coli*/100 mL Exceeding 20

Figure 1 shows the results of the analysis of the source water from 2019 to 2022 at all three intakes compared to the limits for source water bacterial levels in the DWTO. As in previous years, all three sources met the limit of not more than 10% exceeding 20 *E. coli*/100 mL. Also, as is typical, samples collected at the intakes in the Fall and Winter had the highest *E. coli* levels. Typically, *E. coli* can be traced back to high flow levels at the main tributaries of the supply lakes and a first flush phenomenon after a period of dry weather.

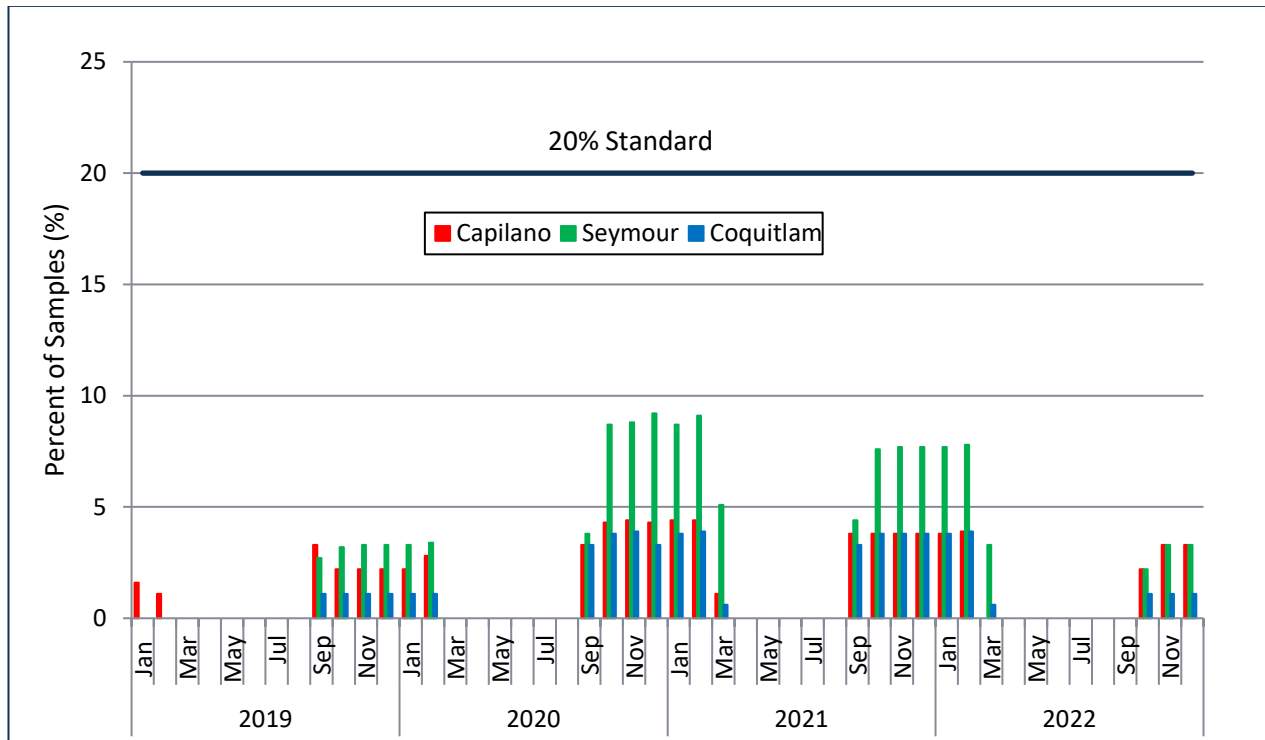


Figure 1: Percent of Samples Exceeding 20 E. coli/100 mL at all Three Sources (2019 to 2022)

Note: Metro Vancouver has protected Water Supply Areas and therefore the source of *E. coli* is most likely originating from endemic animals in the Water Supply Areas. Samples in summer have minimal *E. coli* and no detectable amounts for some sources.

1.2. Source Water Monitoring for *Giardia* and *Cryptosporidium*

Unfiltered surface water supplies have the potential of containing the protozoan pathogens *Giardia* and *Cryptosporidium*. Outbreaks of *Giardiasis* occurred in a number of locations in BC and Washington State in the late 1980s, and Metro Vancouver has been monitoring raw water for *Giardia* since 1987. Since 1992, Metro Vancouver has participated in a program with the Environmental Microbiology Laboratory of the BC Centre of Disease Control Public Health Laboratory, to gather more information about the number and nature of cysts found in the GVWD water supplies. The program has involved collecting samples from the Capilano and Coquitlam supplies upstream of disinfection; beginning in July 2022 Metro Vancouver increased monitoring to include Seymour source prior to treatment. This is in addition to the existing monitoring of recycled water at the SCFP.

At the SCFP, monitoring for *Giardia* and *Cryptosporidium* has focused on the recycled water returning to the head of the plant and this monitoring has confirmed that the procedures in place effectively control the levels of *Giardia* and *Cryptosporidium* in the recycled wash water from the filters.

Complete results of the 2022 testing program are contained in the “Metro Vancouver Detection of Waterborne *Cryptosporidium* and *Giardia* January - December, 2022 Annual Report”, which was prepared by the BCCDC PHL Environmental Microbiology Laboratory, and can be found in Appendix D. Two of twelve (17%) samples collected at Capilano and one of the twelve (8%) collected at Coquitlam were positive for *Giardia* (Table 2).

	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022
Capilano	50	18	18	50	58	33	33	33	25	17
Seymour	-	-	-	-	-	-	-	-	-	0
Coquitlam	23	8	0	17	67	8	25	25	25	8

Table 2: Percent of Samples Positive for *Giardia*

Zero of twelve (0%) samples collected at Capilano were positive for *Cryptosporidium*, and zero of twelve (0%) were positive at Coquitlam (Table 3). Collection of *Giardia* and *Cryptosporidium* samples from the Seymour source as initiated in August 2022. The percentages for Seymour shown on Tables 2 and 3 are for only 5 months compared to the Capilano and Coquitlam sources, which are based on 12 months.

	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022
Capilano	9	9	9	25	17	8	0	0	0	0
Seymour	-	-	-	-	-	-	-	-	-	0
Coquitlam	9	0	0	0	0	0	0	0	0	0

Table 3: Percent of Samples Positive of *Cryptosporidium*

Year to year fluctuations are demonstrated for *Giardia* and *Cryptosporidium* and there has always been considerable variation in the results.

1.3. Turbidity

As shown in Figure 2, GVWD water sources have been susceptible to turbidity events due to high runoff from storms, which can cause slides and stream scouring in the Water Supply Areas, or from re-suspension of sediment from the edges of the lakes during periods of low water levels. The DWTO allows a utility to be exempt from filtration if the turbidity does not exceed specific water quality parameters requirements and provided that a number of other provisions, including source water protection, and two forms of water treatment requirements are in place. Historically the turbidity levels on both the Capilano and Seymour sources would not meet these criteria, and filtration was implemented for both supplies.

Section 4.4 of the DWTO (Version 1.2, November 2012) contains the following provision for filtration exemption:

“For nonfiltered surface water to be acceptable as a drinking water source supply, average daily turbidity levels should be established through sampling at equal intervals (at least every four hours) immediately before the disinfectant is applied. Turbidity levels of around 1.0 NTU but not exceeding 5.0 NTU for more than two days in a 12-month period should be demonstrated in the absence of filtration. In addition, source water turbidity also should not show evidence of harbouring microbiological contaminants in excess of the exemption criteria.”

Capilano and Seymour water is filtered so these source water criteria do not apply to the delivered water. Coquitlam, which is unfiltered, was in service for all of 2022 in accordance with the DWTO.

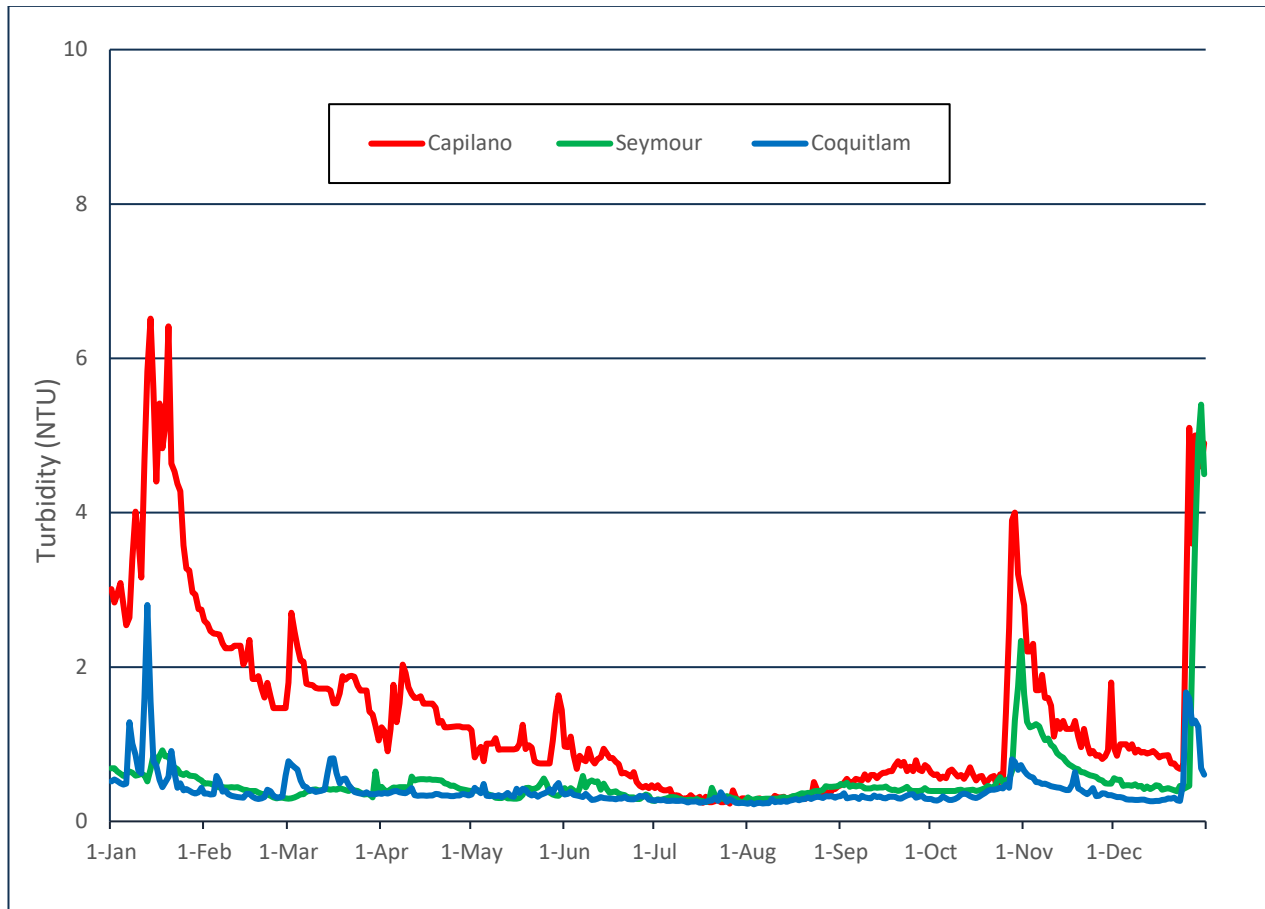


Figure 2: Average Daily Turbidity of Source Water (From In-line Readings)

1.4. Chemistry

1.4.1. Chemical and Physical Characteristics of the Source Water

The chemical and physical characteristics of the GVWD source water are summarized in Appendix B of this report; detailed analytical results are provided in Volume 2. The results from the chemical and physical analyses of the source water in 2022 were similar to those for previous years. The analysis was carried out by accredited laboratories using methods based on the current version of *Standard Methods For the Examination of Water and Wastewater*.

1.4.2. Analysis of Water for Organic Components and Radionuclides

Analyses of the source water for a variety of organic and other compounds, including all of the compounds with a specified MAC in the *Guidelines for Canadian Drinking Water Quality* (GCDWQ), is carried out on an annual basis in accordance with the WQMRP. The results are contained in Appendix C of this report and in Volume 2. No parameters were detected above the applicable GCDWQ health based limits.

1.4.3. PFOS and PFOA

Perfluorooctane Sulfonate (PFOS) and Perfluorooctanoic Acid (PFOA) testing is conducted on source waters and the results are detailed in Table 4. Common sources of these synthetic chemicals are from consumer products and fire-fighting foam, for their water and oil repellent properties. Neither parameter was detected above the applicable health based limits at the time of the publication of this report.

Parameter	Capilano (ng/L)	Seymour (ng/L)	Coquitlam (ng/L)	MAC (ng/L)
	Jul 26	Jul 26	Jul 26	
PFOS	<0.2	<0.2	<0.2	600
PFOA	<0.2	<0.2	<0.2	200

Table 4: Monitoring of Source Waters for PFOS and PFOA

1.4.4. Limnology

The Reservoir Water Quality Monitoring Program, started in 2014, collects limnology data (physical, chemical and biological parameters) for the Capilano, Seymour and Coquitlam supply reservoirs. Reservoir monitoring information is important in proactively managing the supply reservoirs as water quality could be impacted by environmental variability and climate change. This program assists in ensuring that variation and trends in reservoir quality are scientifically tracked over time.

Water sampling of the source reservoirs and inflow rivers is conducted between April and November. Biological productivity that can influence water quality is the highest during this time of year, making it an important time for sampling and measurements. Monthly sampling of the source water is conducted and sample analysis undertaken by accredited labs. More frequent water quality measurements are compiled by arrays of scientific instruments in each reservoir.

Metro Vancouver analysis of 2022 data resulted, as in previous years, in confirmation that the three reservoirs are ultra-oligotrophic (see Table 5), which means they have low levels of available nutrients and low levels of biological production. A single value called the Trophic State Index (TSI) is used to infer time course change in water quality based on the amount of algal biomass in the water column of each reservoir. TSI values have remained consistently low since measurements began (see Figure 3), which shows low biological production. The ultra-oligotrophic classification and low TSI values are highly desirable for source drinking water supply and shows that the GVWD Water Supply Areas and reservoirs continue to supply high quality source water.

There is worldwide interest in bluegreen algae (also known as cyanobacteria) in drinking water reservoirs. These algae can produce toxins that are collectively known as microcystins. A common cyanobacterium in GVWD reservoirs is called *Merismopedia* spp., which is thought to produce these microcystins. Despite the presence of cyanobacteria, the concentration of microcystins in GVWD reservoirs remains below the level stipulated in the GCDWQ, 1.5 µg/L. This desirable condition is due to the ultra-oligotrophic status of the reservoirs. Metro Vancouver continues to monitor cyanobacteria, including *Merismopedia* spp. as well as processes in the reservoirs that control the growth of cyanobacteria and other algae. These data are routinely used to help predict changes to water quality over time related to climatic and environmental change and aid in making proactive decisions about ongoing reservoir management strategies.

Chemical Measurement	Average Value					Status of Reservoirs
	Ultra-oligotrophic status ¹	Ultra-oligotrophic status	Capilano Reservoir 2014-2022 (2022 only)	Seymour Reservoir 2014-2022 (2022 only)	Coquitlam Reservoir 2014-2022 (2022 only)	
Total Phosphorus (µg/L)	5.0	8.0	3.1 (3.1)	3.2 (3.5)	3.2 (4.0)	Ultra-oligotrophic (very high water quality)
Total Nitrogen (µg/L)	250	661	122 (105)	120 (109)	128 (121)	Ultra-oligotrophic (very high water quality)
Phytoplankton Biomass (µg/L of chlorophyll-a)	0.5	1.7	0.43 (0.68)	0.55 (0.68)	0.59 (0.85)	Ultra-oligotrophic (very high water quality)

Table 5: Comparison of Water Quality in GVWD Water Supply Sources to Standard Water Quality Classifications

¹Wetzel, R.G. 2001 River Ecosystems. 3rd edition. Academic Press. New York.

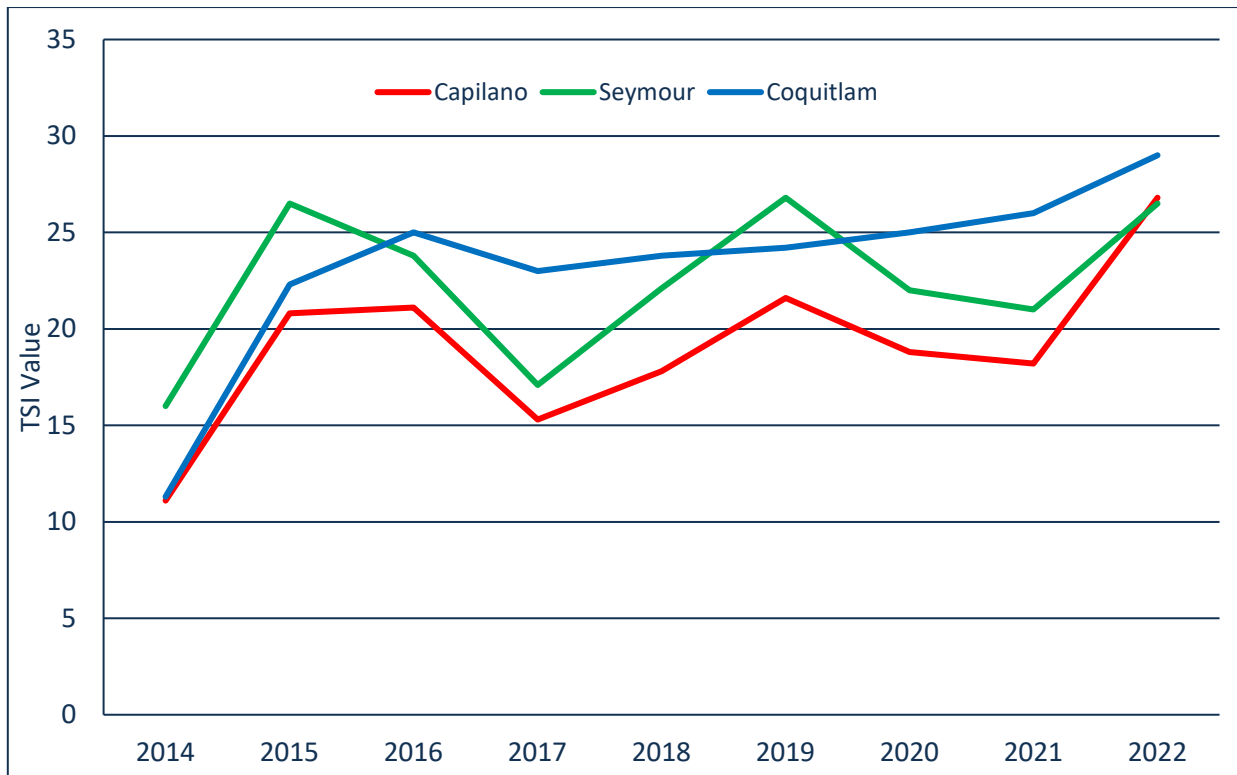


Figure 3: Trophic State Index of Source Waters

2.0 QUALITY CONTROL ASSESSMENT OF WATER TREATMENT

Primary treatment of the source water is the second barrier, following source water protection, used to assure the quality of the water supply.

Metro Vancouver filters water from the Capilano and Seymour source reservoirs at the Seymour Capilano Filtration Plant (SCFP), which is located in GVWD's Lower Seymour Conservation Reserve. Twin tunnels connect the two supply sources. Each tunnel is 3.8 metres in diameter, 7.1 kilometres long, and 160 to 640 meters below ground level, running beneath Grouse Mountain and Mount Fromme. The water from the Raw Water Tunnel is filtered and treated alongside the Seymour source water at the Seymour Capilano Filtration Plant (SCFP). Both treated sources enter the Clearwell at the SCFP for further treatment before the blended water is distributed to the region. Blended treated water returns to Capilano service area through the Treated Water Tunnel and provides high quality drinking water to the Capilano area, while the remainder is distributed through the Seymour system. This system typically supplies about two thirds of the region's drinking water.

The Coquitlam Water Treatment Plant is located north of the City of Coquitlam, and typically supplies about one third of the region's drinking water. Due to the historically low turbidity levels, the Coquitlam source water is not filtered.

Metro Vancouver operates the water supply system under the *GVWD Permit to Operate* issued jointly by Vancouver Coastal Health and Fraser Health. The permit stipulates that Metro Vancouver must meet the requirements to achieve at least a 4-log (99.99%) reduction and/or inactivation of Viruses, and at least a 3-log (99.9%) reduction and/or inactivation of *Giardia* cysts and *Cryptosporidium* oocysts. Operationally, Metro Vancouver meets the permit requirements managing the microbial risks using a combination of direct filtration, Ultraviolet (UV) light and chlorine at SCFP, and using ozone, UV light and chlorine at CWTP.

2.1. Seymour Capilano Filtration Plant

The SCFP is a chemically assisted direct filtration plant which uses polyaluminum chloride as a coagulant with polymers to improve particle removal. These substances help aggregate particles to form visible floc. The flocculated particles are removed by passing this water through a filter medium of anthracite and sand. The result is the production of filtered water, which is then exposed to UV light as the water exits each filter. The final processes are the addition of sodium hypochlorite (chlorine) and hydrated lime before the water enters the Clearwells. The West and East Clearwells are large water storage reservoirs that store and allow controlled passage of water with mixing (or blending) of the injected chlorine and hydrated lime. The Clearwells provide sufficient retention (or contact time) with chlorine to provide any further disinfection required after filtration and ultraviolet light treatment. Carbon dioxide (CO₂) in solution is added to trim pH once the desired alkalinity is reached using hydrated lime. After the Clearwells, the finished water enters the transmission system at the Seymour Treated Water Valve Chamber. The quality of the water produced has been excellent leaving the SCFP.

2.1.1. Filtration

Filtration treatment of the Capilano and Seymour water sources help improve the characteristics of the delivered water. This includes a visible decrease in colour and increase in clarity. There is a total loss of brown hue that can sometimes characterize Capilano and Seymour source waters. This improvement in colour is a result of removal of the naturally occurring parameters that cause the brown hue by the filtration process.

Suspended particles in water that cause light to scatter (turbidity) are also removed. The end product is water that is very clear. Due to the purity of the water, it may have a slight bluish tinge.

Figure 4 compares the apparent colour of SCFP filtered water and Capilano and Seymour source waters for 2022. During the fall rainfall events, the apparent colour of the Seymour source water feeding the SCFP had a reading of 44 Apparent Colour Unit (ACU). After the removal of the organic material through filtration, the colour of the filtered water delivered to the public was never greater than 6 ACU.

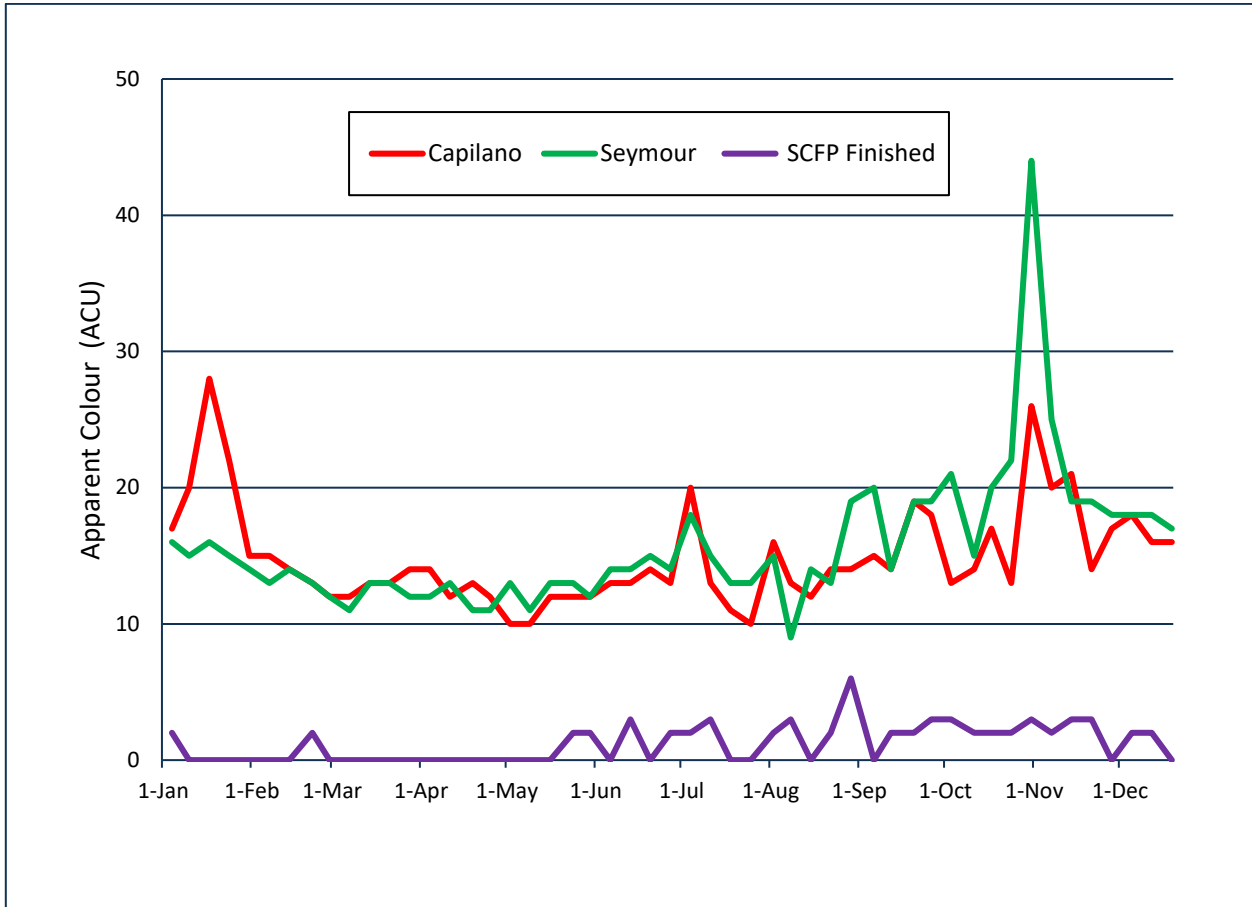


Figure 4: Apparent Colour Levels Before and After Filtration

Figure 5 compares turbidity of the two source waters that feed the SCFP to the turbidity level of the finished water. The Seymour source experienced an average daily turbidity greater than 1.0 NTU for 23 days. The Capilano source exceeded 1.0 NTU on 159 days. Since both sources are filtered at the SCFP, the maximum average daily turbidity of the delivered water was 0.28 NTU, and the average was 0.15 NTU.

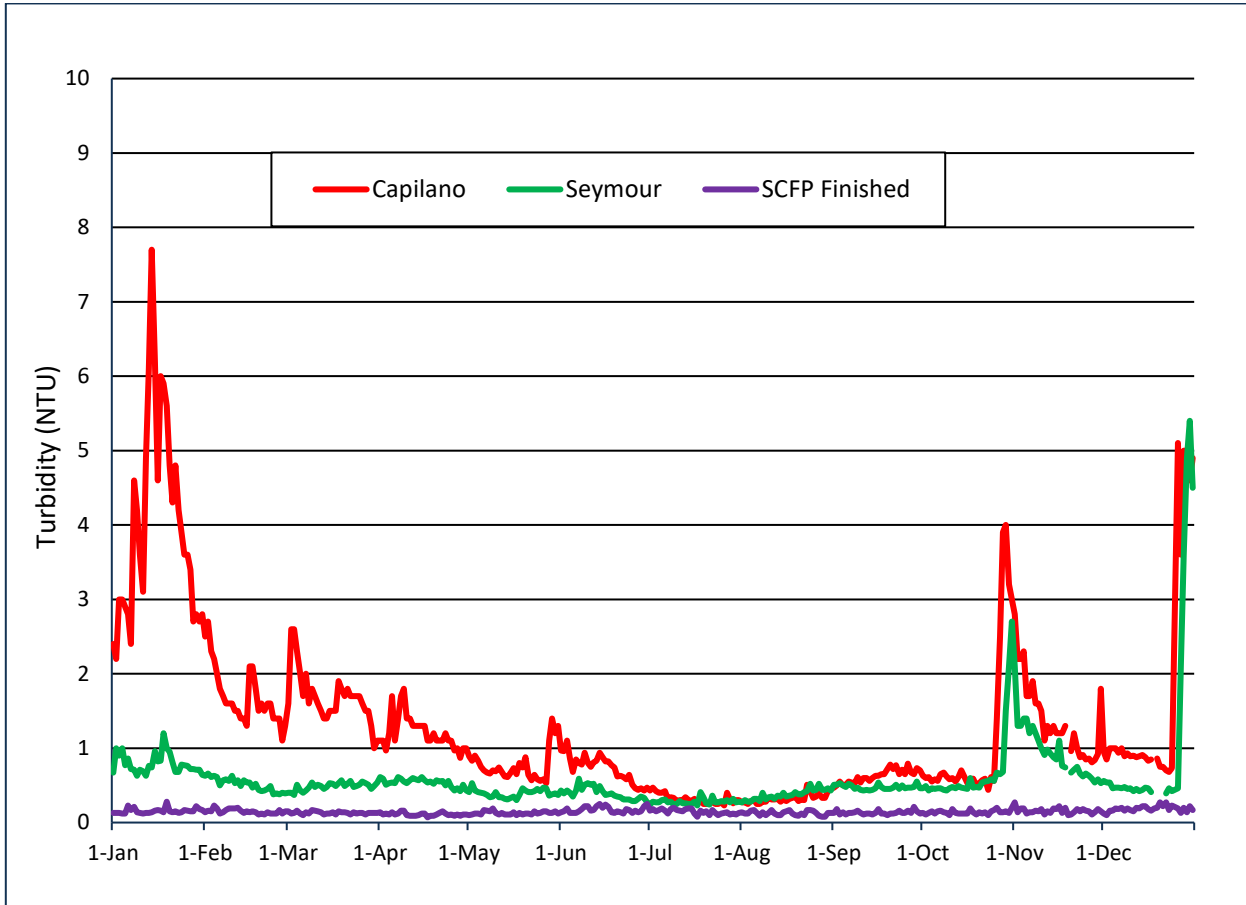


Figure 5: Average Daily Turbidity Levels Before and After Filtration

Removal of turbidity in the source water improves the aesthetic qualities of the water, but it also has the benefit of removing certain types of pathogenic microorganisms that may be present. At a minimum, properly run direct filtration plants such as the SCFP will remove up to 2.5 log (two log is a 99% reduction) of *Giardia* and *Cryptosporidium* plus 1 log of viruses. To ensure this removal, it is critical that the performance of each filter determined by the turbidity of its effluent is monitored on a continuous basis.

The GCDWQ (2020) states: “For conventional and direct filtration, less than or equal to 0.3 nephelometric turbidity units (NTU) in at least 95% of measurements either per filter cycle or per month and never to exceed 1.0 NTU.”

Ideally the turbidity from each filter would never exceed 0.1 NTU; however, there are rare occurrences of turbidity readings that exceed this ideal level. The turbidity performance of all 24 filters is measured by examining the percent of time that the turbidity of each Individual Filter Effluent (IFE) met the turbidity guidelines of not greater than 1.0 NTU, and at least 95% of the time less than 0.3 NTU. This is summarized in Table 6. In 2022, there were no incidents where the IFE was greater than 1.0 NTU, and the few incidences of filter turbidity readings that were greater than 0.3 NTU were well within the 95% limit.

Month	Occurrence of IFE Turbidity greater than 1.0 NTU (None Allowed)	Percent of Time IFE Turbidity was less than 0.3 NTU (Minimum 95% Required)
January	0	99.999%
February	0	100%
March	0	100%
April	0	99.999%
May	0	100%
June	0	100%
July	0	100%
August	0	100%
September	0	100%
October	0	100%
November	0	100%
December	0	99.999%

Table 6: Monthly Filter Effluent Turbidity Summary

Under normal operating conditions the average turbidity of the filtered water at SCFP was 0.15 NTU.

All water that flows through the filters immediately passes through the UV units. The intensity of the UV lamps automatically increases when there is an increase in turbidity or colour of the water exiting each filter. After UV treatment, the water is chlorinated as it enters the Clearwells, where more than one hour of contact time is provided.

2.1.2. Ultraviolet Treatment

The effluent from each filter is treated with UV light as the water exits the filter. UV treatment is effective in altering the DNA structure of *Giardia* and *Cryptosporidium* thus rendering cysts and oocysts, respectively, of these parasites, non-infectious. Other disinfectants, especially chlorine, are ineffective against *Cryptosporidium* oocysts at reasonable dosages. In the unlikely event of a breakthrough of *Cryptosporidium* oocysts, especially at the end of a filter run, UV light is present to render any parasites that may be present as non-infectious. Cysts and oocysts are not able to proliferate inside the intestines of human hosts to cause illness after a sufficient dose of ultraviolet light. The target dosage for UV light is to achieve 2-Log (99%) *Giardia* and *Cryptosporidium* inactivation.

Under normal operating conditions, two rows of lamps operating at 75% power provide sufficient UV light to meet the dosage requirement for 2-log reduction of *Giardia* and *Cryptosporidium*.

Table 7 summarizes the performance of the SCFP UV system in 2022.

Month	Percent of Monthly Volume \geq 2-log of <i>Giardia</i> and <i>Cryptosporidium</i> Inactivation (95% of monthly volume required)
January	99.95%
February	99.97%
March	99.91%
April	99.83%
May	99.96%
June	99.94%
July	99.95%
August	99.94%
September	99.95%
October	99.97%
November	99.88%
December	99.96%

Table 7: Percent of Volume Meeting Ultraviolet Dosage Requirements at SCFP

2.1.3. Chlorination

Chlorination is used for disinfection at the source as well as at secondary disinfection stations to minimize bacterial regrowth in the GVWD transmission and member jurisdiction distribution systems. Chlorination provides 4-log virus inactivation with liquid sodium hypochlorite.

2.2. Coquitlam Water Treatment Plant

The Coquitlam Water Treatment Plant (CWTP) treats the Coquitlam source water using multiple disinfection barriers, specifically, ozone, UV and chlorine, and provides corrosion control. The Coquitlam source water is not filtered. Ozone contact is achieved in a stainless steel contactor pipeline that connects the Ozonation facility with the Corrosion Control and Chlorination facility. The primary function of ozonation is to improve the transmissivity of the water for subsequent UV light treatment and oxidize organic precursors responsible for the formation of disinfection by-products (DBPs) following chlorination.

Ozone also provides disinfection capacity for *Giardia* and viruses. UV light is the primary process for inactivation of *Giardia* and *Cryptosporidium* and chlorine for viruses. Corrosion control is achieved using sodium carbonate and carbon dioxide which is added to trim the pH once the desired alkalinity is reached. After chlorination, the finished water enters the transmission system. The quality of the water produced has been excellent leaving the CWTP.

2.2.1. Ozonation

Ozone is intended as a pre-treatment, however, also provides backup for inactivation of *Giardia* when the UV treatment system is offline. Ozonation also provides additional virus inactivation to chlorination. The ozonation system was fully operational for 99.3% of the time in 2022. The ozone outages in 2022 were due to a combination of electrical/instrument maintenance, ozone dosing test, and ozone generator faults or power loss.

2.2.2. Ultraviolet Treatment

UV light treatment provides for primary disinfection, and achieves 3-log inactivation of chlorine-resistant micro-organisms for *Giardia* and *Cryptosporidium*. The water is directed into 8 ultraviolet units, each containing 40 ultraviolet lamps encased in protective sleeves. Ultraviolet light emitted from the lamps passes through the water. The US Environmental Protection Agency (EPA)¹ requires that the ultraviolet disinfection process results in target *Giardia* and *Cryptosporidium* inactivation in at least 95% of the treated water volume on a monthly basis, which is summarized in Table 8. The EPA performance reference is used in the absence of a Canadian standard. There was no loss of UV in 2022 and 99.88% of the water volume was treated to the above specifications.

Month	Percent of Monthly Volume \geq 3-log <i>Giardia</i> and <i>Cryptosporidium</i> Inactivation (Minimum 95% Required)
January	99.88%
February	99.91%
March	99.89%
April	99.89%
May	99.85%
June	99.86%
July	99.88%
August	99.87%
September	99.91%
October	99.87%
November	99.83%
December	99.90%

Table 8: Percent of Volume Meeting Ultraviolet Dosage Requirements at CWTP

¹ Ultraviolet Disinfection Guidance Manual for the Final Long Term2 Enhanced Surface Water Treatment Rule, November 2006, Sec. 1.4.4.

2.2.3. Chlorination

Chlorination is used for disinfection at the source as well as at secondary disinfection stations to minimize bacterial regrowth in the GVWD transmission and member jurisdiction distribution systems. Chlorination provides 4-log virus inactivation with liquid sodium hypochlorite solution. The chlorination system was fully operational 100% of the time in 2022.

2.3. Secondary Disinfection

There are 8 secondary disinfection stations operated by Metro Vancouver. The purpose of these stations is to increase the chlorine residual in the GVWD transmission and member jurisdiction distribution systems to meet a target residual based on a number of factors, including source water turbidity, the amount of bacterial regrowth detected in member jurisdiction distribution system samples and the chlorine demand in the water. The rate of chlorine decay is lower in the areas receiving filtered water from the SCFP and consequently, lower chlorine dosage levels are required to maintain desired chlorine residual levels. The target chlorine dose leaving the secondary facilities receiving SCFP water is 0.8 mg/L. These facilities frequently have an incoming chlorine residual high enough that boosting is not required. The target chlorine dose leaving the secondary facilities receiving CWTP water ranges from 1.20 to 1.50 mg/L.

Table 9 summarizes the performance of the secondary disinfection facilities in 2022.

Facility	Branch Main	Average Free Chlorine (mg/L)	Range of Free Chlorine (mg/L)	Source Water
Clayton	Whalley/Clayton	1.19	0.89-1.51	Supplied by CWTP water.
	Jericho/Clayton	1.20	0.98-1.50	
Chilco	Capilano No. 4 and No.5	0.74	0.56-0.83	Supplied by SCFP water.
Pitt River	Haney Main No.2	1.20	1.19-1.24	Supplied by CWTP water.
	Haney Main No.3	1.17	1.01-1.51	
Newton	Surrey Hickleton Main	1.08	0.51-1.39	Primarily supplied by SCFP water. Occasionally supplied by CWTP water, depending on flow demands.
Kersland	Capilano No. 4 and No.5	0.86	0.67-1.02	Supplied by SCFP water.
Central Park	South Burnaby Main No.1	0.77	0.53-0.98	Primarily supplied by SCFP water. Occasionally supplied by CWTP water, depending on flow demands.
	South Burnaby Main No.2	0.87	0.63-1.37	
Cape Horn	Coquitlam Main No.2	1.20	0.99-1.52	Supplied by CWTP water.
	Coquitlam Main No.3	1.21	0.97-1.53	
Vancouver Heights	Boundary Road Main No. 5	0.85	0.71-1.02	Supplied by SCFP water.

Table 9: Performance of Secondary Disinfection Facilities

2.4. Corrosion Control

Metro Vancouver’s corrosion control program began in the 1990s, and involves several steps to reduce pipe corrosion. As part of the current *Corrosion Control Program: Copper Pipes Protection* initiative, further changes in pH and alkalinity were made in June 2021 to help reduce pipe corrosion through the addition of natural minerals. The GCDWQ established.

The untreated water from all three sources had a pH lower than the limit of the GCDWQ of pH 7.0.

In the SCFP process, filtered water is dosed with hydrated lime (calcium hydroxide) to raise its pH and alkalinity before it enters the Clearwells. To achieve the desired alkalinity, the resultant pH is trimmed using CO₂ to bring it down to target levels.

At the Coquitlam source, the commissioning of the CO₂ system at the CWTP began in 2019, and was fully operational in 2021. The CO₂ system with the addition of soda ash (sodium carbonate) allows the GVWD to meet new target pH and alkalinity values across the entire system. Similar to the SCFP, the CO₂ system is used to trim the resultant pH to desired target levels.

The average pH of the treated water leaving SCFP and CWTP was 8.6 and 8.4, respectively, during 2022.

Performance of the corrosion control facilities is summarized in Table 10.

Facility	Performance	Discussion
SCFP Corrosion Control	pH ranged from 7.3 – 9.2	The annual average pH was 8.6 and was continually monitored with online instrumentation.
CWTP Corrosion Control	pH ranged from 6.7 – 10.1	<p>The annual average pH was 8.4.</p> <p>The pH was <7.0, the recommended lower limit of the GCDWQ, on January 1 for a total of 3 hours and August 2 for 2.5 hours, both times due to soda ash equipment fault.</p> <p>The pH never exceeded the recommended limit of 10.5 under the GCDWQ.</p>

Table 10: Performance of Corrosion Control Facilities

The chemical and physical characteristics of the GVWD treated water are summarized in Appendix B of this report and detailed analytical results are provided in Volume 2.

3.0 TRANSMISSION/DISTRIBUTION SYSTEM WATER QUALITY

Schedule A of the *BC Drinking Water Protection Regulation* (BCDWPR) contains standards for the bacteriological quality of potable water in the Province. There are three components of this standard that apply to large utilities such as GVWD and its member jurisdictions. These are:

Part 1: No sample should be positive for *E. coli*.

Part 2: Not more than 10% of the samples in a 30-day period should be positive for total coliform bacteria when more than 1 sample is collected.

Part 3: No sample should contain more than 10 total coliform bacteria per 100 mL.

The BCDWPR does not contain any water standards other than the three limits for *E. coli* and total coliform bacteria. Information on the significance of the detection of these organisms can be found in the GCDWQ – Supporting Documents, specifically:

“E. coli is a member of the total coliform group of bacteria and is the only member that is found exclusively in the faeces of humans and other animals. Its presence in water indicates not only recent faecal contamination of the water but also the possible presence of intestinal disease-causing bacteria, viruses and protozoa.”

“The presence of total coliform bacteria in water in the distribution system (but not in water leaving the treatment plant) indicates that the distribution system may be vulnerable to contamination or may simply be experiencing bacterial regrowth.”

To summarize, the detection of an *E. coli* bacteria in a sample of treated water is an indication of a potentially serious risk. The detection of total coliform bacteria may indicate intrusion into the system, or it may indicate that these bacteria are growing in the system itself (regrowth).

The number of *E. coli* detected in both GVWD and member jurisdiction drinking water samples is typically very low. Out of more than 28,700 samples collected from GVWD and member jurisdiction systems analyzed in 2022, one sample was positive for *E. coli*. The detection of a positive *E. coli* sample triggers a protocol which involves immediate notification to health and member jurisdiction officials, re-sampling, and a thorough investigation into the possible causes. Three repeat samples were taken and no additional *E. coli* were found.

In the GVWD transmission system, only 12 out of the approximately 7,400 samples collected, tested positive for total coliforms. Only 20 of the approximately 21,300 samples collected from the member jurisdiction distribution systems tested positive for total coliforms in 2022. The majority of the coliforms (70%) in the member jurisdiction (and 67% in GVWD) systems appeared in the warmer water months of June through October.

The most likely source of these organisms is attributed to bacterial regrowth. It should be emphasized that 99.9% of the samples in 2022 had no coliforms present, which is a good indicator of effective water treatment and good transmission and distribution system water quality.

3.1. Microbiological Water Quality in the GVWD System

3.1.1. GVWD Water Mains

Water quality in GVWD water mains is monitored from the point leaving the source and throughout the transmission system. In 2022, there were approximately 4,000 samples collected and tested for the presence of indicator bacteria. The percentage of samples from the GVWD water mains that were positive for total coliform bacteria was very low, well below the 10% standard. Of the approximately 4,000 samples processed, 10 samples tested positive for total coliforms and no samples were positive for *E. coli* bacteria. The compliance of monitoring results from GVWD water mains with BCDWPR criteria is shown in Figure 6.

There were another 436 samples collected from stations where only chlorine residuals are measured. In addition, there are inline stations collecting chlorine data every 10-minutes after chlorination at each source, but these samples are not included in the calculations for compliance monitoring.

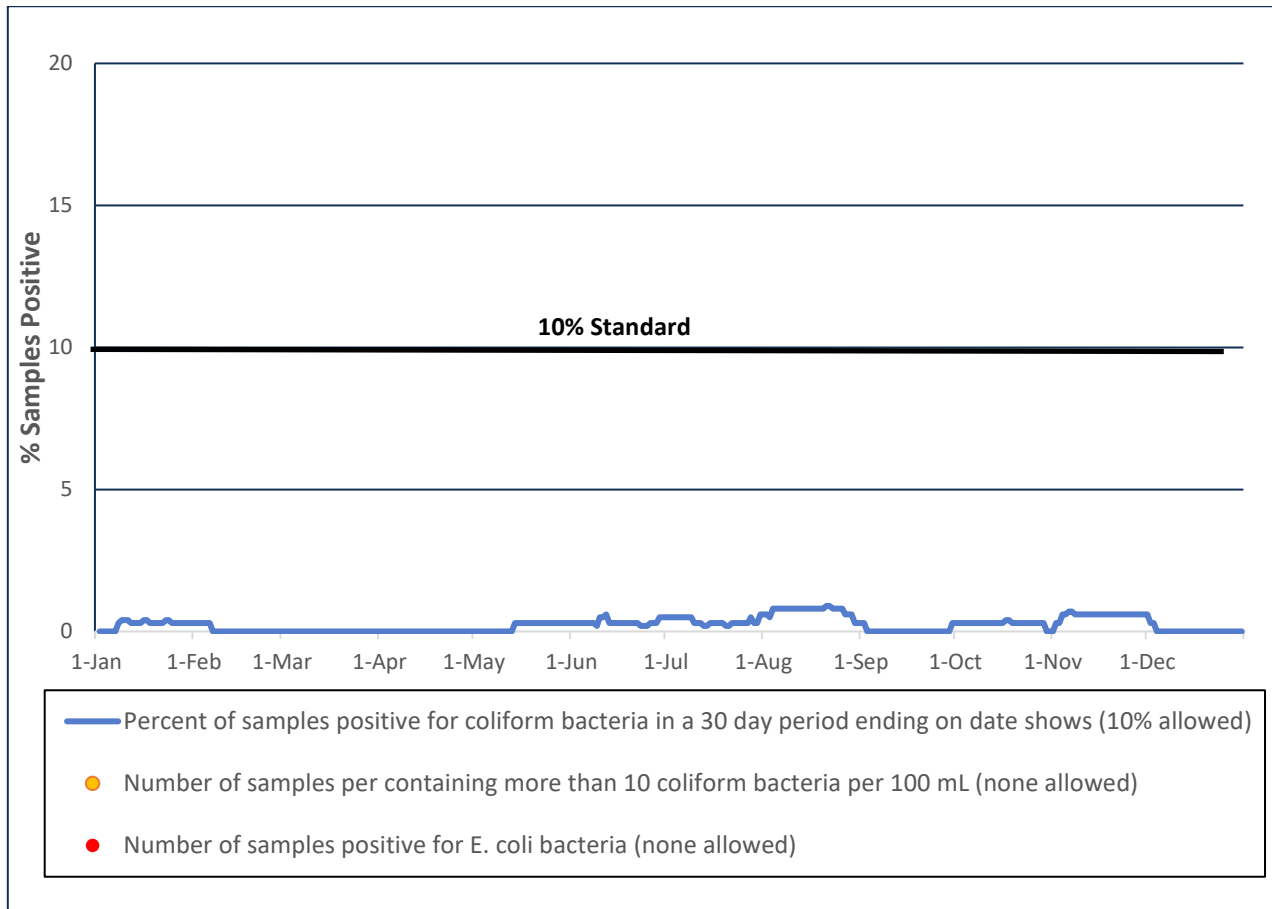


Figure 6: Bacteriological Quality of Water in GVWD Water Mains

3.1.2. GVWD In-System Reservoirs

In 2022, over 2,000 samples were collected from reservoirs that are located throughout the GVWD water system. Only 1 sample was positive for total coliforms. No sample from a reservoir was positive for *E. coli*.

The compliance of 2022 monitoring results from GVWD reservoirs with the criteria in the BCDWPR is shown in Figure 7.

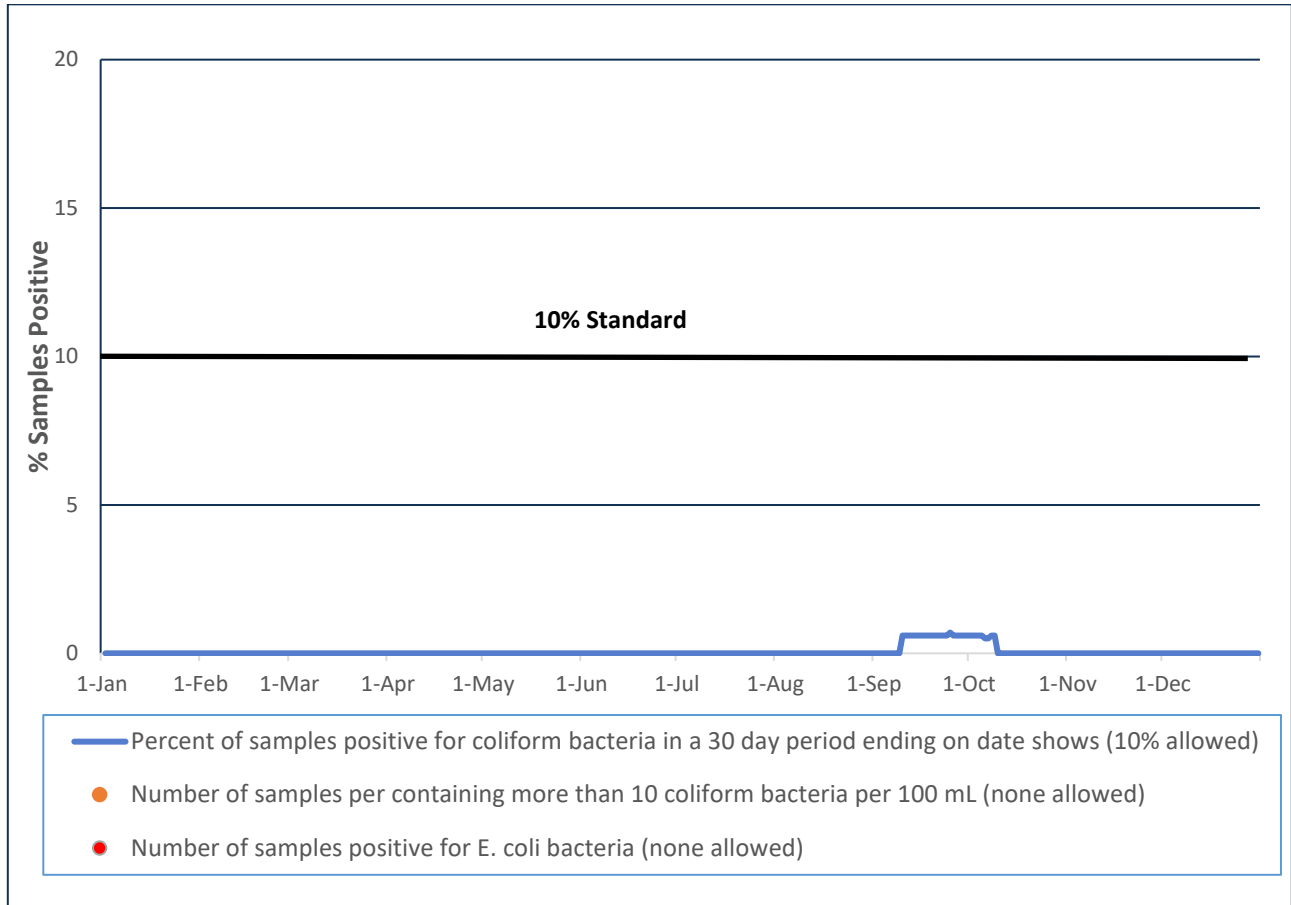


Figure 7: Bacteriological Quality of Water in GVWD In-System Reservoirs

Reservoir water quality is optimized by the use of secondary disinfection coupled with an active reservoir exercising program that includes a minimum of weekly monitoring of chlorine residuals and bacteriology results, which can result in changes to filling levels, if necessary.

Table 11 provides an overview of the status of the GVWD reservoirs from 2019 to 2022. During certain times of the year, it is not possible to cycle reservoirs as often as desired due to operational constraints. Despite these constraints, water quality as determined by coliform bacteria was satisfactory in all reservoirs.

Reservoir (Capacity in Million Litres)					Discussion
	2019	2020	2021	2022	
Burnaby Mountain Reservoir (13.2)	0.53	0.57	0.53	0.49	No operational issues
Burnaby Tank (2.3)	0.58	0.60	0.57	0.56	No operational issues
Cape Horn Reservoir (40.0)	0.61	0.78	0.71	0.78	No operational issues
Central Park Reservoir (35.0)	0.51	0.66	0.54	0.56	No operational issues
Clayton Reservoir (21.6)	1.02	1.08	1.1	1.05	To maintain water quality due to seasonal low demand, the cells of this reservoir are periodically removed from service. Cell 1 was in service Jan 1 - Nov 15 Cell 2 was in service March 16 - Dec 31
Glenmore Tanks (1.0)	0.68	0.77	0.73	0.67	No operational issues
Grandview Reservoir (13.5)	0.73	0.80	0.85	0.84	No operational issues
Greenwood Reservoir (8.8)	0.68	0.75	0.70	0.68	No operational issues
Hellings Tank (4.3)	0.48	0.54	0.56	0.52	No operational issues
Jericho Reservoir (20.0)	-	-	1.10	0.92	Cell 1 in service for entire year . Cell 2 not yet commissioned. Construction delays in 2022, anticipate completion in 2023.
Kennedy Reservoir (16.3)	0.52	0.58	0.65	0.60	No operational issues
Kersland Reservoir (73.7)	0.55	0.66	0.65	0.61	Following the completion of upgrades that were begun in Oct 2021, Cell No.1 was disinfected and returned to service in May. No operational issues with other cell.
Little Mountain Reservoir (171.0)	0.67	0.72	0.69	0.66	No operational issues
Maple Ridge Reservoir (20.0)	0.52	0.44	0.46	0.43	Reservoir was cleaned by divers in December.
Newton Reservoir (32.0)	0.46	0.55	0.44	0.64	Cell 2 was out of service beginning in March for inspection and preparatory work, it was then disinfected and returned to service on April 27. In October, the cell was once again removed from service for work on a new outlet structure. Work continued in 2023. During the fall outage, cell 1 operated at a lower level for worker safety in cell 2.
Pebble Hill Reservoir (42.2)	0.60	0.66	0.54	0.61	Cells 1 and 2 are being seismically upgraded. Work on Cell 1 that began in Fall 2021 continued in the spring until the cell was needed to meet the seasonal demands; after demand dropped, both Cells 1 & 2 were isolated and drained. Cell 1 was out of service Jan 1 - May 19. Oct 16 - Dec 31. Cell 2 was out of service Oct 16 - Dec 31.
Prospect Reservoir (4.4)	0.66	0.76	0.73	0.69	No operational issues
Sasamat Reservoir (26.0)	0.54	0.65	0.62	0.61	No operational issues

Reservoir (Capacity in Million Litres)					Discussion
	2019	2020	2021	2022	
Sunnyside Reservoir (22.7)	0.47	0.73	0.85	0.78	No operational issues
Vancouver Heights Reservoir (43.0)	0.75	0.82	0.78	0.71	No operational issues
Westburnco Reservoir (73.0)	0.58	0.64	0.60	0.65	No operational issues
Whalley Reservoir (33.4)	0.59	0.73	0.71	0.65	The reservoir was cleaned, disinfected and returned to service in April.

Table 11: Status of GVWD Reservoirs (2019-2022)

3.2. Microbiological Water Quality in Member Jurisdiction Systems

For samples collected from member jurisdiction systems, the percent positive per month for total coliform bacteria from 2019-2022 is shown in Figure 8.

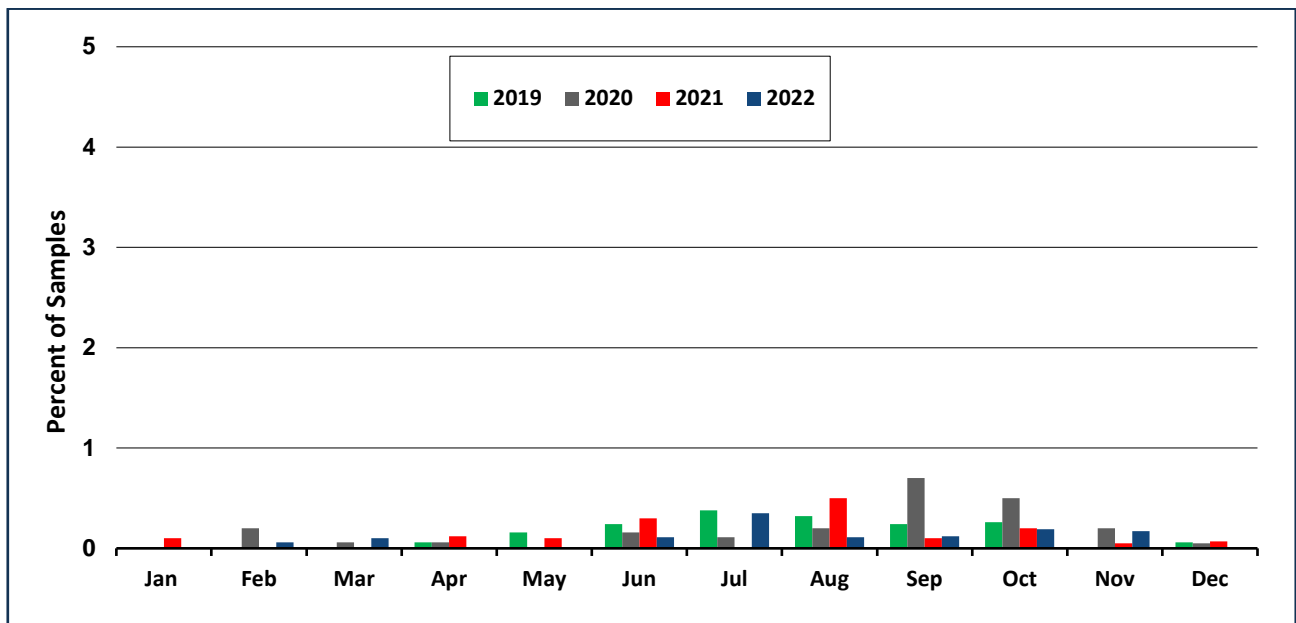


Figure 8: Percent of Samples per Month Positive for Total Coliform Bacteria (2019 to 2022)

The percentage of samples positive for total coliform bacteria in 2022 remained relatively similar as compared to 2021.

For Part 1 of the BCDWPR, no sample should be positive for *E. coli*. A single sample in July from member jurisdiction systems was positive *E. coli*. All subsequent samples taken over the following 3 days were negative.

For Part 3 no sample should contain more than 10 total coliform bacteria per 100 mL. For samples from member jurisdiction systems, this requirement was met in 2022 with the following exceptions:

- One sample in April contained more than 10 total coliform bacteria.
- One sample in July contained more than 10 total coliform bacteria.

Table 12 shows the compliance with the bacteriological standards (3 parts) in the BCDWPR for samples taken within the distribution systems of the 21 member jurisdictions that are supplied with GVWD water.

Month	Number that met Part 1	Number that met Part 2	Number that met Part 3	Number that met all requirements
January	21	21	21	21
February	21	21	21	21
March	21	21	21	21
April	21	21	20	20
May	21	21	21	21
June	21	21	21	21
July	20	21	20	20
August	21	21	21	21
September	21	21	21	21
October	21	21	21	21
November	21	21	21	21
December	21	21	21	21

Table 12: Member Jurisdiction Water Quality Compared to the Provincial Bacteriological Standards


3.3. Disinfection By-Products in the Transmission/Distribution Systems

As the treated water moves through the GVWD Transmission system and into the member jurisdiction distribution system’s infrastructure of water mains and reservoirs, changes in water quality occur. This is mainly due to the reaction between the chlorine in the water (added during primary and secondary disinfection) with naturally occurring organic matter in the water.

One of the most significant changes is the production of chlorinated DBPs. DBPs is a term used to describe a group of organic and inorganic compounds formed during water disinfection.

Reactions between dissolved natural organic matter and chlorine can lead to the formation of a variety of halogenated DBPs. There are two major groups of chlorinated DBPs: Total Trihalomethanes (TTHMs) and Total Haloacetic Acids (THAA). Factors that affect DBP formation include: amount of chlorine added to water, reaction time, concentration and characteristics of dissolved organic materials (precursors), water temperature, and water pH. In general, DBPs continue to form as long as chlorine and reactive DBP precursors are present in the water.

The Maximum Acceptable Concentration (MAC) in the GCDWQ for TTHMs is a locational yearly running average of 100 µg/L (0.1 mg/L) based on quarterly samples. A comparison of TTHM levels in the GVWD and member jurisdiction systems in 2022 is shown in Figure 9. All THM results from GVWD water mains and member jurisdiction systems were below the MAC of 100 µg/L.

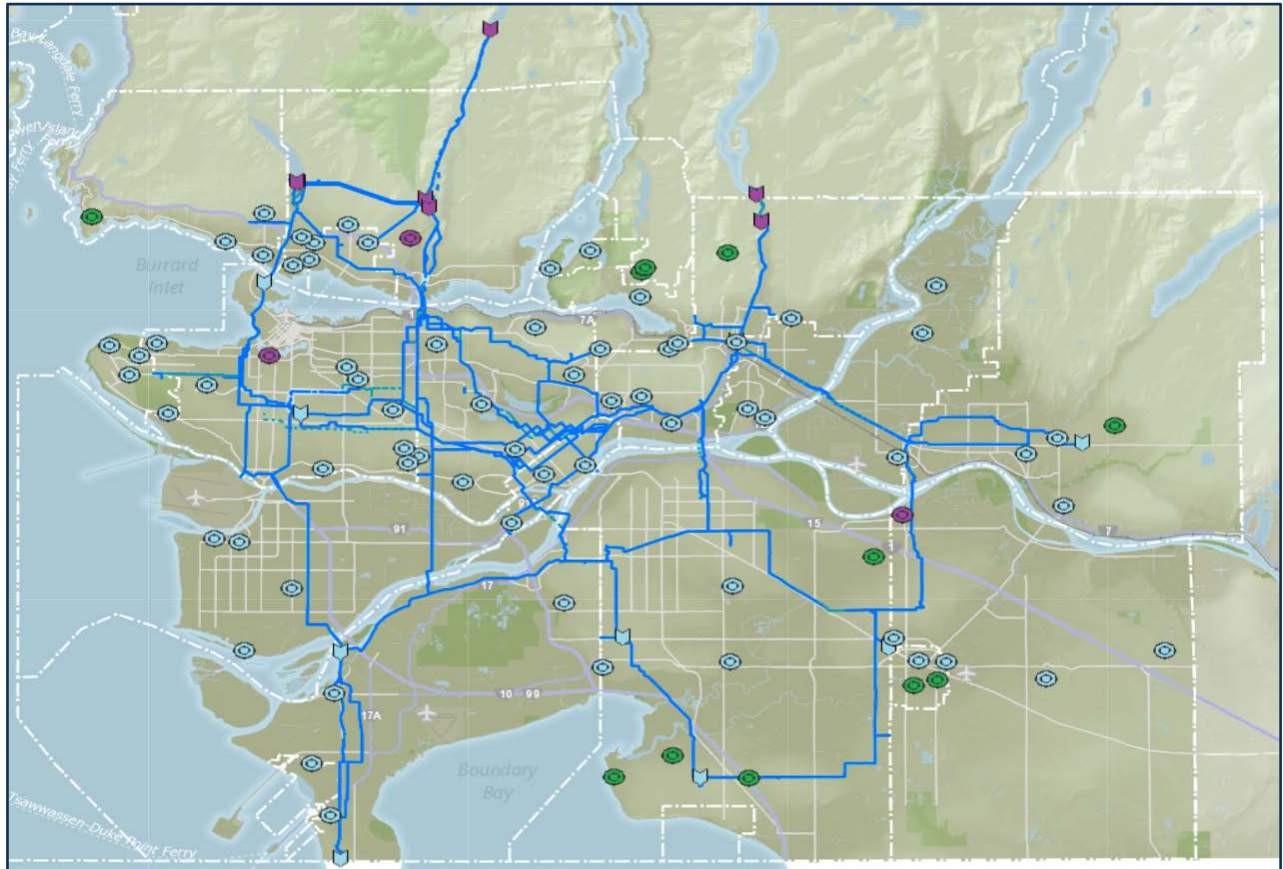

2022 Average GVWD TTHM = 23 µg/L
 2022 Average Member Jurisdictions TTHM = 30 µg/L

Total Trihalomethane Levels - GVWD




Total Trihalomethane Levels - Member Jurisdiction



MAC for Total Trihalomethane values is 100 µg/L

Figure 9: Average Total Trihalomethane Levels

The other group of disinfection by-products of interest is the Total Haloacetic Acid (THAA) group. Comparison of THAA in the GVWD and member jurisdiction systems in 2022 is shown in Figure 10. In 2022, all HAA results from GVWD water mains and member jurisdiction systems were below the MAC of 80 µg/L.

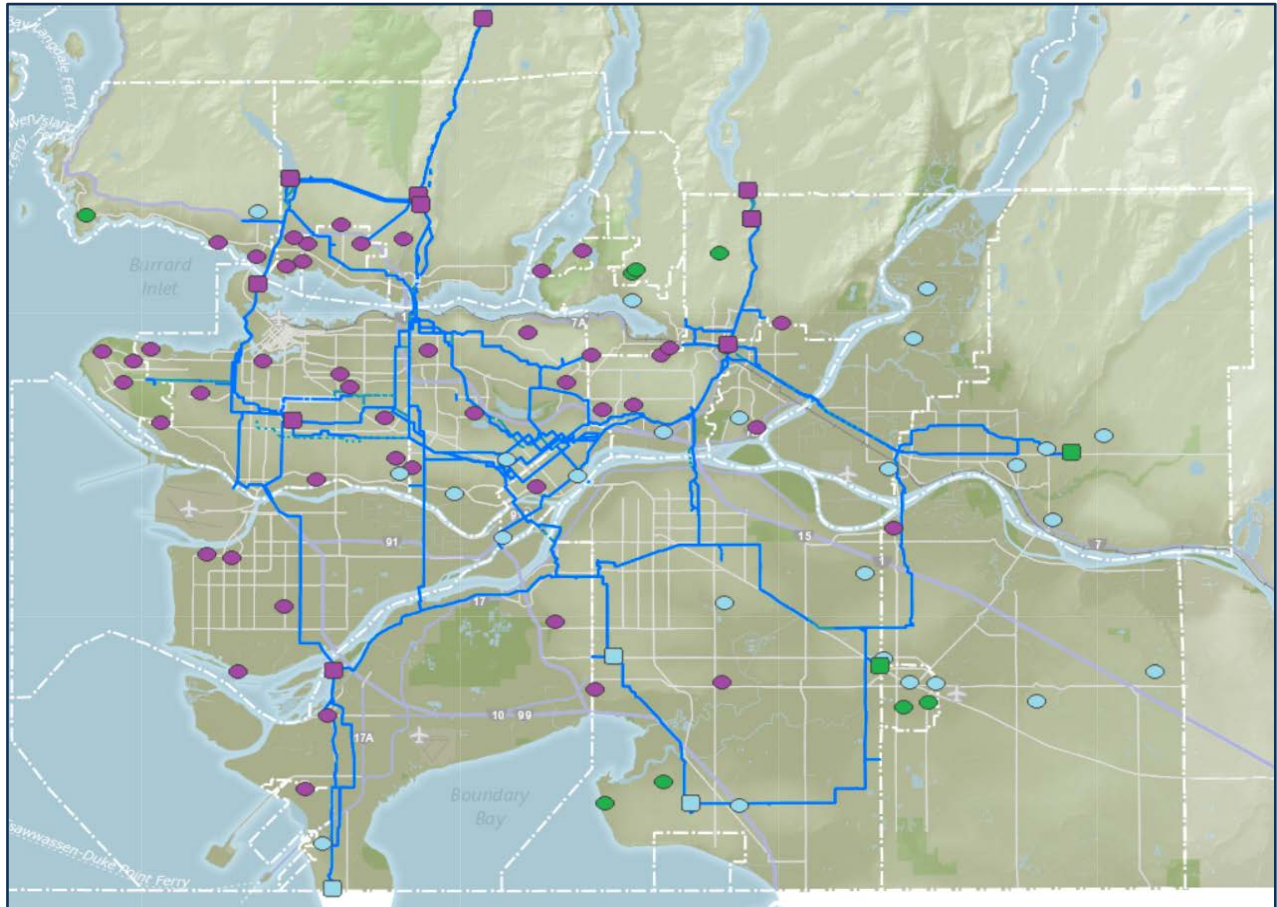

2022 Average GVWD THAA = 19 µg/L
 2022 Average Member Jurisdictions THAA = 23 µg/L

Total Haloacetic Acid Levels - GVWD	Total Haloacetic Acid Levels - Member Jurisdiction
<ul style="list-style-type: none"> ≤ 0 AND < 20 ≥ 20 AND < 40 ≥ 40 AND < 60 ≥ 60 AND < 80 ≥ 80 AND < 100 ≥ 100 	<ul style="list-style-type: none"> ≤ 0 AND < 20 ≥ 20 AND < 40 ≥ 40 AND < 60 ≥ 60 AND < 80 ≥ 80 AND < 100 ≥ 100

MAC for Total Haloacetic Acid values is 80 µg/L

Figure 10: Average Total Haloacetic Acid Levels

4.0 QUALITY CONTROL/QUALITY ASSURANCE

Since 1994, the Metro Vancouver Microbiology Laboratory has participated in the BC Centre for Disease Control Public Health Laboratory Enhanced Water Quality Assurance Program and has been approved by the Provincial Medical Health Officer to perform microbiological analysis of drinking water as required in the BCDWPR. An ongoing requirement of this approval is successful participation in the provincial Clinical Microbiology Proficiency Testing Program, or its equivalent. Representatives of the Approval Committee for Bacteriology Laboratories carried out an inspection of the Metro Vancouver Microbiology Laboratory at the Lake City Operations Centre in September 2022 as part of the process leading up to approval of the laboratory by the Provincial Health Officer. The next inspection is planned for 2025.

In addition to the approval process discussed above, the Metro Vancouver Laboratories are accredited by the Canadian Association for Laboratory Accreditation (CALA) for the analysis of specific parameters to the ISO/IEC 17025 *General requirements for the competence of testing and calibrations laboratories* international standard.

Representatives from CALA have assessed the Metro Vancouver Laboratories bi-annually since 1995. The most recent on-site audit took place in September 2021, and the Metro Vancouver Laboratories have been granted accreditation until 2024. The next CALA assessment will take place in the fall of 2023. The Scope of Accreditation is available on the CALA website – www.cala.ca.

APPENDIX A — WATER SAMPLING FREQUENCY

This page has been intentionally left blank.

Water Type	Parameter	Frequency
Untreated, Source Water	Total coliform and <i>E. coli</i>	Daily
	HPC	Daily
	Turbidity	Daily
	<i>Giardia</i> and <i>Cryptosporidium</i>	Monthly at Capilano, and Coquitlam. Seymour began in July 2022.
	Ammonia, colour, iron, organic carbon, pH	Weekly
	Alkalinity, chloride, calcium, hardness, magnesium, manganese, nitrate, potassium, phosphate, sulphate	Monthly
	Aluminum, copper, sodium, total and suspended solids	Bi-monthly
	THMs, HAAs	Quarterly
	Antimony, arsenic, barium, boron, cadmium, cyanide, chromium, lead, mercury, nickel, phenols, selenium, silver, zinc	Semi-annually
	Pesticides and herbicides	Annually
	PAHs, BTEX	Annually
	VOCs	Annually
	Radionuclides	Annually
	Treated water	Total coliform and <i>E. coli</i>
Turbidity		Daily
Temperature		Daily
pH		Daily
Ammonia, colour, iron, organic carbon, aluminum at SCFP only		Weekly
Aluminum, copper, sodium, total and suspended solids		Bi-Monthly
THMs, HAAs		Quarterly at selected sites
Antimony, arsenic, barium, boron, cadmium, cyanide, chromium, lead, mercury, nickel, phenols, selenium, silver, zinc		Semi-annually
GVWD Water Mains	Total coliform and <i>E. coli</i>	Weekly per site
	HPC	Weekly per site
	Free chlorine	Weekly per site
	THMs, HAAs, pH	Quarterly at selected sites
	PAHs, BTEX	Semi-annually at selected sites
GVWD Reservoirs	Total coliform and <i>E. coli</i>	Weekly per site
	HPC	Weekly per site
	Free chlorine	Weekly per site
	Turbidity	Weekly per site
Member Jurisdiction Distribution Systems	Total coliform and <i>E. coli</i>	Weekly per site
	HPC	Weekly per site
	Free chlorine	Weekly per site
	Turbidity	Weekly per site
	THMs, HAAs, pH	Quarterly at selected sites

APPENDIX B — CHEMICAL AND PHYSICAL ANALYSIS SUMMARIES

This page has been intentionally left blank.

Physical and Chemical Analysis of Water Supply

2022 – Capilano Water System

Parameter	Untreated ¹		Treated ¹		Canadian Guideline	
	Average	Average	Range	Days Exceeded	Limit ²	Reason Established
Alkalinity as CaCO ₃ (mg/L)	3.0	22	18-25	N/A	None	N/A
Aluminum Dissolved (µg/L)	59	26	20-35	N/A	None	N/A
Aluminum Total (µg/L)	126	29	18-51	0	2,900	Health
Antimony Total (µg/L)	<0.5	<0.5	<0.5	0	6	Health
Arsenic Total (µg/L)	<0.5	<0.5	<0.5	0	10 (ALARA)	Health
Barium Total (µg/L)	2.4	2.8	2.5-3.5	0	2,000	Health
Boron Total (µg/L)	<10	<10	<10	0	5,000	Health
Bromate (µg/L)	<10	<10	<10	0	10	Health
Bromide (µg/L)	<10	<10	<10	N/A	None	N/A
Cadmium Total (µg/L)	<0.2	<0.2	<0.2	0	7	Health
Calcium Total (µg/L)	1,200	8,430	7,560-9,280	N/A	None	N/A
Carbon Organic - Dissolved (mg/L)	1.5	0.6	0.4-0.9	N/A	None	N/A
Carbon Organic - Total (mg/L)	1.5	0.6	0.4-0.9	N/A	None	N/A
Chlorate (µg/L)	<10	25	16-41	0	1000	Health
Chloride (mg/L)	<0.5	2.3	2.1-2.9	0	≤ 250	Aesthetic
Chromium Total (µg/L)	<0.08	<0.05	<0.05	0	50	Health
Cobalt Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Colour - Apparent (ACU)	15	<3	<2-14	N/A	None	N/A
Colour - True (TCU)	10	<1	<1-1	0	≤ 15	Aesthetic
Conductivity (µmhos/cm)	10	49	43-54	N/A	None	N/A
Copper Total (µg/L)	1.4	<0.5	<0.5	0/0	2,000/1,000	Health/Aesthetic
Cyanide Total (mg/L)	<0.02	<0.02	<0.02	0	0.2	Health
Cyanobacterial Toxins - Microcystin - LR (µg/L)	<0.20	N/A	N/A	0	1.5	Health
Fluoride (mg/L)	<0.05	<0.05	<0.05	0	1.5	Health
Haloacetic Acids Total (µg/L)	<1.1	10.4	9.5-12	0	80 (ALARA)	Health
Hardness as CaCO ₃ (mg/L)	3.7	22.0	20.3-24.0	N/A	None	N/A
Iron Dissolved (µg/L)	51	<5	<5-9	N/A	None	N/A
Iron Total (µg/L)	154	<9	<5-64	0	≤ 300	Aesthetic
Lead Total (µg/L)	<0.5	<0.5	<0.5	0	5 (ALARA)	Health
Magnesium Total (µg/L)	176	208	181-256	N/A	None	N/A
Manganese Dissolved (µg/L)	7.4	2.8	0.9-5.0	N/A	None	N/A
Manganese Total (µg/L)	8.9	6.0	2.4-10.6	0/0	120/20	Health/Aesthetic
Mercury Total (µg/L)	<0.05	<0.05	<0.05	0	1	Health
Molybdenum Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Nickel Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Nitrogen - Ammonia as N (mg/L)	<0.02	<0.02	<0.02	N/A	None	N/A
Nitrogen - Nitrate as N (mg/L)	0.08	0.07	0.02-0.17	0	10	Health
Nitrogen - Nitrite as N (mg/L)	<0.01	<0.01	<0.01	0	1	Health
pH (pH units)	6.5	8.0	7.8-8.4	0	7.0-10.5	None
Phenol (mg/L)	<0.005	<0.005	<0.005	N/A	None	N/A
Potassium Total (µg/L)	148	172	135-228	N/A	None	N/A
Residue Total (mg/L)	15	34	31-36	N/A	None	N/A
Residue Total Dissolved (TDS) (mg/L)	10	30	30-40	0	≤ 500	Aesthetic
Residue Total Fixed (mg/L)	9	27	25-30	N/A	None	N/A
Residue Total Volatile (mg/L)	6	7	5-9	N/A	None	N/A
Selenium Total (µg/L)	<0.5	<0.5	<0.5	0	50	Health
Silica as SiO ₂ (mg/L)	3.2	3.3	2.8-3.6	N/A	None	N/A
Silver Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Sodium Total (µg/L)	591	1,570	1,380-1,820	0	≤ 200,000	Aesthetic
Trihalomethanes Total (µg/L)	<4	18	16-20	0	100	Health
Turbidity (NTU)	1.3	0.15	0.07-1.2	N/A	None ³	N/A
Uranium Total (µg/L)	0.0302	N/A	N/A	0	50	Health
UV Absorbance 254 nm (Abs/cm)	0.062	0.010	0.008-0.013	N/A	None	N/A
Zinc Total (µg/L)	<3	<3	<3-5	0	≤ 5,000	Aesthetic

¹Untreated water is sampled from the source intake. Treated water is sampled prior to entering the Capilano transmission system.

²Limits are taken from the Guidelines for Canadian Drinking Water Quality summary table (September 2022).

³GCDWQ recommends that water entering the distribution system have turbidity levels of 1.0 NTU or less.

Physical and Chemical Analysis of Water Supply

2022 – Seymour Water System

Parameter	Untreated ¹	Treated ¹		Canadian Guideline		
	Average	Average	Range	Days Exceeded	Limit ²	Reason Established
Alkalinity as CaCO ₃ (mg/L)	3.6	22	18-24	N/A	None	N/A
Aluminum Dissolved (µg/L)	48	25	19-34	N/A	None	N/A
Aluminum Total (µg/L)	87	30	18-55	0	2,900	Health
Antimony Total (µg/L)	<0.5	<0.5	<0.5	0	6	Health
Arsenic Total (µg/L)	<0.5	<0.5	<0.5	0	10 (ALARA)	Health
Barium Total (µg/L)	2.9	2.8	2.5-3.5	0	1,000	Health
Boron Total (µg/L)	<10	<10	<10	0	5,000	Health
Bromate (µg/L)	<10	<10	<10	0	10	Health
Bromide (µg/L)	<10	<10	<10	N/A	None	N/A
Cadmium Total (µg/L)	<0.2	<0.2	<0.2	0	5	Health
Calcium Total (µg/L)	1,620	8,450	7,520-9,240	N/A	None	N/A
Carbon Organic - Dissolved (mg/L)	1.3	0.6	0.5-1.0	N/A	None	N/A
Carbon Organic - Total (mg/L)	1.4	0.6	0.4-1.0	N/A	None	N/A
Chlorate (µg/L)	<10	23	13-40	0	1000	Health
Chloride (mg/L)	<0.5	2.3	2.1-2.9	0	≤250	Aesthetic
Chromium Total (µg/L)	<0.06	<0.06	<0.05-0.07	0	50	Health
Cobalt Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Colour - Apparent (ACU)	14	<2	<2-6	N/A	None	N/A
Colour - True (TCU)	9	<1	<1-1	0	≤15	Aesthetic
Conductivity (µmhos/cm)	12	49	43-53	N/A	None	N/A
Copper Total (µg/L)	22.3	<2	<0.5-5.5	0/0	2,000/1,000	Health/Aesthetic
Cyanide Total (mg/L)	<0.02	<0.02	<0.02	0	0.2	Health
Cyanobacterial Toxins - Microcystin - LR (µg/L)	<0.20	N/A	N/A	0	1.5	Health
Fluoride (mg/L)	<0.05	<0.05	<0.05	0	1.5	Health
Haloacetic Acids Total (µg/L)	<1.1	11.7	7.8-19	0	80 (ALARA)	Health
Hardness as CaCO ₃ (mg/L)	4.7	21.9	19.5-23.9	N/A	None	N/A
Iron Dissolved (µg/L)	74	<5	<5-7	N/A	None	N/A
Iron Total (µg/L)	168	<9	<5-22	0	≤300	Aesthetic
Lead Total (µg/L)	<0.5	<0.5	<0.5	0	5 (ALARA)	Health
Magnesium Total (µg/L)	153	210	180-266	N/A	None	N/A
Manganese Dissolved (µg/L)	5.6	3.5	1.1-6.1	N/A	None	N/A
Manganese Total (µg/L)	8.8	6.5	2.7-12.8	0	≤50	Aesthetic
Mercury Total (µg/L)	<0.05	<0.05	<0.05	0	1	Health
Molybdenum Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Nickel Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Nitrogen - Ammonia as N (mg/L)	<0.02	<0.02	<0.02	N/A	None	N/A
Nitrogen - Nitrate as N (mg/L)	0.06	0.07	0.02-0.17	0	45	Health
Nitrogen - Nitrite as N (mg/L)	<0.01	<0.01	<0.01	0	1	Health
pH (pH units)	6.5	8.0	7.7-8.3	0	7.0-10.5	None
Phenol (mg/L)	<0.005	<0.005	<0.005	N/A	None	N/A
Potassium Total (µg/L)	156	170	137-226	N/A	None	N/A
Residue Total (mg/L)	16	34	31-36	N/A	None	N/A
Residue Total Dissolved (TDS) (mg/L)	10	30	30-40	0	≤500	Aesthetic
Residue Total Fixed (mg/L)	9	27	25-30	N/A	None	N/A
Residue Total Volatile (mg/L)	6	7	5-8	N/A	None	N/A
Selenium Total (µg/L)	<0.5	<0.5	<0.5	0	50	Health
Silica as SiO ₂ (mg/L)	3.2	3.3	2.8-3.6	N/A	None	N/A
Silver Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Sodium Total (µg/L)	558	1,550	1,390-1,810	0	≤200,000	Aesthetic
Trihalomethanes Total (µg/L)	<4	16	16-17	0	100	Health
Turbidity (NTU)	0.58	0.15	0.07-0.28	N/A	None ³	N/A
Uranium Total (µg/L)	0.0198	N/A	N/A	0	50	Health
UV Absorbance 254 nm (Abs/cm)	0.058	0.010	0.008-0.015	N/A	None	N/A
Zinc Total (µg/L)	<5	<3	<3-3	0	≤5,000	Aesthetic

¹Untreated water is sampled prior to the SCFP. Treated water is sampled prior to entering the Seymour transmission system.

²Limits are taken from the Guidelines for Canadian Drinking Water Quality summary table (September 2022).

³GCDWQ recommends that water entering the distribution system have turbidity levels of 1.0 NTU or less.

Physical and Chemical Analysis of Water Supply

2022 – Coquitlam Water System

Parameter	Untreated ¹	Treated ¹		Canadian Guideline		
	Average	Average	Range	Days Exceeded	Limit ²	Reason Established
Alkalinity as CaCO ₃ (mg/L)	1.9	21	20-26	N/A	None	N/A
Aluminum Dissolved (µg/L)	59	68	51-85	N/A	None	N/A
Aluminum Total (µg/L)	81	83	61-106	0	2,900	Health
Antimony Total (µg/L)	<0.5	<0.5	<0.5	0	6	Health
Arsenic Total (µg/L)	<0.5	<0.5	<0.5	0	10 ¹	Health
Barium Total (µg/L)	2.6	2.4	1.7-3.6	0	1,000	Health
Boron Total (µg/L)	<10	<10	<10	0	5,000	Health
Bromate (µg/L)	<10	<10	<10	0	10	Health
Bromide (µg/L)	<10	<10	<10		None	N/A
Cadmium Total (µg/L)	<0.2	<0.2	<0.2	0	5	Health
Calcium Total (µg/L)	807	911	706-2,300	N/A	None	N/A
Carbon Organic - Dissolved (mg/L)	1.5	1.4	1.1-2.0	N/A	None	N/A
Carbon Organic - Total (mg/L)	1.6	1.4	1.2-2.1	N/A	None	N/A
Chlorate (µg/L)	<10	52	32-85	0	1,000	Health
Chloride (mg/L)	<0.5	2.1	1.9-2.3	0	≤250	Aesthetic
Chromium Total (µg/L)	<0.06	<0.05	<0.05-0.05	0	50	Health
Cobalt Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Colour - Apparent (ACU)	12	<3	<2-8	N/A	None	N/A
Colour - True (TCU)	9	<1	<1-6	0	≤15	Aesthetic
Conductivity (µmhos/cm)	8	45	40-53	N/A	None	N/A
Copper Total (µg/L)	4.4	<0.5	<0.5	0/0	2,000/1,000	Health/Aesthetic
Cyanide Total (mg/L)	<0.02	<0.02	<0.02	0	0.2	Health
Cyanobacterial Toxins - Microcystin - LR (µg/L)	<0.20	N/A	N/A	0	1.5	Health
Fluoride (mg/L)	<0.05	<0.05	<0.05	0	1.5	Health
Haloacetic Acids Total (µg/L)	<1.1	7.4	4.2-12	0	80 ¹	Health
Hardness as CaCO ₃ (mg/L)	2.4	2.7	2.1-6.2	N/A	None	N/A
Iron Dissolved (µg/L)	18	19	12-35	N/A	None	N/A
Iron Total (µg/L)	48	49	25-76	0	≤300	Aesthetic
Lead Total (µg/L)	<0.5	<0.5	<0.5	0	5 ¹	Health
Magnesium Total (µg/L)	93	94	77-110	N/A	None	N/A
Manganese Dissolved (µg/L)	3.9	2.7	1.6-3.7	N/A	None	N/A
Manganese Total (µg/L)	4.4	3.6	2.0-4.8	0	≤50	Aesthetic
Mercury Total (µg/L)	<0.05	<0.05	<0.05	0	1	Health
Molybdenum Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Nickel Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Nitrogen - Ammonia as N (mg/L)	<0.02	<0.02	<0.02	N/A	None	N/A
Nitrogen - Nitrate as N (mg/L)	0.07	0.08	0.04-0.11	0	45	Health
Nitrogen - Nitrite as N (mg/L)	<0.01	<0.01	<0.01	0	1	Health
pH (pH units)	6.3	8.2	7.6-8.9	0		None
Phenol (mg/L)	<0.005	<0.005	<0.005	N/A	None	N/A
Potassium Total (µg/L)	147	144	102-234	N/A	None	N/A
Residue Total (mg/L)	12	35	33-37	N/A	None	N/A
Residue Total Dissolved (TDS) (mg/L)	9	30	30	0	≤500	Aesthetic
Residue Total Fixed (mg/L)	6	23	20-24	N/A	None	N/A
Residue Total Volatile (mg/L)	6	12	9-14	N/A	None	N/A
Selenium Total (µg/L)	<0.5	<0.5	<0.5	0	50	Health
Silica as SiO ₂ (mg/L)	2.4	2.4	2.2-2.5	N/A	None	N/A
Silver Total (µg/L)	<0.5	<0.5	<0.5	N/A	None	N/A
Sodium Total (µg/L)	448	10,300	9,000-11,100	0	≤200,000	Aesthetic
Trihalomethanes Total (µg/L)	<4	8	6-12	0	100	Health
Turbidity (NTU)	<0.4	0.36	0.13-4.5	N/A	None ³	N/A
Uranium Total (µg/L)	0.0491	N/A	N/A	0	50	Health
UV 254 - Apparent (Abs/cm)	0.065	0.023	0.016-0.057	N/A	None	N/A
UV Absorbance 254 nm (Abs/cm)	0.059	0.020	0.013-0.050	N/A	None	N/A
Zinc Total (µg/L)	<3	<3	<3-5	0	≤5,000	Aesthetic

¹Untreated water is sampled from the source intake. Treated water is sampled prior to entering the Coquitlam transmission system.

²Limits are taken from the Guidelines for Canadian Drinking Water Quality summary table (September 2022).

³GCDWQ recommends that water entering the distribution system have turbidity levels of 1.0 NTU or less.

APPENDIX C — ANALYSIS OF WATER FOR ORGANIC COMPONENTS AND RADIONUCLIDES

This page has been intentionally left blank.

Analysis of Source Waters for Herbicides, Pesticides, and other Organic Compounds

Parameter	Capilano (µg/L)	Seymour (µg/L)	Coquitlam (µg/L)	MAC (µg/L)	AO (µg/L)
	Jul 26	Jul 26	Jul 26		
Herbicides					
2,4-D	<1.0	<1.0	<1.0	100	None
Bromoxynil	<0.50	<0.50	<0.50	30	None
Dicamba	<1.0	<1.0	<1.0	110	None
Diclofop-methyl	<0.90	<0.90	<0.90	None	None
Diquat	<7.0	<7.0	<7.0	50	None
Diuron	<10	<10	<10	None	None
Glyphosate	<10	<10	<10	280	None
MCPA	<10	<10	<10	350	None
Metribuzin (Sencor)	<5.0	<5.0	<5.0	80	None
Paraquat	<1.0	<1.0	<1.0	None	None
Picloram	<5.0	<5.0	<5.0	None	None
Pesticides					
Atrazine	<0.50	<0.50	<0.50	5	None
Carbaryl	<5.0	<5.0	<5.0	None	None
Carbofuran	<5.0	<5.0	<5.0	None	None
Chlorpyrifos (Dursban)	<1.0	<1.0	<1.0	90	None
Diazinon	<1.0	<1.0	<1.0	None	None
Dimethoate	<2.5	<2.5	<2.5	20	None
Guthion (Azinphos-methyl)	<2.0	<2.0	<2.0	None	None
Malathion	<5.0	<5.0	<5.0	190	None
Metolachlor	<0.50	<0.50	<0.50	None	None
Phorate (Thimet)	<0.50	<0.50	<0.50	None	None
Simazine	<1.0	<1.0	<1.0	None	None
Terbufos	<0.50	<0.50	<0.50	None	None
Trifluralin	<1.0	<1.0	<1.0	None	None
Other Organic Compounds					
Phenolics					
2,3,4,6-tetrachlorophenol	<0.50	<0.50	<0.50	None	None
2,4,6-trichlorophenol	<0.50	<0.50	<0.50	5	≤2
2,4-dichlorophenol	<0.25	<0.25	<0.25	None	None
Pentachlorophenol	<0.50	<0.50	<0.50	60	≤30

Analysis of Source Waters for Herbicides, Pesticides, and other Organic Compounds Con't.

Parameter	Capilano (µg/L)	Seymour (µg/L)	Coquitlam (µg/L)	MAC (µg/L)	AO (µg/L)
	Jul 26	Jul 26	Jul 26		
Volatile Organics					
1,1-dichloroethene	<0.50	<0.50	<0.50	14	None
1,2-dichlorobenzene	<0.50	<0.50	<0.50	None	None
1,2-dichloroethane	<0.50	<0.50	<0.50	5	None
1,4-dichlorobenzene	<0.50	<0.50	<0.50	5	≤1
Benzene	<0.40	<0.40	<0.40	5	None
Carbon tetrachloride	<0.50	<0.50	<0.50	2	None
Chlorobenzene	<0.50	<0.50	<0.50	None	None
Dibromomethane	<0.90	<0.90	<0.90	None	None
Dichloromethane	<2.0	<2.0	<2.0	50	None
Ethylbenzene	<0.40	<0.40	<0.40	140	1.6
Methyl-tert-butylether (MTBE)	<4.0	<4.0	<4.0	None	≤15
Tetrachloroethene	<0.50	<0.50	<0.50	10	N/A
Toluene	<0.40	<0.40	<0.40	60	24
Trichloroethene	<0.50	<0.50	<0.50	5	None
Vinyl chloride	<0.50	<0.50	<0.50	2 (ALARA)	None
m & p-Xylene	<0.40	<0.40	<0.40	None	None
o-Xylene	<0.40	<0.40	<0.40	None	None
Xylenes (Total)	<0.40	<0.40	<0.40	90	20
Miscellaneous					
Nitritotriacetic Acid : Nitritotriacetic acid (NTA) (mg/L)	<0.050	<0.050	<0.050	0.4 mg/L	None
N-Nitrosodimethylamine (NDMA) (ng/L)	<2.2	<2.2	<2.1	40 ng/L	None

Monitoring of Selected GVWD Water Mains for BTEX

Parameter	Maple Ridge Main		Barnston Island Main at Willoughby Pump Station		Jericho Clayton Main		South Burnaby Main No. 2		MAC (µg/L)	AO (µg/L)
	(µg/L)		(µg/L)		(µg/L)		(µg/L)			
	May 16	Dec 1	May 17	Dec 8	May 17	Dec 1	May 17	Nov 29		
Benzene	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	5	None
Ethyl Benzene	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	140	1.6
Toluene	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	60	24
m & p-Xylene	<1	<1	<1	<1	<1	<1	<1	<1	None	None
o-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	None	None
Total Xylenes	<1	1	<1	1	<1	1	<1	1	90	20
Total BTEX	<1	2	1	1	<1	2	<1	1	None	None

Analysis of Source Water for PAHs

Parameter	Capilano (µg/L)			Seymour (µg/L)			Coquitlam (µg/L)		
	May 16	Jul 26	Nov 29	May 16	Jul 26	Nov 28	May 16	Jul 26	Dec 1
1-Methylnaphthalene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
2-Methylnaphthalene	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10
Acenaphthene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Acenaphthylene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Acridine	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Anthracene	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010
Benzo(a)anthracene	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010
Benzo(a)pyrene ¹	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050
Benzo(b&j)fluoranthene	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030
Benzo(g,h,i)perylene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Benzo(k)fluoranthene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Chrysene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Dibenz(a,h)anthracene	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030
Fluoranthene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Fluorene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Indeno(1,2,3-cd)pyrene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Naphthalene	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10
Phenanthrene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Pyrene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Quinoline	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Total PAHs	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10

¹Benzo(a)pyrene is the only PAH compound that has a GCDWQ limit. Maximum Acceptable Concentration of Benzo(a)pyrene is 0.04 µg/L.

Analysis of Selected GVWD Mains for PAHs

Parameters	Coquitlam Main No. 2		Westburnco Reservoir		Barnston Island Main		Annacis Main No. 4		Whalley - Kennedy Link Main		Haney Main No. 2		36 Ave. Main	
	(µg/L)		(µg/L)		(µg/L)		(µg/L)		(µg/L)		(µg/L)		(µg/L)	
	May 16	Nov 30	May 17	Dec 1	May 17	Dec 1	May 16	Nov 29	May 17	Dec 6	May 16	Dec 1	May 17	Dec 2
1-Methylnaphthalene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
2-Methylnaphthalene	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10
Acenaphthene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Acenaphthylene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Acridine	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Anthracene	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010
Benz[a]anthracene	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010	<0.010
Benzo[a]pyrene	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050	<0.0050
Benzo[b+j]fluoranthene	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030	<0.030
Benzo[g,h,i]perylene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Benzo[k]fluoranthene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Chrysene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Dibenz[a,h]anthracene	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030
Fluoranthene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Fluorene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Indeno[1,2,3-c,d]pyrene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Naphthalene	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10
Phenanthrene	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050	<0.050
Pyrene	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020	<0.020
Quinoline	<0.020	<0.020	<0.020	0.028	<0.020	<0.020	<0.020	<0.020	0.021	<0.020	0.023	<0.020	<0.020	<0.020
Total PAHs	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10

¹Benzo(a)pyrene is the only PAH compound that has a GCDWQ limit. Maximum Acceptable Concentration of Benzo(a)pyrene is 0.04 µg/L.

Analysis of Source Water for Radionuclides

Parameter	Capilano (Bq/L)	Seymour (Bq/L)	Coquitlam (Bq/L)	MAC (Bq/L)
	Jul 26	Jul 26	Jul 26	
Gross Alpha	<0.10	<0.10	<0.10	0.5
Gross Beta	<0.10	<0.10	<0.10	1
Cesium-134	<1	<1	<1	None
Cesium-137	<1	<1	<1	10
Iodine-131	<1	<1	<1	6
Lead-210	<0.10	<0.10	<0.10	0.2
Manganese-54	<1	<1	<1	None
Radium 226	<0.010	<0.010	<0.010	0.5
Radon-222	<10	<10	<10	None
Strontium-90	<0.10	<0.10	<0.10	7
Tritium	<20	<20	<20	7,000
Zinc-65	<1	<1	<1	None

APPENDIX D — METRO VANCOUVER DETECTION OF WATERBORNE *CRYPTOSPORIDIUM* AND *GIARDIA* JANUARY - DECEMBER 2022 ANNUAL REPORT

This page has been intentionally left blank

Metro Vancouver
Detection of Waterborne *Cryptosporidium* and *Giardia*
January - December, 2022
Annual Report

February 2023

Dr. Natalie Prystajcky, Program Head
Christine Tchao, Team Lead
Tracy Chan, Technical Coordinator
Angela Kong, Technical Coordinator
Jenny Jeong, Technical Coordinator

Environmental Microbiology
BCCDC Public Health Laboratory
Provincial Health Services Authority

Metro Vancouver Detection of Waterborne *Cryptosporidium* and *Giardia* January - December 2022 Annual Report

Purpose

To detect and quantify *Cryptosporidium* oocysts and *Giardia* cysts from Metro Vancouver reservoirs (Capilano, Coquitlam and Seymour), as well as from the Recycled Clarified Water (RCW) from Seymour-Capilano Filtration Plant (SCFP).

Introduction

Cryptosporidium and *Giardia* species are parasites that infect the intestinal tracts of a wide range of warm-blooded animals. In humans, infection with *Cryptosporidium* species or *Giardia lamblia* can cause gastroenteritis. Since *Cryptosporidium* oocysts and *Giardia* cysts are resistant to chlorination, they are of great concern for drinking water purveyors (1-3). On behalf of Metro Vancouver, the Environmental Microbiology Laboratory at BCCDC Public Health Laboratory (BCCDC PHL) examined the source water of Capilano, Coquitlam and Seymour reservoirs, as well as Recycled Clarified Water (RCW) at the Seymour-Capilano Filtration Plant (SCFP) for the presence of *Cryptosporidium* oocysts and *Giardia* cysts. All sample collection, testing, analysis and reporting occurred on a monthly basis using a validated method.

Methods

The Environmental Microbiology Laboratory at BCCDC PHL follows the United States Environmental Protection Agency (USEPA) Method 1623.1: *Cryptosporidium* and *Giardia* in Water by Filtration/IMS/FA (4) for the detection of oocysts and cysts in water. As stated by Method 1623.1, the performance is based on the method applicable for the quantification of *Cryptosporidium* and *Giardia* in aqueous matrices. It requires the filtration of a large volume of water and immunomagnetic separation (IMS) to concentrate and purify the oocysts and cysts from sample material captured. After the IMS purification, immunofluorescence microscopy was performed to identify and enumerate oocysts and cysts. 4'-6-diamidino-2-phenylindole staining (DAPI) and differential interference contrast microscopy (DIC) are used to confirm internal structures of the cysts and oocysts.

Raw water samples were collected by the Metro Vancouver at specific sampling sites at the reservoirs and filtration plants on the scheduled date each month. A desired volume of samples were filtered in the field using Pall Life Science Envirochek HV filters. After collection and filtration, the Envirochek HV filters were transported to the Environmental Microbiology Laboratory at BCCDC PHL, where they were processed and analysed within 96 hours. Positive and negative controls were included for the entire process to assess the performance of the method. Matrix spike testing was also performed at scheduled collection periods, annually for baseline assessment.

Results & Discussions

In 2022, 41 sample filters (excluding matrix spikes) were examined in total. These include:

- 12 Envirochek HV filters from Capilano reservoir
- 12 Envirochek HV filters from Coquitlam reservoir
- 12 Envirochek HV filters from SCFP-RCW
- 5 Envirocheck HV filters from Seymour reservoir

Table 1 and Figures 1-3 show the summary of all results. Detailed results per collection site can be found in Tables A1-A4 in Appendix A.

	Capilano Reservoir		Coquitlam Reservoir		Seymour Capilano Filtration Plant – Recycled Clarified Water		Seymour Reservoir	
# of Filter Tested	12		12		12		5	
Average volume (L) Filtered per Month	48.3		49.6		279.9		39.2	
Average Detection Limit (oo)cysts per 100 L	<2.0		<2.0		0.66		2.69	
	<i>Cryptosporidium</i>	<i>Giardia</i>	<i>Cryptosporidium</i>	<i>Giardia</i>	<i>Cryptosporidium</i>	<i>Giardia</i>	<i>Cryptosporidium</i>	<i>Giardia</i>
# Positive Filters	0	2	0	1	0	0	0	0
% Positive Filters	0%	17%	0%	8%	0%	0%	0%	0%
Max Count (oo)cysts per 100 L	0	2	0	2	0	0	0	0

Table 1. Metro Vancouver Filter Result Summary in 2022

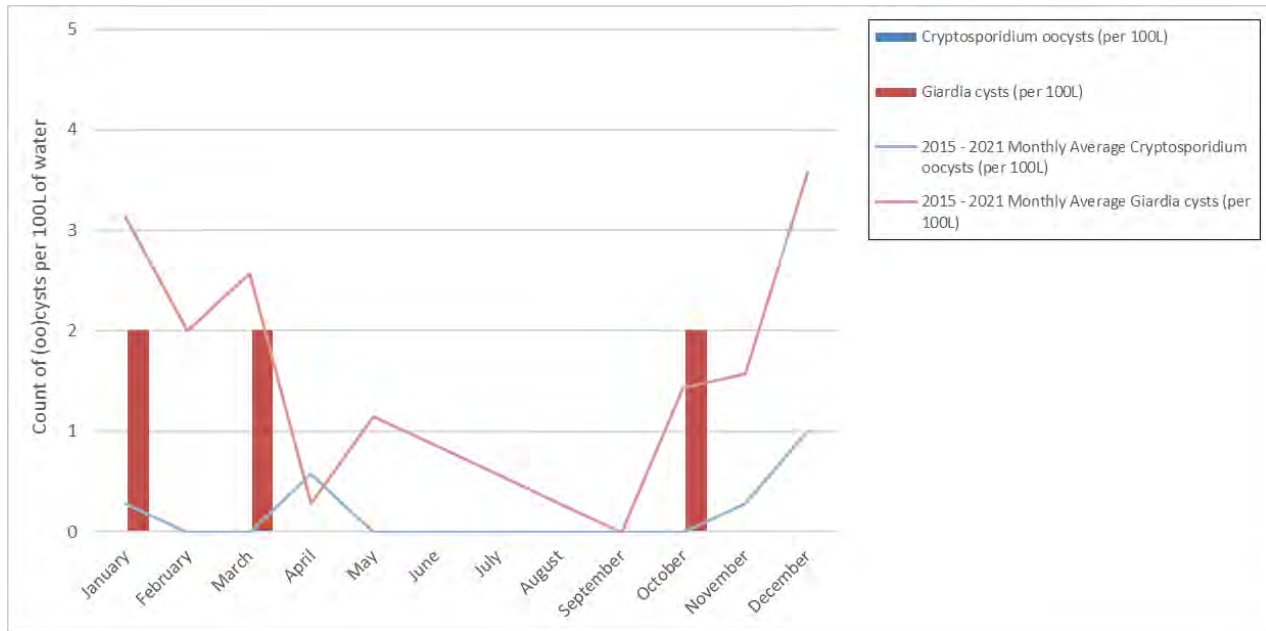


Figure 1. Capilano Reservoir *Cryptosporidium* Oocysts and *Giardia* Cysts Counts per 100 Litres of Raw Water in 2022

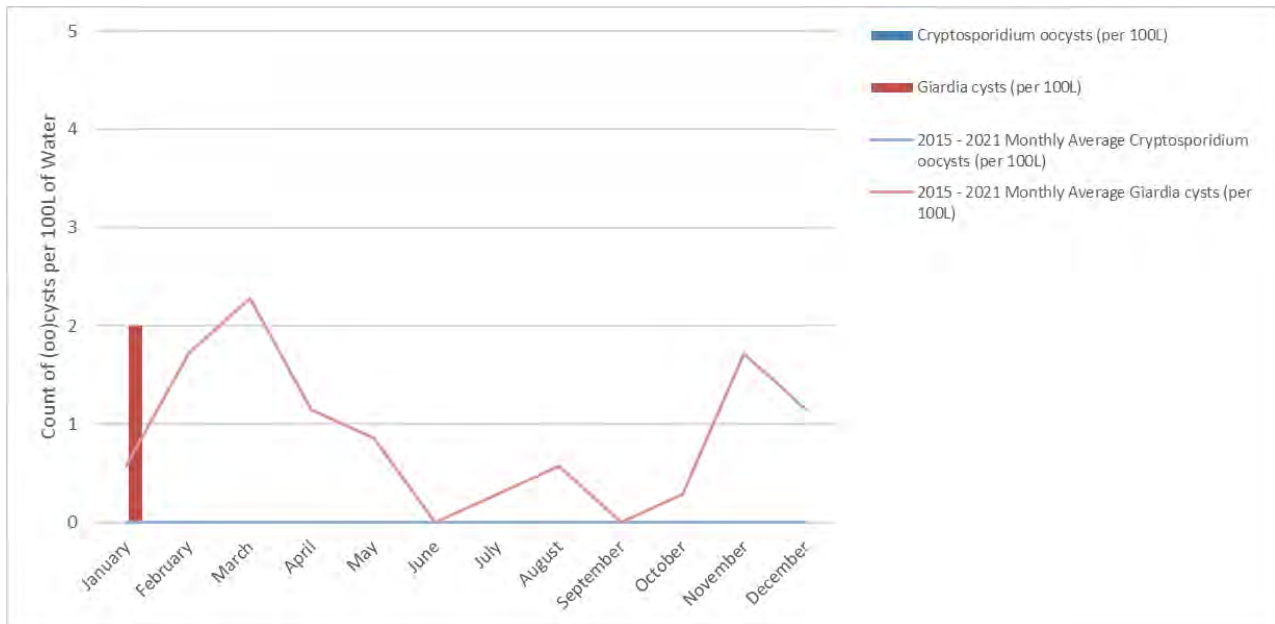


Figure 2: Coquitlam Reservoir *Cryptosporidium* Oocysts and *Giardia* Cysts Counts per 100 Litres of Raw Water in 2022

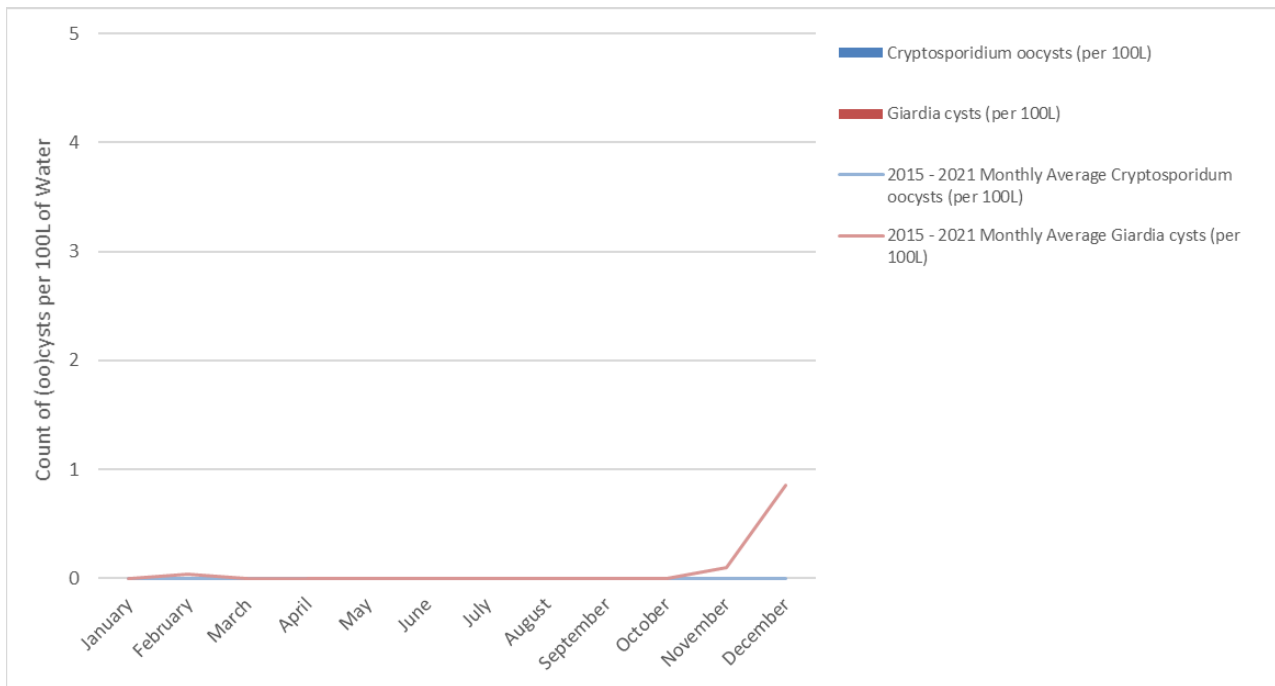


Figure 3: Seymour Capilano Filtration Plant - Recycled Clarified Water *Cryptosporidium* Oocysts and *Giardia* Cysts Counts per 100 Litres of Raw Water in 2022

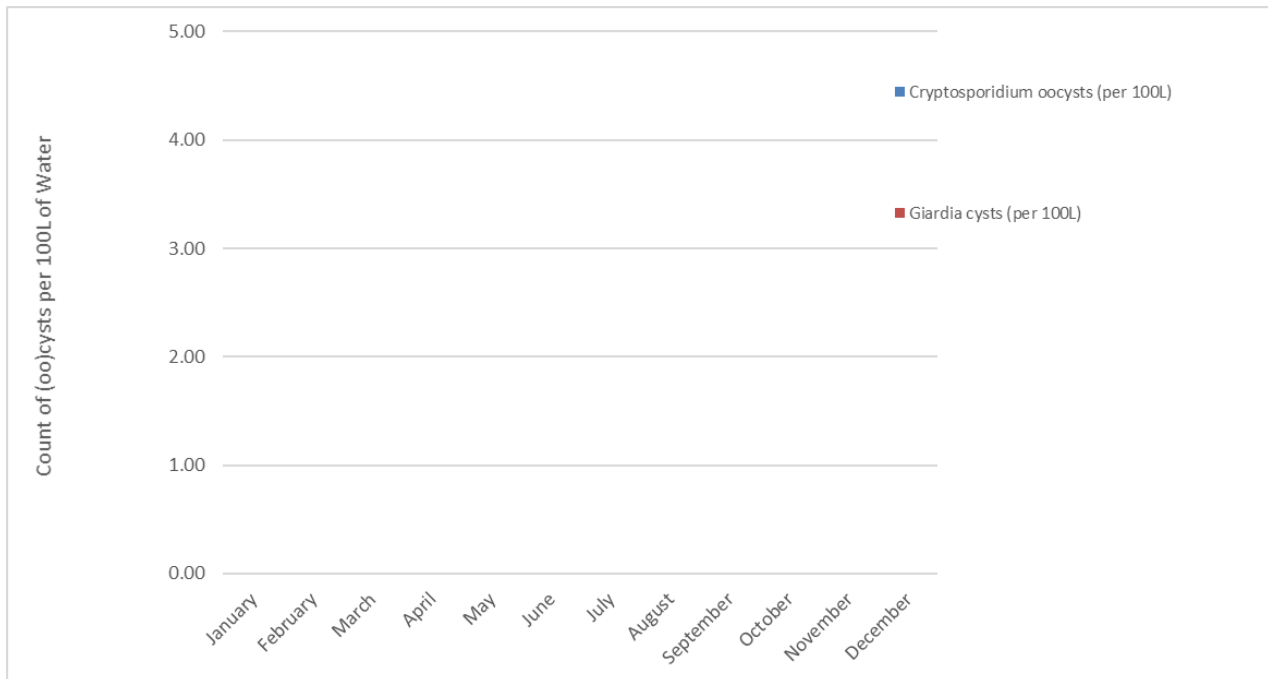


Figure 4: Seymour Reservoir *Cryptosporidium* Oocysts and *Giardia* Cysts Counts per 100 Litres of Raw Water in 2022

Overall, similar trends were observed for both *Cryptosporidium* and *Giardia* in 2022, in comparison to historical data in 2015-2021. Testing for Seymour reservoir started in July 2022, therefore there is no historical data for comparison. There were no detections of *Cryptosporidium* or *Giardia* at this site in 2022.

DAPI staining is used as part of the confirmation of the internal structure of *Cryptosporidium* oocysts and *Giardia* cysts. DIC microscopy is used primarily for *Cryptosporidium* oocyst and *Giardia* cyst confirmation but it can also serve as an indicator of oocysts/cysts cytoplasm and cell wall integrity. While no median body (or axoneme) was observed for all *Giardia* cysts detected, the cytoplasm was observed indicating that the cysts were not empty and could be viable.

Summary of morphological results are listed in Tables 2 and 3. Detailed results for staining by IFA, DAPI and internal morphology, as determined through DIC microscopy, for every identified cyst and oocyst were recorded in Tables A5-A12 in Appendix A.

Site	Count of oocysts	DAPI -	DAPI +		DIC		
		Light blue internal staining, no distinct nuclei, green rim	Intense blue internal staining	Nuclei stained sky blue	Empty oocysts	Oocysts with amorphous structure	Oocysts with internal structure, sporozoites
Capilano	0	0	0	0	0	0	0
		0.0%	0.0%		0.0%	0.0%	0.0%
Coquitlam	0	0	0	0	0	0	0
		0.0%	0.0%		0.0%	0.0%	0.0%
SCFP-RCW	0	0	0	0	0	0	0
		0.0%	0.0%		0.0%	0.0%	0.0%
Seymour	0	0	0	0	0	0	0
		0.0%	0.0%		0.0%	0.0%	0.0%

Table 2. 2022 Summary of morphological results for *Cryptosporidium* oocysts observed under fluorescence microscope

Site	Count of cysts	DAPI -	DAPI +		DIC				
		Light blue internal staining, no distinct	Intense blue internal staining	Nuclei stained sky blue	Empty cysts	Cysts with amorphous structure	Cysts with internal structure		
							Nuclei	Median Body	Axoneme
Capilano	2	1	1	0	0	2	0	0	0
		50.0%	50.0%		0.0%	100.0%		0.0%	0.0%
Coquitlam	1	0	0	3	0	0	1	0	0
		0.0%	0.0%		0.0%	0.0%		0.0%	0.0%
SCFP-RCW	0	0	0	0	0	0	0	0	0
		0.0%	0.0%		0.0%	0.0%		0.0%	0.0%
Seymour	0	0	0	0	0	0	0	0	0
		0.0%	0.0%		0.0%	0.0%		0.0%	0.0%

Table 3: 2022 Summary of morphological results for *Giardia* cysts observed under fluorescence microscope

DAPI staining is used as an indicator of nuclei integrity by staining the DNA. It can also approximate oocysts/cysts integrity; the absence of nuclei is indicative of an aged, damaged or non-infective cell. A number of oocysts and cysts observed across all sites had no visible nuclei indicating that they were aged and likely subjected to environmental degradation (Table 4). However, they were likely in previous infective state.

Number of Nuclei per (oo)cyst	0*	1	2	3	4	Total # of (oo)cysts
<i>Cryptosporidium</i> oocysts						
Capilano	0	0	0	0	0	0
Coquitlam	0	0	0	0	0	0
SCFP-RCW	0	0	0	0	0	0
<i>Giardia</i> cysts						
Capilano	2	0	0	0	0	2
Coquitlam	0	0	0	1	0	1
SCFP-RCW	0	0	0	0	0	0

Table 4: 2022 Number of nuclei in each *Cryptosporidium* oocysts and *Giardia* cysts. *DAPI negative or only intense blue internal staining.

Due to the variations of water chemistry and organic matters between geographical area and temporally within each sampling sites, a matrix spike is performed annually to provide recovery rate estimation from each site. The results of the matrix spike recovery (2007-2022) are compiled in Table 5. Matrix recovery rates fluctuate from year-to-year, even within each site. This variation is not uncommon for the test and has been noted in USEPA's Method 1623.1.

Matrix testing in 2022 was completed in both summer and winter on two separate sampling events at each site. 50L were provided from each site and the percentage recovery for *Cryptosporidium* oocysts and *Giardia* cysts and were noted in Table 5. One of the carboys containing 10L of matrix water from Capilano reservoir leaked in transit and was not used in testing; therefore the Capilano 2022 Fall/Winter matrix testing was performed with only 40L of water.

Year	Capilano		Coquitlam		SCFP - Recycled Clarified Water		Seymour	
	<i>Cryptosporidium</i> % Recovery	<i>Giardia</i> % Recovery	<i>Cryptosporidium</i> % Recovery	<i>Giardia</i> % Recovery	<i>Cryptosporidium</i> % Recovery	<i>Giardia</i> % Recovery	<i>Cryptosporidium</i> % Recovery	<i>Giardia</i> % Recovery
2007	27.6%	37.4%	28.0%	54.0%	not collected		not collected	
2008	25.0%	55.0%	28.0%	39.0%	not collected		not collected	
2009	10.0%	40.0%	16.0%	37.0%	not collected		not collected	
2010	28.0%	43.0%	26.0%	49.0%	17.0%	13.0%	not collected	
2011	27.0%	44.0%	22.0%	47.0%	1.0%	0.0%	not collected	
2012	38.4%	76.5%	35.0%	49.0%	7.0%	13.7%	not collected	
2013	22.4%	59.4%	16.3%	64.4%	6.1%	14.9%	not collected	
2014	not collected		55.0%	39.4%	18.0%	14.1%	not collected	
2015	26.3%	40.4%	2.0%	60.6%	9.1%	26.5%	not collected	
2016	35.4%	47.5%	22.2%	50.5%	9.1%	14.0%	not collected	
2017	20.2%	38.4%	22.2%	21.2%	0.0%	2.0%	not collected	
2018	43.4%	75.8%	17.1%	59.6%	1.0%	11.1%	not collected	
2019	0.0%	43.0%	1.0%	55.0%	0.0%	4.1%	not collected	
2020	5.1%	37.4%	8.1%	59.8%	0.0%	4.0%	not collected	
2021 June	2.0%	53.0%	0.0%	35.0%	5.1%	38.0%	not collected	
2021 November	11.1%	52.0%	15.2%	80.0%	0.0%	8.0%	not collected	
2022 Summer	12.1%	17.0%	4.0%	13.0%	0.0%	11.0%	0.0%	19.0%
2022 Fall/Winter	0.0%	12.2%	5.1%	49.0%	1.0%	36.7%	not collected	

Table 5: Matrix Results from 2007 - 2022

Summary

In brief, we reported:

1. Overall, a low but consistent positivity rate was observed across all sites, except for Seymour reservoir, for both *Cryptosporidium* oocysts and *Giardia* cysts. Seymour reservoir is a new site this year and more data will be required for any trend analysis.
2. *Cryptosporidium* oocysts were not detected the following sites: Capilano reservoir, Coquitlam reservoir, SCFP-RCW and Seymour reservoir.
3. *Giardia* cysts were detected in filters from Capilano and Coquitlam reservoirs but not from SCFP-RCW or Seymour reservoir. 17% of all filters received from Capilano were positive for *Giardia*, and 8% of all filters received from Coquitlam were positive for *Giardia*, and there were no *Giardia* cysts detected for SCFP-RCW or Seymour reservoir.
4. The highest concentration of *Giardia* cysts detected in 2022 was 2 cysts per 100 L from Capilano reservoir in January and October, as well as from Coquitlam reservoir in January.
5. Most of the *Giardia* cysts detected showed evidence of environmental degradation, based on microscopic examination. .
6. Matrix recovery for *Cryptosporidium* oocyst continued to be low, which is consistent with previous years. The additional matrix collection in the summer did not confirm suspected seasonality variabilities for this year. Further summer matrix collections are recommended to continue this investigation.

These *semi-quantitative* data (reported oocyst and cyst levels) should be interpreted in the context of, and with the understanding that the current standard laboratory method, USEPA Method 1623.1, used for detecting and analysing parasites in water matrices has its limitations, with variable recovery rates depending on the water matrix and environmental conditions.

Acknowledgements

The BCCDC Public Health Laboratory thanks Metro Vancouver for their ongoing support of this program and other related projects. In particular, the assistance of Larry Chow, Vila Goh, Eileen Butler, Melody Sato, and Rick Zolkiewski of the Metro Vancouver, Water Quality Department are greatly appreciated.

References

1. Haas CN, Aturaliye D. Semi-quantitative characterization of electroporation-assisted disinfection processes for inactivation of *Giardia* and *Cryptosporidium*. 1999. Journal of Applied Microbiology. 88:899-905.
2. Hoff JC. Inactivation of microbial agents by chemical disinfectants. 1986. Publication EPA/600/2-86/067. U.S. Environmental Protection Agency, Cincinnati, Ohio.
3. Korich DG, Mead JR, Madore MS, et al. Effects of ozone, chlorine dioxide, chlorine, and monochloramine on *Cryptosporidium parvum* oocysts viability. 1990. Applied and Environmental Microbiology. 56(5):1423-1428.
4. U.S. Environmental Protection Agency. Method 1623.1: *Cryptosporidium* and *Giardia* in water by filtration/IMS/FA. 2012. Publication EPA-816-R-12-001. U.S. Environmental Protection Agency Office of Water, Washington, D.C.
5. Atherholt TB, LeChevallier MW, Norton WD, and Rosen JS. Effect of rainfall on *Giardia* and *Crypto*. 1998. Journal of American Water Works Association. 90(9): 66-80.

Appendix A

Lab #	Site Sampled	Month	Date Sampled	Volume filtered (L)	Detection Limit (per 100L)	Cryptosporidium oocysts (per 100L)	Giardia cysts (per 100L)	2015 - 2021 Monthly Average	
								Cryptosporidium oocysts (per 100L)	Giardia cysts (per 100L)
8224	Capilano Reservoir	January	January 17, 2022	50	<2.0	0	2	0.3	3.1
8229	Capilano Reservoir	February	February 14, 2023	50	<2.0	0	0	0.0	2.0
8234	Capilano Reservoir	March	March 21, 2022	50	<2.0	0	0	0.0	2.6
8239	Capilano Reservoir	April	April 11, 2022	50	<2.0	0	0	0.6	0.3
8249	Capilano Reservoir	May	May 16, 2022	50	<2.0	0	0	0.0	1.1
8254	Capilano Reservoir	June	June 20, 2022	50	<2.0	0	0	0.0	0.9
8262	Capilano Reservoir	July	July 18, 2022	50	<2.0	0	0	0.0	0.6
8270	Capilano Reservoir	August	August 22, 2022	50	<2.0	0	0	0.0	0.3
8278	Capilano Reservoir	September	September 26, 2022	30	<3.3	0	0	0.0	0.0
8293	Capilano Reservoir	October	October 31, 2022	50	<2.0	0	2	0.0	1.4
8300	Capilano Reservoir	November	November 21, 2022	50	<2.0	0	0	0.3	1.6
8307	Capilano Reservoir	December	December 12, 2022	50	<2.0	0	0	1.0	3.6
2022 Average				48.3	<2.0	0	0.3		

Table A1. Capilano Reservoir Monthly Filter Results in 2022

Lab #	Site Sampled	Month	Date Sampled	Volume filtered (L)	Detection Limit (per 100L)	Cryptosporidium oocysts (per 100L)	Giardia cysts (per 100L)	2015 - 2021 Monthly Average	
								Cryptosporidium oocysts (per 100L)	Giardia cysts (per 100L)
8225	Coquitlam Reservoir	January	January 17, 2022	50	<2.0	0	2	0.0	0.6
8230	Coquitlam Reservoir	February	February 14, 2024	50	<2.0	0	0	0.0	1.7
8235	Coquitlam Reservoir	March	March 21, 2022	50	<2.0	0	0	0.0	2.3
8240	Coquitlam Reservoir	April	April 11, 2022	50	<2.0	0	0	0.0	1.1
8250	Coquitlam Reservoir	May	May 16, 2022	50	<2.0	0	0	0.0	0.9
8255	Coquitlam Reservoir	June	June 20, 2022	50	<2.0	0	0	0.0	0.0
8263	Coquitlam Reservoir	July	July 18, 2022	50	<2.0	0	0	0.0	0.3
8271	Coquitlam Reservoir	August	August 22, 2022	50	<2.0	0	0	0.0	0.6
8279	Coquitlam Reservoir	September	September 26, 2022	45	<2.2	0	0	0.0	0.0
8294	Coquitlam Reservoir	October	October 31, 2022	50	<2.0	0	0	0.0	0.3
8301	Coquitlam Reservoir	November	November 21, 2022	50	<2.0	0	0	0.0	1.7
8308	Coquitlam Reservoir	December	December 12, 2022	50	<2.0	0	0	0.0	1.1
2022 Average				49.6	<2.0	0	0		

Table A2. Coquitlam Reservoir Monthly Filter Results in 2022

Lab #	Site Sampled	Month	Date Sampled	Volume filtered (L)	Detection Limit (per 100L)	Cryptosporidium oocysts (per 100L)	Giardia cysts (per 100L)	2015 - 2021 Monthly Average	
								Cryptosporidium oocysts (per 100L)	Giardia cysts (per 100L)
8226	SCFP - Recycled Clarified Water	January	January 18, 2022	898	0.111	0	0	0.0	0.0
8231	SCFP - Recycled Clarified Water	February	February 15, 2022	319.7	<0.31	0	0	0.0	0.0
8236	SCFP - Recycled Clarified Water	March	March 22, 2022	168.5	<0.59	0	0	0.0	0.0
8241	SCFP - Recycled Clarified Water	April	April 12, 2022	343.7	<0.29	0	0	0.0	0.0
8251	SCFP - Recycled Clarified Water	May	May 17, 2022	259.8	<0.38	0	0	0.0	0.0
8256	SCFP - Recycled Clarified Water	June	June 21, 2022	327.5	<0.31	0	0	0.0	0.0
8264	SCFP - Recycled Clarified Water	July	July 19, 2022	91.1	<1.1	0	0	0.0	0.0
8273	SCFP - Recycled Clarified Water	August	August 24, 2022	59	<1.7	0	0	0.0	0.0
8281	SCFP - Recycled Clarified Water	September	September 27, 2022	102.5	<0.97	0	0	0.0	0.0
8285	SCFP - Recycled Clarified Water	October	October 18, 2022	50	<1.53	0	0	0.0	0.0
8303	SCFP - Recycled Clarified Water	November	November 22, 2022	207.1	<0.48	0	0	0.0	0.1
8310	SCFP - Recycled Clarified Water	December	December 13, 2022	531.9	<0.19	0	0	0.0	0.9
2022 Average				279.9	0.66	0	0		

Table A3. Seymour Capilano Filtration Plant - Recycled Clarified Water (SCFP-RCW) Monthly Filter Results in 2022

Lab #	Site Sampled	Month	Date Sampled	Volume filtered (L)	Detection Limit (per 100L)	Cryptosporidium oocysts (per 100L)	Giardia cysts (per 100L)
n/a	Seymour Reservoir	January			not sampled		
n/a	Seymour Reservoir	February			not sampled		
n/a	Seymour Reservoir	March			not sampled		
n/a	Seymour Reservoir	April			not sampled		
n/a	Seymour Reservoir	May			not sampled		
n/a	Seymour Reservoir	June			not sampled		
8265	Seymour Reservoir	July	July 18, 2022	50	<2.0	0	0
8272	Seymour Reservoir	August	August 22, 2022	36	<2.0	0	0
8280	Seymour Reservoir	September	September 26, 2022	30	<3.3	0	0
n/a	Seymour Reservoir	October			not sampled		
8302	Seymour Reservoir	November	November 21, 2022	30	<3.33	0	0
8309	Seymour Reservoir	December	December 12, 2022	50	<2.0	0	0
			2022 Average	39.2	2.69	0	0

Table A4. Seymour Reservoir Monthly Filter Results in 2022

Lab #	Site name	Date sampled	Cryptosporidium								
			Cryptosporidium			DAPI -		DAPI +		DIC	
			Object located by FA	Shape (oval or round)	Size L x W (µm)	Light blue internal staining, no distinct nuclei, green rim	Intense blue internal staining	Number of nuclei stained sky blue	Empty oocysts	Oocysts with amorphous structure	Oocysts with internal structure, Number of sporozoites
8224	Capilano Reservoir	January 16, 2022	0								
8229	Capilano Reservoir	February 13, 2022	0								
8234	Capilano Reservoir	March 20, 2022	0								
8239	Capilano Reservoir	April 10, 2022	0								
8249	Capilano Reservoir	May 15, 2022	0								
8254	Capilano Reservoir	June 19, 2022	0								
8262	Capilano Reservoir	July 17, 2022	0								
8270	Capilano Reservoir	August 21, 2022	0								
8278	Capilano Reservoir	September 25, 2022	0								
8293	Capilano Reservoir	October 30, 2022	0								
8300	Capilano Reservoir	November 20, 2022	0								
8307	Capilano Reservoir	December 11, 2022	0								

Table A5. Capilano Reservoir Slide Examination Results - Cryptosporidium 2022

Lab #	Site name	Date sampled	Cryptosporidium								
			Cryptosporidium			DAPI -		DAPI +		DIC	
			Object located by FA	Shape (oval or round)	Size L x W (µm)	Light blue internal staining, no distinct nuclei, green rim	Intense blue internal staining	Number of nuclei stained sky blue	Empty oocysts	Oocysts with amorphous structure	Oocysts with internal structure, Number of sporozoites
8225	Coquitlam Reservoir	January 16, 2022	0								
8230	Coquitlam Reservoir	February 13, 2022	0								
8235	Coquitlam Reservoir	March 20, 2022	0								
8240	Coquitlam Reservoir	April 10, 2022	0								
8250	Coquitlam Reservoir	May 15, 2022	0								
8255	Coquitlam Reservoir	June 19, 2022	0								
8263	Coquitlam Reservoir	July 17, 2022	0								
8271	Coquitlam Reservoir	August 21, 2022	0								
8279	Coquitlam Reservoir	September 25, 2022	0								
8294	Coquitlam Reservoir	October 30, 2022	0								
8301	Coquitlam Reservoir	November 20, 2022	0								
8308	Coquitlam Reservoir	December 11, 2022	0								

Table A6. Coquitlam Reservoir Slide Examination Results - Cryptosporidium 2022

Lab #	Site name	Date sampled	Cryptosporidium								
			Cryptosporidium			DAPI -		DAPI +		DIC	
			Object located by FA	Shape (oval or round)	Size L x W (µm)	Light blue internal staining, no distinct nuclei, green rim	Intense blue internal staining	Number of nuclei stained sky blue	Empty oocysts	Oocysts with amorphous structure	Oocysts with internal structure, Number of sporozoites
8226	SCFP - Recycled Clarified Water	January 18, 2022	0								
8231	SCFP - Recycled Clarified Water	February 15, 2022	0								
8236	SCFP - Recycled Clarified Water	March 22, 2022	0								
8241	SCFP - Recycled Clarified Water	April 12, 2022	0								
8251	SCFP - Recycled Clarified Water	May 17, 2022	0								
8256	SCFP - Recycled Clarified Water	June 21, 2022	0								
8264	SCFP - Recycled Clarified Water	July 19, 2022	0								
8273	SCFP - Recycled Clarified Water	August 24, 2022	0								
8281	SCFP - Recycled Clarified Water	September 26, 2022	0								
8285	SCFP - Recycled Clarified Water	October 18, 2022	0								
8303	SCFP - Recycled Clarified Water	November 22, 2022	0								
8310	SCFP - Recycled Clarified Water	December 13, 2022	0								

Table A7. Seymour Capilano Filtration Plant – Recycled Clarified Water Slide Examination Results - Cryptosporidium 2022

Lab #	Site name	Date sampled	Cryptosporidium									
			Cryptosporidium			DAPI -		DAPI +		DIC		
			Object located by FA	Shape (oval or round)	Size L x W (µm)	Light blue internal staining, no distinct nuclei, green rim	Intense blue internal staining	Number of nuclei stained sky blue	Empty oocysts	Oocysts with amorphous structure	Oocysts with internal structure, Number of sporozoites	
8265	Seymour Reservoir	July 17, 2022	0									
8272	Seymour Reservoir	August 21, 2022	0									
8280	Seymour Reservoir	September 25, 2022	0									
8302	Seymour Reservoir	November 20, 2022	0									
8309	Seymour Reservoir	December 11, 2022	0									

Table A8. Seymour Reservoir Slide Examination Results - *Cryptosporidium* 2022

Lab #	Site name	Date sampled	Giardia											
			Giardia			DAPI -		DAPI +		DIC			Median Body	Axoneme
			Object located by FA	Shape (oval or round)	Size L x W (µm)	Light blue internal staining, no distinct nuclei, green rim	Intense blue internal staining	Number of nuclei stained sky blue	Empty cysts	Cysts with amorphous structure	Number of nuclei			
8224	Capilano Reservoir	January 16, 2022	#1	Oval	14x10	P					P			
8229	Capilano Reservoir	February 13, 2022	0											
8234	Capilano Reservoir	March 20, 2022	0											
8239	Capilano Reservoir	April 10, 2022	0											
8249	Capilano Reservoir	May 15, 2022	0											
8254	Capilano Reservoir	June 19, 2022	0											
8262	Capilano Reservoir	July 17, 2022	0											
8270	Capilano Reservoir	August 21, 2022	0											
8278	Capilano Reservoir	September 25, 2022	0											
8293	Capilano Reservoir	October 30, 2022	#1	oval	14x7			P			P			
8300	Capilano Reservoir	November 20, 2022	0											
8307	Capilano Reservoir	December 11, 2022	0											

Table A9. Capilano Reservoir Slide Examination Results - *Giardia* 2022 (P = present)

Lab #	Site name	Date sampled	Giardia											
			Giardia			DAPI -		DAPI +		DIC			Median Body	Axoneme
			Object located by FA	Shape (oval or round)	Size L x W (µm)	Light blue internal staining, no distinct nuclei, green rim	Intense blue internal staining	Number of nuclei stained sky blue	Empty cysts	Cysts with amorphous structure	Number of nuclei			
8225	Coquitlam Reservoir	January 16, 2022	#1	Oval	11x8			3			1			
8230	Coquitlam Reservoir	February 13, 2022	0											
8235	Coquitlam Reservoir	March 20, 2022	0											
8240	Coquitlam Reservoir	April 10, 2022	0											
8250	Coquitlam Reservoir	May 15, 2022	0											
8255	Coquitlam Reservoir	June 19, 2022	0											
8263	Coquitlam Reservoir	July 17, 2022	0											
8271	Coquitlam Reservoir	August 21, 2022	0											
8279	Coquitlam Reservoir	September 25, 2022	0											
8294	Coquitlam Reservoir	October 30, 2022	0											
8301	Coquitlam Reservoir	November 20, 2022	0											
8308	Coquitlam Reservoir	December 11, 2022	0											

Table A10. Coquitlam Reservoir Slide Examination Results - *Giardia* 2022 (P = present)

Lab #	Site name	Date sampled	Giardia											
			Giardia			DAPI -		DAPI +		DIC			Median Body	Axoneme
			Object located by FA	Shape (oval or round)	Size L x W (µm)	Light blue internal staining, no distinct nuclei, green rim	Intense blue internal staining	Number of nuclei stained sky blue	Empty cysts	Cysts with amorphous structure	Number of nuclei			
8226	SCFP - Recycled Clarified Water	January 18, 2022	0											
8231	SCFP - Recycled Clarified Water	February 15, 2022	0											
8236	SCFP - Recycled Clarified Water	March 22, 2022	0											
8241	SCFP - Recycled Clarified Water	April 12, 2022	0											
8251	SCFP - Recycled Clarified Water	May 17, 2022	0											
8256	SCFP - Recycled Clarified Water	June 21, 2022	0											
8264	SCFP - Recycled Clarified Water	July 19, 2022	0											
8273	SCFP - Recycled Clarified Water	August 24, 2022	0											
8281	SCFP - Recycled Clarified Water	September 26, 2022	0											
8285	SCFP - Recycled Clarified Water	October 18, 2022	0											
8303	SCFP - Recycled Clarified Water	November 22, 2022	0											
8310	SCFP - Recycled Clarified Water	December 13, 2022	0											

Table A11. Seymour Capilano Filtration Plant – Recycled Clarified Water Slide Examination Results - *Giardia* 2022

Lab #	Site name	Date sampled	Giardia												
			Object located by FA	Shape (oval or round)	Size L x W (µm)	DAPI - Light blue internal staining, no distinct nuclei, green rim	DAPI + Intense blue internal staining	DAPI + Number of nuclei stained sky blue	Empty cysts	Cysts with amorphous structure	DIC Number of nuclei	DIC Median Body	Axoneme		
8265	Seymour Reservoir	July 17, 2022	0												
8272	Seymour Reservoir	August 21, 2022	0												
8280	Seymour Reservoir	September 25, 2022	0												
8302	Seymour Reservoir	November 20, 2022	0												
8309	Seymour Reservoir	December 11, 2022	0												

Table A12. Seymour Reservoir Slide Examination Results - *Giardia* 2022



Greater Vancouver Water District
2022 Water Quality Annual Report
Volume 2 of 2

March 2023

This page has intentionally been left blank

Table of Contents

CAPILANO SOURCE	1
SEYMOUR SOURCE	69
COQUITLAM SOURCE.....	137
GVWD TRANSMISSION SYSTEM.....	217

ACRONYMS

Abs/cm	Absorbance per centimetre
ACU	Apparent Colour Unit
mg/L	Milligram per litre (0.001 g/L)
µg/L	Microgram per litre (0.000001 g/L)
µmhos/cm	Micromhos per centimetre
TCU	True Colour Unit
NTU	Nephelometric Turbidity Unit
-	Sample result not available
Date Format	Year- Month-Day (2202-01-01)

CAPILANO SOURCE

This page has intentionally been left blank

Analysis - Capilano	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-01-04	2.7	23
Alkalinity as CaCO ₃	mg/L	2022-01-10	2.7	20
Alkalinity as CaCO ₃	mg/L	2022-01-17	2.2	22
Alkalinity as CaCO ₃	mg/L	2022-01-24	2.4	21
Alkalinity as CaCO ₃	mg/L	2022-01-31	2.5	22
Alkalinity as CaCO ₃	mg/L	2022-02-07	2.8	25
Alkalinity as CaCO ₃	mg/L	2022-02-14	2.7	21
Alkalinity as CaCO ₃	mg/L	2022-02-17	-	20
Alkalinity as CaCO ₃	mg/L	2022-02-22	3.1	23
Alkalinity as CaCO ₃	mg/L	2022-02-28	3.1	23
Alkalinity as CaCO ₃	mg/L	2022-03-07	3.0	22
Alkalinity as CaCO ₃	mg/L	2022-03-14	3.0	23
Alkalinity as CaCO ₃	mg/L	2022-03-21	3.0	21
Alkalinity as CaCO ₃	mg/L	2022-03-28	3.0	23
Alkalinity as CaCO ₃	mg/L	2022-04-04	2.9	21
Alkalinity as CaCO ₃	mg/L	2022-04-11	2.9	21
Alkalinity as CaCO ₃	mg/L	2022-04-19	3.1	22
Alkalinity as CaCO ₃	mg/L	2022-04-25	2.9	22
Alkalinity as CaCO ₃	mg/L	2022-05-02	3.1	23
Alkalinity as CaCO ₃	mg/L	2022-05-09	3.1	23
Alkalinity as CaCO ₃	mg/L	2022-05-10	-	24
Alkalinity as CaCO ₃	mg/L	2022-05-16	3.1	22
Alkalinity as CaCO ₃	mg/L	2022-05-24	3.0	20
Alkalinity as CaCO ₃	mg/L	2022-05-30	2.8	22
Alkalinity as CaCO ₃	mg/L	2022-06-06	2.6	21
Alkalinity as CaCO ₃	mg/L	2022-06-13	2.4	20
Alkalinity as CaCO ₃	mg/L	2022-06-20	2.5	21
Alkalinity as CaCO ₃	mg/L	2022-06-27	2.6	21
Alkalinity as CaCO ₃	mg/L	2022-07-04	2.6	23
Alkalinity as CaCO ₃	mg/L	2022-07-11	2.7	22
Alkalinity as CaCO ₃	mg/L	2022-07-18	2.5	24
Alkalinity as CaCO ₃	mg/L	2022-07-25	2.7	21
Alkalinity as CaCO ₃	mg/L	2022-08-02	2.7	22
Alkalinity as CaCO ₃	mg/L	2022-08-08	2.8	23
Alkalinity as CaCO ₃	mg/L	2022-08-15	2.8	23
Alkalinity as CaCO ₃	mg/L	2022-08-22	2.9	20
Alkalinity as CaCO ₃	mg/L	2022-08-23	-	21
Alkalinity as CaCO ₃	mg/L	2022-08-29	3.1	22
Alkalinity as CaCO ₃	mg/L	2022-09-06	3.4	23
Alkalinity as CaCO ₃	mg/L	2022-09-12	3.4	21
Alkalinity as CaCO ₃	mg/L	2022-09-20	3.6	23
Alkalinity as CaCO ₃	mg/L	2022-09-26	3.8	21

Analysis - Capilano	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-10-03	4.0	23
Alkalinity as CaCO ₃	mg/L	2022-10-11	4.0	23
Alkalinity as CaCO ₃	mg/L	2022-10-17	4.0	21
Alkalinity as CaCO ₃	mg/L	2022-10-24	4.3	20
Alkalinity as CaCO ₃	mg/L	2022-10-31	3.0	18
Alkalinity as CaCO ₃	mg/L	2022-11-07	3.0	20
Alkalinity as CaCO ₃	mg/L	2022-11-14	2.9	23
Alkalinity as CaCO ₃	mg/L	2022-11-15	-	20
Alkalinity as CaCO ₃	mg/L	2022-11-21	3.2	21
Alkalinity as CaCO ₃	mg/L	2022-11-28	3.4	21
Alkalinity as CaCO ₃	mg/L	2022-12-05	3.2	20
Alkalinity as CaCO ₃	mg/L	2022-12-12	3.0	20
Alkalinity as CaCO ₃	mg/L	2022-12-19	3.2	20
Aluminum Dissolved	µg/L	2022-02-14	64	35
Aluminum Dissolved	µg/L	2022-04-04	68	23
Aluminum Dissolved	µg/L	2022-05-02	55	20
Aluminum Dissolved	µg/L	2022-07-04	67	24
Aluminum Dissolved	µg/L	2022-09-12	41	20
Aluminum Dissolved	µg/L	2022-11-07	61	32
Aluminum Total	µg/L	2022-01-04	234	42
Aluminum Total	µg/L	2022-01-10	261	41
Aluminum Total	µg/L	2022-01-17	450	51
Aluminum Total	µg/L	2022-01-24	327	48
Aluminum Total	µg/L	2022-01-31	226	41
Aluminum Total	µg/L	2022-02-07	149	42
Aluminum Total	µg/L	2022-02-14	141	37
Aluminum Total	µg/L	2022-02-17	-	41
Aluminum Total	µg/L	2022-02-22	196	38
Aluminum Total	µg/L	2022-02-28	124	33
Aluminum Total	µg/L	2022-03-07	170	32
Aluminum Total	µg/L	2022-03-14	133	30
Aluminum Total	µg/L	2022-03-21	166	29
Aluminum Total	µg/L	2022-03-28	140	31
Aluminum Total	µg/L	2022-04-04	146	26
Aluminum Total	µg/L	2022-04-11	155	28
Aluminum Total	µg/L	2022-04-19	149	25
Aluminum Total	µg/L	2022-04-25	131	24
Aluminum Total	µg/L	2022-05-02	110	21
Aluminum Total	µg/L	2022-05-04	105	21
Aluminum Total	µg/L	2022-05-09	90	23
Aluminum Total	µg/L	2022-05-10	-	23
Aluminum Total	µg/L	2022-05-16	98	21

Analysis - Capilano	Units	Date Sampled	Source	Treated
Aluminum Total	µg/L	2022-05-24	109	25
Aluminum Total	µg/L	2022-05-30	146	34
Aluminum Total	µg/L	2022-06-06	111	24
Aluminum Total	µg/L	2022-06-13	118	31
Aluminum Total	µg/L	2022-06-20	115	29
Aluminum Total	µg/L	2022-06-27	92	33
Aluminum Total	µg/L	2022-07-04	86	26
Aluminum Total	µg/L	2022-07-11	81	27
Aluminum Total	µg/L	2022-07-18	72	23
Aluminum Total	µg/L	2022-07-25	72	22
Aluminum Total	µg/L	2022-08-02	69	23
Aluminum Total	µg/L	2022-08-08	70	24
Aluminum Total	µg/L	2022-08-15	69	25
Aluminum Total	µg/L	2022-08-22	67	22
Aluminum Total	µg/L	2022-08-23	-	24
Aluminum Total	µg/L	2022-08-29	70	26
Aluminum Total	µg/L	2022-09-06	67	26
Aluminum Total	µg/L	2022-09-12	67	22
Aluminum Total	µg/L	2022-09-20	68	21
Aluminum Total	µg/L	2022-09-26	63	22
Aluminum Total	µg/L	2022-10-03	47	40
Aluminum Total	µg/L	2022-10-11	46	22
Aluminum Total	µg/L	2022-10-17	48	19
Aluminum Total	µg/L	2022-10-24	40	18
Aluminum Total	µg/L	2022-10-31	296	33
Aluminum Total	µg/L	2022-11-07	161	35
Aluminum Total	µg/L	2022-11-08	114	35
Aluminum Total	µg/L	2022-11-14	120	33
Aluminum Total	µg/L	2022-11-15	-	32
Aluminum Total	µg/L	2022-11-21	122	30
Aluminum Total	µg/L	2022-11-28	110	30
Aluminum Total	µg/L	2022-12-05	105	31
Aluminum Total	µg/L	2022-12-12	93	32
Aluminum Total	µg/L	2022-12-19	87	33
Antimony Total	µg/L	2022-02-17	-	<0.5
Antimony Total	µg/L	2022-05-02	<0.5	<0.5
Antimony Total	µg/L	2022-05-04	<0.5	<0.5
Antimony Total	µg/L	2022-05-10	-	<0.5
Antimony Total	µg/L	2022-08-23	-	<0.5
Antimony Total	µg/L	2022-11-07	<0.5	<0.5
Antimony Total	µg/L	2022-11-08	<0.5	<0.5
Antimony Total	µg/L	2022-11-15	-	<0.5

Analysis - Capilano	Units	Date Sampled	Source	Treated
Arsenic Total	µg/L	2022-02-17	-	<0.5
Arsenic Total	µg/L	2022-05-02	<0.5	<0.5
Arsenic Total	µg/L	2022-05-04	<0.5	<0.5
Arsenic Total	µg/L	2022-05-10	-	<0.5
Arsenic Total	µg/L	2022-08-23	-	<0.5
Arsenic Total	µg/L	2022-11-07	<0.5	<0.5
Arsenic Total	µg/L	2022-11-08	<0.5	<0.5
Arsenic Total	µg/L	2022-11-15	-	<0.5
Barium Total	µg/L	2022-02-17	-	2.5
Barium Total	µg/L	2022-05-02	2.7	2.6
Barium Total	µg/L	2022-05-04	2.4	2.7
Barium Total	µg/L	2022-05-10	-	3.0
Barium Total	µg/L	2022-08-23	-	2.6
Barium Total	µg/L	2022-11-07	0.8	2.6
Barium Total	µg/L	2022-11-08	3.5	3.5
Barium Total	µg/L	2022-11-15	-	3.3
Boron Total	µg/L	2022-02-17	-	<10
Boron Total	µg/L	2022-05-02	<10	<10
Boron Total	µg/L	2022-05-04	<10	<10
Boron Total	µg/L	2022-05-10	-	<10
Boron Total	µg/L	2022-08-23	-	<10
Boron Total	µg/L	2022-11-07	<10	<10
Boron Total	µg/L	2022-11-08	<10	<10
Boron Total	µg/L	2022-11-15	-	<10
Bromate	µg/L	2022-02-17	<10.0	<10.0
Bromate	µg/L	2022-05-10	<10.0	<10.0
Bromate	µg/L	2022-08-23	<10.0	<10.0
Bromate	µg/L	2022-11-15	-	<10.0
Bromate	µg/L	2022-11-17	<10.0	-
Bromide	µg/L	2022-02-17	<10.0	<10.0
Bromide	µg/L	2022-05-10	<10.0	<10.0
Bromide	µg/L	2022-08-23	<10.0	<10.0
Bromide	µg/L	2022-11-15	-	<10.0
Bromide	µg/L	2022-11-17	<10.0	-
Bromodichloromethane	µg/L	2022-02-17	<1	<1
Bromodichloromethane	µg/L	2022-05-10	<1	<1
Bromodichloromethane	µg/L	2022-11-15	-	<1
Bromodichloromethane	µg/L	2022-11-17	<1	-
Bromoform	µg/L	2022-02-17	<1	<1
Bromoform	µg/L	2022-05-10	<1	<1
Bromoform	µg/L	2022-11-15	-	<1
Bromoform	µg/L	2022-11-17	<1	-

Analysis - Capilano	Units	Date Sampled	Source	Treated
Cadmium Total	µg/L	2022-02-17	-	<0.2
Cadmium Total	µg/L	2022-05-02	<0.2	<0.2
Cadmium Total	µg/L	2022-05-04	<0.2	<0.2
Cadmium Total	µg/L	2022-05-10	-	<0.2
Cadmium Total	µg/L	2022-08-23	-	<0.2
Cadmium Total	µg/L	2022-11-07	<0.2	<0.2
Cadmium Total	µg/L	2022-11-08	<0.2	<0.2
Cadmium Total	µg/L	2022-11-15	-	<0.2
Calcium Total	µg/L	2022-01-04	1,070	8,710
Calcium Total	µg/L	2022-02-07	1,120	9,280
Calcium Total	µg/L	2022-02-14	1,100	7,960
Calcium Total	µg/L	2022-02-17	-	7,560
Calcium Total	µg/L	2022-03-07	1,220	8,320
Calcium Total	µg/L	2022-04-04	1,180	7,820
Calcium Total	µg/L	2022-05-02	1,220	8,340
Calcium Total	µg/L	2022-05-04	1,230	8,980
Calcium Total	µg/L	2022-05-10	-	9,100
Calcium Total	µg/L	2022-06-06	1,030	7,990
Calcium Total	µg/L	2022-07-04	983	9,120
Calcium Total	µg/L	2022-08-08	1,020	8,720
Calcium Total	µg/L	2022-08-23	-	7,980
Calcium Total	µg/L	2022-09-12	1,160	8,190
Calcium Total	µg/L	2022-10-11	1,430	8,790
Calcium Total	µg/L	2022-11-07	1,470	8,360
Calcium Total	µg/L	2022-11-08	1,360	8,230
Calcium Total	µg/L	2022-11-15	-	8,390
Calcium Total	µg/L	2022-12-05	1,420	8,280
Carbon Organic - Dissolved	mg/L	2022-01-04	1.8	0.6
Carbon Organic - Dissolved	mg/L	2022-01-10	1.7	0.6
Carbon Organic - Dissolved	mg/L	2022-01-17	1.9	0.6
Carbon Organic - Dissolved	mg/L	2022-01-24	1.8	0.6
Carbon Organic - Dissolved	mg/L	2022-01-31	1.6	0.5
Carbon Organic - Dissolved	mg/L	2022-02-07	1.7	0.7
Carbon Organic - Dissolved	mg/L	2022-02-14	1.6	0.6
Carbon Organic - Dissolved	mg/L	2022-02-22	1.5	0.6
Carbon Organic - Dissolved	mg/L	2022-02-28	1.4	0.6
Carbon Organic - Dissolved	mg/L	2022-03-07	1.5	0.6
Carbon Organic - Dissolved	mg/L	2022-03-14	1.6	0.6
Carbon Organic - Dissolved	mg/L	2022-03-21	1.5	0.6
Carbon Organic - Dissolved	mg/L	2022-03-28	1.5	0.6
Carbon Organic - Dissolved	mg/L	2022-04-04	1.6	0.6
Carbon Organic - Dissolved	mg/L	2022-04-11	1.5	0.6

Analysis - Capilano	Units	Date Sampled	Source	Treated
Carbon Organic - Dissolved	mg/L	2022-04-19	1.5	0.6
Carbon Organic - Dissolved	mg/L	2022-04-25	1.5	0.6
Carbon Organic - Dissolved	mg/L	2022-05-02	1.4	0.6
Carbon Organic - Dissolved	mg/L	2022-05-09	1.4	0.5
Carbon Organic - Dissolved	mg/L	2022-05-16	1.5	0.6
Carbon Organic - Dissolved	mg/L	2022-05-24	1.6	0.6
Carbon Organic - Dissolved	mg/L	2022-05-30	1.6	0.6
Carbon Organic - Dissolved	mg/L	2022-06-06	1.7	0.5
Carbon Organic - Dissolved	mg/L	2022-06-13	1.8	0.6
Carbon Organic - Dissolved	mg/L	2022-06-20	1.7	0.5
Carbon Organic - Dissolved	mg/L	2022-06-27	1.6	0.6
Carbon Organic - Dissolved	mg/L	2022-07-04	1.6	0.5
Carbon Organic - Dissolved	mg/L	2022-07-11	1.5	0.5
Carbon Organic - Dissolved	mg/L	2022-07-18	1.4	0.5
Carbon Organic - Dissolved	mg/L	2022-07-25	1.4	0.5
Carbon Organic - Dissolved	mg/L	2022-08-02	1.3	0.5
Carbon Organic - Dissolved	mg/L	2022-08-08	1.3	0.5
Carbon Organic - Dissolved	mg/L	2022-08-15	1.3	0.4
Carbon Organic - Dissolved	mg/L	2022-08-22	1.2	0.5
Carbon Organic - Dissolved	mg/L	2022-08-29	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-09-06	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-09-12	1.2	0.5
Carbon Organic - Dissolved	mg/L	2022-09-20	1.2	0.5
Carbon Organic - Dissolved	mg/L	2022-09-26	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-10-03	1.1	0.6
Carbon Organic - Dissolved	mg/L	2022-10-11	1.1	0.5
Carbon Organic - Dissolved	mg/L	2022-10-17	1.0	0.6
Carbon Organic - Dissolved	mg/L	2022-10-24	1.1	0.5
Carbon Organic - Dissolved	mg/L	2022-10-31	1.8	0.8
Carbon Organic - Dissolved	mg/L	2022-11-07	1.7	0.9
Carbon Organic - Dissolved	mg/L	2022-11-14	1.9	0.9
Carbon Organic - Dissolved	mg/L	2022-11-21	1.5	0.7
Carbon Organic - Dissolved	mg/L	2022-11-28	1.5	0.7
Carbon Organic - Dissolved	mg/L	2022-12-05	1.6	0.7
Carbon Organic - Dissolved	mg/L	2022-12-12	1.5	0.7
Carbon Organic - Dissolved	mg/L	2022-12-19	1.5	0.7
Carbon Organic - Total	mg/L	2022-01-04	1.8	0.6
Carbon Organic - Total	mg/L	2022-01-10	1.7	0.6
Carbon Organic - Total	mg/L	2022-01-17	1.9	0.6
Carbon Organic - Total	mg/L	2022-01-24	1.8	0.6
Carbon Organic - Total	mg/L	2022-01-31	1.6	0.5
Carbon Organic - Total	mg/L	2022-02-07	1.7	0.6

Analysis - Capilano	Units	Date Sampled	Source	Treated
Carbon Organic - Total	mg/L	2022-02-14	1.6	0.5
Carbon Organic - Total	mg/L	2022-02-22	1.5	0.6
Carbon Organic - Total	mg/L	2022-02-28	1.4	0.6
Carbon Organic - Total	mg/L	2022-03-07	1.5	0.6
Carbon Organic - Total	mg/L	2022-03-14	1.6	0.6
Carbon Organic - Total	mg/L	2022-03-21	1.6	0.6
Carbon Organic - Total	mg/L	2022-03-28	1.5	0.6
Carbon Organic - Total	mg/L	2022-04-04	1.6	0.6
Carbon Organic - Total	mg/L	2022-04-11	1.5	0.6
Carbon Organic - Total	mg/L	2022-04-19	1.5	0.6
Carbon Organic - Total	mg/L	2022-04-25	1.5	0.6
Carbon Organic - Total	mg/L	2022-05-02	1.4	0.6
Carbon Organic - Total	mg/L	2022-05-09	1.4	0.5
Carbon Organic - Total	mg/L	2022-05-16	1.5	0.6
Carbon Organic - Total	mg/L	2022-05-24	1.6	0.6
Carbon Organic - Total	mg/L	2022-05-30	1.7	0.6
Carbon Organic - Total	mg/L	2022-06-06	1.7	0.5
Carbon Organic - Total	mg/L	2022-06-13	1.9	0.6
Carbon Organic - Total	mg/L	2022-06-20	1.8	0.6
Carbon Organic - Total	mg/L	2022-06-27	1.6	0.6
Carbon Organic - Total	mg/L	2022-07-04	1.5	0.5
Carbon Organic - Total	mg/L	2022-07-11	1.5	0.5
Carbon Organic - Total	mg/L	2022-07-18	1.4	0.5
Carbon Organic - Total	mg/L	2022-07-25	1.3	0.5
Carbon Organic - Total	mg/L	2022-08-02	1.3	0.5
Carbon Organic - Total	mg/L	2022-08-08	1.3	0.5
Carbon Organic - Total	mg/L	2022-08-15	1.3	0.4
Carbon Organic - Total	mg/L	2022-08-22	1.3	0.5
Carbon Organic - Total	mg/L	2022-08-29	1.2	0.5
Carbon Organic - Total	mg/L	2022-09-06	1.2	0.5
Carbon Organic - Total	mg/L	2022-09-12	1.2	0.6
Carbon Organic - Total	mg/L	2022-09-20	1.2	0.5
Carbon Organic - Total	mg/L	2022-09-26	1.2	0.6
Carbon Organic - Total	mg/L	2022-10-03	1.1	0.6
Carbon Organic - Total	mg/L	2022-10-11	1.1	0.5
Carbon Organic - Total	mg/L	2022-10-17	1.1	0.5
Carbon Organic - Total	mg/L	2022-10-24	1.1	0.6
Carbon Organic - Total	mg/L	2022-10-31	1.9	0.8
Carbon Organic - Total	mg/L	2022-11-07	1.7	0.9
Carbon Organic - Total	mg/L	2022-11-14	1.8	0.9
Carbon Organic - Total	mg/L	2022-11-21	1.5	0.7
Carbon Organic - Total	mg/L	2022-11-28	1.6	0.8

Analysis - Capilano	Units	Date Sampled	Source	Treated
Carbon Organic - Total	mg/L	2022-12-05	1.6	0.8
Carbon Organic - Total	mg/L	2022-12-12	1.6	0.7
Carbon Organic - Total	mg/L	2022-12-19	1.6	0.7
Chlorate	µg/L	2022-02-17	<10.0	19.8
Chlorate	µg/L	2022-05-10	<10.0	16.2
Chlorate	µg/L	2022-08-23	<10.0	40.6
Chlorate	µg/L	2022-11-15	-	21.6
Chlorate	µg/L	2022-11-17	<10.0	-
Chloride	mg/L	2022-01-04	<0.5	2.3
Chloride	mg/L	2022-02-07	<0.5	2.2
Chloride	mg/L	2022-02-17	<0.5	2.3
Chloride	mg/L	2022-03-07	<0.5	2.2
Chloride	mg/L	2022-04-04	<0.5	2.2
Chloride	mg/L	2022-05-02	<0.5	2.1
Chloride	mg/L	2022-05-10	<0.5	2.2
Chloride	mg/L	2022-06-06	<0.5	2.2
Chloride	mg/L	2022-07-04	<0.5	2.3
Chloride	mg/L	2022-08-08	<0.5	2.3
Chloride	mg/L	2022-08-23	<0.5	2.3
Chloride	mg/L	2022-09-12	<0.5	2.1
Chloride	mg/L	2022-10-11	<0.5	2.4
Chloride	mg/L	2022-11-07	0.7	2.9
Chloride	mg/L	2022-11-15	-	2.8
Chloride	mg/L	2022-11-17	0.7	-
Chloride	mg/L	2022-12-05	0.7	2.6
Chlorine Free	mg/L	2022-01-01	-	0.89
Chlorine Free	mg/L	2022-01-02	-	0.73
Chlorine Free	mg/L	2022-01-03	-	0.85
Chlorine Free	mg/L	2022-01-04	-	0.78
Chlorine Free	mg/L	2022-01-05	-	0.83
Chlorine Free	mg/L	2022-01-06	-	0.73
Chlorine Free	mg/L	2022-01-07	-	0.76
Chlorine Free	mg/L	2022-01-08	-	0.82
Chlorine Free	mg/L	2022-01-09	-	0.73
Chlorine Free	mg/L	2022-01-10	-	0.81
Chlorine Free	mg/L	2022-01-11	-	0.80
Chlorine Free	mg/L	2022-01-12	-	0.82
Chlorine Free	mg/L	2022-01-13	-	0.87
Chlorine Free	mg/L	2022-01-14	-	0.74
Chlorine Free	mg/L	2022-01-15	-	0.81
Chlorine Free	mg/L	2022-01-16	-	0.74
Chlorine Free	mg/L	2022-01-17	-	0.78

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-01-18	-	0.79
Chlorine Free	mg/L	2022-01-19	-	0.72
Chlorine Free	mg/L	2022-01-20	-	0.76
Chlorine Free	mg/L	2022-01-21	-	0.83
Chlorine Free	mg/L	2022-01-22	-	0.75
Chlorine Free	mg/L	2022-01-23	-	0.72
Chlorine Free	mg/L	2022-01-24	-	0.72
Chlorine Free	mg/L	2022-01-25	-	0.79
Chlorine Free	mg/L	2022-01-26	-	0.79
Chlorine Free	mg/L	2022-01-27	-	1.09
Chlorine Free	mg/L	2022-01-28	-	0.81
Chlorine Free	mg/L	2022-01-29	-	0.89
Chlorine Free	mg/L	2022-01-30	-	0.71
Chlorine Free	mg/L	2022-01-31	-	0.76
Chlorine Free	mg/L	2022-02-01	-	0.79
Chlorine Free	mg/L	2022-02-02	-	0.83
Chlorine Free	mg/L	2022-02-03	-	0.74
Chlorine Free	mg/L	2022-02-04	-	0.74
Chlorine Free	mg/L	2022-02-05	-	0.84
Chlorine Free	mg/L	2022-02-06	-	0.81
Chlorine Free	mg/L	2022-02-07	-	0.76
Chlorine Free	mg/L	2022-02-08	-	0.74
Chlorine Free	mg/L	2022-02-09	-	0.79
Chlorine Free	mg/L	2022-02-10	-	0.83
Chlorine Free	mg/L	2022-02-11	-	0.72
Chlorine Free	mg/L	2022-02-12	-	0.83
Chlorine Free	mg/L	2022-02-13	-	0.72
Chlorine Free	mg/L	2022-02-14	-	0.72
Chlorine Free	mg/L	2022-02-15	-	0.75
Chlorine Free	mg/L	2022-02-16	-	0.68
Chlorine Free	mg/L	2022-02-17	-	0.74
Chlorine Free	mg/L	2022-02-18	-	0.86
Chlorine Free	mg/L	2022-02-19	-	0.74
Chlorine Free	mg/L	2022-02-20	-	0.77
Chlorine Free	mg/L	2022-02-21	-	0.78
Chlorine Free	mg/L	2022-02-22	-	0.75
Chlorine Free	mg/L	2022-02-23	-	0.76
Chlorine Free	mg/L	2022-02-24	-	0.78
Chlorine Free	mg/L	2022-02-25	-	0.77
Chlorine Free	mg/L	2022-02-26	-	0.78
Chlorine Free	mg/L	2022-02-27	-	0.80
Chlorine Free	mg/L	2022-02-28	-	0.77

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-03-01	-	0.75
Chlorine Free	mg/L	2022-03-02	-	0.79
Chlorine Free	mg/L	2022-03-03	-	0.79
Chlorine Free	mg/L	2022-03-04	-	0.73
Chlorine Free	mg/L	2022-03-05	-	0.81
Chlorine Free	mg/L	2022-03-06	-	0.81
Chlorine Free	mg/L	2022-03-07	-	0.79
Chlorine Free	mg/L	2022-03-08	-	0.77
Chlorine Free	mg/L	2022-03-09	-	0.81
Chlorine Free	mg/L	2022-03-10	-	0.74
Chlorine Free	mg/L	2022-03-11	-	0.77
Chlorine Free	mg/L	2022-03-12	-	0.89
Chlorine Free	mg/L	2022-03-13	-	0.77
Chlorine Free	mg/L	2022-03-14	-	0.75
Chlorine Free	mg/L	2022-03-15	-	0.79
Chlorine Free	mg/L	2022-03-16	-	0.80
Chlorine Free	mg/L	2022-03-17	-	0.83
Chlorine Free	mg/L	2022-03-18	-	0.80
Chlorine Free	mg/L	2022-03-19	-	0.74
Chlorine Free	mg/L	2022-03-20	-	0.77
Chlorine Free	mg/L	2022-03-21	-	0.73
Chlorine Free	mg/L	2022-03-22	-	0.77
Chlorine Free	mg/L	2022-03-23	-	0.77
Chlorine Free	mg/L	2022-03-24	-	0.79
Chlorine Free	mg/L	2022-03-25	-	0.80
Chlorine Free	mg/L	2022-03-26	-	0.78
Chlorine Free	mg/L	2022-03-27	-	0.77
Chlorine Free	mg/L	2022-03-28	-	0.75
Chlorine Free	mg/L	2022-03-29	-	0.77
Chlorine Free	mg/L	2022-03-30	-	0.83
Chlorine Free	mg/L	2022-03-31	-	0.77
Chlorine Free	mg/L	2022-04-01	-	0.83
Chlorine Free	mg/L	2022-04-02	-	0.80
Chlorine Free	mg/L	2022-04-03	-	0.76
Chlorine Free	mg/L	2022-04-04	-	0.75
Chlorine Free	mg/L	2022-04-05	-	0.79
Chlorine Free	mg/L	2022-04-06	-	0.78
Chlorine Free	mg/L	2022-04-07	-	0.80
Chlorine Free	mg/L	2022-04-08	-	0.89
Chlorine Free	mg/L	2022-04-09	-	0.74
Chlorine Free	mg/L	2022-04-10	-	0.73
Chlorine Free	mg/L	2022-04-11	-	0.74

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-04-12	-	0.79
Chlorine Free	mg/L	2022-04-13	-	0.73
Chlorine Free	mg/L	2022-04-14	-	0.83
Chlorine Free	mg/L	2022-04-15	-	0.76
Chlorine Free	mg/L	2022-04-16	-	0.83
Chlorine Free	mg/L	2022-04-17	-	0.81
Chlorine Free	mg/L	2022-04-18	-	0.81
Chlorine Free	mg/L	2022-04-19	-	0.76
Chlorine Free	mg/L	2022-04-20	-	0.80
Chlorine Free	mg/L	2022-04-21	-	0.77
Chlorine Free	mg/L	2022-04-22	-	0.79
Chlorine Free	mg/L	2022-04-23	-	0.91
Chlorine Free	mg/L	2022-04-24	-	0.82
Chlorine Free	mg/L	2022-04-25	-	0.70
Chlorine Free	mg/L	2022-04-26	-	0.77
Chlorine Free	mg/L	2022-04-27	-	0.62
Chlorine Free	mg/L	2022-04-28	-	0.74
Chlorine Free	mg/L	2022-04-29	-	0.77
Chlorine Free	mg/L	2022-04-30	-	0.64
Chlorine Free	mg/L	2022-05-01	-	0.79
Chlorine Free	mg/L	2022-05-02	-	0.76
Chlorine Free	mg/L	2022-05-03	-	0.75
Chlorine Free	mg/L	2022-05-04	-	0.72
Chlorine Free	mg/L	2022-05-05	-	0.75
Chlorine Free	mg/L	2022-05-06	-	0.73
Chlorine Free	mg/L	2022-05-07	-	0.78
Chlorine Free	mg/L	2022-05-08	-	0.78
Chlorine Free	mg/L	2022-05-09	-	0.75
Chlorine Free	mg/L	2022-05-10	-	0.77
Chlorine Free	mg/L	2022-05-11	-	0.77
Chlorine Free	mg/L	2022-05-12	-	0.75
Chlorine Free	mg/L	2022-05-13	-	0.72
Chlorine Free	mg/L	2022-05-14	-	0.77
Chlorine Free	mg/L	2022-05-15	-	0.80
Chlorine Free	mg/L	2022-05-16	-	0.80
Chlorine Free	mg/L	2022-05-17	-	0.85
Chlorine Free	mg/L	2022-05-18	-	0.84
Chlorine Free	mg/L	2022-05-19	-	0.79
Chlorine Free	mg/L	2022-05-20	-	0.77
Chlorine Free	mg/L	2022-05-21	-	0.69
Chlorine Free	mg/L	2022-05-22	-	0.73
Chlorine Free	mg/L	2022-05-23	-	0.76

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-05-24	-	0.70
Chlorine Free	mg/L	2022-05-25	-	0.64
Chlorine Free	mg/L	2022-05-26	-	0.69
Chlorine Free	mg/L	2022-05-27	-	0.82
Chlorine Free	mg/L	2022-05-28	-	0.76
Chlorine Free	mg/L	2022-05-29	-	0.76
Chlorine Free	mg/L	2022-05-30	-	0.71
Chlorine Free	mg/L	2022-05-31	-	0.77
Chlorine Free	mg/L	2022-06-01	-	0.76
Chlorine Free	mg/L	2022-06-02	-	0.73
Chlorine Free	mg/L	2022-06-03	-	0.79
Chlorine Free	mg/L	2022-06-04	-	0.64
Chlorine Free	mg/L	2022-06-05	-	0.63
Chlorine Free	mg/L	2022-06-06	-	0.72
Chlorine Free	mg/L	2022-06-07	-	0.67
Chlorine Free	mg/L	2022-06-08	-	0.76
Chlorine Free	mg/L	2022-06-09	-	0.76
Chlorine Free	mg/L	2022-06-10	-	0.78
Chlorine Free	mg/L	2022-06-11	-	0.76
Chlorine Free	mg/L	2022-06-12	-	0.74
Chlorine Free	mg/L	2022-06-13	-	0.70
Chlorine Free	mg/L	2022-06-14	-	0.82
Chlorine Free	mg/L	2022-06-15	-	0.79
Chlorine Free	mg/L	2022-06-16	-	0.74
Chlorine Free	mg/L	2022-06-17	-	0.76
Chlorine Free	mg/L	2022-06-18	-	0.78
Chlorine Free	mg/L	2022-06-19	-	0.75
Chlorine Free	mg/L	2022-06-20	-	0.75
Chlorine Free	mg/L	2022-06-21	-	0.75
Chlorine Free	mg/L	2022-06-22	-	0.85
Chlorine Free	mg/L	2022-06-23	-	0.71
Chlorine Free	mg/L	2022-06-24	-	0.76
Chlorine Free	mg/L	2022-06-25	-	0.79
Chlorine Free	mg/L	2022-06-26	-	0.79
Chlorine Free	mg/L	2022-06-27	-	0.76
Chlorine Free	mg/L	2022-06-28	-	0.79
Chlorine Free	mg/L	2022-06-29	-	0.76
Chlorine Free	mg/L	2022-06-30	-	0.79
Chlorine Free	mg/L	2022-07-01	-	0.79
Chlorine Free	mg/L	2022-07-02	-	0.74
Chlorine Free	mg/L	2022-07-03	-	0.76
Chlorine Free	mg/L	2022-07-04	-	0.73

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-07-05	-	0.74
Chlorine Free	mg/L	2022-07-06	-	0.70
Chlorine Free	mg/L	2022-07-07	-	0.78
Chlorine Free	mg/L	2022-07-08	-	0.79
Chlorine Free	mg/L	2022-07-09	-	0.80
Chlorine Free	mg/L	2022-07-10	-	0.81
Chlorine Free	mg/L	2022-07-11	-	0.80
Chlorine Free	mg/L	2022-07-12	-	0.76
Chlorine Free	mg/L	2022-07-13	-	0.78
Chlorine Free	mg/L	2022-07-14	-	0.75
Chlorine Free	mg/L	2022-07-15	-	0.81
Chlorine Free	mg/L	2022-07-16	-	0.74
Chlorine Free	mg/L	2022-07-17	-	0.78
Chlorine Free	mg/L	2022-07-18	-	0.75
Chlorine Free	mg/L	2022-07-19	-	0.77
Chlorine Free	mg/L	2022-07-20	-	0.70
Chlorine Free	mg/L	2022-07-21	-	0.74
Chlorine Free	mg/L	2022-07-22	-	0.93
Chlorine Free	mg/L	2022-07-23	-	0.82
Chlorine Free	mg/L	2022-07-24	-	0.80
Chlorine Free	mg/L	2022-07-25	-	0.82
Chlorine Free	mg/L	2022-07-26	-	0.80
Chlorine Free	mg/L	2022-07-27	-	0.80
Chlorine Free	mg/L	2022-07-28	-	0.77
Chlorine Free	mg/L	2022-07-29	-	0.78
Chlorine Free	mg/L	2022-07-30	-	0.76
Chlorine Free	mg/L	2022-07-31	-	0.82
Chlorine Free	mg/L	2022-08-01	-	0.79
Chlorine Free	mg/L	2022-08-02	-	0.80
Chlorine Free	mg/L	2022-08-03	-	0.79
Chlorine Free	mg/L	2022-08-04	-	0.80
Chlorine Free	mg/L	2022-08-05	-	0.72
Chlorine Free	mg/L	2022-08-06	-	0.81
Chlorine Free	mg/L	2022-08-07	-	0.76
Chlorine Free	mg/L	2022-08-08	-	0.83
Chlorine Free	mg/L	2022-08-09	-	0.79
Chlorine Free	mg/L	2022-08-10	-	0.74
Chlorine Free	mg/L	2022-08-11	-	0.82
Chlorine Free	mg/L	2022-08-12	-	0.81
Chlorine Free	mg/L	2022-08-13	-	0.82
Chlorine Free	mg/L	2022-08-14	-	0.78
Chlorine Free	mg/L	2022-08-15	-	0.77

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-08-16	-	0.77
Chlorine Free	mg/L	2022-08-17	-	0.83
Chlorine Free	mg/L	2022-08-18	-	0.78
Chlorine Free	mg/L	2022-08-19	-	0.77
Chlorine Free	mg/L	2022-08-20	-	0.75
Chlorine Free	mg/L	2022-08-21	-	0.74
Chlorine Free	mg/L	2022-08-22	-	0.76
Chlorine Free	mg/L	2022-08-23	-	0.74
Chlorine Free	mg/L	2022-08-24	-	0.77
Chlorine Free	mg/L	2022-08-25	-	0.72
Chlorine Free	mg/L	2022-08-26	-	0.67
Chlorine Free	mg/L	2022-08-27	-	0.78
Chlorine Free	mg/L	2022-08-28	-	0.77
Chlorine Free	mg/L	2022-08-29	-	0.74
Chlorine Free	mg/L	2022-08-30	-	0.77
Chlorine Free	mg/L	2022-08-31	-	0.78
Chlorine Free	mg/L	2022-09-01	-	0.77
Chlorine Free	mg/L	2022-09-02	-	0.72
Chlorine Free	mg/L	2022-09-03	-	0.74
Chlorine Free	mg/L	2022-09-04	-	0.76
Chlorine Free	mg/L	2022-09-05	-	0.74
Chlorine Free	mg/L	2022-09-06	-	0.77
Chlorine Free	mg/L	2022-09-07	-	0.74
Chlorine Free	mg/L	2022-09-08	-	0.73
Chlorine Free	mg/L	2022-09-09	-	0.72
Chlorine Free	mg/L	2022-09-10	-	0.77
Chlorine Free	mg/L	2022-09-11	-	0.68
Chlorine Free	mg/L	2022-09-12	-	0.72
Chlorine Free	mg/L	2022-09-13	-	0.77
Chlorine Free	mg/L	2022-09-14	-	0.71
Chlorine Free	mg/L	2022-09-15	-	0.73
Chlorine Free	mg/L	2022-09-16	-	0.76
Chlorine Free	mg/L	2022-09-17	-	0.77
Chlorine Free	mg/L	2022-09-18	-	0.76
Chlorine Free	mg/L	2022-09-19	-	0.75
Chlorine Free	mg/L	2022-09-20	-	0.86
Chlorine Free	mg/L	2022-09-21	-	0.77
Chlorine Free	mg/L	2022-09-22	-	0.79
Chlorine Free	mg/L	2022-09-23	-	0.79
Chlorine Free	mg/L	2022-09-24	-	0.71
Chlorine Free	mg/L	2022-09-25	-	0.71
Chlorine Free	mg/L	2022-09-26	-	0.85

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-09-27	-	0.82
Chlorine Free	mg/L	2022-09-28	-	0.85
Chlorine Free	mg/L	2022-09-29	-	0.85
Chlorine Free	mg/L	2022-09-30	-	0.84
Chlorine Free	mg/L	2022-10-01	-	0.82
Chlorine Free	mg/L	2022-10-02	-	0.79
Chlorine Free	mg/L	2022-10-03	-	0.75
Chlorine Free	mg/L	2022-10-04	-	0.81
Chlorine Free	mg/L	2022-10-05	-	0.81
Chlorine Free	mg/L	2022-10-06	-	0.82
Chlorine Free	mg/L	2022-10-07	-	0.74
Chlorine Free	mg/L	2022-10-08	-	0.79
Chlorine Free	mg/L	2022-10-09	-	0.80
Chlorine Free	mg/L	2022-10-10	-	0.78
Chlorine Free	mg/L	2022-10-11	-	0.86
Chlorine Free	mg/L	2022-10-12	-	1.17
Chlorine Free	mg/L	2022-10-13	-	1.05
Chlorine Free	mg/L	2022-10-14	-	0.79
Chlorine Free	mg/L	2022-10-15	-	0.81
Chlorine Free	mg/L	2022-10-16	-	0.85
Chlorine Free	mg/L	2022-10-17	-	0.92
Chlorine Free	mg/L	2022-10-18	-	0.80
Chlorine Free	mg/L	2022-10-19	-	0.81
Chlorine Free	mg/L	2022-10-20	-	0.97
Chlorine Free	mg/L	2022-10-21	-	0.81
Chlorine Free	mg/L	2022-10-22	-	0.87
Chlorine Free	mg/L	2022-10-23	-	0.85
Chlorine Free	mg/L	2022-10-24	-	1.14
Chlorine Free	mg/L	2022-10-25	-	0.77
Chlorine Free	mg/L	2022-10-26	-	0.86
Chlorine Free	mg/L	2022-10-27	-	0.80
Chlorine Free	mg/L	2022-10-28	-	0.82
Chlorine Free	mg/L	2022-10-29	-	0.79
Chlorine Free	mg/L	2022-10-30	-	0.72
Chlorine Free	mg/L	2022-10-31	-	0.70
Chlorine Free	mg/L	2022-11-01	-	0.91
Chlorine Free	mg/L	2022-11-02	-	0.80
Chlorine Free	mg/L	2022-11-03	-	0.7
Chlorine Free	mg/L	2022-11-04	-	0.58
Chlorine Free	mg/L	2022-11-05	-	0.81
Chlorine Free	mg/L	2022-11-06	-	0.92
Chlorine Free	mg/L	2022-11-07	-	0.73

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-11-08	-	0.82
Chlorine Free	mg/L	2022-11-09	-	0.79
Chlorine Free	mg/L	2022-11-10	-	0.82
Chlorine Free	mg/L	2022-11-11	-	0.81
Chlorine Free	mg/L	2022-11-12	-	0.82
Chlorine Free	mg/L	2022-11-13	-	0.77
Chlorine Free	mg/L	2022-11-14	-	0.85
Chlorine Free	mg/L	2022-11-15	-	0.80
Chlorine Free	mg/L	2022-11-16	-	0.83
Chlorine Free	mg/L	2022-11-17	-	0.78
Chlorine Free	mg/L	2022-11-18	-	0.78
Chlorine Free	mg/L	2022-11-19	-	0.82
Chlorine Free	mg/L	2022-11-20	-	0.81
Chlorine Free	mg/L	2022-11-21	-	0.75
Chlorine Free	mg/L	2022-11-22	-	0.76
Chlorine Free	mg/L	2022-11-23	-	0.87
Chlorine Free	mg/L	2022-11-24	-	0.89
Chlorine Free	mg/L	2022-11-25	-	0.77
Chlorine Free	mg/L	2022-11-26	-	0.79
Chlorine Free	mg/L	2022-11-27	-	0.81
Chlorine Free	mg/L	2022-11-28	-	0.71
Chlorine Free	mg/L	2022-11-29	-	0.76
Chlorine Free	mg/L	2022-11-30	-	0.85
Chlorine Free	mg/L	2022-12-01	-	0.92
Chlorine Free	mg/L	2022-12-02	-	0.83
Chlorine Free	mg/L	2022-12-03	-	0.92
Chlorine Free	mg/L	2022-12-04	-	0.83
Chlorine Free	mg/L	2022-12-05	-	0.95
Chlorine Free	mg/L	2022-12-06	-	0.83
Chlorine Free	mg/L	2022-12-07	-	0.95
Chlorine Free	mg/L	2022-12-08	-	0.75
Chlorine Free	mg/L	2022-12-09	-	0.74
Chlorine Free	mg/L	2022-12-10	-	0.73
Chlorine Free	mg/L	2022-12-11	-	0.81
Chlorine Free	mg/L	2022-12-12	-	0.75
Chlorine Free	mg/L	2022-12-13	-	0.83
Chlorine Free	mg/L	2022-12-14	-	1.08
Chlorine Free	mg/L	2022-12-15	-	0.90
Chlorine Free	mg/L	2022-12-16	-	0.81
Chlorine Free	mg/L	2022-12-17	-	0.77
Chlorine Free	mg/L	2022-12-18	-	0.85
Chlorine Free	mg/L	2022-12-19	-	0.71

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-12-20	-	1.50
Chlorine Free	mg/L	2022-12-21	-	0.90
Chlorine Free	mg/L	2022-12-22	-	0.69
Chlorine Free	mg/L	2022-12-23	-	0.70
Chlorine Free	mg/L	2022-12-24	-	0.81
Chlorine Free	mg/L	2022-12-26	-	0.80
Chlorine Free	mg/L	2022-12-27	-	0.80
Chlorine Free	mg/L	2022-12-28	-	0.76
Chlorine Free	mg/L	2022-12-29	-	0.73
Chlorine Free	mg/L	2022-12-30	-	0.79
Chlorine Free	mg/L	2022-12-31	-	0.77
Chlorine Total	mg/L	2022-01-01	-	0.91
Chlorine Total	mg/L	2022-01-02	-	0.83
Chlorine Total	mg/L	2022-01-03	-	0.85
Chlorine Total	mg/L	2022-01-04	-	0.80
Chlorine Total	mg/L	2022-01-05	-	0.88
Chlorine Total	mg/L	2022-01-06	-	0.81
Chlorine Total	mg/L	2022-01-07	-	0.81
Chlorine Total	mg/L	2022-01-08	-	0.89
Chlorine Total	mg/L	2022-01-09	-	0.74
Chlorine Total	mg/L	2022-01-10	-	-
Chlorine Total	mg/L	2022-01-11	-	0.81
Chlorine Total	mg/L	2022-01-12	-	0.84
Chlorine Total	mg/L	2022-01-13	-	0.87
Chlorine Total	mg/L	2022-01-14	-	0.75
Chlorine Total	mg/L	2022-01-15	-	0.89
Chlorine Total	mg/L	2022-01-16	-	0.81
Chlorine Total	mg/L	2022-01-17	-	0.89
Chlorine Total	mg/L	2022-01-18	-	0.82
Chlorine Total	mg/L	2022-01-19	-	-
Chlorine Total	mg/L	2022-01-20	-	0.76
Chlorine Total	mg/L	2022-01-21	-	0.92
Chlorine Total	mg/L	2022-01-22	-	0.78
Chlorine Total	mg/L	2022-01-23	-	0.78
Chlorine Total	mg/L	2022-01-24	-	0.78
Chlorine Total	mg/L	2022-01-25	-	0.80
Chlorine Total	mg/L	2022-01-26	-	0.80
Chlorine Total	mg/L	2022-01-27	-	1.10
Chlorine Total	mg/L	2022-01-28	-	0.81
Chlorine Total	mg/L	2022-01-29	-	0.96
Chlorine Total	mg/L	2022-01-30	-	0.77
Chlorine Total	mg/L	2022-01-31	-	0.77

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-02-01	-	0.80
Chlorine Total	mg/L	2022-02-02	-	0.91
Chlorine Total	mg/L	2022-02-03	-	0.74
Chlorine Total	mg/L	2022-02-04	-	0.78
Chlorine Total	mg/L	2022-02-05	-	0.93
Chlorine Total	mg/L	2022-02-06	-	0.82
Chlorine Total	mg/L	2022-02-07	-	0.78
Chlorine Total	mg/L	2022-02-08	-	0.74
Chlorine Total	mg/L	2022-02-09	-	0.79
Chlorine Total	mg/L	2022-02-10	-	0.89
Chlorine Total	mg/L	2022-02-11	-	0.76
Chlorine Total	mg/L	2022-02-12	-	0.89
Chlorine Total	mg/L	2022-02-13	-	0.72
Chlorine Total	mg/L	2022-02-14	-	0.80
Chlorine Total	mg/L	2022-02-15	-	0.76
Chlorine Total	mg/L	2022-02-16	-	0.74
Chlorine Total	mg/L	2022-02-17	-	-
Chlorine Total	mg/L	2022-02-18	-	0.88
Chlorine Total	mg/L	2022-02-19	-	0.74
Chlorine Total	mg/L	2022-02-20	-	0.77
Chlorine Total	mg/L	2022-02-21	-	-
Chlorine Total	mg/L	2022-02-22	-	0.76
Chlorine Total	mg/L	2022-02-23	-	0.76
Chlorine Total	mg/L	2022-02-24	-	0.76
Chlorine Total	mg/L	2022-02-25	-	0.78
Chlorine Total	mg/L	2022-02-26	-	0.78
Chlorine Total	mg/L	2022-02-27	-	0.80
Chlorine Total	mg/L	2022-02-28	-	-
Chlorine Total	mg/L	2022-03-01	-	0.76
Chlorine Total	mg/L	2022-03-02	-	0.80
Chlorine Total	mg/L	2022-03-03	-	0.84
Chlorine Total	mg/L	2022-03-04	-	0.81
Chlorine Total	mg/L	2022-03-05	-	0.87
Chlorine Total	mg/L	2022-03-06	-	0.85
Chlorine Total	mg/L	2022-03-07	-	0.79
Chlorine Total	mg/L	2022-03-08	-	0.77
Chlorine Total	mg/L	2022-03-09	-	0.93
Chlorine Total	mg/L	2022-03-10	-	0.74
Chlorine Total	mg/L	2022-03-11	-	0.77
Chlorine Total	mg/L	2022-03-12	-	0.97
Chlorine Total	mg/L	2022-03-13	-	0.79
Chlorine Total	mg/L	2022-03-14	-	0.76

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-03-15	-	0.83
Chlorine Total	mg/L	2022-03-16	-	0.80
Chlorine Total	mg/L	2022-03-17	-	0.83
Chlorine Total	mg/L	2022-03-18	-	0.81
Chlorine Total	mg/L	2022-03-19	-	0.85
Chlorine Total	mg/L	2022-03-20	-	0.77
Chlorine Total	mg/L	2022-03-21	-	0.79
Chlorine Total	mg/L	2022-03-22	-	0.77
Chlorine Total	mg/L	2022-03-23	-	0.78
Chlorine Total	mg/L	2022-03-24	-	0.87
Chlorine Total	mg/L	2022-03-25	-	0.82
Chlorine Total	mg/L	2022-03-26	-	0.84
Chlorine Total	mg/L	2022-03-27	-	0.78
Chlorine Total	mg/L	2022-03-28	-	0.75
Chlorine Total	mg/L	2022-03-29	-	0.78
Chlorine Total	mg/L	2022-03-30	-	0.89
Chlorine Total	mg/L	2022-03-31	-	0.77
Chlorine Total	mg/L	2022-04-01	-	0.90
Chlorine Total	mg/L	2022-04-02	-	0.89
Chlorine Total	mg/L	2022-04-03	-	0.76
Chlorine Total	mg/L	2022-04-04	-	0.75
Chlorine Total	mg/L	2022-04-05	-	0.85
Chlorine Total	mg/L	2022-04-06	-	0.81
Chlorine Total	mg/L	2022-04-07	-	0.80
Chlorine Total	mg/L	2022-04-08	-	0.94
Chlorine Total	mg/L	2022-04-09	-	0.80
Chlorine Total	mg/L	2022-04-10	-	0.78
Chlorine Total	mg/L	2022-04-11	-	0.75
Chlorine Total	mg/L	2022-04-12	-	0.85
Chlorine Total	mg/L	2022-04-13	-	0.75
Chlorine Total	mg/L	2022-04-14	-	0.83
Chlorine Total	mg/L	2022-04-15	-	0.84
Chlorine Total	mg/L	2022-04-16	-	0.83
Chlorine Total	mg/L	2022-04-17	-	0.81
Chlorine Total	mg/L	2022-04-18	-	0.86
Chlorine Total	mg/L	2022-04-19	-	0.78
Chlorine Total	mg/L	2022-04-20	-	0.80
Chlorine Total	mg/L	2022-04-21	-	0.77
Chlorine Total	mg/L	2022-04-22	-	0.87
Chlorine Total	mg/L	2022-04-23	-	0.98
Chlorine Total	mg/L	2022-04-24	-	0.82
Chlorine Total	mg/L	2022-04-25	-	0.75

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-04-26	-	0.79
Chlorine Total	mg/L	2022-04-27	-	0.63
Chlorine Total	mg/L	2022-04-28	-	0.77
Chlorine Total	mg/L	2022-04-29	-	0.79
Chlorine Total	mg/L	2022-04-30	-	0.66
Chlorine Total	mg/L	2022-05-01	-	0.83
Chlorine Total	mg/L	2022-05-02	-	0.76
Chlorine Total	mg/L	2022-05-03	-	0.79
Chlorine Total	mg/L	2022-05-04	-	0.72
Chlorine Total	mg/L	2022-05-05	-	0.77
Chlorine Total	mg/L	2022-05-06	-	0.73
Chlorine Total	mg/L	2022-05-07	-	0.82
Chlorine Total	mg/L	2022-05-08	-	0.82
Chlorine Total	mg/L	2022-05-09	-	0.77
Chlorine Total	mg/L	2022-05-10	-	0.78
Chlorine Total	mg/L	2022-05-11	-	0.77
Chlorine Total	mg/L	2022-05-12	-	0.79
Chlorine Total	mg/L	2022-05-13	-	0.76
Chlorine Total	mg/L	2022-05-14	-	0.78
Chlorine Total	mg/L	2022-05-15	-	0.83
Chlorine Total	mg/L	2022-05-16	-	0.80
Chlorine Total	mg/L	2022-05-17	-	0.85
Chlorine Total	mg/L	2022-05-18	-	0.84
Chlorine Total	mg/L	2022-05-19	-	0.79
Chlorine Total	mg/L	2022-05-20	-	0.77
Chlorine Total	mg/L	2022-05-21	-	0.75
Chlorine Total	mg/L	2022-05-22	-	0.77
Chlorine Total	mg/L	2022-05-23	-	0.77
Chlorine Total	mg/L	2022-05-24	-	0.77
Chlorine Total	mg/L	2022-05-25	-	0.79
Chlorine Total	mg/L	2022-05-26	-	0.75
Chlorine Total	mg/L	2022-05-27	-	0.84
Chlorine Total	mg/L	2022-05-28	-	0.77
Chlorine Total	mg/L	2022-05-29	-	0.77
Chlorine Total	mg/L	2022-05-30	-	0.76
Chlorine Total	mg/L	2022-05-31	-	0.77
Chlorine Total	mg/L	2022-06-01	-	0.76
Chlorine Total	mg/L	2022-06-02	-	0.76
Chlorine Total	mg/L	2022-06-03	-	0.81
Chlorine Total	mg/L	2022-06-04	-	0.81
Chlorine Total	mg/L	2022-06-05	-	0.79
Chlorine Total	mg/L	2022-06-06	-	0.72

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-06-07	-	0.73
Chlorine Total	mg/L	2022-06-08	-	0.77
Chlorine Total	mg/L	2022-06-09	-	0.78
Chlorine Total	mg/L	2022-06-10	-	0.83
Chlorine Total	mg/L	2022-06-11	-	-
Chlorine Total	mg/L	2022-06-12	-	0.76
Chlorine Total	mg/L	2022-06-13	-	0.79
Chlorine Total	mg/L	2022-06-14	-	0.86
Chlorine Total	mg/L	2022-06-15	-	0.79
Chlorine Total	mg/L	2022-06-16	-	0.74
Chlorine Total	mg/L	2022-06-17	-	0.77
Chlorine Total	mg/L	2022-06-18	-	0.78
Chlorine Total	mg/L	2022-06-19	-	0.75
Chlorine Total	mg/L	2022-06-20	-	0.78
Chlorine Total	mg/L	2022-06-21	-	0.75
Chlorine Total	mg/L	2022-06-22	-	0.88
Chlorine Total	mg/L	2022-06-23	-	0.73
Chlorine Total	mg/L	2022-06-24	-	0.76
Chlorine Total	mg/L	2022-06-25	-	0.86
Chlorine Total	mg/L	2022-06-26	-	0.82
Chlorine Total	mg/L	2022-06-27	-	0.76
Chlorine Total	mg/L	2022-06-28	-	0.82
Chlorine Total	mg/L	2022-06-29	-	0.76
Chlorine Total	mg/L	2022-06-30	-	0.79
Chlorine Total	mg/L	2022-07-01	-	0.82
Chlorine Total	mg/L	2022-07-02	-	0.80
Chlorine Total	mg/L	2022-07-03	-	0.79
Chlorine Total	mg/L	2022-07-04	-	0.73
Chlorine Total	mg/L	2022-07-05	-	0.77
Chlorine Total	mg/L	2022-07-06	-	0.74
Chlorine Total	mg/L	2022-07-07	-	0.80
Chlorine Total	mg/L	2022-07-08	-	0.81
Chlorine Total	mg/L	2022-07-09	-	0.81
Chlorine Total	mg/L	2022-07-10	-	0.82
Chlorine Total	mg/L	2022-07-11	-	0.80
Chlorine Total	mg/L	2022-07-12	-	0.76
Chlorine Total	mg/L	2022-07-13	-	0.82
Chlorine Total	mg/L	2022-07-14	-	0.75
Chlorine Total	mg/L	2022-07-15	-	0.87
Chlorine Total	mg/L	2022-07-16	-	0.78
Chlorine Total	mg/L	2022-07-17	-	0.81
Chlorine Total	mg/L	2022-07-18	-	-

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-07-19	-	0.78
Chlorine Total	mg/L	2022-07-20	-	0.79
Chlorine Total	mg/L	2022-07-21	-	0.75
Chlorine Total	mg/L	2022-07-22	-	0.96
Chlorine Total	mg/L	2022-07-23	-	0.84
Chlorine Total	mg/L	2022-07-24	-	0.80
Chlorine Total	mg/L	2022-07-25	-	0.82
Chlorine Total	mg/L	2022-07-26	-	0.81
Chlorine Total	mg/L	2022-07-27	-	0.81
Chlorine Total	mg/L	2022-07-28	-	0.79
Chlorine Total	mg/L	2022-07-29	-	0.87
Chlorine Total	mg/L	2022-07-30	-	0.81
Chlorine Total	mg/L	2022-07-31	-	0.83
Chlorine Total	mg/L	2022-08-01	-	0.79
Chlorine Total	mg/L	2022-08-02	-	0.81
Chlorine Total	mg/L	2022-08-03	-	0.79
Chlorine Total	mg/L	2022-08-04	-	0.86
Chlorine Total	mg/L	2022-08-05	-	0.73
Chlorine Total	mg/L	2022-08-06	-	0.82
Chlorine Total	mg/L	2022-08-07	-	0.79
Chlorine Total	mg/L	2022-08-08	-	0.83
Chlorine Total	mg/L	2022-08-09	-	0.81
Chlorine Total	mg/L	2022-08-10	-	0.77
Chlorine Total	mg/L	2022-08-11	-	0.85
Chlorine Total	mg/L	2022-08-12	-	0.81
Chlorine Total	mg/L	2022-08-13	-	0.85
Chlorine Total	mg/L	2022-08-14	-	0.78
Chlorine Total	mg/L	2022-08-15	-	0.77
Chlorine Total	mg/L	2022-08-16	-	0.79
Chlorine Total	mg/L	2022-08-17	-	0.84
Chlorine Total	mg/L	2022-08-18	-	0.79
Chlorine Total	mg/L	2022-08-19	-	0.82
Chlorine Total	mg/L	2022-08-20	-	0.79
Chlorine Total	mg/L	2022-08-21	-	0.74
Chlorine Total	mg/L	2022-08-22	-	0.78
Chlorine Total	mg/L	2022-08-23	-	0.79
Chlorine Total	mg/L	2022-08-24	-	0.77
Chlorine Total	mg/L	2022-08-25	-	0.72
Chlorine Total	mg/L	2022-08-26	-	0.69
Chlorine Total	mg/L	2022-08-27	-	0.79
Chlorine Total	mg/L	2022-08-28	-	0.79
Chlorine Total	mg/L	2022-08-29	-	0.79

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-08-30	-	0.81
Chlorine Total	mg/L	2022-08-31	-	0.81
Chlorine Total	mg/L	2022-09-01	-	0.83
Chlorine Total	mg/L	2022-09-02	-	0.78
Chlorine Total	mg/L	2022-09-03	-	0.79
Chlorine Total	mg/L	2022-09-04	-	0.80
Chlorine Total	mg/L	2022-09-05	-	0.80
Chlorine Total	mg/L	2022-09-06	-	0.80
Chlorine Total	mg/L	2022-09-07	-	0.77
Chlorine Total	mg/L	2022-09-08	-	0.79
Chlorine Total	mg/L	2022-09-09	-	0.74
Chlorine Total	mg/L	2022-09-10	-	0.80
Chlorine Total	mg/L	2022-09-11	-	0.78
Chlorine Total	mg/L	2022-09-12	-	0.74
Chlorine Total	mg/L	2022-09-13	-	0.79
Chlorine Total	mg/L	2022-09-14	-	0.73
Chlorine Total	mg/L	2022-09-15	-	0.73
Chlorine Total	mg/L	2022-09-16	-	0.84
Chlorine Total	mg/L	2022-09-17	-	0.81
Chlorine Total	mg/L	2022-09-18	-	0.78
Chlorine Total	mg/L	2022-09-19	-	0.77
Chlorine Total	mg/L	2022-09-20	-	0.86
Chlorine Total	mg/L	2022-09-21	-	0.80
Chlorine Total	mg/L	2022-09-22	-	0.79
Chlorine Total	mg/L	2022-09-23	-	0.86
Chlorine Total	mg/L	2022-09-24	-	0.79
Chlorine Total	mg/L	2022-09-25	-	0.81
Chlorine Total	mg/L	2022-09-26	-	1.03
Chlorine Total	mg/L	2022-09-27	-	0.82
Chlorine Total	mg/L	2022-09-28	-	0.97
Chlorine Total	mg/L	2022-09-29	-	0.97
Chlorine Total	mg/L	2022-09-30	-	0.84
Chlorine Total	mg/L	2022-10-01	-	0.83
Chlorine Total	mg/L	2022-10-02	-	0.80
Chlorine Total	mg/L	2022-10-03	-	0.93
Chlorine Total	mg/L	2022-10-04	-	0.99
Chlorine Total	mg/L	2022-10-05	-	0.81
Chlorine Total	mg/L	2022-10-06	-	0.97
Chlorine Total	mg/L	2022-10-07	-	0.77
Chlorine Total	mg/L	2022-10-08	-	0.79
Chlorine Total	mg/L	2022-10-09	-	0.80
Chlorine Total	mg/L	2022-10-10	-	0.79

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-10-11	-	0.99
Chlorine Total	mg/L	2022-10-12	-	1.18
Chlorine Total	mg/L	2022-10-13	-	1.05
Chlorine Total	mg/L	2022-10-14	-	0.79
Chlorine Total	mg/L	2022-10-15	-	0.84
Chlorine Total	mg/L	2022-10-16	-	0.97
Chlorine Total	mg/L	2022-10-17	-	-
Chlorine Total	mg/L	2022-10-18	-	0.81
Chlorine Total	mg/L	2022-10-19	-	0.85
Chlorine Total	mg/L	2022-10-20	-	0.97
Chlorine Total	mg/L	2022-10-21	-	0.84
Chlorine Total	mg/L	2022-10-22	-	0.88
Chlorine Total	mg/L	2022-10-23	-	0.97
Chlorine Total	mg/L	2022-10-24	-	1.14
Chlorine Total	mg/L	2022-10-25	-	0.77
Chlorine Total	mg/L	2022-10-26	-	0.91
Chlorine Total	mg/L	2022-10-27	-	0.80
Chlorine Total	mg/L	2022-10-28	-	0.82
Chlorine Total	mg/L	2022-10-29	-	0.79
Chlorine Total	mg/L	2022-10-30	-	0.73
Chlorine Total	mg/L	2022-10-31	-	0.92
Chlorine Total	mg/L	2022-11-01	-	0.92
Chlorine Total	mg/L	2022-11-02	-	0.81
Chlorine Total	mg/L	2022-11-03	-	0.71
Chlorine Total	mg/L	2022-11-04	-	0.62
Chlorine Total	mg/L	2022-11-05	-	0.85
Chlorine Total	mg/L	2022-11-06	-	0.92
Chlorine Total	mg/L	2022-11-07	-	0.74
Chlorine Total	mg/L	2022-11-08	-	0.85
Chlorine Total	mg/L	2022-11-09	-	0.84
Chlorine Total	mg/L	2022-11-10	-	0.84
Chlorine Total	mg/L	2022-11-11	-	0.84
Chlorine Total	mg/L	2022-11-12	-	0.82
Chlorine Total	mg/L	2022-11-13	-	0.74
Chlorine Total	mg/L	2022-11-14	-	0.99
Chlorine Total	mg/L	2022-11-15	-	0.86
Chlorine Total	mg/L	2022-11-16	-	0.83
Chlorine Total	mg/L	2022-11-17	-	0.78
Chlorine Total	mg/L	2022-11-18	-	0.81
Chlorine Total	mg/L	2022-11-19	-	0.82
Chlorine Total	mg/L	2022-11-20	-	0.81
Chlorine Total	mg/L	2022-11-21	-	0.97

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-11-22	-	0.82
Chlorine Total	mg/L	2022-11-23	-	0.87
Chlorine Total	mg/L	2022-11-24	-	0.89
Chlorine Total	mg/L	2022-11-25	-	0.83
Chlorine Total	mg/L	2022-11-26	-	0.79
Chlorine Total	mg/L	2022-11-27	-	0.97
Chlorine Total	mg/L	2022-11-28	-	0.72
Chlorine Total	mg/L	2022-11-29	-	0.84
Chlorine Total	mg/L	2022-11-30	-	0.98
Chlorine Total	mg/L	2022-12-01	-	0.92
Chlorine Total	mg/L	2022-12-02	-	0.88
Chlorine Total	mg/L	2022-12-03	-	0.92
Chlorine Total	mg/L	2022-12-04	-	0.86
Chlorine Total	mg/L	2022-12-05	-	0.95
Chlorine Total	mg/L	2022-12-06	-	0.83
Chlorine Total	mg/L	2022-12-07	-	0.95
Chlorine Total	mg/L	2022-12-08	-	0.98
Chlorine Total	mg/L	2022-12-09	-	0.75
Chlorine Total	mg/L	2022-12-10	-	0.80
Chlorine Total	mg/L	2022-12-11	-	0.83
Chlorine Total	mg/L	2022-12-12	-	0.96
Chlorine Total	mg/L	2022-12-13	-	0.85
Chlorine Total	mg/L	2022-12-14	-	1.08
Chlorine Total	mg/L	2022-12-15	-	0.90
Chlorine Total	mg/L	2022-12-16	-	0.92
Chlorine Total	mg/L	2022-12-17	-	0.78
Chlorine Total	mg/L	2022-12-18	-	0.94
Chlorine Total	mg/L	2022-12-19	-	0.72
Chlorine Total	mg/L	2022-12-20	-	1.50
Chlorine Total	mg/L	2022-12-21	-	0.90
Chlorine Total	mg/L	2022-12-22	-	0.74
Chlorine Total	mg/L	2022-12-23	-	0.73
Chlorine Total	mg/L	2022-12-24	-	0.82
Chlorine Total	mg/L	2022-12-26	-	0.80
Chlorine Total	mg/L	2022-12-27	-	0.80
Chlorine Total	mg/L	2022-12-28	-	0.80
Chlorine Total	mg/L	2022-12-29	-	0.75
Chlorine Total	mg/L	2022-12-30	-	0.80
Chlorine Total	mg/L	2022-12-31	-	0.80
Chlorodibromomethane	µg/L	2022-02-17	<1	<1
Chlorodibromomethane	µg/L	2022-05-10	<1	<1
Chlorodibromomethane	µg/L	2022-11-15	-	<1

Analysis - Capilano	Units	Date Sampled	Source	Treated
Chlorodibromomethane	µg/L	2022-11-17	<1	-
Chloroform	µg/L	2022-02-17	<1	15
Chloroform	µg/L	2022-05-10	<1	18
Chloroform	µg/L	2022-11-15	-	18
Chloroform	µg/L	2022-11-17	<1	-
Chromium Total	µg/L	2022-02-17	-	<0.05
Chromium Total	µg/L	2022-05-02	0.09	<0.05
Chromium Total	µg/L	2022-05-04	0.07	<0.05
Chromium Total	µg/L	2022-05-10	-	<0.05
Chromium Total	µg/L	2022-08-23	-	<0.05
Chromium Total	µg/L	2022-11-07	<0.05	<0.05
Chromium Total	µg/L	2022-11-08	0.10	<0.05
Chromium Total	µg/L	2022-11-15	-	<0.05
Cobalt Total	µg/L	2022-02-17	-	<0.5
Cobalt Total	µg/L	2022-05-04	<0.5	<0.5
Cobalt Total	µg/L	2022-05-10	-	<0.5
Cobalt Total	µg/L	2022-08-23	-	<0.5
Cobalt Total	µg/L	2022-11-08	<0.5	<0.5
Cobalt Total	µg/L	2022-11-15	-	<0.5
Colour - Apparent	ACU	2022-01-04	17	2
Colour - Apparent	ACU	2022-01-10	20	<2
Colour - Apparent	ACU	2022-01-17	28	<2
Colour - Apparent	ACU	2022-01-24	22	<2
Colour - Apparent	ACU	2022-01-31	15	<2
Colour - Apparent	ACU	2022-02-07	15	<2
Colour - Apparent	ACU	2022-02-14	14	<2
Colour - Apparent	ACU	2022-02-22	13	2
Colour - Apparent	ACU	2022-02-28	12	<2
Colour - Apparent	ACU	2022-03-07	12	<2
Colour - Apparent	ACU	2022-03-14	13	<2
Colour - Apparent	ACU	2022-03-21	13	<2
Colour - Apparent	ACU	2022-03-28	14	<2
Colour - Apparent	ACU	2022-04-04	14	<2
Colour - Apparent	ACU	2022-04-11	12	<2
Colour - Apparent	ACU	2022-04-19	13	<2
Colour - Apparent	ACU	2022-04-25	12	<2
Colour - Apparent	ACU	2022-05-02	10	<2
Colour - Apparent	ACU	2022-05-09	10	<2
Colour - Apparent	ACU	2022-05-16	12	<2
Colour - Apparent	ACU	2022-05-24	12	2
Colour - Apparent	ACU	2022-05-30	12	2
Colour - Apparent	ACU	2022-06-06	13	<2

Analysis - Capilano	Units	Date Sampled	Source	Treated
Colour - Apparent	ACU	2022-06-13	13	3
Colour - Apparent	ACU	2022-06-20	14	<2
Colour - Apparent	ACU	2022-06-27	13	2
Colour - Apparent	ACU	2022-07-04	20	5
Colour - Apparent	ACU	2022-07-11	13	3
Colour - Apparent	ACU	2022-07-18	11	<2
Colour - Apparent	ACU	2022-07-25	10	2
Colour - Apparent	ACU	2022-08-02	16	2
Colour - Apparent	ACU	2022-08-08	13	3
Colour - Apparent	ACU	2022-08-15	12	3
Colour - Apparent	ACU	2022-08-22	14	2
Colour - Apparent	ACU	2022-08-29	14	7
Colour - Apparent	ACU	2022-09-06	15	3
Colour - Apparent	ACU	2022-09-12	14	3
Colour - Apparent	ACU	2022-09-20	19	3
Colour - Apparent	ACU	2022-09-26	18	3
Colour - Apparent	ACU	2022-10-03	13	6
Colour - Apparent	ACU	2022-10-11	14	<2
Colour - Apparent	ACU	2022-10-17	17	2
Colour - Apparent	ACU	2022-10-24	13	2
Colour - Apparent	ACU	2022-10-31	26	<2
Colour - Apparent	ACU	2022-11-07	20	2
Colour - Apparent	ACU	2022-11-14	21	2
Colour - Apparent	ACU	2022-11-21	14	2
Colour - Apparent	ACU	2022-11-28	17	2
Colour - Apparent	ACU	2022-12-05	18	2
Colour - Apparent	ACU	2022-12-12	16	14
Colour - Apparent	ACU	2022-12-19	16	<2
Colour - True	TCU	2022-01-04	12	<1
Colour - True	TCU	2022-01-10	11	<1
Colour - True	TCU	2022-01-17	12	<1
Colour - True	TCU	2022-01-24	12	<1
Colour - True	TCU	2022-01-31	11	<1
Colour - True	TCU	2022-02-07	11	<1
Colour - True	TCU	2022-02-14	9	<1
Colour - True	TCU	2022-02-22	10	<1
Colour - True	TCU	2022-02-28	9	<1
Colour - True	TCU	2022-03-07	10	<1
Colour - True	TCU	2022-03-14	10	<1
Colour - True	TCU	2022-03-21	10	<1
Colour - True	TCU	2022-03-28	10	<1
Colour - True	TCU	2022-04-04	10	<1

Analysis - Capilano	Units	Date Sampled	Source	Treated
Colour - True	TCU	2022-04-11	10	<1
Colour - True	TCU	2022-04-19	9	<1
Colour - True	TCU	2022-04-25	10	<1
Colour - True	TCU	2022-05-02	9	<1
Colour - True	TCU	2022-05-09	9	<1
Colour - True	TCU	2022-05-16	10	<1
Colour - True	TCU	2022-05-24	9	<1
Colour - True	TCU	2022-05-30	9	<1
Colour - True	TCU	2022-06-06	11	<1
Colour - True	TCU	2022-06-13	11	<1
Colour - True	TCU	2022-06-20	11	<1
Colour - True	TCU	2022-06-27	10	<1
Colour - True	TCU	2022-07-04	10	<1
Colour - True	TCU	2022-07-11	9	<1
Colour - True	TCU	2022-07-18	7	<1
Colour - True	TCU	2022-07-25	9	<1
Colour - True	TCU	2022-08-02	9	<1
Colour - True	TCU	2022-08-08	9	<1
Colour - True	TCU	2022-08-15	9	<1
Colour - True	TCU	2022-08-22	8	<1
Colour - True	TCU	2022-08-29	9	<1
Colour - True	TCU	2022-09-06	8	<1
Colour - True	TCU	2022-09-12	9	<1
Colour - True	TCU	2022-09-20	9	<1
Colour - True	TCU	2022-09-26	8	<1
Colour - True	TCU	2022-10-03	8	<1
Colour - True	TCU	2022-10-11	7	<1
Colour - True	TCU	2022-10-17	8	<1
Colour - True	TCU	2022-10-24	6	<1
Colour - True	TCU	2022-10-31	11	<1
Colour - True	TCU	2022-11-07	11	1
Colour - True	TCU	2022-11-14	10	<1
Colour - True	TCU	2022-11-21	9	<1
Colour - True	TCU	2022-11-28	10	<1
Colour - True	TCU	2022-12-05	10	<1
Colour - True	TCU	2022-12-12	10	<1
Colour - True	TCU	2022-12-19	10	<1
Conductivity	µmhos/cm	2022-01-04	10	53
Conductivity	µmhos/cm	2022-01-10	10	46
Conductivity	µmhos/cm	2022-01-17	9	49
Conductivity	µmhos/cm	2022-01-24	10	48
Conductivity	µmhos/cm	2022-01-31	10	48

Analysis - Capilano	Units	Date Sampled	Source	Treated
Conductivity	µmhos/cm	2022-02-07	10	53
Conductivity	µmhos/cm	2022-02-14	10	47
Conductivity	µmhos/cm	2022-02-22	11	51
Conductivity	µmhos/cm	2022-02-28	11	51
Conductivity	µmhos/cm	2022-03-07	11	50
Conductivity	µmhos/cm	2022-03-14	10	47
Conductivity	µmhos/cm	2022-03-21	11	47
Conductivity	µmhos/cm	2022-03-28	11	54
Conductivity	µmhos/cm	2022-04-04	10	46
Conductivity	µmhos/cm	2022-04-11	10	47
Conductivity	µmhos/cm	2022-04-19	11	50
Conductivity	µmhos/cm	2022-04-25	11	50
Conductivity	µmhos/cm	2022-05-02	11	50
Conductivity	µmhos/cm	2022-05-09	11	53
Conductivity	µmhos/cm	2022-05-16	10	46
Conductivity	µmhos/cm	2022-05-24	10	46
Conductivity	µmhos/cm	2022-05-30	9	48
Conductivity	µmhos/cm	2022-06-06	9	47
Conductivity	µmhos/cm	2022-06-13	8	47
Conductivity	µmhos/cm	2022-06-20	8	44
Conductivity	µmhos/cm	2022-06-27	8	49
Conductivity	µmhos/cm	2022-07-04	8	52
Conductivity	µmhos/cm	2022-07-11	8	46
Conductivity	µmhos/cm	2022-07-18	8	53
Conductivity	µmhos/cm	2022-07-25	8	48
Conductivity	µmhos/cm	2022-08-02	8	50
Conductivity	µmhos/cm	2022-08-08	9	51
Conductivity	µmhos/cm	2022-08-15	8	51
Conductivity	µmhos/cm	2022-08-22	9	47
Conductivity	µmhos/cm	2022-08-29	9	50
Conductivity	µmhos/cm	2022-09-06	10	51
Conductivity	µmhos/cm	2022-09-12	10	49
Conductivity	µmhos/cm	2022-09-20	11	50
Conductivity	µmhos/cm	2022-09-26	10	43
Conductivity	µmhos/cm	2022-10-03	11	47
Conductivity	µmhos/cm	2022-10-11	12	52
Conductivity	µmhos/cm	2022-10-17	12	47
Conductivity	µmhos/cm	2022-10-24	13	45
Conductivity	µmhos/cm	2022-10-31	12	45
Conductivity	µmhos/cm	2022-11-07	12	49
Conductivity	µmhos/cm	2022-11-14	12	52
Conductivity	µmhos/cm	2022-11-21	12	46

Analysis - Capilano	Units	Date Sampled	Source	Treated
Conductivity	µmhos/cm	2022-11-28	13	49
Conductivity	µmhos/cm	2022-12-05	13	49
Conductivity	µmhos/cm	2022-12-12	13	51
Conductivity	µmhos/cm	2022-12-19	13	50
Copper Total	µg/L	2022-02-17	-	<0.5
Copper Total	µg/L	2022-05-02	1.5	<0.5
Copper Total	µg/L	2022-05-04	1.4	<0.5
Copper Total	µg/L	2022-05-10	-	<0.5
Copper Total	µg/L	2022-08-23	-	<0.5
Copper Total	µg/L	2022-11-07	0.6	<0.5
Copper Total	µg/L	2022-11-08	2.2	<0.5
Copper Total	µg/L	2022-11-15	-	<0.5
Cyanide Total	mg/L	2022-05-02	<0.02	<0.02
Cyanide Total	mg/L	2022-11-07	<0.02	<0.02
Dibromoacetic Acid	µg/L	2022-02-17	<0.5	<0.5
Dibromoacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Dibromoacetic Acid	µg/L	2022-08-23	<0.5	<0.5
Dibromoacetic Acid	µg/L	2022-11-15	-	<0.5
Dibromoacetic Acid	µg/L	2022-11-17	<0.5	-
Dichloroacetic Acid	µg/L	2022-02-17	<0.5	7.0
Dichloroacetic Acid	µg/L	2022-05-10	<0.5	6.2
Dichloroacetic Acid	µg/L	2022-08-23	<0.5	6.7
Dichloroacetic Acid	µg/L	2022-11-15	-	7.8
Dichloroacetic Acid	µg/L	2022-11-17	<0.5	-
Fluoride	mg/L	2022-01-04	<0.05	<0.05
Fluoride	mg/L	2022-02-07	<0.05	<0.05
Fluoride	mg/L	2022-03-07	<0.05	<0.05
Fluoride	mg/L	2022-04-04	<0.05	<0.05
Fluoride	mg/L	2022-05-02	<0.05	<0.05
Fluoride	mg/L	2022-06-06	<0.05	<0.05
Fluoride	mg/L	2022-07-04	<0.05	<0.05
Fluoride	mg/L	2022-08-08	<0.05	<0.05
Fluoride	mg/L	2022-09-12	<0.05	<0.05
Fluoride	mg/L	2022-10-11	<0.05	<0.05
Fluoride	mg/L	2022-11-07	<0.05	<0.05
Fluoride	mg/L	2022-12-05	<0.05	<0.05
Hardness as CaCO ₃	mg/L	2022-01-04	3.5	22.6
Hardness as CaCO ₃	mg/L	2022-02-07	3.5	24.0
Hardness as CaCO ₃	mg/L	2022-02-14	3.4	20.6
Hardness as CaCO ₃	mg/L	2022-03-07	3.8	21.5
Hardness as CaCO ₃	mg/L	2022-04-04	3.7	20.3
Hardness as CaCO ₃	mg/L	2022-05-02	3.8	21.6

Analysis - Capilano	Units	Date Sampled	Source	Treated
Hardness as CaCO ₃	mg/L	2022-06-06	3.2	20.9
Hardness as CaCO ₃	mg/L	2022-07-04	2.9	23.7
Hardness as CaCO ₃	mg/L	2022-08-08	3.0	22.6
Hardness as CaCO ₃	mg/L	2022-09-12	3.5	21.3
Hardness as CaCO ₃	mg/L	2022-10-11	4.4	22.9
Hardness as CaCO ₃	mg/L	2022-11-07	4.6	21.8
Hardness as CaCO ₃	mg/L	2022-12-05	4.4	21.7
Iron Dissolved	µg/L	2022-01-04	36	<5
Iron Dissolved	µg/L	2022-01-10	34	<5
Iron Dissolved	µg/L	2022-01-17	32	<5
Iron Dissolved	µg/L	2022-01-24	35	<5
Iron Dissolved	µg/L	2022-01-31	39	<5
Iron Dissolved	µg/L	2022-02-14	33	<5
Iron Dissolved	µg/L	2022-02-22	42	<5
Iron Dissolved	µg/L	2022-02-28	44	<5
Iron Dissolved	µg/L	2022-03-07	29	7
Iron Dissolved	µg/L	2022-03-14	36	<5
Iron Dissolved	µg/L	2022-03-21	39	<5
Iron Dissolved	µg/L	2022-03-28	36	6
Iron Dissolved	µg/L	2022-04-04	35	<5
Iron Dissolved	µg/L	2022-04-11	32	<5
Iron Dissolved	µg/L	2022-04-19	28	<5
Iron Dissolved	µg/L	2022-04-25	30	<5
Iron Dissolved	µg/L	2022-05-02	28	6
Iron Dissolved	µg/L	2022-05-09	27	<5
Iron Dissolved	µg/L	2022-05-16	25	<5
Iron Dissolved	µg/L	2022-05-24	14	<5
Iron Dissolved	µg/L	2022-05-30	15	<5
Iron Dissolved	µg/L	2022-06-06	13	<5
Iron Dissolved	µg/L	2022-06-13	13	<5
Iron Dissolved	µg/L	2022-06-20	12	<5
Iron Dissolved	µg/L	2022-06-27	12	<5
Iron Dissolved	µg/L	2022-07-04	13	<5
Iron Dissolved	µg/L	2022-07-11	19	<5
Iron Dissolved	µg/L	2022-07-18	17	<5
Iron Dissolved	µg/L	2022-07-25	22	<5
Iron Dissolved	µg/L	2022-08-02	27	<5
Iron Dissolved	µg/L	2022-08-08	29	<5
Iron Dissolved	µg/L	2022-08-15	36	<5
Iron Dissolved	µg/L	2022-08-22	41	<5
Iron Dissolved	µg/L	2022-08-29	58	<5
Iron Dissolved	µg/L	2022-09-06	71	<5

Analysis - Capilano	Units	Date Sampled	Source	Treated
Iron Dissolved	µg/L	2022-09-12	106	<5
Iron Dissolved	µg/L	2022-09-20	135	<5
Iron Dissolved	µg/L	2022-09-26	132	9
Iron Dissolved	µg/L	2022-10-03	131	<5
Iron Dissolved	µg/L	2022-10-11	135	<5
Iron Dissolved	µg/L	2022-10-17	135	<5
Iron Dissolved	µg/L	2022-10-24	124	<5
Iron Dissolved	µg/L	2022-10-31	89	<5
Iron Dissolved	µg/L	2022-11-07	88	<5
Iron Dissolved	µg/L	2022-11-14	76	<5
Iron Dissolved	µg/L	2022-11-21	82	<5
Iron Dissolved	µg/L	2022-11-28	76	<5
Iron Dissolved	µg/L	2022-12-05	60	<5
Iron Dissolved	µg/L	2022-12-12	68	<5
Iron Dissolved	µg/L	2022-12-19	55	<5
Iron Total	µg/L	2022-01-04	165	7
Iron Total	µg/L	2022-01-10	199	8
Iron Total	µg/L	2022-01-17	301	9
Iron Total	µg/L	2022-01-24	221	9
Iron Total	µg/L	2022-01-31	172	8
Iron Total	µg/L	2022-02-07	130	8
Iron Total	µg/L	2022-02-14	99	5
Iron Total	µg/L	2022-02-17	-	5
Iron Total	µg/L	2022-02-22	154	5
Iron Total	µg/L	2022-02-28	122	6
Iron Total	µg/L	2022-03-07	136	<5
Iron Total	µg/L	2022-03-14	117	<5
Iron Total	µg/L	2022-03-21	142	<5
Iron Total	µg/L	2022-03-28	112	10
Iron Total	µg/L	2022-04-04	106	5
Iron Total	µg/L	2022-04-11	110	6
Iron Total	µg/L	2022-04-19	101	6
Iron Total	µg/L	2022-04-25	103	7
Iron Total	µg/L	2022-05-02	90	12
Iron Total	µg/L	2022-05-04	86	7
Iron Total	µg/L	2022-05-09	67	11
Iron Total	µg/L	2022-05-10	-	7
Iron Total	µg/L	2022-05-16	66	<5
Iron Total	µg/L	2022-05-24	64	5
Iron Total	µg/L	2022-05-30	94	11
Iron Total	µg/L	2022-06-06	41	<5
Iron Total	µg/L	2022-06-13	44	6

Analysis - Capilano	Units	Date Sampled	Source	Treated
Iron Total	µg/L	2022-06-20	49	12
Iron Total	µg/L	2022-06-27	37	18
Iron Total	µg/L	2022-07-04	40	7
Iron Total	µg/L	2022-07-11	39	9
Iron Total	µg/L	2022-07-18	39	8
Iron Total	µg/L	2022-07-25	46	7
Iron Total	µg/L	2022-08-02	57	7
Iron Total	µg/L	2022-08-08	64	8
Iron Total	µg/L	2022-08-15	76	8
Iron Total	µg/L	2022-08-22	90	6
Iron Total	µg/L	2022-08-23	-	7
Iron Total	µg/L	2022-08-29	123	8
Iron Total	µg/L	2022-09-06	171	7
Iron Total	µg/L	2022-09-12	266	6
Iron Total	µg/L	2022-09-20	342	10
Iron Total	µg/L	2022-09-26	347	9
Iron Total	µg/L	2022-10-03	323	64
Iron Total	µg/L	2022-10-11	336	7
Iron Total	µg/L	2022-10-17	350	5
Iron Total	µg/L	2022-10-24	278	6
Iron Total	µg/L	2022-10-31	350	8
Iron Total	µg/L	2022-11-07	246	8
Iron Total	µg/L	2022-11-08	204	8
Iron Total	µg/L	2022-11-14	380	9
Iron Total	µg/L	2022-11-15	-	7
Iron Total	µg/L	2022-11-21	200	7
Iron Total	µg/L	2022-11-28	189	6
Iron Total	µg/L	2022-12-05	179	8
Iron Total	µg/L	2022-12-12	156	10
Iron Total	µg/L	2022-12-19	142	11
Lead Total	µg/L	2022-02-17	-	<0.5
Lead Total	µg/L	2022-05-02	<0.5	<0.5
Lead Total	µg/L	2022-05-04	<0.5	<0.5
Lead Total	µg/L	2022-05-10	-	<0.5
Lead Total	µg/L	2022-08-23	-	<0.5
Lead Total	µg/L	2022-11-07	<0.5	<0.5
Lead Total	µg/L	2022-11-08	<0.5	<0.5
Lead Total	µg/L	2022-11-15	-	<0.5
Magnesium Total	µg/L	2022-01-04	195	200
Magnesium Total	µg/L	2022-02-07	180	192
Magnesium Total	µg/L	2022-02-14	168	184
Magnesium Total	µg/L	2022-02-17	-	188

Analysis - Capilano	Units	Date Sampled	Source	Treated
Magnesium Total	µg/L	2022-03-07	184	181
Magnesium Total	µg/L	2022-04-04	174	183
Magnesium Total	µg/L	2022-05-02	178	188
Magnesium Total	µg/L	2022-05-04	172	198
Magnesium Total	µg/L	2022-05-10	-	239
Magnesium Total	µg/L	2022-06-06	140	218
Magnesium Total	µg/L	2022-07-04	120	214
Magnesium Total	µg/L	2022-08-08	121	198
Magnesium Total	µg/L	2022-08-23	-	197
Magnesium Total	µg/L	2022-09-12	141	206
Magnesium Total	µg/L	2022-10-11	210	244
Magnesium Total	µg/L	2022-11-07	233	222
Magnesium Total	µg/L	2022-11-08	210	218
Magnesium Total	µg/L	2022-11-15	-	223
Magnesium Total	µg/L	2022-12-05	217	256
Manganese Dissolved	µg/L	2022-01-04	8.3	3.7
Manganese Dissolved	µg/L	2022-02-14	4.3	3.8
Manganese Dissolved	µg/L	2022-03-07	7.1	3.6
Manganese Dissolved	µg/L	2022-04-04	5.3	2.7
Manganese Dissolved	µg/L	2022-05-02	4.6	3.5
Manganese Dissolved	µg/L	2022-06-06	1.8	1.4
Manganese Dissolved	µg/L	2022-07-04	2.0	1.6
Manganese Dissolved	µg/L	2022-08-08	3.7	1.3
Manganese Dissolved	µg/L	2022-09-12	13.2	0.9
Manganese Dissolved	µg/L	2022-10-11	15.6	2.8
Manganese Dissolved	µg/L	2022-11-07	13.5	5.0
Manganese Dissolved	µg/L	2022-12-05	9.8	3.3
Manganese Total	µg/L	2022-01-04	10.6	5.8
Manganese Total	µg/L	2022-02-07	7.2	5.7
Manganese Total	µg/L	2022-02-14	5.3	5.0
Manganese Total	µg/L	2022-02-17	-	5.3
Manganese Total	µg/L	2022-03-07	8.7	5.9
Manganese Total	µg/L	2022-04-04	6.4	4.0
Manganese Total	µg/L	2022-05-02	5.3	5.2
Manganese Total	µg/L	2022-05-04	5.5	5.9
Manganese Total	µg/L	2022-05-10	-	6.5
Manganese Total	µg/L	2022-06-06	2.3	2.4
Manganese Total	µg/L	2022-07-04	2.3	2.9
Manganese Total	µg/L	2022-08-08	4.3	2.9
Manganese Total	µg/L	2022-08-23	-	5.7
Manganese Total	µg/L	2022-09-12	15.8	7.5
Manganese Total	µg/L	2022-10-11	18.4	7.9

Analysis - Capilano	Units	Date Sampled	Source	Treated
Manganese Total	µg/L	2022-11-07	15.8	10.6
Manganese Total	µg/L	2022-11-08	13.9	9.4
Manganese Total	µg/L	2022-11-15	-	8.0
Manganese Total	µg/L	2022-12-05	11.1	6.6
Mercury Total	µg/L	2022-02-17	-	<0.05
Mercury Total	µg/L	2022-05-02	<0.05	<0.05
Mercury Total	µg/L	2022-05-04	<0.05	<0.05
Mercury Total	µg/L	2022-05-10	-	<0.05
Mercury Total	µg/L	2022-08-23	-	<0.05
Mercury Total	µg/L	2022-11-07	<0.05	<0.05
Mercury Total	µg/L	2022-11-08	<0.05	<0.05
Mercury Total	µg/L	2022-11-15	-	<0.05
Molybdenum Total	µg/L	2022-02-17	-	<0.5
Molybdenum Total	µg/L	2022-05-04	<0.5	<0.5
Molybdenum Total	µg/L	2022-05-10	-	<0.5
Molybdenum Total	µg/L	2022-08-23	-	<0.5
Molybdenum Total	µg/L	2022-11-08	<0.5	<0.5
Molybdenum Total	µg/L	2022-11-15	-	<0.5
Monobromoacetic Acid	µg/L	2022-02-17	<0.5	<0.5
Monobromoacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Monobromoacetic Acid	µg/L	2022-08-23	<0.5	<0.5
Monobromoacetic Acid	µg/L	2022-11-15	-	<0.5
Monobromoacetic Acid	µg/L	2022-11-17	<0.5	-
Monochloroacetic Acid	µg/L	2022-02-17	<0.5	<0.5
Monochloroacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Monochloroacetic Acid	µg/L	2022-08-23	<5.0	<5.0
Monochloroacetic Acid	µg/L	2022-11-15	-	<0.5
Monochloroacetic Acid	µg/L	2022-11-17	<5.0	-
Nickel Total	µg/L	2022-02-17	-	<0.5
Nickel Total	µg/L	2022-05-02	<0.5	<0.5
Nickel Total	µg/L	2022-05-04	<0.5	<0.5
Nickel Total	µg/L	2022-05-10	-	<0.5
Nickel Total	µg/L	2022-08-23	-	<0.5
Nickel Total	µg/L	2022-11-07	<0.5	<0.5
Nickel Total	µg/L	2022-11-08	<0.5	<0.5
Nickel Total	µg/L	2022-11-15	-	<0.5
Nitrogen - Ammonia as N	mg/L	2022-01-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-10	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-17	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-24	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-31	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-07	<0.02	<0.02

Analysis - Capilano	Units	Date Sampled	Source	Treated
Nitrogen - Ammonia as N	mg/L	2022-02-14	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-22	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-28	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-07	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-14	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-21	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-28	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-11	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-19	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-25	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-02	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-09	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-16	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-24	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-30	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-06	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-13	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-20	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-27	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-11	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-18	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-25	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-02	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-08	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-15	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-22	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-29	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-06	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-12	0.03	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-20	0.03	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-26	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-03	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-11	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-17	0.03	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-24	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-31	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-07	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-14	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-21	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-28	<0.02	<0.02

Analysis - Capilano	Units	Date Sampled	Source	Treated
Nitrogen - Ammonia as N	mg/L	2022-12-05	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-12-12	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-12-19	<0.02	<0.02
Nitrogen - Nitrate as N	mg/L	2022-01-04	0.08	0.06
Nitrogen - Nitrate as N	mg/L	2022-02-07	0.09	0.08
Nitrogen - Nitrate as N	mg/L	2022-03-07	0.09	0.08
Nitrogen - Nitrate as N	mg/L	2022-04-04	0.08	0.07
Nitrogen - Nitrate as N	mg/L	2022-05-02	0.08	0.06
Nitrogen - Nitrate as N	mg/L	2022-06-06	0.05	0.05
Nitrogen - Nitrate as N	mg/L	2022-07-04	0.03	0.02
Nitrogen - Nitrate as N	mg/L	2022-08-08	0.02	0.03
Nitrogen - Nitrate as N	mg/L	2022-09-12	0.02	0.03
Nitrogen - Nitrate as N	mg/L	2022-10-11	0.02	0.03
Nitrogen - Nitrate as N	mg/L	2022-11-07	0.20	0.16
Nitrogen - Nitrate as N	mg/L	2022-12-05	0.18	0.17
Nitrogen - Nitrite as N	mg/L	2022-01-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-02-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-03-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-04-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-05-02	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-06-06	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-07-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-08-08	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-09-12	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-10-11	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-11-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-12-05	<0.01	<0.01
pH	pH units	2022-01-01	6.6	8.5
pH	pH units	2022-01-03	6.6	8.5
pH	pH units	2022-01-04	6.5	8.1
pH	pH units	2022-01-05	7.5	8.2
pH	pH units	2022-01-06	6.5	8.3
pH	pH units	2022-01-07	7.7	8.1
pH	pH units	2022-01-08	6.5	8.4
pH	pH units	2022-01-09	6.5	8.4
pH	pH units	2022-01-10	6.5	8.0
pH	pH units	2022-01-11	6.7	8.4
pH	pH units	2022-01-12	6.6	8.5
pH	pH units	2022-01-13	6.7	8.0
pH	pH units	2022-01-14	6.6	8.4
pH	pH units	2022-01-15	6.5	8.3
pH	pH units	2022-01-16	6.6	8.4

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-01-17	6.4	8.3
pH	pH units	2022-01-18	6.5	8.3
pH	pH units	2022-01-19	-	8.0
pH	pH units	2022-01-20	6.7	8.4
pH	pH units	2022-01-21	6.6	8.0
pH	pH units	2022-01-22	6.7	8.3
pH	pH units	2022-01-23	6.5	8.5
pH	pH units	2022-01-24	6.4	7.9
pH	pH units	2022-01-25	7.3	8.4
pH	pH units	2022-01-26	6.5	8.5
pH	pH units	2022-01-27	6.6	8.1
pH	pH units	2022-01-28	6.6	8.4
pH	pH units	2022-01-29	6.6	8.1
pH	pH units	2022-01-30	6.6	8.3
pH	pH units	2022-01-31	6.4	7.9
pH	pH units	2022-02-01	6.5	8.3
pH	pH units	2022-02-02	6.6	8.1
pH	pH units	2022-02-03	7.3	8.1
pH	pH units	2022-02-04	6.7	8.2
pH	pH units	2022-02-05	6.4	8.1
pH	pH units	2022-02-06	6.7	8.5
pH	pH units	2022-02-07	6.4	8.0
pH	pH units	2022-02-08	7.0	8.2
pH	pH units	2022-02-09	6.5	8.5
pH	pH units	2022-02-10	6.6	8.3
pH	pH units	2022-02-11	6.6	8.3
pH	pH units	2022-02-12	6.7	8.3
pH	pH units	2022-02-13	6.5	8.3
pH	pH units	2022-02-14	6.4	7.8
pH	pH units	2022-02-15	7.0	7.8
pH	pH units	2022-02-16	6.7	8.4
pH	pH units	2022-02-17	6.5	8.1
pH	pH units	2022-02-18	6.6	8.4
pH	pH units	2022-02-19	6.5	8.4
pH	pH units	2022-02-20	6.6	8.6
pH	pH units	2022-02-21	6.6	8.5
pH	pH units	2022-02-22	6.5	8.0
pH	pH units	2022-02-23	7.2	8.4
pH	pH units	2022-02-24	6.7	8.6
pH	pH units	2022-02-25	6.6	8.1
pH	pH units	2022-02-26	6.7	8.5
pH	pH units	2022-02-27	6.6	8.6

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-02-28	6.6	8.1
pH	pH units	2022-03-01	6.6	8.6
pH	pH units	2022-03-02	6.7	8.4
pH	pH units	2022-03-03	6.6	8.4
pH	pH units	2022-03-04	6.5	8.4
pH	pH units	2022-03-05	6.6	8.5
pH	pH units	2022-03-06	6.6	8.4
pH	pH units	2022-03-07	6.5	8.0
pH	pH units	2022-03-08	6.7	8.5
pH	pH units	2022-03-09	6.6	8.4
pH	pH units	2022-03-10	6.6	8.5
pH	pH units	2022-03-11	6.6	8.4
pH	pH units	2022-03-12	6.7	8.4
pH	pH units	2022-03-13	6.7	8.4
pH	pH units	2022-03-14	6.5	7.9
pH	pH units	2022-03-15	6.7	8.4
pH	pH units	2022-03-16	6.7	8.4
pH	pH units	2022-03-17	6.6	8.5
pH	pH units	2022-03-18	6.8	8.4
pH	pH units	2022-03-19	6.7	8.3
pH	pH units	2022-03-20	6.7	8.4
pH	pH units	2022-03-21	6.7	7.9
pH	pH units	2022-03-22	6.7	8.3
pH	pH units	2022-03-23	6.7	8.4
pH	pH units	2022-03-24	6.6	8.4
pH	pH units	2022-03-25	6.7	8.4
pH	pH units	2022-03-26	6.6	8.3
pH	pH units	2022-03-27	6.7	8.6
pH	pH units	2022-03-28	6.6	7.9
pH	pH units	2022-03-29	6.7	8.5
pH	pH units	2022-03-30	6.7	8.6
pH	pH units	2022-03-31	6.6	8.4
pH	pH units	2022-04-01	6.7	8.3
pH	pH units	2022-04-02	6.8	8.3
pH	pH units	2022-04-03	6.7	8.3
pH	pH units	2022-04-04	6.5	8.0
pH	pH units	2022-04-05	6.8	8.4
pH	pH units	2022-04-06	6.6	8.4
pH	pH units	2022-04-07	6.7	8.4
pH	pH units	2022-04-08	6.8	8.6
pH	pH units	2022-04-09	6.8	8.3
pH	pH units	2022-04-10	6.7	8.5

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-04-11	6.7	8.0
pH	pH units	2022-04-12	6.8	8.5
pH	pH units	2022-04-13	6.8	8.5
pH	pH units	2022-04-14	6.7	8.4
pH	pH units	2022-04-15	5.2	7.1
pH	pH units	2022-04-16	6.0	8.3
pH	pH units	2022-04-17	6.7	7.8
pH	pH units	2022-04-18	6.8	8.5
pH	pH units	2022-04-19	6.8	8.1
pH	pH units	2022-04-20	6.7	8.5
pH	pH units	2022-04-21	6.8	8.5
pH	pH units	2022-04-22	6.8	8.5
pH	pH units	2022-04-23	6.7	8.7
pH	pH units	2022-04-24	6.8	8.2
pH	pH units	2022-04-25	6.5	8.0
pH	pH units	2022-04-26	6.8	8.5
pH	pH units	2022-04-27	6.7	8.5
pH	pH units	2022-04-28	6.8	8.4
pH	pH units	2022-04-29	6.8	8.3
pH	pH units	2022-04-30	6.8	8.5
pH	pH units	2022-05-01	6.7	8.6
pH	pH units	2022-05-02	6.6	8.1
pH	pH units	2022-05-03	6.8	8.6
pH	pH units	2022-05-04	6.8	8.6
pH	pH units	2022-05-05	6.6	8.5
pH	pH units	2022-05-06	6.9	8.6
pH	pH units	2022-05-07	6.6	8.6
pH	pH units	2022-05-08	6.5	8.6
pH	pH units	2022-05-09	6.6	8.6
pH	pH units	2022-05-10	6.6	8.5
pH	pH units	2022-05-11	6.6	8.6
pH	pH units	2022-05-12	-	8.5
pH	pH units	2022-05-13	6.8	8.5
pH	pH units	2022-05-14	6.6	8.5
pH	pH units	2022-05-15	6.6	8.6
pH	pH units	2022-05-16	6.7	8.5
pH	pH units	2022-05-17	6.7	8.7
pH	pH units	2022-05-18	6.7	8.9
pH	pH units	2022-05-19	6.7	8.5
pH	pH units	2022-05-20	6.7	8.4
pH	pH units	2022-05-21	6.6	8.5
pH	pH units	2022-05-22	6.6	8.5

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-05-23	6.6	8.5
pH	pH units	2022-05-24	6.8	8.0
pH	pH units	2022-05-25	6.8	8.6
pH	pH units	2022-05-26	6.7	8.6
pH	pH units	2022-05-27	6.9	8.3
pH	pH units	2022-05-28	6.6	8.3
pH	pH units	2022-05-29	6.7	8.3
pH	pH units	2022-05-30	6.6	8.0
pH	pH units	2022-05-31	6.8	8.4
pH	pH units	2022-06-01	6.8	8.5
pH	pH units	2022-06-02	6.8	8.5
pH	pH units	2022-06-03	6.8	8.5
pH	pH units	2022-06-04	6.7	8.4
pH	pH units	2022-06-05	6.7	8.5
pH	pH units	2022-06-06	6.6	8.0
pH	pH units	2022-06-07	6.7	8.6
pH	pH units	2022-06-08	6.8	8.5
pH	pH units	2022-06-09	7.8	8.4
pH	pH units	2022-06-10	6.7	8.5
pH	pH units	2022-06-12	6.6	8.0
pH	pH units	2022-06-13	6.6	8.5
pH	pH units	2022-06-14	6.9	8.6
pH	pH units	2022-06-15	6.7	8.4
pH	pH units	2022-06-16	6.8	8.5
pH	pH units	2022-06-17	6.7	8.5
pH	pH units	2022-06-18	6.6	8.4
pH	pH units	2022-06-19	6.8	8.3
pH	pH units	2022-06-20	6.7	8.5
pH	pH units	2022-06-21	6.7	8.5
pH	pH units	2022-06-22	6.7	8.5
pH	pH units	2022-06-23	6.8	8.5
pH	pH units	2022-06-24	6.7	8.5
pH	pH units	2022-06-25	6.7	8.1
pH	pH units	2022-06-26	6.7	8.3
pH	pH units	2022-06-27	6.6	8.4
pH	pH units	2022-06-28	6.8	8.5
pH	pH units	2022-06-29	6.9	8.6
pH	pH units	2022-06-30	6.7	8.5
pH	pH units	2022-07-01	6.8	8.4
pH	pH units	2022-07-02	6.9	8.5
pH	pH units	2022-07-03	6.8	8.5
pH	pH units	2022-07-04	6.6	8.4

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-07-05	6.8	8.4
pH	pH units	2022-07-06	6.8	8.5
pH	pH units	2022-07-07	6.8	8.5
pH	pH units	2022-07-08	6.8	8.5
pH	pH units	2022-07-09	6.8	8.4
pH	pH units	2022-07-10	6.7	8.4
pH	pH units	2022-07-11	6.6	8.1
pH	pH units	2022-07-12	6.8	8.5
pH	pH units	2022-07-13	6.8	8.4
pH	pH units	2022-07-14	7.0	8.4
pH	pH units	2022-07-15	6.7	8.4
pH	pH units	2022-07-16	6.8	8.4
pH	pH units	2022-07-17	6.6	8.4
pH	pH units	2022-07-18	6.7	8.1
pH	pH units	2022-07-19	6.8	8.4
pH	pH units	2022-07-20	6.9	8.3
pH	pH units	2022-07-21	6.8	8.4
pH	pH units	2022-07-22	6.9	8.5
pH	pH units	2022-07-23	6.8	8.3
pH	pH units	2022-07-24	6.9	8.4
pH	pH units	2022-07-25	6.5	8.1
pH	pH units	2022-07-26	6.7	8.5
pH	pH units	2022-07-27	6.8	8.4
pH	pH units	2022-07-28	6.7	8.5
pH	pH units	2022-07-29	6.8	8.5
pH	pH units	2022-07-30	6.8	8.5
pH	pH units	2022-07-31	6.9	8.4
pH	pH units	2022-08-01	7.0	8.3
pH	pH units	2022-08-02	6.7	8.1
pH	pH units	2022-08-04	6.7	8.4
pH	pH units	2022-08-05	6.7	8.4
pH	pH units	2022-08-06	6.8	8.5
pH	pH units	2022-08-07	6.7	8.5
pH	pH units	2022-08-08	6.5	8.4
pH	pH units	2022-08-09	6.8	8.6
pH	pH units	2022-08-10	6.8	8.6
pH	pH units	2022-08-11	6.9	8.5
pH	pH units	2022-08-12	6.7	8.5
pH	pH units	2022-08-13	6.9	8.5
pH	pH units	2022-08-14	6.8	8.5
pH	pH units	2022-08-15	6.7	8.2
pH	pH units	2022-08-16	6.7	8.5

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-08-17	6.9	8.4
pH	pH units	2022-08-18	6.8	8.5
pH	pH units	2022-08-19	6.8	8.5
pH	pH units	2022-08-20	6.8	8.3
pH	pH units	2022-08-21	6.9	8.4
pH	pH units	2022-08-22	6.5	8.4
pH	pH units	2022-08-23	6.9	8.1
pH	pH units	2022-08-24	6.9	8.4
pH	pH units	2022-08-25	6.6	8.4
pH	pH units	2022-08-26	6.7	8.5
pH	pH units	2022-08-27	6.9	8.4
pH	pH units	2022-08-28	6.9	8.4
pH	pH units	2022-08-29	6.6	8.2
pH	pH units	2022-08-30	6.7	8.5
pH	pH units	2022-08-31	6.6	8.5
pH	pH units	2022-09-01	7.0	8.6
pH	pH units	2022-09-02	6.8	8.6
pH	pH units	2022-09-03	6.8	8.5
pH	pH units	2022-09-04	6.9	8.3
pH	pH units	2022-09-05	6.9	8.4
pH	pH units	2022-09-06	6.4	8.5
pH	pH units	2022-09-07	6.7	8.6
pH	pH units	2022-09-08	6.8	8.5
pH	pH units	2022-09-09	6.8	8.5
pH	pH units	2022-09-10	6.8	8.4
pH	pH units	2022-09-11	6.8	8.4
pH	pH units	2022-09-12	6.4	8.1
pH	pH units	2022-09-13	6.8	8.5
pH	pH units	2022-09-14	6.8	8.5
pH	pH units	2022-09-15	6.7	8.5
pH	pH units	2022-09-16	6.8	8.5
pH	pH units	2022-09-17	6.8	8.5
pH	pH units	2022-09-18	6.9	8.8
pH	pH units	2022-09-19	6.9	8.7
pH	pH units	2022-09-20	6.4	8.4
pH	pH units	2022-09-21	6.8	8.6
pH	pH units	2022-09-22	6.9	8.6
pH	pH units	2022-09-23	6.9	8.5
pH	pH units	2022-09-24	6.9	8.6
pH	pH units	2022-09-25	6.9	8.5
pH	pH units	2022-09-26	6.4	8.54
pH	pH units	2022-09-27	6.7	8.5

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-09-28	6.7	8.4
pH	pH units	2022-09-29	6.5	8.5
pH	pH units	2022-09-30	6.9	8.7
pH	pH units	2022-10-01	6.9	8.5
pH	pH units	2022-10-02	7.0	8.7
pH	pH units	2022-10-03	6.6	8.2
pH	pH units	2022-10-04	6.7	8.5
pH	pH units	2022-10-05	6.9	8.5
pH	pH units	2022-10-06	7.0	8.5
pH	pH units	2022-10-07	6.6	8.5
pH	pH units	2022-10-08	7.0	8.6
pH	pH units	2022-10-09	7.0	8.7
pH	pH units	2022-10-10	6.9	8.8
pH	pH units	2022-10-11	6.5	8.3
pH	pH units	2022-10-12	6.6	8.6
pH	pH units	2022-10-13	6.6	8.6
pH	pH units	2022-10-14	6.9	8.7
pH	pH units	2022-10-15	6.6	8.4
pH	pH units	2022-10-16	6.8	8.4
pH	pH units	2022-10-17	6.4	8.0
pH	pH units	2022-10-18	6.8	8.8
pH	pH units	2022-10-19	7.1	8.5
pH	pH units	2022-10-20	6.9	8.6
pH	pH units	2022-10-21	6.9	8.7
pH	pH units	2022-10-22	7.2	8.5
pH	pH units	2022-10-23	7.1	8.4
pH	pH units	2022-10-24	6.6	8.0
pH	pH units	2022-10-25	7.0	8.7
pH	pH units	2022-10-27	6.9	8.4
pH	pH units	2022-10-28	8.8	8.7
pH	pH units	2022-10-29	7.1	8.4
pH	pH units	2022-10-30	7.2	8.5
pH	pH units	2022-10-31	6.5	8.5
pH	pH units	2022-11-01	7.0	8.7
pH	pH units	2022-11-02	6.9	8.7
pH	pH units	2022-11-03	6.8	8.5
pH	pH units	2022-11-04	6.9	8.5
pH	pH units	2022-11-05	7.2	8.4
pH	pH units	2022-11-06	7.2	8.1
pH	pH units	2022-11-07	6.7	8.3
pH	pH units	2022-11-08	6.7	8.5
pH	pH units	2022-11-09	6.8	8.4

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-11-10	6.8	8.2
pH	pH units	2022-11-11	6.7	7.2
pH	pH units	2022-11-12	6.9	7.8
pH	pH units	2022-11-13	6.7	7.4
pH	pH units	2022-11-14	6.5	8.5
pH	pH units	2022-11-15	6.8	8.1
pH	pH units	2022-11-16	6.7	8.5
pH	pH units	2022-11-17	6.5	8.4
pH	pH units	2022-11-18	6.8	8.4
pH	pH units	2022-11-19	-	8.5
pH	pH units	2022-11-20	7.0	8.2
pH	pH units	2022-11-21	6.6	8.0
pH	pH units	2022-11-22	6.8	8.5
pH	pH units	2022-11-23	6.9	8.5
pH	pH units	2022-11-24	6.8	8.7
pH	pH units	2022-11-25	6.8	8.2
pH	pH units	2022-11-26	7.4	8.4
pH	pH units	2022-11-27	6.9	8.3
pH	pH units	2022-11-28	6.6	8.4
pH	pH units	2022-11-29	6.9	8.3
pH	pH units	2022-11-30	6.8	8.5
pH	pH units	2022-12-01	6.7	8.5
pH	pH units	2022-12-02	6.8	8.2
pH	pH units	2022-12-03	7.3	8.3
pH	pH units	2022-12-04	6.8	7.8
pH	pH units	2022-12-05	6.6	7.9
pH	pH units	2022-12-06	6.8	8.4
pH	pH units	2022-12-07	6.7	8.5
pH	pH units	2022-12-08	6.7	8.5
pH	pH units	2022-12-09	6.8	8.4
pH	pH units	2022-12-10	7.2	8.0
pH	pH units	2022-12-11	7.2	7.9
pH	pH units	2022-12-12	6.6	8.4
pH	pH units	2022-12-13	6.8	8.4
pH	pH units	2022-12-14	6.6	8.5
pH	pH units	2022-12-15	6.8	8.1
pH	pH units	2022-12-16	6.8	8.4
pH	pH units	2022-12-17	7.0	8.6
pH	pH units	2022-12-18	-	8.5
pH	pH units	2022-12-19	6.9	8.5
pH	pH units	2022-12-20	6.7	8.4
pH	pH units	2022-12-21	6.6	8.4

Analysis - Capilano	Units	Date Sampled	Source	Treated
pH	pH units	2022-12-22	-	8.4
pH	pH units	2022-12-23	-	8.3
pH	pH units	2022-12-24	7.0	8.8
pH	pH units	2022-12-26	6.8	9.0
pH	pH units	2022-12-27	6.3	8.6
pH	pH units	2022-12-28	6.9	7.9
pH	pH units	2022-12-29	6.5	7.7
pH	pH units	2022-12-30	7.4	8.1
pH	pH units	2022-12-31	6.5	8.2
Phenol	mg/L	2022-05-02	<0.005	<0.005
Phenol	mg/L	2022-11-07	<0.005	<0.005
Phosphorus Dissolved	µg/L	2022-01-04	<10	<10
Phosphorus Dissolved	µg/L	2022-02-14	<10	<10
Phosphorus Dissolved	µg/L	2022-03-07	<10	<10
Phosphorus Dissolved	µg/L	2022-04-04	<10	<10
Phosphorus Dissolved	µg/L	2022-05-02	<10	<10
Phosphorus Dissolved	µg/L	2022-06-06	<10	<10
Phosphorus Dissolved	µg/L	2022-07-04	<10	<10
Phosphorus Dissolved	µg/L	2022-08-08	<10	<10
Phosphorus Dissolved	µg/L	2022-09-12	<10	<10
Phosphorus Dissolved	µg/L	2022-10-11	<10	<10
Phosphorus Dissolved	µg/L	2022-11-07	<10	<10
Phosphorus Dissolved	µg/L	2022-12-05	<10	<10
Phosphorus Total	µg/L	2022-01-04	<10	<10
Phosphorus Total	mg/L	2022-02-07	<0.005	<0.005
Phosphorus Total	µg/L	2022-02-07	<10	<10
Phosphorus Total	µg/L	2022-02-14	<10	<10
Phosphorus Total	µg/L	2022-03-07	<10	<10
Phosphorus Total	µg/L	2022-04-04	<10	<10
Phosphorus Total	µg/L	2022-05-02	<10	<10
Phosphorus Total	µg/L	2022-06-06	<10	<10
Phosphorus Total	µg/L	2022-07-04	<10	<10
Phosphorus Total	µg/L	2022-08-08	<10	<10
Phosphorus Total	µg/L	2022-09-12	<10	<10
Phosphorus Total	µg/L	2022-10-11	<10	<10
Phosphorus Total	µg/L	2022-11-07	16	<10
Phosphorus Total	µg/L	2022-12-05	13	<10
Potassium Total	µg/L	2022-02-17	-	153
Potassium Total	µg/L	2022-05-02	160	156
Potassium Total	µg/L	2022-05-04	152	161
Potassium Total	µg/L	2022-05-10	-	167
Potassium Total	µg/L	2022-08-23	-	148

Analysis - Capilano	Units	Date Sampled	Source	Treated
Potassium Total	µg/L	2022-11-07	48	135
Potassium Total	µg/L	2022-11-08	230	228
Potassium Total	µg/L	2022-11-15	-	227
Reactive Phosphorus	mg/L	2022-02-07	0.005	<0.005
Residue Total	mg/L	2022-02-07	15	36
Residue Total	mg/L	2022-04-04	15	31
Residue Total	mg/L	2022-05-02	16	36
Residue Total	mg/L	2022-07-04	12	34
Residue Total	mg/L	2022-09-12	14	33
Residue Total	mg/L	2022-11-07	18	36
Residue Total Dissolved	mg/L	2022-02-07	13	35
Residue Total Dissolved	mg/L	2022-04-04	12	31
Residue Total Dissolved	mg/L	2022-05-02	15	34
Residue Total Dissolved	mg/L	2022-07-04	11	33
Residue Total Dissolved	mg/L	2022-09-12	10	31
Residue Total Dissolved	mg/L	2022-11-07	13	31
Residue Total Fixed	mg/L	2022-02-07	11	30
Residue Total Fixed	mg/L	2022-04-04	11	26
Residue Total Fixed	mg/L	2022-05-02	9	28
Residue Total Fixed	mg/L	2022-07-04	6	25
Residue Total Fixed	mg/L	2022-09-12	8	25
Residue Total Fixed	mg/L	2022-11-07	9	29
Residue Total Volatile	mg/L	2022-02-07	4	7
Residue Total Volatile	mg/L	2022-04-04	4	5
Residue Total Volatile	mg/L	2022-05-02	7	8
Residue Total Volatile	mg/L	2022-07-04	7	9
Residue Total Volatile	mg/L	2022-09-12	7	8
Residue Total Volatile	mg/L	2022-11-07	8	7
Selenium Total	µg/L	2022-02-17	-	<0.5
Selenium Total	µg/L	2022-05-02	<0.5	<0.5
Selenium Total	µg/L	2022-05-04	<0.5	<0.5
Selenium Total	µg/L	2022-05-10	-	<0.5
Selenium Total	µg/L	2022-08-23	-	<0.5
Selenium Total	µg/L	2022-11-07	<0.5	<0.5
Selenium Total	µg/L	2022-11-08	<0.5	<0.5
Selenium Total	µg/L	2022-11-15	-	<0.5
Silica as SiO ₂	mg/L	2022-02-07	3.4	3.4
Silica as SiO ₂	mg/L	2022-04-04	3.4	3.4
Silica as SiO ₂	mg/L	2022-05-02	3.5	3.6
Silica as SiO ₂	mg/L	2022-07-04	2.8	2.8
Silica as SiO ₂	mg/L	2022-09-12	3.0	3.3
Silica as SiO ₂	mg/L	2022-11-07	3.4	3.2

Analysis - Capilano	Units	Date Sampled	Source	Treated
Silver Total	µg/L	2022-02-17	-	<0.5
Silver Total	µg/L	2022-05-02	<0.5	<0.5
Silver Total	µg/L	2022-05-04	<0.5	<0.5
Silver Total	µg/L	2022-05-10	-	<0.5
Silver Total	µg/L	2022-08-23	-	<0.5
Silver Total	µg/L	2022-11-07	<0.5	<0.5
Silver Total	µg/L	2022-11-08	<0.5	<0.5
Silver Total	µg/L	2022-11-15	-	<0.5
Sodium Total	µg/L	2022-02-07	595	1,380
Sodium Total	µg/L	2022-02-14	583	1,400
Sodium Total	µg/L	2022-02-17	654	1,510
Sodium Total	µg/L	2022-04-04	598	1,490
Sodium Total	µg/L	2022-05-02	598	1,440
Sodium Total	µg/L	2022-05-04	624	1,530
Sodium Total	µg/L	2022-05-10	603	1,580
Sodium Total	µg/L	2022-07-04	425	1,400
Sodium Total	µg/L	2022-08-23	462	1,680
Sodium Total	µg/L	2022-09-12	490	1,500
Sodium Total	µg/L	2022-11-07	703	1,790
Sodium Total	µg/L	2022-11-08	664	1,820
Sodium Total	µg/L	2022-11-15	-	1,770
Sodium Total	µg/L	2022-11-17	679	-
Strontium Total	µg/L	2022-05-02	5.9	-
Strontium Total	µg/L	2022-11-07	1.4	-
Sulphate	mg/L	2022-01-04	0.7	1.1
Sulphate	mg/L	2022-02-07	0.7	0.9
Sulphate	mg/L	2022-03-07	0.8	1.1
Sulphate	mg/L	2022-04-04	0.7	1.0
Sulphate	mg/L	2022-05-02	0.7	1.0
Sulphate	mg/L	2022-06-06	0.6	0.8
Sulphate	mg/L	2022-07-04	0.5	0.8
Sulphate	mg/L	2022-08-08	0.5	0.7
Sulphate	mg/L	2022-09-12	0.5	0.8
Sulphate	mg/L	2022-10-11	0.7	0.9
Sulphate	mg/L	2022-11-07	0.7	1.1
Sulphate	mg/L	2022-12-05	0.7	1.0
Temperature	°C	2022-01-01	4.7	4.7
Temperature	°C	2022-01-02	5	4
Temperature	°C	2022-01-03	3.2	2.7
Temperature	°C	2022-01-04	3	3
Temperature	°C	2022-01-05	2.9	2.7
Temperature	°C	2022-01-06	3.2	3.2

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-01-07	3.4	2.6
Temperature	°C	2022-01-08	2.0	3.0
Temperature	°C	2022-01-09	1.6	2.9
Temperature	°C	2022-01-10	2	3
Temperature	°C	2022-01-11	2.5	2.4
Temperature	°C	2022-01-12	1.4	2.9
Temperature	°C	2022-01-13	2.4	2.7
Temperature	°C	2022-01-14	2.2	2.5
Temperature	°C	2022-01-15	3.8	3.6
Temperature	°C	2022-01-16	2.9	3.0
Temperature	°C	2022-01-17	2	2.7
Temperature	°C	2022-01-18	2.7	3.0
Temperature	°C	2022-01-19	2.9	2.9
Temperature	°C	2022-01-20	2.9	2.8
Temperature	°C	2022-01-21	3.2	3.2
Temperature	°C	2022-01-22	2.3	3.4
Temperature	°C	2022-01-23	3.0	3.4
Temperature	°C	2022-01-24	3	3.4
Temperature	°C	2022-01-25	3.3	3.2
Temperature	°C	2022-01-26	3.7	3.4
Temperature	°C	2022-01-27	2.1	2.4
Temperature	°C	2022-01-28	3.0	3.2
Temperature	°C	2022-01-29	2.1	2.3
Temperature	°C	2022-01-30	2.8	3.2
Temperature	°C	2022-01-31	2.8	3.2
Temperature	°C	2022-02-01	3.1	3.3
Temperature	°C	2022-02-02	3.1	3.2
Temperature	°C	2022-02-03	3.0	3.0
Temperature	°C	2022-02-04	4.0	3.1
Temperature	°C	2022-02-05	5.3	5.7
Temperature	°C	2022-02-06	4.7	3.3
Temperature	°C	2022-02-07	3.6	3.5
Temperature	°C	2022-02-08	5.6	3.2
Temperature	°C	2022-02-09	5.7	3.6
Temperature	°C	2022-02-10	7.2	3.8
Temperature	°C	2022-02-11	6.8	3.4
Temperature	°C	2022-02-12	6.8	3.4
Temperature	°C	2022-02-13	7.2	3.5
Temperature	°C	2022-02-14	7	3.4
Temperature	°C	2022-02-15	7.3	3.4
Temperature	°C	2022-02-16	3.2	3.4
Temperature	°C	2022-02-17	3	4

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-02-18	3.0	3.4
Temperature	°C	2022-02-19	3.3	3.7
Temperature	°C	2022-02-20	3.3	3.5
Temperature	°C	2022-02-21	3	4
Temperature	°C	2022-02-22	3.0	4
Temperature	°C	2022-02-23	2.9	3.4
Temperature	°C	2022-02-24	3.0	3.3
Temperature	°C	2022-02-25	3.1	3.2
Temperature	°C	2022-02-26	3.1	3.2
Temperature	°C	2022-02-27	3.2	3.2
Temperature	°C	2022-02-28	3	3
Temperature	°C	2022-03-01	2.9	3.4
Temperature	°C	2022-03-02	2.9	3.5
Temperature	°C	2022-03-03	3.7	3.3
Temperature	°C	2022-03-04	4.2	3.7
Temperature	°C	2022-03-05	4.3	3.6
Temperature	°C	2022-03-06	3.0	3.3
Temperature	°C	2022-03-07	3	3
Temperature	°C	2022-03-08	3.3	3.6
Temperature	°C	2022-03-09	3.2	3.7
Temperature	°C	2022-03-10	3.2	3.8
Temperature	°C	2022-03-11	3.4	3.8
Temperature	°C	2022-03-12	3.2	3.8
Temperature	°C	2022-03-13	3.8	3.9
Temperature	°C	2022-03-14	4	4
Temperature	°C	2022-03-15	4.5	4.0
Temperature	°C	2022-03-16	3.6	4.0
Temperature	°C	2022-03-17	3.6	4.0
Temperature	°C	2022-03-18	3.5	4.0
Temperature	°C	2022-03-19	3.6	4.5
Temperature	°C	2022-03-20	3.6	4.2
Temperature	°C	2022-03-21	4	4
Temperature	°C	2022-03-22	4.2	4.2
Temperature	°C	2022-03-23	4.3	4.2
Temperature	°C	2022-03-24	4.4	4.4
Temperature	°C	2022-03-25	3.8	4.4
Temperature	°C	2022-03-26	3.9	4.5
Temperature	°C	2022-03-27	4.2	4.7
Temperature	°C	2022-03-28	4	4.7
Temperature	°C	2022-03-29	4.4	4.7
Temperature	°C	2022-03-30	4.8	4.9
Temperature	°C	2022-03-31	4.9	5.0

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-04-01	4.5	5.0
Temperature	°C	2022-04-02	4.9	5.3
Temperature	°C	2022-04-03	4.9	5.5
Temperature	°C	2022-04-04	5	5.7
Temperature	°C	2022-04-05	4.6	5.3
Temperature	°C	2022-04-06	4.8	5.2
Temperature	°C	2022-04-07	5.1	5.3
Temperature	°C	2022-04-08	5.5	5.7
Temperature	°C	2022-04-09	5.0	5.3
Temperature	°C	2022-04-10	5.1	5.5
Temperature	°C	2022-04-11	5.0	5
Temperature	°C	2022-04-12	5.4	5.7
Temperature	°C	2022-04-13	5.1	5.5
Temperature	°C	2022-04-14	5.4	5.6
Temperature	°C	2022-04-15	5.3	5.6
Temperature	°C	2022-04-16	5.3	5.6
Temperature	°C	2022-04-17	5.3	5.5
Temperature	°C	2022-04-18	5.6	5.7
Temperature	°C	2022-04-19	6	6
Temperature	°C	2022-04-20	6.0	5.8
Temperature	°C	2022-04-21	5.5	5.9
Temperature	°C	2022-04-22	5.2	5.8
Temperature	°C	2022-04-23	5.3	5.8
Temperature	°C	2022-04-24	5.8	5.9
Temperature	°C	2022-04-25	5	6
Temperature	°C	2022-04-26	6.0	6.0
Temperature	°C	2022-04-27	6.1	6.4
Temperature	°C	2022-04-28	6.5	6.5
Temperature	°C	2022-04-29	6.5	6.5
Temperature	°C	2022-04-30	6.5	6.6
Temperature	°C	2022-05-01	6.1	6.5
Temperature	°C	2022-05-02	7	6.8
Temperature	°C	2022-05-03	5.9	7.1
Temperature	°C	2022-05-04	6.1	6.8
Temperature	°C	2022-05-05	6.8	7.0
Temperature	°C	2022-05-06	6.3	7.1
Temperature	°C	2022-05-07	6.5	6.8
Temperature	°C	2022-05-08	6.3	6.8
Temperature	°C	2022-05-09	6.5	7
Temperature	°C	2022-05-10	6.5	6.8
Temperature	°C	2022-05-11	6.7	7.1
Temperature	°C	2022-05-12	6.5	7.2

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-05-13	6.3	6.8
Temperature	°C	2022-05-14	6.8	7.2
Temperature	°C	2022-05-15	6.8	7.5
Temperature	°C	2022-05-16	6.8	8
Temperature	°C	2022-05-17	6.7	7.0
Temperature	°C	2022-05-18	6.5	7.0
Temperature	°C	2022-05-19	6.8	6.7
Temperature	°C	2022-05-20	6.3	7.0
Temperature	°C	2022-05-21	6.6	6.8
Temperature	°C	2022-05-22	7.0	7.0
Temperature	°C	2022-05-23	6.8	7.2
Temperature	°C	2022-05-24	7	7.9
Temperature	°C	2022-05-25	7.0	7.4
Temperature	°C	2022-05-26	7.2	7.8
Temperature	°C	2022-05-27	6.8	7.9
Temperature	°C	2022-05-28	6.9	7.7
Temperature	°C	2022-05-29	7.0	7.5
Temperature	°C	2022-05-30	7	7
Temperature	°C	2022-05-31	7.2	7.3
Temperature	°C	2022-06-01	7.5	7.9
Temperature	°C	2022-06-02	7.3	7.8
Temperature	°C	2022-06-03	7.6	7.6
Temperature	°C	2022-06-04	7.5	8.2
Temperature	°C	2022-06-05	7.6	8.6
Temperature	°C	2022-06-06	7	8.1
Temperature	°C	2022-06-07	7.9	7.9
Temperature	°C	2022-06-08	8.0	7.9
Temperature	°C	2022-06-09	6.8	7.8
Temperature	°C	2022-06-10	7.8	7.9
Temperature	°C	2022-06-11	8	8
Temperature	°C	2022-06-12	7.8	8.0
Temperature	°C	2022-06-13	7.8	7.8
Temperature	°C	2022-06-14	7.8	7.9
Temperature	°C	2022-06-15	7.7	7.7
Temperature	°C	2022-06-16	7.9	8.1
Temperature	°C	2022-06-17	8.2	8.4
Temperature	°C	2022-06-18	8.0	8.4
Temperature	°C	2022-06-19	8.1	8.6
Temperature	°C	2022-06-20	8	9
Temperature	°C	2022-06-21	8.1	8.5
Temperature	°C	2022-06-22	8.0	8.7
Temperature	°C	2022-06-23	8.2	8.1

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-06-24	8.4	8.7
Temperature	°C	2022-06-25	8.4	8.6
Temperature	°C	2022-06-26	8.7	9.0
Temperature	°C	2022-06-27	9	10
Temperature	°C	2022-06-28	8.6	9.3
Temperature	°C	2022-06-29	8.7	9.5
Temperature	°C	2022-06-30	8.7	9.4
Temperature	°C	2022-07-01	8.2	9.1
Temperature	°C	2022-07-02	8.5	9.6
Temperature	°C	2022-07-03	8.7	10.0
Temperature	°C	2022-07-04	9	10.0
Temperature	°C	2022-07-05	9.0	10.1
Temperature	°C	2022-07-06	9.1	10.2
Temperature	°C	2022-07-07	9.0	10.0
Temperature	°C	2022-07-08	9.4	10.2
Temperature	°C	2022-07-09	9.2	10.1
Temperature	°C	2022-07-10	9.6	10.2
Temperature	°C	2022-07-11	10	10.8
Temperature	°C	2022-07-12	9.9	10.9
Temperature	°C	2022-07-13	9.9	11.0
Temperature	°C	2022-07-14	10.0	11.0
Temperature	°C	2022-07-15	10.2	11.3
Temperature	°C	2022-07-16	10.1	11.3
Temperature	°C	2022-07-17	10.2	11.4
Temperature	°C	2022-07-18	10	12
Temperature	°C	2022-07-19	10.4	11.8
Temperature	°C	2022-07-20	10.5	12.0
Temperature	°C	2022-07-21	10.4	11.0
Temperature	°C	2022-07-22	10.7	11.2
Temperature	°C	2022-07-23	10.5	11.1
Temperature	°C	2022-07-24	10.5	11.7
Temperature	°C	2022-07-25	10	12
Temperature	°C	2022-07-26	10.5	11.4
Temperature	°C	2022-07-27	10.4	11.8
Temperature	°C	2022-07-28	10.9	11.8
Temperature	°C	2022-07-29	10.9	12.0
Temperature	°C	2022-07-30	11.3	12.3
Temperature	°C	2022-07-31	11.2	13.9
Temperature	°C	2022-08-01	11.0	14.1
Temperature	°C	2022-08-02	11	13
Temperature	°C	2022-08-03	11.4	12.7
Temperature	°C	2022-08-04	11.4	12.3

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-08-05	10.9	12.2
Temperature	°C	2022-08-06	11.6	12.3
Temperature	°C	2022-08-07	11.8	13.0
Temperature	°C	2022-08-08	11.3	13
Temperature	°C	2022-08-09	11.5	12.3
Temperature	°C	2022-08-10	11.0	13.0
Temperature	°C	2022-08-11	11.7	12.7
Temperature	°C	2022-08-12	11.0	13.6
Temperature	°C	2022-08-13	11.3	12.7
Temperature	°C	2022-08-14	11.7	13.4
Temperature	°C	2022-08-15	11	14
Temperature	°C	2022-08-16	11.5	12.9
Temperature	°C	2022-08-17	11.3	13.5
Temperature	°C	2022-08-18	11.6	13.2
Temperature	°C	2022-08-19	11.9	14.5
Temperature	°C	2022-08-20	11.7	13.4
Temperature	°C	2022-08-21	12.0	14.0
Temperature	°C	2022-08-22	12	14.2
Temperature	°C	2022-08-23	12.0	13.9
Temperature	°C	2022-08-24	11.4	14.3
Temperature	°C	2022-08-25	12.2	14.1
Temperature	°C	2022-08-26	12.0	14.6
Temperature	°C	2022-08-27	12.3	14.0
Temperature	°C	2022-08-28	13.2	14.5
Temperature	°C	2022-08-29	12.0	15.0
Temperature	°C	2022-08-30	12.7	14.2
Temperature	°C	2022-08-31	12.1	14.6
Temperature	°C	2022-09-01	13.3	14.5
Temperature	°C	2022-09-02	12.5	14.9
Temperature	°C	2022-09-03	13.1	14.5
Temperature	°C	2022-09-04	13.8	14.7
Temperature	°C	2022-09-05	12.3	14.9
Temperature	°C	2022-09-06	14	14.5
Temperature	°C	2022-09-07	14.1	15.0
Temperature	°C	2022-09-08	13.6	14.5
Temperature	°C	2022-09-09	12.7	15.2
Temperature	°C	2022-09-10	14.0	14.7
Temperature	°C	2022-09-11	14.7	15.3
Temperature	°C	2022-09-12	13.4	16
Temperature	°C	2022-09-13	14.2	14.8
Temperature	°C	2022-09-14	14.8	15.3
Temperature	°C	2022-09-15	14.5	15.0

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-09-16	14.7	15.1
Temperature	°C	2022-09-17	14.0	15.0
Temperature	°C	2022-09-18	14.8	15.1
Temperature	°C	2022-09-19	13.3	15.2
Temperature	°C	2022-09-20	14	15
Temperature	°C	2022-09-21	13.6	15.4
Temperature	°C	2022-09-22	14.5	15.1
Temperature	°C	2022-09-23	14.8	14.9
Temperature	°C	2022-09-24	14.5	15.0
Temperature	°C	2022-09-25	14.7	14.8
Temperature	°C	2022-09-26	15	15
Temperature	°C	2022-09-27	14.5	15.0
Temperature	°C	2022-09-28	14.9	14.8
Temperature	°C	2022-09-29	14.7	15.0
Temperature	°C	2022-09-30	14.7	15.0
Temperature	°C	2022-10-01	15.0	14.8
Temperature	°C	2022-10-02	15.5	15.1
Temperature	°C	2022-10-03	15.6	15
Temperature	°C	2022-10-04	15.2	15.0
Temperature	°C	2022-10-05	15.5	15.2
Temperature	°C	2022-10-06	15.5	15.2
Temperature	°C	2022-10-07	15.7	15.2
Temperature	°C	2022-10-08	15.1	15.0
Temperature	°C	2022-10-09	15.3	15.0
Temperature	°C	2022-10-10	14.5	15.1
Temperature	°C	2022-10-11	14.9	15.2
Temperature	°C	2022-10-12	15.0	15.2
Temperature	°C	2022-10-13	14.7	15.0
Temperature	°C	2022-10-14	14.7	14.9
Temperature	°C	2022-10-15	14.5	14.6
Temperature	°C	2022-10-16	14.6	15.0
Temperature	°C	2022-10-17	14	15
Temperature	°C	2022-10-18	14.3	14.4
Temperature	°C	2022-10-19	14.3	14.4
Temperature	°C	2022-10-20	14.0	14.5
Temperature	°C	2022-10-21	13.7	13.9
Temperature	°C	2022-10-22	14.0	13.8
Temperature	°C	2022-10-23	14.2	13.9
Temperature	°C	2022-10-24	13	14
Temperature	°C	2022-10-25	13.5	13.5
Temperature	°C	2022-10-26	13	13
Temperature	°C	2022-10-27	13	13

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-10-28	12	12
Temperature	°C	2022-10-29	11	11
Temperature	°C	2022-10-30	11	11
Temperature	°C	2022-10-31	10	11
Temperature	°C	2022-11-01	10	10
Temperature	°C	2022-11-02	10	10
Temperature	°C	2022-11-03	10	10
Temperature	°C	2022-11-04	10	10
Temperature	°C	2022-11-05	9	9
Temperature	°C	2022-11-06	9	9
Temperature	°C	2022-11-07	9	8
Temperature	°C	2022-11-08	9	8
Temperature	°C	2022-11-09	9	8
Temperature	°C	2022-11-10	8	8
Temperature	°C	2022-11-11	8	8
Temperature	°C	2022-11-12	8	7
Temperature	°C	2022-11-13	8	7
Temperature	°C	2022-11-14	8	8
Temperature	°C	2022-11-15	8	8
Temperature	°C	2022-11-16	8	8
Temperature	°C	2022-11-17	8	7
Temperature	°C	2022-11-18	7	7
Temperature	°C	2022-11-19	-	7
Temperature	°C	2022-11-20	7	7
Temperature	°C	2022-11-21	7	7
Temperature	°C	2022-11-22	7	7
Temperature	°C	2022-11-23	7	6
Temperature	°C	2022-11-24	7	6
Temperature	°C	2022-11-25	7	7
Temperature	°C	2022-11-26	7	7
Temperature	°C	2022-11-27	7	6
Temperature	°C	2022-11-28	7	6
Temperature	°C	2022-11-29	6	6
Temperature	°C	2022-11-30	6	6
Temperature	°C	2022-12-01	6	6
Temperature	°C	2022-12-02	7	6
Temperature	°C	2022-12-03	6	5
Temperature	°C	2022-12-04	6	5
Temperature	°C	2022-12-05	6	5
Temperature	°C	2022-12-06	5	5
Temperature	°C	2022-12-07	6	5
Temperature	°C	2022-12-08	6	5

Analysis - Capilano	Units	Date Sampled	Source	Treated
Temperature	°C	2022-12-09	6	5
Temperature	°C	2022-12-10	6	5
Temperature	°C	2022-12-11	6	5
Temperature	°C	2022-12-12	6	5
Temperature	°C	2022-12-13	6	5
Temperature	°C	2022-12-14	6	4
Temperature	°C	2022-12-15	5	4
Temperature	°C	2022-12-16	6	4
Temperature	°C	2022-12-17	5	4
Temperature	°C	2022-12-18	-	4
Temperature	°C	2022-12-19	5	4
Temperature	°C	2022-12-20	5	4
Temperature	°C	2022-12-21	5	5
Temperature	°C	2022-12-22	4	5
Temperature	°C	2022-12-23	5	4
Temperature	°C	2022-12-24	4	4
Temperature	°C	2022-12-26	4	3
Temperature	°C	2022-12-27	4	3
Temperature	°C	2022-12-28	4	3
Temperature	°C	2022-12-29	4	3
Temperature	°C	2022-12-30	4	3
Temperature	°C	2022-12-31	4	3
Trichloroacetic Acid	µg/L	2022-02-17	<0.5	4.3
Trichloroacetic Acid	µg/L	2022-05-10	<0.5	3.0
Trichloroacetic Acid	µg/L	2022-08-23	<0.5	2.9
Trichloroacetic Acid	µg/L	2022-11-15	-	3.9
Trichloroacetic Acid	µg/L	2022-11-17	<0.5	-
Turbidity	NTU	2022-01-01	2.4	0.13
Turbidity	NTU	2022-01-02	2.2	0.14
Turbidity	NTU	2022-01-03	3.0	0.14
Turbidity	NTU	2022-01-04	3.0	0.15
Turbidity	NTU	2022-01-05	2.9	0.15
Turbidity	NTU	2022-01-06	2.8	0.18
Turbidity	NTU	2022-01-07	2.4	0.18
Turbidity	NTU	2022-01-08	4.6	0.17
Turbidity	NTU	2022-01-09	4.2	0.13
Turbidity	NTU	2022-01-10	3.6	0.15
Turbidity	NTU	2022-01-11	3.1	0.13
Turbidity	NTU	2022-01-12	4.9	0.13
Turbidity	NTU	2022-01-13	6.1	0.13
Turbidity	NTU	2022-01-14	7.7	0.14
Turbidity	NTU	2022-01-15	6.2	0.11

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-01-16	4.6	0.14
Turbidity	NTU	2022-01-17	6.0	0.17
Turbidity	NTU	2022-01-18	5.9	0.13
Turbidity	NTU	2022-01-19	5.6	0.15
Turbidity	NTU	2022-01-20	4.8	0.15
Turbidity	NTU	2022-01-21	4.3	0.15
Turbidity	NTU	2022-01-22	4.8	0.15
Turbidity	NTU	2022-01-23	4.2	0.12
Turbidity	NTU	2022-01-24	3.9	0.13
Turbidity	NTU	2022-01-25	3.6	0.14
Turbidity	NTU	2022-01-26	3.6	0.14
Turbidity	NTU	2022-01-27	3.4	0.14
Turbidity	NTU	2022-01-28	2.7	0.16
Turbidity	NTU	2022-01-29	2.8	0.14
Turbidity	NTU	2022-01-30	2.7	0.12
Turbidity	NTU	2022-01-31	2.8	0.16
Turbidity	NTU	2022-02-01	2.5	0.13
Turbidity	NTU	2022-02-02	2.7	0.14
Turbidity	NTU	2022-02-03	2.3	0.14
Turbidity	NTU	2022-02-04	2.2	0.13
Turbidity	NTU	2022-02-05	2.0	0.14
Turbidity	NTU	2022-02-06	1.8	0.13
Turbidity	NTU	2022-02-07	1.7	0.13
Turbidity	NTU	2022-02-08	1.6	0.15
Turbidity	NTU	2022-02-09	1.6	0.16
Turbidity	NTU	2022-02-10	1.6	0.19
Turbidity	NTU	2022-02-11	1.5	0.16
Turbidity	NTU	2022-02-12	1.5	0.13
Turbidity	NTU	2022-02-13	1.4	0.13
Turbidity	NTU	2022-02-14	1.4	0.13
Turbidity	NTU	2022-02-15	1.3	0.14
Turbidity	NTU	2022-02-16	2.1	0.15
Turbidity	NTU	2022-02-17	2.1	0.16
Turbidity	NTU	2022-02-18	1.8	0.10
Turbidity	NTU	2022-02-19	1.5	0.09
Turbidity	NTU	2022-02-20	1.6	0.11
Turbidity	NTU	2022-02-21	1.5	0.13
Turbidity	NTU	2022-02-22	1.6	0.15
Turbidity	NTU	2022-02-23	1.6	0.12
Turbidity	NTU	2022-02-24	1.4	0.10
Turbidity	NTU	2022-02-25	1.4	0.14
Turbidity	NTU	2022-02-26	1.4	0.13

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-02-27	1.1	0.12
Turbidity	NTU	2022-02-28	1.3	0.14
Turbidity	NTU	2022-03-01	1.6	0.15
Turbidity	NTU	2022-03-02	2.6	0.13
Turbidity	NTU	2022-03-03	2.6	0.13
Turbidity	NTU	2022-03-04	2.3	0.12
Turbidity	NTU	2022-03-05	2.0	0.13
Turbidity	NTU	2022-03-06	1.7	0.11
Turbidity	NTU	2022-03-07	2.0	0.12
Turbidity	NTU	2022-03-08	1.6	0.11
Turbidity	NTU	2022-03-09	1.8	0.10
Turbidity	NTU	2022-03-10	1.7	0.11
Turbidity	NTU	2022-03-11	1.6	0.13
Turbidity	NTU	2022-03-12	1.5	0.11
Turbidity	NTU	2022-03-13	1.4	0.11
Turbidity	NTU	2022-03-14	1.4	0.11
Turbidity	NTU	2022-03-15	1.5	0.15
Turbidity	NTU	2022-03-16	1.5	0.14
Turbidity	NTU	2022-03-17	1.5	0.11
Turbidity	NTU	2022-03-18	1.9	0.53
Turbidity	NTU	2022-03-19	1.8	0.11
Turbidity	NTU	2022-03-20	1.7	0.12
Turbidity	NTU	2022-03-21	1.8	0.11
Turbidity	NTU	2022-03-22	1.7	0.12
Turbidity	NTU	2022-03-23	1.7	0.12
Turbidity	NTU	2022-03-24	1.7	0.12
Turbidity	NTU	2022-03-25	1.7	0.14
Turbidity	NTU	2022-03-26	1.6	0.12
Turbidity	NTU	2022-03-27	1.5	0.15
Turbidity	NTU	2022-03-28	1.5	0.15
Turbidity	NTU	2022-03-29	1.3	0.13
Turbidity	NTU	2022-03-30	1.0	0.16
Turbidity	NTU	2022-03-31	1.1	0.14
Turbidity	NTU	2022-04-01	1.1	0.14
Turbidity	NTU	2022-04-02	1.1	0.13
Turbidity	NTU	2022-04-03	0.97	0.09
Turbidity	NTU	2022-04-04	1.2	0.12
Turbidity	NTU	2022-04-05	1.7	0.13
Turbidity	NTU	2022-04-06	1.1	0.13
Turbidity	NTU	2022-04-07	1.4	0.14
Turbidity	NTU	2022-04-08	1.7	0.15
Turbidity	NTU	2022-04-09	1.8	0.15

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-04-10	1.4	0.09
Turbidity	NTU	2022-04-11	1.4	0.13
Turbidity	NTU	2022-04-12	1.3	0.09
Turbidity	NTU	2022-04-13	1.3	0.11
Turbidity	NTU	2022-04-14	1.3	0.10
Turbidity	NTU	2022-04-15	1.3	0.09
Turbidity	NTU	2022-04-16	1.3	0.12
Turbidity	NTU	2022-04-17	1.1	0.07
Turbidity	NTU	2022-04-18	1.1	0.11
Turbidity	NTU	2022-04-19	1.2	0.10
Turbidity	NTU	2022-04-20	1.1	0.13
Turbidity	NTU	2022-04-21	1.1	0.13
Turbidity	NTU	2022-04-22	1.1	0.14
Turbidity	NTU	2022-04-23	1.2	0.11
Turbidity	NTU	2022-04-24	1.1	0.09
Turbidity	NTU	2022-04-25	1.1	0.12
Turbidity	NTU	2022-04-26	0.97	0.09
Turbidity	NTU	2022-04-27	1.0	0.11
Turbidity	NTU	2022-04-28	0.87	0.11
Turbidity	NTU	2022-04-29	1.0	0.11
Turbidity	NTU	2022-04-30	1.0	0.09
Turbidity	NTU	2022-05-01	0.89	0.10
Turbidity	NTU	2022-05-02	0.83	0.09
Turbidity	NTU	2022-05-03	0.90	0.12
Turbidity	NTU	2022-05-04	0.83	0.12
Turbidity	NTU	2022-05-05	0.75	0.15
Turbidity	NTU	2022-05-06	0.70	0.15
Turbidity	NTU	2022-05-07	0.67	0.15
Turbidity	NTU	2022-05-08	0.66	0.15
Turbidity	NTU	2022-05-09	0.70	0.17
Turbidity	NTU	2022-05-10	0.69	0.13
Turbidity	NTU	2022-05-11	0.74	0.09
Turbidity	NTU	2022-05-12	0.68	0.14
Turbidity	NTU	2022-05-13	0.62	0.10
Turbidity	NTU	2022-05-14	0.61	0.10
Turbidity	NTU	2022-05-15	0.67	0.12
Turbidity	NTU	2022-05-16	0.73	0.12
Turbidity	NTU	2022-05-17	0.65	0.08
Turbidity	NTU	2022-05-18	0.80	0.12
Turbidity	NTU	2022-05-19	0.74	0.14
Turbidity	NTU	2022-05-20	0.88	0.11
Turbidity	NTU	2022-05-21	0.64	0.13

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-05-22	0.57	0.12
Turbidity	NTU	2022-05-23	0.64	0.14
Turbidity	NTU	2022-05-24	0.58	0.15
Turbidity	NTU	2022-05-25	0.56	0.14
Turbidity	NTU	2022-05-26	0.58	0.11
Turbidity	NTU	2022-05-27	0.53	0.16
Turbidity	NTU	2022-05-28	1.1	0.11
Turbidity	NTU	2022-05-29	1.4	0.14
Turbidity	NTU	2022-05-30	1.2	0.15
Turbidity	NTU	2022-05-31	1.3	0.13
Turbidity	NTU	2022-06-01	0.97	0.16
Turbidity	NTU	2022-06-02	0.96	0.12
Turbidity	NTU	2022-06-03	1.1	0.16
Turbidity	NTU	2022-06-04	0.86	0.13
Turbidity	NTU	2022-06-05	0.68	0.13
Turbidity	NTU	2022-06-06	0.85	0.15
Turbidity	NTU	2022-06-07	0.80	0.14
Turbidity	NTU	2022-06-08	0.78	0.16
Turbidity	NTU	2022-06-09	0.94	0.22
Turbidity	NTU	2022-06-10	0.80	0.19
Turbidity	NTU	2022-06-11	0.75	0.12
Turbidity	NTU	2022-06-12	0.81	0.15
Turbidity	NTU	2022-06-13	0.83	0.17
Turbidity	NTU	2022-06-14	0.94	0.18
Turbidity	NTU	2022-06-15	0.88	0.16
Turbidity	NTU	2022-06-16	0.82	0.24
Turbidity	NTU	2022-06-17	0.82	0.18
Turbidity	NTU	2022-06-18	0.77	0.13
Turbidity	NTU	2022-06-19	0.74	0.13
Turbidity	NTU	2022-06-20	0.62	0.12
Turbidity	NTU	2022-06-21	0.63	0.14
Turbidity	NTU	2022-06-22	0.61	0.14
Turbidity	NTU	2022-06-23	0.58	0.17
Turbidity	NTU	2022-06-24	0.64	0.17
Turbidity	NTU	2022-06-25	0.51	0.15
Turbidity	NTU	2022-06-26	0.46	0.19
Turbidity	NTU	2022-06-27	0.44	0.18
Turbidity	NTU	2022-06-28	0.46	0.16
Turbidity	NTU	2022-06-29	0.43	0.19
Turbidity	NTU	2022-06-30	0.47	0.20
Turbidity	NTU	2022-07-01	0.43	0.17
Turbidity	NTU	2022-07-02	0.47	0.20

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-07-03	0.42	0.19
Turbidity	NTU	2022-07-04	0.40	0.17
Turbidity	NTU	2022-07-05	0.40	0.13
Turbidity	NTU	2022-07-06	0.42	0.13
Turbidity	NTU	2022-07-07	0.32	0.13
Turbidity	NTU	2022-07-08	0.34	0.14
Turbidity	NTU	2022-07-09	0.33	0.19
Turbidity	NTU	2022-07-10	0.29	0.16
Turbidity	NTU	2022-07-11	0.30	0.15
Turbidity	NTU	2022-07-12	0.30	0.14
Turbidity	NTU	2022-07-13	0.34	0.16
Turbidity	NTU	2022-07-14	0.30	0.13
Turbidity	NTU	2022-07-15	0.29	0.13
Turbidity	NTU	2022-07-16	0.32	0.13
Turbidity	NTU	2022-07-17	0.24	0.10
Turbidity	NTU	2022-07-18	0.32	0.14
Turbidity	NTU	2022-07-19	0.25	0.12
Turbidity	NTU	2022-07-20	0.25	0.15
Turbidity	NTU	2022-07-21	0.26	0.12
Turbidity	NTU	2022-07-22	0.28	0.17
Turbidity	NTU	2022-07-23	0.25	0.13
Turbidity	NTU	2022-07-24	0.25	0.14
Turbidity	NTU	2022-07-25	0.27	0.13
Turbidity	NTU	2022-07-26	0.23	0.11
Turbidity	NTU	2022-07-27	0.40	0.17
Turbidity	NTU	2022-07-28	0.31	0.13
Turbidity	NTU	2022-07-29	0.26	0.13
Turbidity	NTU	2022-07-30	0.30	0.16
Turbidity	NTU	2022-07-31	0.30	0.16
Turbidity	NTU	2022-08-01	0.27	0.13
Turbidity	NTU	2022-08-02	0.27	0.10
Turbidity	NTU	2022-08-03	0.25	0.15
Turbidity	NTU	2022-08-04	0.29	0.17
Turbidity	NTU	2022-08-05	0.30	0.17
Turbidity	NTU	2022-08-06	0.25	0.10
Turbidity	NTU	2022-08-07	0.25	0.11
Turbidity	NTU	2022-08-08	0.28	0.15
Turbidity	NTU	2022-08-09	0.28	0.13
Turbidity	NTU	2022-08-10	0.33	0.13
Turbidity	NTU	2022-08-11	0.31	0.13
Turbidity	NTU	2022-08-12	0.31	0.13
Turbidity	NTU	2022-08-13	0.32	0.14

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-08-14	0.28	0.11
Turbidity	NTU	2022-08-15	0.31	0.13
Turbidity	NTU	2022-08-16	0.29	0.13
Turbidity	NTU	2022-08-17	0.32	0.13
Turbidity	NTU	2022-08-18	0.33	0.13
Turbidity	NTU	2022-08-19	0.35	0.13
Turbidity	NTU	2022-08-20	0.29	0.12
Turbidity	NTU	2022-08-21	0.31	0.11
Turbidity	NTU	2022-08-22	0.30	0.11
Turbidity	NTU	2022-08-23	0.51	0.16
Turbidity	NTU	2022-08-24	0.42	0.14
Turbidity	NTU	2022-08-25	0.33	0.12
Turbidity	NTU	2022-08-26	0.35	0.12
Turbidity	NTU	2022-08-27	0.39	0.12
Turbidity	NTU	2022-08-28	0.33	0.09
Turbidity	NTU	2022-08-29	0.41	0.13
Turbidity	NTU	2022-08-30	0.42	0.13
Turbidity	NTU	2022-08-31	0.45	0.16
Turbidity	NTU	2022-09-01	0.47	0.13
Turbidity	NTU	2022-09-02	0.50	0.14
Turbidity	NTU	2022-09-03	0.55	0.15
Turbidity	NTU	2022-09-04	0.50	0.10
Turbidity	NTU	2022-09-05	0.51	0.12
Turbidity	NTU	2022-09-06	0.55	0.13
Turbidity	NTU	2022-09-07	0.54	0.12
Turbidity	NTU	2022-09-08	0.53	0.15
Turbidity	NTU	2022-09-09	0.61	0.15
Turbidity	NTU	2022-09-10	0.54	0.13
Turbidity	NTU	2022-09-11	0.60	0.13
Turbidity	NTU	2022-09-12	0.60	0.11
Turbidity	NTU	2022-09-13	0.56	0.12
Turbidity	NTU	2022-09-14	0.60	0.13
Turbidity	NTU	2022-09-15	0.63	0.12
Turbidity	NTU	2022-09-16	0.63	0.15
Turbidity	NTU	2022-09-17	0.65	0.13
Turbidity	NTU	2022-09-18	0.65	0.13
Turbidity	NTU	2022-09-19	0.72	0.09
Turbidity	NTU	2022-09-20	0.78	0.11
Turbidity	NTU	2022-09-21	0.72	0.12
Turbidity	NTU	2022-09-22	0.77	0.14
Turbidity	NTU	2022-09-23	0.65	0.11
Turbidity	NTU	2022-09-24	0.71	0.12

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-09-25	0.65	0.10
Turbidity	NTU	2022-09-26	0.79	0.16
Turbidity	NTU	2022-09-27	0.67	0.12
Turbidity	NTU	2022-09-28	0.65	0.12
Turbidity	NTU	2022-09-29	0.73	0.14
Turbidity	NTU	2022-09-30	0.70	0.14
Turbidity	NTU	2022-10-01	0.63	0.14
Turbidity	NTU	2022-10-02	0.60	0.11
Turbidity	NTU	2022-10-03	0.61	1.2
Turbidity	NTU	2022-10-04	0.55	0.12
Turbidity	NTU	2022-10-05	0.58	0.12
Turbidity	NTU	2022-10-06	0.56	0.14
Turbidity	NTU	2022-10-07	0.65	0.15
Turbidity	NTU	2022-10-08	0.67	0.14
Turbidity	NTU	2022-10-09	0.62	0.12
Turbidity	NTU	2022-10-10	0.58	0.10
Turbidity	NTU	2022-10-11	0.60	0.16
Turbidity	NTU	2022-10-12	0.55	0.12
Turbidity	NTU	2022-10-13	0.61	0.13
Turbidity	NTU	2022-10-14	0.70	0.17
Turbidity	NTU	2022-10-15	0.61	0.17
Turbidity	NTU	2022-10-16	0.53	0.11
Turbidity	NTU	2022-10-17	0.58	0.17
Turbidity	NTU	2022-10-18	0.59	0.12
Turbidity	NTU	2022-10-19	0.50	0.12
Turbidity	NTU	2022-10-20	0.53	0.12
Turbidity	NTU	2022-10-21	0.57	0.14
Turbidity	NTU	2022-10-22	0.59	0.14
Turbidity	NTU	2022-10-23	0.44	0.13
Turbidity	NTU	2022-10-24	0.61	0.11
Turbidity	NTU	2022-10-25	0.56	0.18
Turbidity	NTU	2022-10-26	1.4	0.14
Turbidity	NTU	2022-10-27	2.5	0.14
Turbidity	NTU	2022-10-28	3.9	0.11
Turbidity	NTU	2022-10-29	4.0	0.14
Turbidity	NTU	2022-10-30	3.2	0.12
Turbidity	NTU	2022-10-31	3.0	0.13
Turbidity	NTU	2022-11-01	2.8	0.18
Turbidity	NTU	2022-11-02	2.2	0.13
Turbidity	NTU	2022-11-03	2.2	0.18
Turbidity	NTU	2022-11-04	2.3	0.18
Turbidity	NTU	2022-11-05	1.7	0.14

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-11-06	1.7	0.16
Turbidity	NTU	2022-11-07	1.9	0.14
Turbidity	NTU	2022-11-08	1.6	0.12
Turbidity	NTU	2022-11-09	1.6	0.13
Turbidity	NTU	2022-11-10	1.5	0.21
Turbidity	NTU	2022-11-11	1.1	0.11
Turbidity	NTU	2022-11-12	1.3	0.14
Turbidity	NTU	2022-11-13	1.2	0.13
Turbidity	NTU	2022-11-14	1.3	0.17
Turbidity	NTU	2022-11-15	1.2	0.17
Turbidity	NTU	2022-11-16	1.2	0.19
Turbidity	NTU	2022-11-17	1.2	0.13
Turbidity	NTU	2022-11-18	1.3	0.21
Turbidity	NTU	2022-11-19	-	0.10
Turbidity	NTU	2022-11-20	0.96	0.11
Turbidity	NTU	2022-11-21	1.2	0.14
Turbidity	NTU	2022-11-22	1.0	0.18
Turbidity	NTU	2022-11-23	0.88	0.14
Turbidity	NTU	2022-11-24	0.91	0.16
Turbidity	NTU	2022-11-25	0.85	0.16
Turbidity	NTU	2022-11-26	0.86	0.13
Turbidity	NTU	2022-11-27	0.81	0.12
Turbidity	NTU	2022-11-28	0.84	0.14
Turbidity	NTU	2022-11-29	0.92	0.16
Turbidity	NTU	2022-11-30	1.8	0.13
Turbidity	NTU	2022-12-01	0.95	0.16
Turbidity	NTU	2022-12-02	0.85	0.13
Turbidity	NTU	2022-12-03	1.0	0.17
Turbidity	NTU	2022-12-04	1.0	0.14
Turbidity	NTU	2022-12-05	1.0	0.81
Turbidity	NTU	2022-12-06	0.94	0.11
Turbidity	NTU	2022-12-07	1.0	1.0
Turbidity	NTU	2022-12-08	0.89	0.16
Turbidity	NTU	2022-12-09	0.93	0.16
Turbidity	NTU	2022-12-10	0.89	0.15
Turbidity	NTU	2022-12-11	0.90	0.15
Turbidity	NTU	2022-12-12	0.88	0.21
Turbidity	NTU	2022-12-13	0.89	0.16
Turbidity	NTU	2022-12-14	0.91	0.36
Turbidity	NTU	2022-12-15	0.88	0.22
Turbidity	NTU	2022-12-16	0.83	0.20
Turbidity	NTU	2022-12-17	0.85	0.14

Analysis - Capilano	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-12-18	-	0.15
Turbidity	NTU	2022-12-19	0.86	0.20
Turbidity	NTU	2022-12-20	0.75	0.15
Turbidity	NTU	2022-12-21	0.75	0.17
Turbidity	NTU	2022-12-22	0.70	0.18
Turbidity	NTU	2022-12-23	0.68	0.21
Turbidity	NTU	2022-12-24	0.73	0.24
Turbidity	NTU	2022-12-26	5.1	0.20
Turbidity	NTU	2022-12-27	3.6	0.14
Turbidity	NTU	2022-12-28	5.0	0.18
Turbidity	NTU	2022-12-29	5.0	0.15
Turbidity	NTU	2022-12-30	4.6	0.23
Turbidity	NTU	2022-12-31	4.9	0.16
UV Absorbance 254 nm	Abs/cm	2022-01-04	0.075	0.011
UV Absorbance 254 nm	Abs/cm	2022-01-10	0.069	0.010
UV Absorbance 254 nm	Abs/cm	2022-01-17	0.079	0.011
UV Absorbance 254 nm	Abs/cm	2022-01-24	0.075	0.010
UV Absorbance 254 nm	Abs/cm	2022-01-31	0.069	0.011
UV Absorbance 254 nm	Abs/cm	2022-02-07	0.068	0.011
UV Absorbance 254 nm	Abs/cm	2022-02-14	0.066	0.010
UV Absorbance 254 nm	Abs/cm	2022-02-22	0.062	0.010
UV Absorbance 254 nm	Abs/cm	2022-02-28	0.060	0.010
UV Absorbance 254 nm	Abs/cm	2022-03-07	0.065	0.010
UV Absorbance 254 nm	Abs/cm	2022-03-14	0.064	0.011
UV Absorbance 254 nm	Abs/cm	2022-03-21	0.064	0.011
UV Absorbance 254 nm	Abs/cm	2022-03-28	0.065	0.011
UV Absorbance 254 nm	Abs/cm	2022-04-04	0.065	0.011
UV Absorbance 254 nm	Abs/cm	2022-04-11	0.062	0.009
UV Absorbance 254 nm	Abs/cm	2022-04-19	0.063	0.010
UV Absorbance 254 nm	Abs/cm	2022-04-25	0.063	0.011
UV Absorbance 254 nm	Abs/cm	2022-05-02	0.060	0.011
UV Absorbance 254 nm	Abs/cm	2022-05-09	0.060	0.009
UV Absorbance 254 nm	Abs/cm	2022-05-16	0.063	0.010
UV Absorbance 254 nm	Abs/cm	2022-05-24	0.064	0.010
UV Absorbance 254 nm	Abs/cm	2022-05-30	0.068	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-06	0.070	0.008
UV Absorbance 254 nm	Abs/cm	2022-06-13	0.076	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-20	0.072	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-27	0.066	0.009
UV Absorbance 254 nm	Abs/cm	2022-07-04	0.064	0.009
UV Absorbance 254 nm	Abs/cm	2022-07-11	0.062	0.008
UV Absorbance 254 nm	Abs/cm	2022-07-18	0.060	0.009

Analysis - Capilano	Units	Date Sampled	Source	Treated
UV Absorbance 254 nm	Abs/cm	2022-07-25	0.059	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-02	0.057	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-08	0.056	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-15	0.056	0.009
UV Absorbance 254 nm	Abs/cm	2022-08-22	0.054	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-29	0.054	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-06	0.052	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-12	0.055	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-20	0.050	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-26	0.049	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-03	0.046	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-11	0.046	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-17	0.046	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-24	0.039	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-31	0.072	0.011
UV Absorbance 254 nm	Abs/cm	2022-11-07	0.068	0.012
UV Absorbance 254 nm	Abs/cm	2022-11-14	0.066	0.013
UV Absorbance 254 nm	Abs/cm	2022-11-21	0.063	0.009
UV Absorbance 254 nm	Abs/cm	2022-11-28	0.063	0.012
UV Absorbance 254 nm	Abs/cm	2022-12-05	0.066	0.013
UV Absorbance 254 nm	Abs/cm	2022-12-12	0.064	0.012
UV Absorbance 254 nm	Abs/cm	2022-12-19	0.061	0.011
Zinc Total	µg/L	2022-02-17	-	<3.0
Zinc Total	µg/L	2022-05-02	<3.0	<3.0
Zinc Total	µg/L	2022-05-04	<3.0	<3.0
Zinc Total	µg/L	2022-05-10	-	<3.0
Zinc Total	µg/L	2022-08-23	-	<3.0
Zinc Total	µg/L	2022-11-07	<3.0	<3.0
Zinc Total	µg/L	2022-11-08	<3.0	5.4
Zinc Total	µg/L	2022-11-15	-	<3.0

SEYMOUR SOURCE

This page has intentionally been left blank

Analysis - Seymour	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-01-04	3.1	23
Alkalinity as CaCO ₃	mg/L	2022-01-10	3.6	21
Alkalinity as CaCO ₃	mg/L	2022-01-17	3.2	22
Alkalinity as CaCO ₃	mg/L	2022-01-24	3.1	21
Alkalinity as CaCO ₃	mg/L	2022-01-31	3.1	22
Alkalinity as CaCO ₃	mg/L	2022-02-07	2.8	24
Alkalinity as CaCO ₃	mg/L	2022-02-14	3.2	22
Alkalinity as CaCO ₃	mg/L	2022-02-22	3.6	23
Alkalinity as CaCO ₃	mg/L	2022-02-28	3.7	23
Alkalinity as CaCO ₃	mg/L	2022-03-07	3.7	22
Alkalinity as CaCO ₃	mg/L	2022-03-14	3.7	22
Alkalinity as CaCO ₃	mg/L	2022-03-21	3.6	21
Alkalinity as CaCO ₃	mg/L	2022-03-28	3.7	23
Alkalinity as CaCO ₃	mg/L	2022-04-04	3.9	20
Alkalinity as CaCO ₃	mg/L	2022-04-11	3.7	21
Alkalinity as CaCO ₃	mg/L	2022-04-19	3.8	21
Alkalinity as CaCO ₃	mg/L	2022-04-25	3.5	22
Alkalinity as CaCO ₃	mg/L	2022-05-02	3.8	23
Alkalinity as CaCO ₃	mg/L	2022-05-09	4.1	23
Alkalinity as CaCO ₃	mg/L	2022-05-16	3.9	22
Alkalinity as CaCO ₃	mg/L	2022-05-24	3.4	20
Alkalinity as CaCO ₃	mg/L	2022-05-30	3.4	22
Alkalinity as CaCO ₃	mg/L	2022-06-06	3.5	20
Alkalinity as CaCO ₃	mg/L	2022-06-13	2.9	21
Alkalinity as CaCO ₃	mg/L	2022-06-20	-	21
Alkalinity as CaCO ₃	mg/L	2022-06-27	-	21
Alkalinity as CaCO ₃	mg/L	2022-07-04	3.4	23
Alkalinity as CaCO ₃	mg/L	2022-07-11	-	22
Alkalinity as CaCO ₃	mg/L	2022-07-18	-	24
Alkalinity as CaCO ₃	mg/L	2022-07-25	-	21
Alkalinity as CaCO ₃	mg/L	2022-08-02	4.0	22
Alkalinity as CaCO ₃	mg/L	2022-08-08	-	22
Alkalinity as CaCO ₃	mg/L	2022-08-15	-	23
Alkalinity as CaCO ₃	mg/L	2022-08-22	-	21
Alkalinity as CaCO ₃	mg/L	2022-08-29	-	22
Alkalinity as CaCO ₃	mg/L	2022-09-06	-	23
Alkalinity as CaCO ₃	mg/L	2022-09-12	4.4	22
Alkalinity as CaCO ₃	mg/L	2022-09-20	-	24
Alkalinity as CaCO ₃	mg/L	2022-09-26	-	20
Alkalinity as CaCO ₃	mg/L	2022-10-03	-	23
Alkalinity as CaCO ₃	mg/L	2022-10-11	4.1	22
Alkalinity as CaCO ₃	mg/L	2022-10-17	-	21

Analysis - Seymour	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-10-24	-	20
Alkalinity as CaCO ₃	mg/L	2022-10-31	-	18
Alkalinity as CaCO ₃	mg/L	2022-11-07	3.2	20
Alkalinity as CaCO ₃	mg/L	2022-11-14	3.5	21
Alkalinity as CaCO ₃	mg/L	2022-11-21	-	20
Alkalinity as CaCO ₃	mg/L	2022-11-28	-	21
Alkalinity as CaCO ₃	mg/L	2022-12-05	3.5	21
Alkalinity as CaCO ₃	mg/L	2022-12-12	-	20
Alkalinity as CaCO ₃	mg/L	2022-12-19	3.9	20
Aluminum Dissolved	µg/L	2022-02-14	60	34
Aluminum Dissolved	µg/L	2022-04-04	50	23
Aluminum Dissolved	µg/L	2022-05-02	40	19
Aluminum Dissolved	µg/L	2022-07-04	57	23
Aluminum Dissolved	µg/L	2022-09-12	26	19
Aluminum Dissolved	µg/L	2022-11-07	58	32
Aluminum Total	µg/L	2022-01-04	130	44
Aluminum Total	µg/L	2022-01-10	98	42
Aluminum Total	µg/L	2022-01-17	140	55
Aluminum Total	µg/L	2022-01-24	112	47
Aluminum Total	µg/L	2022-01-31	97	41
Aluminum Total	µg/L	2022-02-07	98	42
Aluminum Total	µg/L	2022-02-14	83	37
Aluminum Total	µg/L	2022-02-22	78	40
Aluminum Total	µg/L	2022-02-28	63	32
Aluminum Total	µg/L	2022-03-07	73	32
Aluminum Total	µg/L	2022-03-14	73	29
Aluminum Total	µg/L	2022-03-21	77	30
Aluminum Total	µg/L	2022-03-28	76	28
Aluminum Total	µg/L	2022-04-04	86	25
Aluminum Total	µg/L	2022-04-11	89	25
Aluminum Total	µg/L	2022-04-19	87	23
Aluminum Total	µg/L	2022-04-25	82	22
Aluminum Total	µg/L	2022-05-02	105	21
Aluminum Total	µg/L	2022-05-04	79	25
Aluminum Total	µg/L	2022-05-09	68	22
Aluminum Total	µg/L	2022-05-16	69	21
Aluminum Total	µg/L	2022-05-24	85	22
Aluminum Total	µg/L	2022-05-30	86	29
Aluminum Total	µg/L	2022-06-06	90	26
Aluminum Total	µg/L	2022-06-13	93	32
Aluminum Total	µg/L	2022-06-20	-	28
Aluminum Total	µg/L	2022-06-27	-	29

Analysis - Seymour	Units	Date Sampled	Source	Treated
Aluminum Total	µg/L	2022-07-04	75	25
Aluminum Total	µg/L	2022-07-11	-	33
Aluminum Total	µg/L	2022-07-18	-	23
Aluminum Total	µg/L	2022-07-25	-	23
Aluminum Total	µg/L	2022-08-02	57	23
Aluminum Total	µg/L	2022-08-08	-	23
Aluminum Total	µg/L	2022-08-15	-	23
Aluminum Total	µg/L	2022-08-22	-	24
Aluminum Total	µg/L	2022-08-29	-	24
Aluminum Total	µg/L	2022-09-06	-	25
Aluminum Total	µg/L	2022-09-12	45	27
Aluminum Total	µg/L	2022-09-20	-	22
Aluminum Total	µg/L	2022-09-26	-	21
Aluminum Total	µg/L	2022-10-03	-	21
Aluminum Total	µg/L	2022-10-11	45	27
Aluminum Total	µg/L	2022-10-17	-	18
Aluminum Total	µg/L	2022-10-24	-	19
Aluminum Total	µg/L	2022-10-31	-	42
Aluminum Total	µg/L	2022-11-07	128	36
Aluminum Total	µg/L	2022-11-08	129	43
Aluminum Total	µg/L	2022-11-14	107	32
Aluminum Total	µg/L	2022-11-21	-	30
Aluminum Total	µg/L	2022-11-28	-	33
Aluminum Total	µg/L	2022-12-05	72	33
Aluminum Total	µg/L	2022-12-12	-	34
Aluminum Total	µg/L	2022-12-19	68	34
Antimony Total	µg/L	2022-05-02	<0.5	<0.5
Antimony Total	µg/L	2022-05-04	<0.5	<0.5
Antimony Total	µg/L	2022-11-07	<0.5	<0.5
Antimony Total	µg/L	2022-11-08	<0.5	<0.5
Arsenic Total	µg/L	2022-05-02	<0.5	<0.5
Arsenic Total	µg/L	2022-05-04	<0.5	<0.5
Arsenic Total	µg/L	2022-11-07	<0.5	<0.5
Arsenic Total	µg/L	2022-11-08	<0.5	<0.5
Barium Total	µg/L	2022-05-02	3.6	2.7
Barium Total	µg/L	2022-05-04	3.1	2.5
Barium Total	µg/L	2022-11-07	0.8	2.6
Barium Total	µg/L	2022-11-08	4.1	3.5
Boron Total	µg/L	2022-05-02	<10	<10
Boron Total	µg/L	2022-05-04	<10	<10
Boron Total	µg/L	2022-11-07	<10	<10
Boron Total	µg/L	2022-11-08	<10	<10

Analysis - Seymour	Units	Date Sampled	Source	Treated
Bromate	µg/L	2022-02-15	-	<10.0
Bromate	µg/L	2022-02-16	<10.0	-
Bromate	µg/L	2022-05-10	<10.0	<10.0
Bromate	µg/L	2022-08-23	<10.0	<10.0
Bromate	µg/L	2022-11-15	<10.0	<10.0
Bromide	µg/L	2022-02-15	-	<10.0
Bromide	µg/L	2022-02-16	<10.0	-
Bromide	µg/L	2022-05-10	<10.0	<10.0
Bromide	µg/L	2022-08-23	<10.0	<10.0
Bromide	µg/L	2022-11-15	<10.0	<10.0
Bromodichloromethane	µg/L	2022-02-15	-	<1
Bromodichloromethane	µg/L	2022-02-16	<1	-
Bromodichloromethane	µg/L	2022-05-10	<1	<1
Bromodichloromethane	µg/L	2022-11-15	<1	<1
Bromoform	µg/L	2022-02-15	-	<1
Bromoform	µg/L	2022-02-16	<1	-
Bromoform	µg/L	2022-05-10	<1	<1
Bromoform	µg/L	2022-11-15	<1	<1
Cadmium Total	µg/L	2022-05-02	<0.2	<0.2
Cadmium Total	µg/L	2022-05-04	<0.2	<0.2
Cadmium Total	µg/L	2022-11-07	<0.2	<0.2
Cadmium Total	µg/L	2022-11-08	<0.2	<0.2
Calcium Total	µg/L	2022-01-04	1,380	8,780
Calcium Total	µg/L	2022-02-07	1,420	9,240
Calcium Total	µg/L	2022-02-14	1,440	7,960
Calcium Total	µg/L	2022-03-07	1,630	8,200
Calcium Total	µg/L	2022-04-04	1,680	7,520
Calcium Total	µg/L	2022-05-02	1,750	8,560
Calcium Total	µg/L	2022-05-04	1,690	8,800
Calcium Total	µg/L	2022-06-06	1,470	7,820
Calcium Total	µg/L	2022-07-04	1,470	8,920
Calcium Total	µg/L	2022-08-08	-	8,680
Calcium Total	µg/L	2022-09-12	1,800	8,460
Calcium Total	µg/L	2022-10-11	1,770	8,610
Calcium Total	µg/L	2022-11-07	1,740	8,350
Calcium Total	µg/L	2022-11-08	1,660	8,320
Calcium Total	µg/L	2022-12-05	1,780	8,460
Carbon Organic - Dissolved	mg/L	2022-01-04	1.4	0.6
Carbon Organic - Dissolved	mg/L	2022-01-10	1.4	0.6
Carbon Organic - Dissolved	mg/L	2022-01-17	1.5	0.6
Carbon Organic - Dissolved	mg/L	2022-01-24	1.6	0.6
Carbon Organic - Dissolved	mg/L	2022-01-31	1.3	0.5

Analysis - Seymour	Units	Date Sampled	Source	Treated
Carbon Organic - Dissolved	mg/L	2022-02-07	1.5	0.7
Carbon Organic - Dissolved	mg/L	2022-02-14	1.4	0.6
Carbon Organic - Dissolved	mg/L	2022-02-22	1.3	0.6
Carbon Organic - Dissolved	mg/L	2022-02-28	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-03-07	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-03-14	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-03-21	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-03-28	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-04-04	1.3	0.6
Carbon Organic - Dissolved	mg/L	2022-04-11	1.4	0.6
Carbon Organic - Dissolved	mg/L	2022-04-19	1.3	0.6
Carbon Organic - Dissolved	mg/L	2022-04-25	1.3	0.6
Carbon Organic - Dissolved	mg/L	2022-05-02	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-05-09	1.2	0.5
Carbon Organic - Dissolved	mg/L	2022-05-16	1.2	0.6
Carbon Organic - Dissolved	mg/L	2022-05-24	1.6	0.6
Carbon Organic - Dissolved	mg/L	2022-05-30	1.6	0.7
Carbon Organic - Dissolved	mg/L	2022-06-06	1.6	0.5
Carbon Organic - Dissolved	mg/L	2022-06-13	1.7	0.6
Carbon Organic - Dissolved	mg/L	2022-06-20	-	0.6
Carbon Organic - Dissolved	mg/L	2022-06-27	-	0.6
Carbon Organic - Dissolved	mg/L	2022-07-04	1.4	0.5
Carbon Organic - Dissolved	mg/L	2022-07-11	-	0.6
Carbon Organic - Dissolved	mg/L	2022-07-18	-	0.5
Carbon Organic - Dissolved	mg/L	2022-07-25	-	0.6
Carbon Organic - Dissolved	mg/L	2022-08-02	1.1	0.5
Carbon Organic - Dissolved	mg/L	2022-08-08	-	0.5
Carbon Organic - Dissolved	mg/L	2022-08-15	-	0.5
Carbon Organic - Dissolved	mg/L	2022-08-22	-	0.5
Carbon Organic - Dissolved	mg/L	2022-08-29	-	0.5
Carbon Organic - Dissolved	mg/L	2022-09-06	-	0.5
Carbon Organic - Dissolved	mg/L	2022-09-12	0.9	0.5
Carbon Organic - Dissolved	mg/L	2022-09-20	-	0.6
Carbon Organic - Dissolved	mg/L	2022-09-26	-	0.6
Carbon Organic - Dissolved	mg/L	2022-10-03	-	0.6
Carbon Organic - Dissolved	mg/L	2022-10-11	0.9	0.6
Carbon Organic - Dissolved	mg/L	2022-10-17	-	0.5
Carbon Organic - Dissolved	mg/L	2022-10-24	-	0.6
Carbon Organic - Dissolved	mg/L	2022-10-31	-	0.8
Carbon Organic - Dissolved	mg/L	2022-11-07	1.6	0.8
Carbon Organic - Dissolved	mg/L	2022-11-14	1.7	1.0
Carbon Organic - Dissolved	mg/L	2022-11-21	-	0.7

Analysis - Seymour	Units	Date Sampled	Source	Treated
Carbon Organic - Dissolved	mg/L	2022-11-28	-	0.7
Carbon Organic - Dissolved	mg/L	2022-12-05	1.3	0.7
Carbon Organic - Dissolved	mg/L	2022-12-12	-	0.8
Carbon Organic - Dissolved	mg/L	2022-12-19	1.3	0.7
Carbon Organic - Total	mg/L	2022-01-04	1.5	0.6
Carbon Organic - Total	mg/L	2022-01-10	1.4	0.6
Carbon Organic - Total	mg/L	2022-01-17	1.5	0.6
Carbon Organic - Total	mg/L	2022-01-24	1.6	0.6
Carbon Organic - Total	mg/L	2022-01-31	1.4	0.5
Carbon Organic - Total	mg/L	2022-02-07	1.5	0.6
Carbon Organic - Total	mg/L	2022-02-14	1.4	0.6
Carbon Organic - Total	mg/L	2022-02-22	1.3	0.6
Carbon Organic - Total	mg/L	2022-02-28	1.2	0.6
Carbon Organic - Total	mg/L	2022-03-07	1.2	0.6
Carbon Organic - Total	mg/L	2022-03-14	1.3	0.6
Carbon Organic - Total	mg/L	2022-03-21	1.2	0.6
Carbon Organic - Total	mg/L	2022-03-28	1.2	0.6
Carbon Organic - Total	mg/L	2022-04-04	1.3	0.6
Carbon Organic - Total	mg/L	2022-04-11	1.4	0.6
Carbon Organic - Total	mg/L	2022-04-19	1.4	0.6
Carbon Organic - Total	mg/L	2022-04-25	1.3	0.6
Carbon Organic - Total	mg/L	2022-05-02	1.2	0.6
Carbon Organic - Total	mg/L	2022-05-09	1.2	0.5
Carbon Organic - Total	mg/L	2022-05-16	1.3	0.6
Carbon Organic - Total	mg/L	2022-05-24	1.6	0.6
Carbon Organic - Total	mg/L	2022-05-30	1.5	0.6
Carbon Organic - Total	mg/L	2022-06-06	1.6	0.5
Carbon Organic - Total	mg/L	2022-06-13	1.7	0.6
Carbon Organic - Total	mg/L	2022-06-20	-	0.6
Carbon Organic - Total	mg/L	2022-06-27	-	0.5
Carbon Organic - Total	mg/L	2022-07-04	1.5	0.5
Carbon Organic - Total	mg/L	2022-07-11	-	0.5
Carbon Organic - Total	mg/L	2022-07-18	-	0.5
Carbon Organic - Total	mg/L	2022-07-25	-	0.5
Carbon Organic - Total	mg/L	2022-08-02	1.2	0.4
Carbon Organic - Total	mg/L	2022-08-08	-	0.5
Carbon Organic - Total	mg/L	2022-08-15	-	0.4
Carbon Organic - Total	mg/L	2022-08-22	-	0.5
Carbon Organic - Total	mg/L	2022-08-29	-	0.5
Carbon Organic - Total	mg/L	2022-09-06	-	0.5
Carbon Organic - Total	mg/L	2022-09-12	1.0	0.6
Carbon Organic - Total	mg/L	2022-09-20	-	0.5

Analysis - Seymour	Units	Date Sampled	Source	Treated
Carbon Organic - Total	mg/L	2022-09-26	-	0.5
Carbon Organic - Total	mg/L	2022-10-03	-	0.6
Carbon Organic - Total	mg/L	2022-10-11	0.9	0.5
Carbon Organic - Total	mg/L	2022-10-17	-	0.5
Carbon Organic - Total	mg/L	2022-10-24	-	0.7
Carbon Organic - Total	mg/L	2022-10-31	-	0.8
Carbon Organic - Total	mg/L	2022-11-07	1.6	0.7
Carbon Organic - Total	mg/L	2022-11-14	1.7	1.0
Carbon Organic - Total	mg/L	2022-11-21	-	0.7
Carbon Organic - Total	mg/L	2022-11-28	-	0.7
Carbon Organic - Total	mg/L	2022-12-05	1.3	0.7
Carbon Organic - Total	mg/L	2022-12-12	-	0.7
Carbon Organic - Total	mg/L	2022-12-19	1.3	0.7
Chlorate	µg/L	2022-02-15	-	12.7
Chlorate	µg/L	2022-02-16	<10.0	-
Chlorate	µg/L	2022-05-10	<10.0	17.1
Chlorate	µg/L	2022-08-23	<10.0	40.1
Chlorate	µg/L	2022-11-15	<10.0	22.5
Chloride	mg/L	2022-01-04	<0.5	2.3
Chloride	mg/L	2022-02-07	<0.5	2.2
Chloride	mg/L	2022-02-15	-	2.2
Chloride	mg/L	2022-02-16	<0.5	-
Chloride	mg/L	2022-03-07	<0.5	2.2
Chloride	mg/L	2022-04-04	<0.5	2.2
Chloride	mg/L	2022-05-02	<0.5	2.2
Chloride	mg/L	2022-05-10	<0.5	2.1
Chloride	mg/L	2022-06-06	<0.5	2.2
Chloride	mg/L	2022-07-04	<0.5	2.3
Chloride	mg/L	2022-08-08	-	2.3
Chloride	mg/L	2022-08-23	<0.5	2.3
Chloride	mg/L	2022-09-12	<0.5	2.1
Chloride	mg/L	2022-10-11	<0.5	2.5
Chloride	mg/L	2022-11-07	0.6	2.9
Chloride	mg/L	2022-11-15	<0.5	2.8
Chloride	mg/L	2022-12-05	0.5	2.6
Chlorine Free	mg/L	2022-01-01	-	0.79
Chlorine Free	mg/L	2022-01-02	-	0.85
Chlorine Free	mg/L	2022-01-03	-	0.81
Chlorine Free	mg/L	2022-01-04	-	0.84
Chlorine Free	mg/L	2022-01-05	-	0.79
Chlorine Free	mg/L	2022-01-06	-	0.82
Chlorine Free	mg/L	2022-01-07	-	0.79

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-01-08	-	0.84
Chlorine Free	mg/L	2022-01-09	-	0.75
Chlorine Free	mg/L	2022-01-10	-	0.73
Chlorine Free	mg/L	2022-01-11	-	0.83
Chlorine Free	mg/L	2022-01-12	-	0.83
Chlorine Free	mg/L	2022-01-13	-	0.87
Chlorine Free	mg/L	2022-01-14	-	0.81
Chlorine Free	mg/L	2022-01-15	-	0.84
Chlorine Free	mg/L	2022-01-16	-	0.85
Chlorine Free	mg/L	2022-01-17	-	0.84
Chlorine Free	mg/L	2022-01-18	-	0.81
Chlorine Free	mg/L	2022-01-19	-	0.86
Chlorine Free	mg/L	2022-01-20	-	0.78
Chlorine Free	mg/L	2022-01-21	-	0.81
Chlorine Free	mg/L	2022-01-22	-	0.90
Chlorine Free	mg/L	2022-01-23	-	0.83
Chlorine Free	mg/L	2022-01-24	-	0.78
Chlorine Free	mg/L	2022-01-25	-	0.71
Chlorine Free	mg/L	2022-01-26	-	0.86
Chlorine Free	mg/L	2022-01-27	-	0.84
Chlorine Free	mg/L	2022-01-28	-	0.83
Chlorine Free	mg/L	2022-01-29	-	0.94
Chlorine Free	mg/L	2022-01-30	-	0.81
Chlorine Free	mg/L	2022-01-31	-	0.79
Chlorine Free	mg/L	2022-02-01	-	0.81
Chlorine Free	mg/L	2022-02-02	-	0.93
Chlorine Free	mg/L	2022-02-03	-	0.77
Chlorine Free	mg/L	2022-02-04	-	0.83
Chlorine Free	mg/L	2022-02-05	-	0.89
Chlorine Free	mg/L	2022-02-06	-	0.74
Chlorine Free	mg/L	2022-02-07	-	0.82
Chlorine Free	mg/L	2022-02-08	-	0.71
Chlorine Free	mg/L	2022-02-09	-	0.78
Chlorine Free	mg/L	2022-02-10	-	0.83
Chlorine Free	mg/L	2022-02-11	-	0.77
Chlorine Free	mg/L	2022-02-12	-	0.69
Chlorine Free	mg/L	2022-02-13	-	0.81
Chlorine Free	mg/L	2022-02-14	-	0.75
Chlorine Free	mg/L	2022-02-15	-	0.77
Chlorine Free	mg/L	2022-02-16	-	0.85
Chlorine Free	mg/L	2022-02-17	-	0.79
Chlorine Free	mg/L	2022-02-18	-	0.79

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-02-19	-	0.81
Chlorine Free	mg/L	2022-02-20	-	0.75
Chlorine Free	mg/L	2022-02-21	-	0.82
Chlorine Free	mg/L	2022-02-22	-	0.80
Chlorine Free	mg/L	2022-02-23	-	0.76
Chlorine Free	mg/L	2022-02-24	-	0.82
Chlorine Free	mg/L	2022-02-25	-	0.83
Chlorine Free	mg/L	2022-02-26	-	0.86
Chlorine Free	mg/L	2022-02-27	-	0.75
Chlorine Free	mg/L	2022-02-28	-	0.82
Chlorine Free	mg/L	2022-03-01	-	0.84
Chlorine Free	mg/L	2022-03-02	-	0.84
Chlorine Free	mg/L	2022-03-03	-	0.87
Chlorine Free	mg/L	2022-03-04	-	0.77
Chlorine Free	mg/L	2022-03-05	-	0.95
Chlorine Free	mg/L	2022-03-06	-	0.67
Chlorine Free	mg/L	2022-03-07	-	0.83
Chlorine Free	mg/L	2022-03-08	-	0.83
Chlorine Free	mg/L	2022-03-09	-	0.87
Chlorine Free	mg/L	2022-03-10	-	0.77
Chlorine Free	mg/L	2022-03-11	-	0.81
Chlorine Free	mg/L	2022-03-12	-	1.14
Chlorine Free	mg/L	2022-03-13	-	0.78
Chlorine Free	mg/L	2022-03-14	-	0.82
Chlorine Free	mg/L	2022-03-15	-	0.85
Chlorine Free	mg/L	2022-03-16	-	0.82
Chlorine Free	mg/L	2022-03-17	-	0.82
Chlorine Free	mg/L	2022-03-18	-	0.82
Chlorine Free	mg/L	2022-03-19	-	0.88
Chlorine Free	mg/L	2022-03-20	-	0.72
Chlorine Free	mg/L	2022-03-21	-	0.77
Chlorine Free	mg/L	2022-03-22	-	0.80
Chlorine Free	mg/L	2022-03-23	-	0.82
Chlorine Free	mg/L	2022-03-24	-	0.82
Chlorine Free	mg/L	2022-03-25	-	0.84
Chlorine Free	mg/L	2022-03-26	-	0.84
Chlorine Free	mg/L	2022-03-27	-	0.78
Chlorine Free	mg/L	2022-03-28	-	0.83
Chlorine Free	mg/L	2022-03-29	-	0.80
Chlorine Free	mg/L	2022-03-30	-	0.82
Chlorine Free	mg/L	2022-03-31	-	0.82
Chlorine Free	mg/L	2022-04-01	-	0.83

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-04-02	-	0.91
Chlorine Free	mg/L	2022-04-03	-	0.76
Chlorine Free	mg/L	2022-04-04	-	0.78
Chlorine Free	mg/L	2022-04-05	-	0.78
Chlorine Free	mg/L	2022-04-06	-	0.75
Chlorine Free	mg/L	2022-04-07	-	0.80
Chlorine Free	mg/L	2022-04-08	-	0.81
Chlorine Free	mg/L	2022-04-09	-	0.90
Chlorine Free	mg/L	2022-04-10	-	0.78
Chlorine Free	mg/L	2022-04-11	-	0.75
Chlorine Free	mg/L	2022-04-12	-	0.97
Chlorine Free	mg/L	2022-04-13	-	0.76
Chlorine Free	mg/L	2022-04-14	-	0.82
Chlorine Free	mg/L	2022-04-15	-	0.86
Chlorine Free	mg/L	2022-04-16	-	0.80
Chlorine Free	mg/L	2022-04-17	-	0.87
Chlorine Free	mg/L	2022-04-18	-	0.90
Chlorine Free	mg/L	2022-04-19	-	0.78
Chlorine Free	mg/L	2022-04-20	-	0.80
Chlorine Free	mg/L	2022-04-21	-	0.73
Chlorine Free	mg/L	2022-04-22	-	0.86
Chlorine Free	mg/L	2022-04-23	-	0.87
Chlorine Free	mg/L	2022-04-24	-	0.86
Chlorine Free	mg/L	2022-04-25	-	0.80
Chlorine Free	mg/L	2022-04-26	-	0.75
Chlorine Free	mg/L	2022-04-27	-	0.76
Chlorine Free	mg/L	2022-04-28	-	0.70
Chlorine Free	mg/L	2022-04-29	-	0.83
Chlorine Free	mg/L	2022-04-30	-	0.73
Chlorine Free	mg/L	2022-05-01	-	0.81
Chlorine Free	mg/L	2022-05-02	-	0.79
Chlorine Free	mg/L	2022-05-03	-	0.79
Chlorine Free	mg/L	2022-05-04	-	0.81
Chlorine Free	mg/L	2022-05-05	-	0.70
Chlorine Free	mg/L	2022-05-06	-	0.75
Chlorine Free	mg/L	2022-05-07	-	0.82
Chlorine Free	mg/L	2022-05-08	-	0.85
Chlorine Free	mg/L	2022-05-09	-	0.79
Chlorine Free	mg/L	2022-05-10	-	0.79
Chlorine Free	mg/L	2022-05-11	-	0.81
Chlorine Free	mg/L	2022-05-12	-	0.83
Chlorine Free	mg/L	2022-05-13	-	0.72

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-05-14	-	0.82
Chlorine Free	mg/L	2022-05-15	-	0.81
Chlorine Free	mg/L	2022-05-16	-	0.80
Chlorine Free	mg/L	2022-05-17	-	0.84
Chlorine Free	mg/L	2022-05-18	-	0.81
Chlorine Free	mg/L	2022-05-19	-	0.81
Chlorine Free	mg/L	2022-05-20	-	0.81
Chlorine Free	mg/L	2022-05-21	-	0.71
Chlorine Free	mg/L	2022-05-22	-	0.80
Chlorine Free	mg/L	2022-05-23	-	0.76
Chlorine Free	mg/L	2022-05-24	-	0.74
Chlorine Free	mg/L	2022-05-25	-	0.77
Chlorine Free	mg/L	2022-05-26	-	0.73
Chlorine Free	mg/L	2022-05-27	-	0.90
Chlorine Free	mg/L	2022-05-28	-	0.77
Chlorine Free	mg/L	2022-05-29	-	0.78
Chlorine Free	mg/L	2022-05-30	-	0.77
Chlorine Free	mg/L	2022-05-31	-	0.77
Chlorine Free	mg/L	2022-06-01	-	0.80
Chlorine Free	mg/L	2022-06-02	-	0.80
Chlorine Free	mg/L	2022-06-03	-	0.84
Chlorine Free	mg/L	2022-06-04	-	0.75
Chlorine Free	mg/L	2022-06-05	-	0.70
Chlorine Free	mg/L	2022-06-06	-	0.78
Chlorine Free	mg/L	2022-06-07	-	0.77
Chlorine Free	mg/L	2022-06-08	-	0.78
Chlorine Free	mg/L	2022-06-09	-	0.80
Chlorine Free	mg/L	2022-06-10	-	0.76
Chlorine Free	mg/L	2022-06-11	-	0.78
Chlorine Free	mg/L	2022-06-12	-	0.78
Chlorine Free	mg/L	2022-06-13	-	0.80
Chlorine Free	mg/L	2022-06-14	-	0.83
Chlorine Free	mg/L	2022-06-15	-	0.82
Chlorine Free	mg/L	2022-06-16	-	0.72
Chlorine Free	mg/L	2022-06-17	-	0.75
Chlorine Free	mg/L	2022-06-18	-	0.79
Chlorine Free	mg/L	2022-06-19	-	0.78
Chlorine Free	mg/L	2022-06-20	-	0.79
Chlorine Free	mg/L	2022-06-21	-	0.79
Chlorine Free	mg/L	2022-06-22	-	0.79
Chlorine Free	mg/L	2022-06-23	-	0.62
Chlorine Free	mg/L	2022-06-24	-	0.72

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-06-25	-	0.81
Chlorine Free	mg/L	2022-06-26	-	0.83
Chlorine Free	mg/L	2022-06-27	-	0.81
Chlorine Free	mg/L	2022-06-28	-	0.84
Chlorine Free	mg/L	2022-06-29	-	0.81
Chlorine Free	mg/L	2022-06-30	-	0.71
Chlorine Free	mg/L	2022-07-01	-	0.80
Chlorine Free	mg/L	2022-07-02	-	0.79
Chlorine Free	mg/L	2022-07-03	-	0.80
Chlorine Free	mg/L	2022-07-04	-	0.80
Chlorine Free	mg/L	2022-07-05	-	0.75
Chlorine Free	mg/L	2022-07-06	-	0.68
Chlorine Free	mg/L	2022-07-07	-	0.82
Chlorine Free	mg/L	2022-07-08	-	0.60
Chlorine Free	mg/L	2022-07-09	-	0.80
Chlorine Free	mg/L	2022-07-10	-	0.80
Chlorine Free	mg/L	2022-07-11	-	0.82
Chlorine Free	mg/L	2022-07-12	-	0.81
Chlorine Free	mg/L	2022-07-13	-	0.85
Chlorine Free	mg/L	2022-07-14	-	0.77
Chlorine Free	mg/L	2022-07-15	-	0.81
Chlorine Free	mg/L	2022-07-16	-	0.79
Chlorine Free	mg/L	2022-07-17	-	0.81
Chlorine Free	mg/L	2022-07-18	-	0.80
Chlorine Free	mg/L	2022-07-19	-	0.81
Chlorine Free	mg/L	2022-07-20	-	0.81
Chlorine Free	mg/L	2022-07-21	-	0.51
Chlorine Free	mg/L	2022-07-22	-	0.90
Chlorine Free	mg/L	2022-07-23	-	0.83
Chlorine Free	mg/L	2022-07-24	-	0.81
Chlorine Free	mg/L	2022-07-25	-	0.82
Chlorine Free	mg/L	2022-07-26	-	0.83
Chlorine Free	mg/L	2022-07-27	-	0.67
Chlorine Free	mg/L	2022-07-28	-	0.86
Chlorine Free	mg/L	2022-07-29	-	0.78
Chlorine Free	mg/L	2022-07-30	-	0.73
Chlorine Free	mg/L	2022-07-31	-	0.84
Chlorine Free	mg/L	2022-08-01	-	0.83
Chlorine Free	mg/L	2022-08-02	-	0.79
Chlorine Free	mg/L	2022-08-03	-	0.80
Chlorine Free	mg/L	2022-08-04	-	0.84
Chlorine Free	mg/L	2022-08-05	-	0.48

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-08-06	-	0.80
Chlorine Free	mg/L	2022-08-07	-	0.79
Chlorine Free	mg/L	2022-08-08	-	0.78
Chlorine Free	mg/L	2022-08-09	-	0.81
Chlorine Free	mg/L	2022-08-10	-	0.77
Chlorine Free	mg/L	2022-08-11	-	0.77
Chlorine Free	mg/L	2022-08-12	-	0.58
Chlorine Free	mg/L	2022-08-13	-	0.85
Chlorine Free	mg/L	2022-08-14	-	0.79
Chlorine Free	mg/L	2022-08-15	-	0.81
Chlorine Free	mg/L	2022-08-16	-	0.83
Chlorine Free	mg/L	2022-08-17	-	0.83
Chlorine Free	mg/L	2022-08-18	-	0.80
Chlorine Free	mg/L	2022-08-19	-	0.75
Chlorine Free	mg/L	2022-08-20	-	0.77
Chlorine Free	mg/L	2022-08-21	-	0.75
Chlorine Free	mg/L	2022-08-22	-	0.80
Chlorine Free	mg/L	2022-08-23	-	0.79
Chlorine Free	mg/L	2022-08-24	-	0.81
Chlorine Free	mg/L	2022-08-25	-	0.73
Chlorine Free	mg/L	2022-08-26	-	0.54
Chlorine Free	mg/L	2022-08-27	-	0.78
Chlorine Free	mg/L	2022-08-28	-	0.81
Chlorine Free	mg/L	2022-08-29	-	0.80
Chlorine Free	mg/L	2022-08-30	-	0.81
Chlorine Free	mg/L	2022-08-31	-	0.80
Chlorine Free	mg/L	2022-09-01	-	0.80
Chlorine Free	mg/L	2022-09-02	-	0.81
Chlorine Free	mg/L	2022-09-03	-	0.76
Chlorine Free	mg/L	2022-09-04	-	0.80
Chlorine Free	mg/L	2022-09-05	-	0.81
Chlorine Free	mg/L	2022-09-06	-	0.81
Chlorine Free	mg/L	2022-09-07	-	0.79
Chlorine Free	mg/L	2022-09-08	-	0.81
Chlorine Free	mg/L	2022-09-09	-	0.60
Chlorine Free	mg/L	2022-09-10	-	0.79
Chlorine Free	mg/L	2022-09-11	-	0.77
Chlorine Free	mg/L	2022-09-12	-	0.71
Chlorine Free	mg/L	2022-09-13	-	0.82
Chlorine Free	mg/L	2022-09-14	-	0.68
Chlorine Free	mg/L	2022-09-15	-	0.62
Chlorine Free	mg/L	2022-09-16	-	0.79

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-09-17	-	0.79
Chlorine Free	mg/L	2022-09-18	-	0.81
Chlorine Free	mg/L	2022-09-19	-	0.80
Chlorine Free	mg/L	2022-09-20	-	1.04
Chlorine Free	mg/L	2022-09-21	-	0.78
Chlorine Free	mg/L	2022-09-22	-	0.81
Chlorine Free	mg/L	2022-09-23	-	0.78
Chlorine Free	mg/L	2022-09-24	-	0.80
Chlorine Free	mg/L	2022-09-25	-	0.85
Chlorine Free	mg/L	2022-09-26	-	0.82
Chlorine Free	mg/L	2022-09-27	-	0.55
Chlorine Free	mg/L	2022-09-28	-	0.85
Chlorine Free	mg/L	2022-09-29	-	0.82
Chlorine Free	mg/L	2022-09-30	-	0.89
Chlorine Free	mg/L	2022-10-01	-	0.89
Chlorine Free	mg/L	2022-10-02	-	0.84
Chlorine Free	mg/L	2022-10-03	-	0.85
Chlorine Free	mg/L	2022-10-04	-	0.81
Chlorine Free	mg/L	2022-10-05	-	0.71
Chlorine Free	mg/L	2022-10-06	-	0.75
Chlorine Free	mg/L	2022-10-07	-	0.80
Chlorine Free	mg/L	2022-10-08	-	0.84
Chlorine Free	mg/L	2022-10-09	-	0.85
Chlorine Free	mg/L	2022-10-10	-	0.82
Chlorine Free	mg/L	2022-10-11	-	0.87
Chlorine Free	mg/L	2022-10-12	-	1.31
Chlorine Free	mg/L	2022-10-13	-	0.97
Chlorine Free	mg/L	2022-10-14	-	0.83
Chlorine Free	mg/L	2022-10-15	-	0.87
Chlorine Free	mg/L	2022-10-16	-	0.86
Chlorine Free	mg/L	2022-10-17	-	0.88
Chlorine Free	mg/L	2022-10-18	-	0.69
Chlorine Free	mg/L	2022-10-19	-	0.78
Chlorine Free	mg/L	2022-10-20	-	0.93
Chlorine Free	mg/L	2022-10-21	-	0.84
Chlorine Free	mg/L	2022-10-22	-	0.86
Chlorine Free	mg/L	2022-10-23	-	0.89
Chlorine Free	mg/L	2022-10-24	-	0.91
Chlorine Free	mg/L	2022-10-25	-	0.80
Chlorine Free	mg/L	2022-10-26	-	0.81
Chlorine Free	mg/L	2022-10-27	-	0.81
Chlorine Free	mg/L	2022-10-28	-	0.83

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-10-29	-	0.83
Chlorine Free	mg/L	2022-10-30	-	0.80
Chlorine Free	mg/L	2022-10-31	-	0.70
Chlorine Free	mg/L	2022-11-01	-	0.91
Chlorine Free	mg/L	2022-11-02	-	0.81
Chlorine Free	mg/L	2022-11-03	-	0.71
Chlorine Free	mg/L	2022-11-04	-	0.69
Chlorine Free	mg/L	2022-11-05	-	1.19
Chlorine Free	mg/L	2022-11-06	-	1.04
Chlorine Free	mg/L	2022-11-07	-	0.79
Chlorine Free	mg/L	2022-11-08	-	0.80
Chlorine Free	mg/L	2022-11-09	-	0.76
Chlorine Free	mg/L	2022-11-10	-	0.84
Chlorine Free	mg/L	2022-11-11	-	0.83
Chlorine Free	mg/L	2022-11-12	-	0.87
Chlorine Free	mg/L	2022-11-13	-	0.76
Chlorine Free	mg/L	2022-11-14	-	0.97
Chlorine Free	mg/L	2022-11-15	-	0.70
Chlorine Free	mg/L	2022-11-16	-	0.87
Chlorine Free	mg/L	2022-11-17	-	0.98
Chlorine Free	mg/L	2022-11-18	-	0.89
Chlorine Free	mg/L	2022-11-19	-	0.80
Chlorine Free	mg/L	2022-11-20	-	0.98
Chlorine Free	mg/L	2022-11-21	-	0.90
Chlorine Free	mg/L	2022-11-22	-	0.74
Chlorine Free	mg/L	2022-11-23	-	0.89
Chlorine Free	mg/L	2022-11-24	-	0.88
Chlorine Free	mg/L	2022-11-25	-	0.78
Chlorine Free	mg/L	2022-11-26	-	0.85
Chlorine Free	mg/L	2022-11-27	-	1.02
Chlorine Free	mg/L	2022-11-28	-	0.51
Chlorine Free	mg/L	2022-11-29	-	0.78
Chlorine Free	mg/L	2022-11-30	-	1.00
Chlorine Free	mg/L	2022-12-01	-	1.25
Chlorine Free	mg/L	2022-12-02	-	0.76
Chlorine Free	mg/L	2022-12-03	-	0.75
Chlorine Free	mg/L	2022-12-04	-	0.86
Chlorine Free	mg/L	2022-12-05	-	0.88
Chlorine Free	mg/L	2022-12-06	-	0.78
Chlorine Free	mg/L	2022-12-07	-	0.85
Chlorine Free	mg/L	2022-12-08	-	0.99
Chlorine Free	mg/L	2022-12-09	-	0.51

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-12-10	-	0.80
Chlorine Free	mg/L	2022-12-11	-	0.79
Chlorine Free	mg/L	2022-12-12	-	0.85
Chlorine Free	mg/L	2022-12-13	-	0.83
Chlorine Free	mg/L	2022-12-14	-	0.80
Chlorine Free	mg/L	2022-12-15	-	0.85
Chlorine Free	mg/L	2022-12-16	-	0.87
Chlorine Free	mg/L	2022-12-17	-	0.79
Chlorine Free	mg/L	2022-12-18	-	0.84
Chlorine Free	mg/L	2022-12-19	-	0.66
Chlorine Free	mg/L	2022-12-20	-	0.90
Chlorine Free	mg/L	2022-12-21	-	1.05
Chlorine Free	mg/L	2022-12-22	-	0.78
Chlorine Free	mg/L	2022-12-23	-	0.71
Chlorine Free	mg/L	2022-12-24	-	0.83
Chlorine Free	mg/L	2022-12-26	-	0.79
Chlorine Free	mg/L	2022-12-27	-	0.81
Chlorine Free	mg/L	2022-12-28	-	0.80
Chlorine Free	mg/L	2022-12-29	-	0.73
Chlorine Free	mg/L	2022-12-30	-	0.85
Chlorine Free	mg/L	2022-12-31	-	0.80
Chlorine Total	mg/L	2022-01-01	-	0.84
Chlorine Total	mg/L	2022-01-02	-	0.91
Chlorine Total	mg/L	2022-01-03	-	0.85
Chlorine Total	mg/L	2022-01-04	-	0.85
Chlorine Total	mg/L	2022-01-05	-	0.87
Chlorine Total	mg/L	2022-01-06	-	0.84
Chlorine Total	mg/L	2022-01-07	-	0.81
Chlorine Total	mg/L	2022-01-08	-	0.91
Chlorine Total	mg/L	2022-01-09	-	0.75
Chlorine Total	mg/L	2022-01-10	-	-
Chlorine Total	mg/L	2022-01-11	-	0.83
Chlorine Total	mg/L	2022-01-12	-	0.84
Chlorine Total	mg/L	2022-01-13	-	0.87
Chlorine Total	mg/L	2022-01-14	-	0.82
Chlorine Total	mg/L	2022-01-15	-	0.91
Chlorine Total	mg/L	2022-01-16	-	0.85
Chlorine Total	mg/L	2022-01-17	-	0.89
Chlorine Total	mg/L	2022-01-18	-	0.84
Chlorine Total	mg/L	2022-01-19	-	0.89
Chlorine Total	mg/L	2022-01-20	-	0.78
Chlorine Total	mg/L	2022-01-21	-	0.89

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-01-22	-	0.97
Chlorine Total	mg/L	2022-01-23	-	0.83
Chlorine Total	mg/L	2022-01-24	-	0.78
Chlorine Total	mg/L	2022-01-25	-	0.84
Chlorine Total	mg/L	2022-01-26	-	0.86
Chlorine Total	mg/L	2022-01-27	-	0.87
Chlorine Total	mg/L	2022-01-28	-	0.83
Chlorine Total	mg/L	2022-01-29	-	0.97
Chlorine Total	mg/L	2022-01-30	-	0.81
Chlorine Total	mg/L	2022-01-31	-	0.80
Chlorine Total	mg/L	2022-02-01	-	0.81
Chlorine Total	mg/L	2022-02-02	-	0.99
Chlorine Total	mg/L	2022-02-03	-	0.79
Chlorine Total	mg/L	2022-02-04	-	0.85
Chlorine Total	mg/L	2022-02-05	-	0.93
Chlorine Total	mg/L	2022-02-06	-	0.74
Chlorine Total	mg/L	2022-02-07	-	0.83
Chlorine Total	mg/L	2022-02-08	-	0.79
Chlorine Total	mg/L	2022-02-09	-	0.78
Chlorine Total	mg/L	2022-02-10	-	0.89
Chlorine Total	mg/L	2022-02-11	-	0.80
Chlorine Total	mg/L	2022-02-12	-	0.74
Chlorine Total	mg/L	2022-02-13	-	0.81
Chlorine Total	mg/L	2022-02-14	-	0.81
Chlorine Total	mg/L	2022-02-15	-	0.80
Chlorine Total	mg/L	2022-02-16	-	0.90
Chlorine Total	mg/L	2022-02-17	-	-
Chlorine Total	mg/L	2022-02-18	-	0.83
Chlorine Total	mg/L	2022-02-19	-	0.81
Chlorine Total	mg/L	2022-02-20	-	0.80
Chlorine Total	mg/L	2022-02-21	-	-
Chlorine Total	mg/L	2022-02-22	-	0.83
Chlorine Total	mg/L	2022-02-23	-	0.76
Chlorine Total	mg/L	2022-02-24	-	0.83
Chlorine Total	mg/L	2022-02-25	-	0.83
Chlorine Total	mg/L	2022-02-26	-	0.86
Chlorine Total	mg/L	2022-02-27	-	0.82
Chlorine Total	mg/L	2022-02-28	-	-
Chlorine Total	mg/L	2022-03-01	-	0.84
Chlorine Total	mg/L	2022-03-02	-	0.84
Chlorine Total	mg/L	2022-03-03	-	0.96
Chlorine Total	mg/L	2022-03-04	-	0.84

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-03-05	-	0.98
Chlorine Total	mg/L	2022-03-06	-	0.72
Chlorine Total	mg/L	2022-03-07	-	0.83
Chlorine Total	mg/L	2022-03-08	-	0.84
Chlorine Total	mg/L	2022-03-09	-	0.95
Chlorine Total	mg/L	2022-03-10	-	0.83
Chlorine Total	mg/L	2022-03-11	-	0.81
Chlorine Total	mg/L	2022-03-12	-	1.19
Chlorine Total	mg/L	2022-03-13	-	0.81
Chlorine Total	mg/L	2022-03-14	-	0.83
Chlorine Total	mg/L	2022-03-15	-	0.86
Chlorine Total	mg/L	2022-03-16	-	0.82
Chlorine Total	mg/L	2022-03-17	-	0.82
Chlorine Total	mg/L	2022-03-18	-	0.86
Chlorine Total	mg/L	2022-03-19	-	0.94
Chlorine Total	mg/L	2022-03-20	-	0.76
Chlorine Total	mg/L	2022-03-21	-	0.84
Chlorine Total	mg/L	2022-03-22	-	0.82
Chlorine Total	mg/L	2022-03-23	-	0.84
Chlorine Total	mg/L	2022-03-24	-	0.93
Chlorine Total	mg/L	2022-03-25	-	0.85
Chlorine Total	mg/L	2022-03-26	-	0.91
Chlorine Total	mg/L	2022-03-27	-	0.78
Chlorine Total	mg/L	2022-03-28	-	0.83
Chlorine Total	mg/L	2022-03-29	-	0.82
Chlorine Total	mg/L	2022-03-30	-	0.89
Chlorine Total	mg/L	2022-03-31	-	0.83
Chlorine Total	mg/L	2022-04-01	-	0.89
Chlorine Total	mg/L	2022-04-02	-	0.97
Chlorine Total	mg/L	2022-04-03	-	0.83
Chlorine Total	mg/L	2022-04-04	-	0.80
Chlorine Total	mg/L	2022-04-05	-	0.83
Chlorine Total	mg/L	2022-04-06	-	0.82
Chlorine Total	mg/L	2022-04-07	-	0.80
Chlorine Total	mg/L	2022-04-08	-	0.93
Chlorine Total	mg/L	2022-04-09	-	0.94
Chlorine Total	mg/L	2022-04-10	-	0.78
Chlorine Total	mg/L	2022-04-11	-	0.76
Chlorine Total	mg/L	2022-04-12	-	1.00
Chlorine Total	mg/L	2022-04-13	-	0.79
Chlorine Total	mg/L	2022-04-14	-	0.86
Chlorine Total	mg/L	2022-04-15	-	0.86

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-04-16	-	0.84
Chlorine Total	mg/L	2022-04-17	-	0.87
Chlorine Total	mg/L	2022-04-18	-	0.97
Chlorine Total	mg/L	2022-04-19	-	0.78
Chlorine Total	mg/L	2022-04-20	-	0.83
Chlorine Total	mg/L	2022-04-21	-	0.76
Chlorine Total	mg/L	2022-04-22	-	1.00
Chlorine Total	mg/L	2022-04-23	-	0.96
Chlorine Total	mg/L	2022-04-24	-	0.87
Chlorine Total	mg/L	2022-04-25	-	0.82
Chlorine Total	mg/L	2022-04-26	-	0.77
Chlorine Total	mg/L	2022-04-27	-	0.77
Chlorine Total	mg/L	2022-04-28	-	0.81
Chlorine Total	mg/L	2022-04-29	-	0.83
Chlorine Total	mg/L	2022-04-30	-	0.84
Chlorine Total	mg/L	2022-05-01	-	0.83
Chlorine Total	mg/L	2022-05-02	-	0.80
Chlorine Total	mg/L	2022-05-03	-	0.80
Chlorine Total	mg/L	2022-05-04	-	0.81
Chlorine Total	mg/L	2022-05-05	-	0.73
Chlorine Total	mg/L	2022-05-06	-	0.79
Chlorine Total	mg/L	2022-05-07	-	0.84
Chlorine Total	mg/L	2022-05-08	-	0.86
Chlorine Total	mg/L	2022-05-09	-	0.79
Chlorine Total	mg/L	2022-05-10	-	0.79
Chlorine Total	mg/L	2022-05-11	-	0.81
Chlorine Total	mg/L	2022-05-12	-	0.83
Chlorine Total	mg/L	2022-05-13	-	0.75
Chlorine Total	mg/L	2022-05-14	-	0.82
Chlorine Total	mg/L	2022-05-15	-	0.82
Chlorine Total	mg/L	2022-05-16	-	0.87
Chlorine Total	mg/L	2022-05-17	-	0.84
Chlorine Total	mg/L	2022-05-18	-	0.81
Chlorine Total	mg/L	2022-05-19	-	0.81
Chlorine Total	mg/L	2022-05-20	-	0.81
Chlorine Total	mg/L	2022-05-21	-	0.78
Chlorine Total	mg/L	2022-05-22	-	0.80
Chlorine Total	mg/L	2022-05-23	-	0.77
Chlorine Total	mg/L	2022-05-24	-	0.76
Chlorine Total	mg/L	2022-05-25	-	0.83
Chlorine Total	mg/L	2022-05-26	-	0.78
Chlorine Total	mg/L	2022-05-27	-	0.94

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-05-28	-	0.78
Chlorine Total	mg/L	2022-05-29	-	0.82
Chlorine Total	mg/L	2022-05-30	-	0.77
Chlorine Total	mg/L	2022-05-31	-	0.78
Chlorine Total	mg/L	2022-06-01	-	0.80
Chlorine Total	mg/L	2022-06-02	-	0.80
Chlorine Total	mg/L	2022-06-03	-	0.85
Chlorine Total	mg/L	2022-06-04	-	0.83
Chlorine Total	mg/L	2022-06-05	-	0.82
Chlorine Total	mg/L	2022-06-06	-	0.82
Chlorine Total	mg/L	2022-06-07	-	0.80
Chlorine Total	mg/L	2022-06-08	-	0.79
Chlorine Total	mg/L	2022-06-09	-	0.80
Chlorine Total	mg/L	2022-06-10	-	0.79
Chlorine Total	mg/L	2022-06-11	-	-
Chlorine Total	mg/L	2022-06-12	-	0.79
Chlorine Total	mg/L	2022-06-13	-	0.80
Chlorine Total	mg/L	2022-06-14	-	0.89
Chlorine Total	mg/L	2022-06-15	-	0.82
Chlorine Total	mg/L	2022-06-16	-	0.74
Chlorine Total	mg/L	2022-06-17	-	0.77
Chlorine Total	mg/L	2022-06-18	-	0.81
Chlorine Total	mg/L	2022-06-19	-	0.79
Chlorine Total	mg/L	2022-06-20	-	0.79
Chlorine Total	mg/L	2022-06-21	-	0.79
Chlorine Total	mg/L	2022-06-22	-	0.84
Chlorine Total	mg/L	2022-06-23	-	0.63
Chlorine Total	mg/L	2022-06-24	-	0.74
Chlorine Total	mg/L	2022-06-25	-	0.85
Chlorine Total	mg/L	2022-06-26	-	0.84
Chlorine Total	mg/L	2022-06-27	-	0.82
Chlorine Total	mg/L	2022-06-28	-	0.85
Chlorine Total	mg/L	2022-06-29	-	0.83
Chlorine Total	mg/L	2022-06-30	-	0.73
Chlorine Total	mg/L	2022-07-01	-	0.82
Chlorine Total	mg/L	2022-07-02	-	0.81
Chlorine Total	mg/L	2022-07-03	-	0.82
Chlorine Total	mg/L	2022-07-04	-	0.80
Chlorine Total	mg/L	2022-07-05	-	0.82
Chlorine Total	mg/L	2022-07-06	-	0.70
Chlorine Total	mg/L	2022-07-07	-	0.83
Chlorine Total	mg/L	2022-07-08	-	0.64

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-07-09	-	0.82
Chlorine Total	mg/L	2022-07-10	-	0.84
Chlorine Total	mg/L	2022-07-11	-	0.84
Chlorine Total	mg/L	2022-07-12	-	0.82
Chlorine Total	mg/L	2022-07-13	-	0.89
Chlorine Total	mg/L	2022-07-14	-	0.78
Chlorine Total	mg/L	2022-07-15	-	0.85
Chlorine Total	mg/L	2022-07-16	-	0.82
Chlorine Total	mg/L	2022-07-17	-	0.84
Chlorine Total	mg/L	2022-07-18	-	-
Chlorine Total	mg/L	2022-07-19	-	0.81
Chlorine Total	mg/L	2022-07-20	-	0.82
Chlorine Total	mg/L	2022-07-21	-	0.54
Chlorine Total	mg/L	2022-07-22	-	0.97
Chlorine Total	mg/L	2022-07-23	-	0.88
Chlorine Total	mg/L	2022-07-24	-	0.85
Chlorine Total	mg/L	2022-07-25	-	0.84
Chlorine Total	mg/L	2022-07-26	-	0.83
Chlorine Total	mg/L	2022-07-27	-	0.70
Chlorine Total	mg/L	2022-07-28	-	0.86
Chlorine Total	mg/L	2022-07-29	-	0.85
Chlorine Total	mg/L	2022-07-30	-	0.82
Chlorine Total	mg/L	2022-07-31	-	0.85
Chlorine Total	mg/L	2022-08-01	-	0.83
Chlorine Total	mg/L	2022-08-02	-	0.81
Chlorine Total	mg/L	2022-08-03	-	0.82
Chlorine Total	mg/L	2022-08-04	-	0.87
Chlorine Total	mg/L	2022-08-05	-	0.50
Chlorine Total	mg/L	2022-08-06	-	0.83
Chlorine Total	mg/L	2022-08-07	-	0.84
Chlorine Total	mg/L	2022-08-08	-	0.84
Chlorine Total	mg/L	2022-08-09	-	0.85
Chlorine Total	mg/L	2022-08-10	-	0.79
Chlorine Total	mg/L	2022-08-11	-	0.79
Chlorine Total	mg/L	2022-08-12	-	0.61
Chlorine Total	mg/L	2022-08-13	-	0.88
Chlorine Total	mg/L	2022-08-14	-	0.80
Chlorine Total	mg/L	2022-08-15	-	0.81
Chlorine Total	mg/L	2022-08-16	-	0.83
Chlorine Total	mg/L	2022-08-17	-	0.87
Chlorine Total	mg/L	2022-08-18	-	0.83
Chlorine Total	mg/L	2022-08-19	-	0.78

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-08-20	-	0.86
Chlorine Total	mg/L	2022-08-21	-	0.80
Chlorine Total	mg/L	2022-08-22	-	0.80
Chlorine Total	mg/L	2022-08-23	-	0.82
Chlorine Total	mg/L	2022-08-24	-	0.81
Chlorine Total	mg/L	2022-08-25	-	0.77
Chlorine Total	mg/L	2022-08-26	-	0.55
Chlorine Total	mg/L	2022-08-27	-	0.85
Chlorine Total	mg/L	2022-08-28	-	0.83
Chlorine Total	mg/L	2022-08-29	-	0.85
Chlorine Total	mg/L	2022-08-30	-	0.84
Chlorine Total	mg/L	2022-08-31	-	0.84
Chlorine Total	mg/L	2022-09-01	-	0.88
Chlorine Total	mg/L	2022-09-02	-	0.82
Chlorine Total	mg/L	2022-09-03	-	0.81
Chlorine Total	mg/L	2022-09-04	-	0.82
Chlorine Total	mg/L	2022-09-05	-	0.81
Chlorine Total	mg/L	2022-09-06	-	0.84
Chlorine Total	mg/L	2022-09-07	-	0.82
Chlorine Total	mg/L	2022-09-08	-	0.84
Chlorine Total	mg/L	2022-09-09	-	LA
Chlorine Total	mg/L	2022-09-10	-	0.83
Chlorine Total	mg/L	2022-09-11	-	0.83
Chlorine Total	mg/L	2022-09-12	-	0.73
Chlorine Total	mg/L	2022-09-13	-	0.84
Chlorine Total	mg/L	2022-09-14	-	0.69
Chlorine Total	mg/L	2022-09-15	-	0.63
Chlorine Total	mg/L	2022-09-16	-	0.81
Chlorine Total	mg/L	2022-09-17	-	0.91
Chlorine Total	mg/L	2022-09-18	-	0.98
Chlorine Total	mg/L	2022-09-19	-	0.84
Chlorine Total	mg/L	2022-09-20	-	1.04
Chlorine Total	mg/L	2022-09-21	-	0.79
Chlorine Total	mg/L	2022-09-22	-	0.82
Chlorine Total	mg/L	2022-09-23	-	0.82
Chlorine Total	mg/L	2022-09-24	-	0.82
Chlorine Total	mg/L	2022-09-25	-	0.85
Chlorine Total	mg/L	2022-09-26	-	0.95
Chlorine Total	mg/L	2022-09-27	-	0.58
Chlorine Total	mg/L	2022-09-28	-	0.97
Chlorine Total	mg/L	2022-09-29	-	0.96
Chlorine Total	mg/L	2022-09-30	-	0.89

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-10-01	-	0.89
Chlorine Total	mg/L	2022-10-02	-	0.84
Chlorine Total	mg/L	2022-10-03	-	0.97
Chlorine Total	mg/L	2022-10-04	-	0.96
Chlorine Total	mg/L	2022-10-05	-	0.90
Chlorine Total	mg/L	2022-10-06	-	0.84
Chlorine Total	mg/L	2022-10-07	-	0.84
Chlorine Total	mg/L	2022-10-08	-	0.89
Chlorine Total	mg/L	2022-10-09	-	0.89
Chlorine Total	mg/L	2022-10-10	-	0.83
Chlorine Total	mg/L	2022-10-11	-	0.98
Chlorine Total	mg/L	2022-10-12	-	1.31
Chlorine Total	mg/L	2022-10-13	-	0.97
Chlorine Total	mg/L	2022-10-14	-	0.86
Chlorine Total	mg/L	2022-10-15	-	0.99
Chlorine Total	mg/L	2022-10-16	-	0.86
Chlorine Total	mg/L	2022-10-17	-	-
Chlorine Total	mg/L	2022-10-18	-	0.75
Chlorine Total	mg/L	2022-10-19	-	0.83
Chlorine Total	mg/L	2022-10-20	-	0.93
Chlorine Total	mg/L	2022-10-21	-	0.84
Chlorine Total	mg/L	2022-10-22	-	0.87
Chlorine Total	mg/L	2022-10-23	-	0.93
Chlorine Total	mg/L	2022-10-24	-	0.91
Chlorine Total	mg/L	2022-10-25	-	0.85
Chlorine Total	mg/L	2022-10-26	-	0.89
Chlorine Total	mg/L	2022-10-27	-	0.81
Chlorine Total	mg/L	2022-10-28	-	0.87
Chlorine Total	mg/L	2022-10-29	-	0.86
Chlorine Total	mg/L	2022-10-30	-	0.80
Chlorine Total	mg/L	2022-10-31	-	0.97
Chlorine Total	mg/L	2022-11-01	-	0.94
Chlorine Total	mg/L	2022-11-02	-	0.82
Chlorine Total	mg/L	2022-11-03	-	0.73
Chlorine Total	mg/L	2022-11-04	-	0.72
Chlorine Total	mg/L	2022-11-05	-	1.19
Chlorine Total	mg/L	2022-11-06	-	1.04
Chlorine Total	mg/L	2022-11-07	-	0.83
Chlorine Total	mg/L	2022-11-08	-	0.82
Chlorine Total	mg/L	2022-11-09	-	0.81
Chlorine Total	mg/L	2022-11-10	-	0.89
Chlorine Total	mg/L	2022-11-11	-	0.9

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-11-12	-	0.87
Chlorine Total	mg/L	2022-11-13	-	0.76
Chlorine Total	mg/L	2022-11-14	-	0.97
Chlorine Total	mg/L	2022-11-15	-	0.76
Chlorine Total	mg/L	2022-11-16	-	0.98
Chlorine Total	mg/L	2022-11-17	-	0.98
Chlorine Total	mg/L	2022-11-18	-	0.91
Chlorine Total	mg/L	2022-11-19	-	0.80
Chlorine Total	mg/L	2022-11-20	-	0.98
Chlorine Total	mg/L	2022-11-21	-	0.90
Chlorine Total	mg/L	2022-11-22	-	0.79
Chlorine Total	mg/L	2022-11-23	-	0.98
Chlorine Total	mg/L	2022-11-25	-	0.81
Chlorine Total	mg/L	2022-11-26	-	0.85
Chlorine Total	mg/L	2022-11-27	-	1.22
Chlorine Total	mg/L	2022-11-28	-	0.52
Chlorine Total	mg/L	2022-11-29	-	0.84
Chlorine Total	mg/L	2022-11-30	-	1.00
Chlorine Total	mg/L	2022-12-01	-	1.25
Chlorine Total	mg/L	2022-12-02	-	0.86
Chlorine Total	mg/L	2022-12-03	-	0.91
Chlorine Total	mg/L	2022-12-04	-	0.86
Chlorine Total	mg/L	2022-12-05	-	1.65
Chlorine Total	mg/L	2022-12-06	-	0.83
Chlorine Total	mg/L	2022-12-07	-	0.85
Chlorine Total	mg/L	2022-12-08	-	0.99
Chlorine Total	mg/L	2022-12-09	-	0.54
Chlorine Total	mg/L	2022-12-10	-	0.82
Chlorine Total	mg/L	2022-12-11	-	0.85
Chlorine Total	mg/L	2022-12-12	-	0.85
Chlorine Total	mg/L	2022-12-13	-	0.83
Chlorine Total	mg/L	2022-12-14	-	0.80
Chlorine Total	mg/L	2022-12-15	-	0.85
Chlorine Total	mg/L	2022-12-16	-	0.91
Chlorine Total	mg/L	2022-12-17	-	0.82
Chlorine Total	mg/L	2022-12-18	-	0.92
Chlorine Total	mg/L	2022-12-19	-	0.69
Chlorine Total	mg/L	2022-12-20	-	0.90
Chlorine Total	mg/L	2022-12-21	-	1.05
Chlorine Total	mg/L	2022-12-22	-	0.89
Chlorine Total	mg/L	2022-12-23	-	0.75
Chlorine Total	mg/L	2022-12-24	-	0.85

Analysis - Seymour	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-12-26	-	0.86
Chlorine Total	mg/L	2022-12-27	-	0.81
Chlorine Total	mg/L	2022-12-28	-	0.82
Chlorine Total	mg/L	2022-12-29	-	0.81
Chlorine Total	mg/L	2022-12-30	-	0.85
Chlorine Total	mg/L	2022-12-31	-	0.83
Chlorodibromomethane	µg/L	2022-02-15	-	<1
Chlorodibromomethane	µg/L	2022-02-16	<1	-
Chlorodibromomethane	µg/L	2022-05-10	<1	<1
Chlorodibromomethane	µg/L	2022-11-15	<1	<1
Chloroform	µg/L	2022-02-15	-	16
Chloroform	µg/L	2022-02-16	<1	-
Chloroform	µg/L	2022-05-10	<1	15
Chloroform	µg/L	2022-11-15	<1	15
Chromium Total	µg/L	2022-05-02	0.06	<0.05
Chromium Total	µg/L	2022-05-04	<0.05	<0.05
Chromium Total	µg/L	2022-11-07	<0.05	<0.05
Chromium Total	µg/L	2022-11-08	0.10	0.07
Cobalt Total	µg/L	2022-05-04	<0.5	<0.5
Cobalt Total	µg/L	2022-11-08	<0.5	<0.5
Colour - Apparent	ACU	2022-01-04	16	2
Colour - Apparent	ACU	2022-01-10	15	<2
Colour - Apparent	ACU	2022-01-17	16	<2
Colour - Apparent	ACU	2022-01-24	15	<2
Colour - Apparent	ACU	2022-01-31	14	<2
Colour - Apparent	ACU	2022-02-07	13	<2
Colour - Apparent	ACU	2022-02-14	14	<2
Colour - Apparent	ACU	2022-02-22	13	2
Colour - Apparent	ACU	2022-02-28	12	<2
Colour - Apparent	ACU	2022-03-07	11	<2
Colour - Apparent	ACU	2022-03-14	13	<2
Colour - Apparent	ACU	2022-03-21	13	<2
Colour - Apparent	ACU	2022-03-28	12	<2
Colour - Apparent	ACU	2022-04-04	12	<2
Colour - Apparent	ACU	2022-04-11	13	<2
Colour - Apparent	ACU	2022-04-19	11	<2
Colour - Apparent	ACU	2022-04-25	11	<2
Colour - Apparent	ACU	2022-05-02	13	<2
Colour - Apparent	ACU	2022-05-09	11	<2
Colour - Apparent	ACU	2022-05-16	13	<2
Colour - Apparent	ACU	2022-05-24	13	2
Colour - Apparent	ACU	2022-05-30	12	2

Analysis - Seymour	Units	Date Sampled	Source	Treated
Colour - Apparent	ACU	2022-06-06	14	<2
Colour - Apparent	ACU	2022-06-13	14	3
Colour - Apparent	ACU	2022-06-20	-	<2
Colour - Apparent	ACU	2022-06-27	-	2
Colour - Apparent	ACU	2022-07-04	16	2
Colour - Apparent	ACU	2022-07-11	-	3
Colour - Apparent	ACU	2022-07-18	-	<2
Colour - Apparent	ACU	2022-07-25	-	<2
Colour - Apparent	ACU	2022-08-02	14	2
Colour - Apparent	ACU	2022-08-08	-	3
Colour - Apparent	ACU	2022-08-15	-	<2
Colour - Apparent	ACU	2022-08-22	-	2
Colour - Apparent	ACU	2022-08-29	-	6
Colour - Apparent	ACU	2022-09-06	-	<2
Colour - Apparent	ACU	2022-09-12	13	2
Colour - Apparent	ACU	2022-09-20	-	2
Colour - Apparent	ACU	2022-09-26	-	3
Colour - Apparent	ACU	2022-10-03	-	3
Colour - Apparent	ACU	2022-10-11	14	2
Colour - Apparent	ACU	2022-10-17	-	2
Colour - Apparent	ACU	2022-10-24	-	2
Colour - Apparent	ACU	2022-10-31	-	3
Colour - Apparent	ACU	2022-11-07	25	2
Colour - Apparent	ACU	2022-11-14	22	3
Colour - Apparent	ACU	2022-11-21	-	3
Colour - Apparent	ACU	2022-11-28	-	<2
Colour - Apparent	ACU	2022-12-05	18	2
Colour - Apparent	ACU	2022-12-12	-	2
Colour - Apparent	ACU	2022-12-19	17	<2
Colour - True	TCU	2022-01-04	10	<1
Colour - True	TCU	2022-01-10	10	<1
Colour - True	TCU	2022-01-17	10	<1
Colour - True	TCU	2022-01-24	11	<1
Colour - True	TCU	2022-01-31	10	<1
Colour - True	TCU	2022-02-07	9	<1
Colour - True	TCU	2022-02-14	8	<1
Colour - True	TCU	2022-02-22	8	<1
Colour - True	TCU	2022-02-28	7	<1
Colour - True	TCU	2022-03-07	8	<1
Colour - True	TCU	2022-03-14	8	<1
Colour - True	TCU	2022-03-21	8	<1
Colour - True	TCU	2022-03-28	8	<1

Analysis - Seymour	Units	Date Sampled	Source	Treated
Colour - True	TCU	2022-04-04	8	<1
Colour - True	TCU	2022-04-11	9	<1
Colour - True	TCU	2022-04-19	8	<1
Colour - True	TCU	2022-04-25	8	<1
Colour - True	TCU	2022-05-02	7	<1
Colour - True	TCU	2022-05-09	9	<1
Colour - True	TCU	2022-05-16	9	<1
Colour - True	TCU	2022-05-24	11	<1
Colour - True	TCU	2022-05-30	9	<1
Colour - True	TCU	2022-06-06	11	<1
Colour - True	TCU	2022-06-13	11	<1
Colour - True	TCU	2022-06-20	-	<1
Colour - True	TCU	2022-06-27	-	<1
Colour - True	TCU	2022-07-04	11	<1
Colour - True	TCU	2022-07-11	-	<1
Colour - True	TCU	2022-07-18	-	<1
Colour - True	TCU	2022-07-25	-	<1
Colour - True	TCU	2022-08-02	11	<1
Colour - True	TCU	2022-08-08	-	<1
Colour - True	TCU	2022-08-15	-	<1
Colour - True	TCU	2022-08-22	-	<1
Colour - True	TCU	2022-08-29	-	<1
Colour - True	TCU	2022-09-06	-	<1
Colour - True	TCU	2022-09-12	9	<1
Colour - True	TCU	2022-09-20	-	<1
Colour - True	TCU	2022-09-26	-	<1
Colour - True	TCU	2022-10-03	-	<1
Colour - True	TCU	2022-10-11	8	<1
Colour - True	TCU	2022-10-17	-	<1
Colour - True	TCU	2022-10-24	-	1
Colour - True	TCU	2022-10-31	-	<1
Colour - True	TCU	2022-11-07	13	1
Colour - True	TCU	2022-11-14	11	<1
Colour - True	TCU	2022-11-21	-	<1
Colour - True	TCU	2022-11-28	-	<1
Colour - True	TCU	2022-12-05	10	<1
Colour - True	TCU	2022-12-12	-	<1
Colour - True	TCU	2022-12-19	10	<1
Conductivity	µmhos/cm	2022-01-04	11	53
Conductivity	µmhos/cm	2022-01-10	12	47
Conductivity	µmhos/cm	2022-01-17	12	49
Conductivity	µmhos/cm	2022-01-24	12	48

Analysis - Seymour	Units	Date Sampled	Source	Treated
Conductivity	µmhos/cm	2022-01-31	12	48
Conductivity	µmhos/cm	2022-02-07	11	53
Conductivity	µmhos/cm	2022-02-14	12	47
Conductivity	µmhos/cm	2022-02-22	13	50
Conductivity	µmhos/cm	2022-02-28	13	50
Conductivity	µmhos/cm	2022-03-07	13	50
Conductivity	µmhos/cm	2022-03-14	12	47
Conductivity	µmhos/cm	2022-03-21	12	46
Conductivity	µmhos/cm	2022-03-28	13	53
Conductivity	µmhos/cm	2022-04-04	13	45
Conductivity	µmhos/cm	2022-04-11	12	46
Conductivity	µmhos/cm	2022-04-19	13	49
Conductivity	µmhos/cm	2022-04-25	13	49
Conductivity	µmhos/cm	2022-05-02	13	50
Conductivity	µmhos/cm	2022-05-09	14	52
Conductivity	µmhos/cm	2022-05-16	13	47
Conductivity	µmhos/cm	2022-05-24	12	45
Conductivity	µmhos/cm	2022-05-30	11	48
Conductivity	µmhos/cm	2022-06-06	11	46
Conductivity	µmhos/cm	2022-06-13	10	49
Conductivity	µmhos/cm	2022-06-20	-	44
Conductivity	µmhos/cm	2022-06-27	-	48
Conductivity	µmhos/cm	2022-07-04	11	52
Conductivity	µmhos/cm	2022-07-11	-	46
Conductivity	µmhos/cm	2022-07-18	-	53
Conductivity	µmhos/cm	2022-07-25	-	48
Conductivity	µmhos/cm	2022-08-02	12	50
Conductivity	µmhos/cm	2022-08-08	-	51
Conductivity	µmhos/cm	2022-08-15	-	50
Conductivity	µmhos/cm	2022-08-22	-	47
Conductivity	µmhos/cm	2022-08-29	-	50
Conductivity	µmhos/cm	2022-09-06	-	50
Conductivity	µmhos/cm	2022-09-12	14	49
Conductivity	µmhos/cm	2022-09-20	-	53
Conductivity	µmhos/cm	2022-09-26	-	43
Conductivity	µmhos/cm	2022-10-03	-	46
Conductivity	µmhos/cm	2022-10-11	13	51
Conductivity	µmhos/cm	2022-10-17	-	47
Conductivity	µmhos/cm	2022-10-24	-	45
Conductivity	µmhos/cm	2022-10-31	-	46
Conductivity	µmhos/cm	2022-11-07	13	49
Conductivity	µmhos/cm	2022-11-14	13	49

Analysis - Seymour	Units	Date Sampled	Source	Treated
Conductivity	µmhos/cm	2022-11-21	-	46
Conductivity	µmhos/cm	2022-11-28	-	48
Conductivity	µmhos/cm	2022-12-05	14	49
Conductivity	µmhos/cm	2022-12-12	-	51
Conductivity	µmhos/cm	2022-12-19	16	49
Copper Total	µg/L	2022-05-02	20.3	<0.5
Copper Total	µg/L	2022-05-04	19.7	<0.5
Copper Total	µg/L	2022-11-07	7.4	5.5
Copper Total	µg/L	2022-11-08	41.7	0.7
Cyanide Total	mg/L	2022-05-02	<0.02	<0.02
Cyanide Total	mg/L	2022-11-07	<0.02	<0.02
Dibromoacetic Acid	µg/L	2022-02-15	-	<0.5
Dibromoacetic Acid	µg/L	2022-02-16	<0.5	-
Dibromoacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Dibromoacetic Acid	µg/L	2022-08-23	<0.5	<0.5
Dibromoacetic Acid	µg/L	2022-11-15	<0.5	<0.5
Dichloroacetic Acid	µg/L	2022-02-15	-	6.3
Dichloroacetic Acid	µg/L	2022-02-16	<0.5	-
Dichloroacetic Acid	µg/L	2022-05-10	<0.5	5.8
Dichloroacetic Acid	µg/L	2022-08-23	<0.5	6.0
Dichloroacetic Acid	µg/L	2022-11-15	<0.5	7.2
Fluoride	mg/L	2022-01-04	<0.05	<0.05
Fluoride	mg/L	2022-02-07	<0.05	<0.05
Fluoride	mg/L	2022-03-07	<0.05	<0.05
Fluoride	mg/L	2022-04-04	<0.05	<0.05
Fluoride	mg/L	2022-05-02	<0.05	<0.05
Fluoride	mg/L	2022-06-06	<0.05	<0.05
Fluoride	mg/L	2022-07-04	<0.05	<0.05
Fluoride	mg/L	2022-08-08	-	<0.05
Fluoride	mg/L	2022-09-12	<0.05	<0.05
Fluoride	mg/L	2022-10-11	<0.05	<0.05
Fluoride	mg/L	2022-11-07	<0.05	<0.05
Fluoride	mg/L	2022-12-05	<0.05	<0.05
Hardness as CaCO ₃	mg/L	2022-01-04	4.1	22.8
Hardness as CaCO ₃	mg/L	2022-02-07	4.2	23.9
Hardness as CaCO ₃	mg/L	2022-02-14	4.2	20.6
Hardness as CaCO ₃	mg/L	2022-03-07	4.7	21.2
Hardness as CaCO ₃	mg/L	2022-04-04	4.8	19.5
Hardness as CaCO ₃	mg/L	2022-05-02	5.1	22.2
Hardness as CaCO ₃	mg/L	2022-06-06	4.2	20.4
Hardness as CaCO ₃	mg/L	2022-07-04	4.2	23.2
Hardness as CaCO ₃	mg/L	2022-08-08	-	22.5

Analysis - Seymour	Units	Date Sampled	Source	Treated
Hardness as CaCO ₃	mg/L	2022-09-12	5.1	22.0
Hardness as CaCO ₃	mg/L	2022-10-11	5.1	22.5
Hardness as CaCO ₃	mg/L	2022-11-07	5.1	21.8
Hardness as CaCO ₃	mg/L	2022-12-05	5.1	22.2
Iron Dissolved	µg/L	2022-01-04	52	<5
Iron Dissolved	µg/L	2022-01-10	60	<5
Iron Dissolved	µg/L	2022-01-17	89	<5
Iron Dissolved	µg/L	2022-01-24	67	<5
Iron Dissolved	µg/L	2022-01-31	61	<5
Iron Dissolved	µg/L	2022-02-14	52	<5
Iron Dissolved	µg/L	2022-02-22	57	<5
Iron Dissolved	µg/L	2022-02-28	66	<5
Iron Dissolved	µg/L	2022-03-07	59	<5
Iron Dissolved	µg/L	2022-03-14	55	<5
Iron Dissolved	µg/L	2022-03-21	53	<5
Iron Dissolved	µg/L	2022-03-28	57	<5
Iron Dissolved	µg/L	2022-04-04	48	<5
Iron Dissolved	µg/L	2022-04-11	46	<5
Iron Dissolved	µg/L	2022-04-19	41	<5
Iron Dissolved	µg/L	2022-04-25	50	<5
Iron Dissolved	µg/L	2022-05-02	62	7
Iron Dissolved	µg/L	2022-05-09	68	<5
Iron Dissolved	µg/L	2022-05-16	56	<5
Iron Dissolved	µg/L	2022-05-24	35	<5
Iron Dissolved	µg/L	2022-05-30	33	<5
Iron Dissolved	µg/L	2022-06-06	31	<5
Iron Dissolved	µg/L	2022-06-13	24	<5
Iron Dissolved	µg/L	2022-06-20	-	<5
Iron Dissolved	µg/L	2022-06-27	-	<5
Iron Dissolved	µg/L	2022-07-04	29	<5
Iron Dissolved	µg/L	2022-07-11	-	<5
Iron Dissolved	µg/L	2022-07-18	-	<5
Iron Dissolved	µg/L	2022-07-25	-	<5
Iron Dissolved	µg/L	2022-08-02	69	<5
Iron Dissolved	µg/L	2022-08-08	-	<5
Iron Dissolved	µg/L	2022-08-15	-	<5
Iron Dissolved	µg/L	2022-08-22	-	<5
Iron Dissolved	µg/L	2022-08-29	-	<5
Iron Dissolved	µg/L	2022-09-06	-	<5
Iron Dissolved	µg/L	2022-09-12	172	<5
Iron Dissolved	µg/L	2022-09-20	-	<5
Iron Dissolved	µg/L	2022-09-26	-	<5

Analysis - Seymour	Units	Date Sampled	Source	Treated
Iron Dissolved	µg/L	2022-10-03	-	<5
Iron Dissolved	µg/L	2022-10-11	220	<5
Iron Dissolved	µg/L	2022-10-17	-	<5
Iron Dissolved	µg/L	2022-10-24	-	<5
Iron Dissolved	µg/L	2022-10-31	-	<5
Iron Dissolved	µg/L	2022-11-07	176	<5
Iron Dissolved	µg/L	2022-11-14	167	<5
Iron Dissolved	µg/L	2022-11-21	-	<5
Iron Dissolved	µg/L	2022-11-28	-	<5
Iron Dissolved	µg/L	2022-12-05	77	<5
Iron Dissolved	µg/L	2022-12-12	-	<5
Iron Dissolved	µg/L	2022-12-19	148	<5
Iron Total	µg/L	2022-01-04	151	9
Iron Total	µg/L	2022-01-10	142	8
Iron Total	µg/L	2022-01-17	176	12
Iron Total	µg/L	2022-01-24	137	8
Iron Total	µg/L	2022-01-31	122	8
Iron Total	µg/L	2022-02-07	110	8
Iron Total	µg/L	2022-02-14	120	6
Iron Total	µg/L	2022-02-22	128	7
Iron Total	µg/L	2022-02-28	145	11
Iron Total	µg/L	2022-03-07	136	<5
Iron Total	µg/L	2022-03-14	143	7
Iron Total	µg/L	2022-03-21	143	<5
Iron Total	µg/L	2022-03-28	137	6
Iron Total	µg/L	2022-04-04	123	<5
Iron Total	µg/L	2022-04-11	106	<5
Iron Total	µg/L	2022-04-19	106	7
Iron Total	µg/L	2022-04-25	115	6
Iron Total	µg/L	2022-05-02	188	15
Iron Total	µg/L	2022-05-04	139	8
Iron Total	µg/L	2022-05-09	124	7
Iron Total	µg/L	2022-05-16	122	6
Iron Total	µg/L	2022-05-24	92	5
Iron Total	µg/L	2022-05-30	93	10
Iron Total	µg/L	2022-06-06	76	6
Iron Total	µg/L	2022-06-13	60	10
Iron Total	µg/L	2022-06-20	-	6
Iron Total	µg/L	2022-06-27	-	10
Iron Total	µg/L	2022-07-04	74	7
Iron Total	µg/L	2022-07-11	-	15
Iron Total	µg/L	2022-07-18	-	9

Analysis - Seymour	Units	Date Sampled	Source	Treated
Iron Total	µg/L	2022-07-25	-	7
Iron Total	µg/L	2022-08-02	129	6
Iron Total	µg/L	2022-08-08	-	7
Iron Total	µg/L	2022-08-15	-	7
Iron Total	µg/L	2022-08-22	-	10
Iron Total	µg/L	2022-08-29	-	10
Iron Total	µg/L	2022-09-06	-	7
Iron Total	µg/L	2022-09-12	338	19
Iron Total	µg/L	2022-09-20	-	7
Iron Total	µg/L	2022-09-26	-	7
Iron Total	µg/L	2022-10-03	-	7
Iron Total	µg/L	2022-10-11	361	17
Iron Total	µg/L	2022-10-17	-	5
Iron Total	µg/L	2022-10-24	-	8
Iron Total	µg/L	2022-10-31	-	22
Iron Total	µg/L	2022-11-07	389	8
Iron Total	µg/L	2022-11-08	412	20
Iron Total	µg/L	2022-11-14	344	10
Iron Total	µg/L	2022-11-21	-	6
Iron Total	µg/L	2022-11-28	-	10
Iron Total	µg/L	2022-12-05	275	10
Iron Total	µg/L	2022-12-12	-	13
Iron Total	µg/L	2022-12-19	257	12
Lead Total	µg/L	2022-05-02	<0.5	<0.5
Lead Total	µg/L	2022-05-04	<0.5	<0.5
Lead Total	µg/L	2022-11-07	<0.5	<0.5
Lead Total	µg/L	2022-11-08	<0.5	<0.5
Magnesium Total	µg/L	2022-01-04	149	214
Magnesium Total	µg/L	2022-02-07	146	191
Magnesium Total	µg/L	2022-02-14	139	187
Magnesium Total	µg/L	2022-03-07	145	180
Magnesium Total	µg/L	2022-04-04	156	180
Magnesium Total	µg/L	2022-05-02	170	189
Magnesium Total	µg/L	2022-05-04	156	200
Magnesium Total	µg/L	2022-06-06	136	219
Magnesium Total	µg/L	2022-07-04	124	213
Magnesium Total	µg/L	2022-08-08	-	199
Magnesium Total	µg/L	2022-09-12	146	218
Magnesium Total	µg/L	2022-10-11	156	249
Magnesium Total	µg/L	2022-11-07	174	223
Magnesium Total	µg/L	2022-11-08	171	222
Magnesium Total	µg/L	2022-12-05	172	266

Analysis - Seymour	Units	Date Sampled	Source	Treated
Manganese Dissolved	µg/L	2022-01-04	5.7	4.6
Manganese Dissolved	µg/L	2022-02-14	5.0	4.8
Manganese Dissolved	µg/L	2022-03-07	7.1	4.7
Manganese Dissolved	µg/L	2022-04-04	4.5	3.6
Manganese Dissolved	µg/L	2022-05-02	4.7	4.3
Manganese Dissolved	µg/L	2022-06-06	2.5	1.9
Manganese Dissolved	µg/L	2022-07-04	2.6	2.2
Manganese Dissolved	µg/L	2022-08-08	-	1.8
Manganese Dissolved	µg/L	2022-09-12	8.5	1.1
Manganese Dissolved	µg/L	2022-10-11	6.8	2.6
Manganese Dissolved	µg/L	2022-11-07	9.7	6.1
Manganese Dissolved	µg/L	2022-12-05	4.7	4.3
Manganese Total	µg/L	2022-01-04	7.5	6.7
Manganese Total	µg/L	2022-02-07	6.2	6.0
Manganese Total	µg/L	2022-02-14	5.8	5.9
Manganese Total	µg/L	2022-03-07	7.7	6.3
Manganese Total	µg/L	2022-04-04	5.2	4.4
Manganese Total	µg/L	2022-05-02	13.1	6.4
Manganese Total	µg/L	2022-05-04	5.5	5.7
Manganese Total	µg/L	2022-06-06	2.9	2.7
Manganese Total	µg/L	2022-07-04	3.2	3.3
Manganese Total	µg/L	2022-08-08	-	3.3
Manganese Total	µg/L	2022-09-12	11.0	7.9
Manganese Total	µg/L	2022-10-11	8.7	8.7
Manganese Total	µg/L	2022-11-07	14.3	10.4
Manganese Total	µg/L	2022-11-08	24.4	12.8
Manganese Total	µg/L	2022-12-05	7.4	7.2
Mercury Total	µg/L	2022-05-02	<0.05	<0.05
Mercury Total	µg/L	2022-05-04	<0.05	<0.05
Mercury Total	µg/L	2022-11-07	<0.05	<0.05
Mercury Total	µg/L	2022-11-08	<0.05	<0.05
Molybdenum Total	µg/L	2022-05-04	<0.5	<0.5
Molybdenum Total	µg/L	2022-11-08	<0.5	<0.5
Monobromoacetic Acid	µg/L	2022-02-15	-	<5.0
Monobromoacetic Acid	µg/L	2022-02-16	<5.0	-
Monobromoacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Monobromoacetic Acid	µg/L	2022-08-23	<0.5	<0.5
Monobromoacetic Acid	µg/L	2022-11-15	<0.5	<0.5
Monochloroacetic Acid	µg/L	2022-02-15	-	9.0
Monochloroacetic Acid	µg/L	2022-02-16	<5.0	-
Monochloroacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Monochloroacetic Acid	µg/L	2022-08-23	<0.5	<5.0

Analysis - Seymour	Units	Date Sampled	Source	Treated
Monochloroacetic Acid	µg/L	2022-11-15	<0.5	<5.0
Nickel Total	µg/L	2022-05-02	<0.5	<0.5
Nickel Total	µg/L	2022-05-04	<0.5	<0.5
Nickel Total	µg/L	2022-11-07	<0.5	<0.5
Nickel Total	µg/L	2022-11-08	<0.5	<0.5
Nitrogen - Ammonia as N	mg/L	2022-01-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-10	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-17	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-24	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-31	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-07	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-14	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-22	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-28	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-07	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-14	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-21	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-28	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-11	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-19	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-25	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-02	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-09	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-16	0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-24	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-30	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-06	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-13	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-20	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-27	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-11	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-18	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-25	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-02	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-08	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-15	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-22	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-29	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-06	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-12	<0.02	<0.02

Analysis - Seymour	Units	Date Sampled	Source	Treated
Nitrogen - Ammonia as N	mg/L	2022-09-20	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-26	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-03	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-11	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-17	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-24	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-31	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-07	0.03	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-14	0.03	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-21	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-28	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-12-05	0.03	<0.02
Nitrogen - Ammonia as N	mg/L	2022-12-12	-	<0.02
Nitrogen - Ammonia as N	mg/L	2022-12-19	0.02	<0.02
Nitrogen - Nitrate as N	mg/L	2022-01-04	0.05	0.06
Nitrogen - Nitrate as N	mg/L	2022-02-07	0.06	0.07
Nitrogen - Nitrate as N	mg/L	2022-03-07	0.07	0.08
Nitrogen - Nitrate as N	mg/L	2022-04-04	0.06	0.07
Nitrogen - Nitrate as N	mg/L	2022-05-02	0.06	0.06
Nitrogen - Nitrate as N	mg/L	2022-06-06	0.03	0.04
Nitrogen - Nitrate as N	mg/L	2022-07-04	0.02	0.02
Nitrogen - Nitrate as N	mg/L	2022-08-08	-	0.03
Nitrogen - Nitrate as N	mg/L	2022-09-12	0.03	0.03
Nitrogen - Nitrate as N	mg/L	2022-10-11	0.03	0.04
Nitrogen - Nitrate as N	mg/L	2022-11-07	0.16	0.16
Nitrogen - Nitrate as N	mg/L	2022-12-05	0.14	0.17
Nitrogen - Nitrite as N	mg/L	2022-01-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-02-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-03-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-04-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-05-02	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-06-06	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-07-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-08-08	-	<0.01
Nitrogen - Nitrite as N	mg/L	2022-09-12	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-10-11	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-11-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-12-05	<0.01	<0.01
pH	pH units	2022-01-01	7.2	8.4
pH	pH units	2022-01-03	6.6	8.6
pH	pH units	2022-01-04	6.5	8.0
pH	pH units	2022-01-05	6.8	8.0

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-01-06	6.7	8.2
pH	pH units	2022-01-07	6.6	8.0
pH	pH units	2022-01-08	6.5	8.4
pH	pH units	2022-01-09	6.6	8.4
pH	pH units	2022-01-10	6.5	8.0
pH	pH units	2022-01-11	6.7	8.3
pH	pH units	2022-01-12	6.5	8.2
pH	pH units	2022-01-13	7.4	8.1
pH	pH units	2022-01-14	6.6	8.3
pH	pH units	2022-01-15	6.6	8.5
pH	pH units	2022-01-16	6.5	8.3
pH	pH units	2022-01-17	7.3	8.2
pH	pH units	2022-01-18	6.5	8.3
pH	pH units	2022-01-19	7.3	7.9
pH	pH units	2022-01-20	6.6	8.3
pH	pH units	2022-01-21	6.7	8.3
pH	pH units	2022-01-22	6.7	8.4
pH	pH units	2022-01-23	6.5	8.2
pH	pH units	2022-01-24	6.4	8.2
pH	pH units	2022-01-25	7.5	7.9
pH	pH units	2022-01-26	6.5	8.2
pH	pH units	2022-01-27	6.5	8.1
pH	pH units	2022-01-28	6.6	8.3
pH	pH units	2022-01-29	6.5	8.1
pH	pH units	2022-01-30	6.5	8.1
pH	pH units	2022-01-31	7.2	7.9
pH	pH units	2022-02-01	6.6	8.3
pH	pH units	2022-02-02	6.5	8.1
pH	pH units	2022-02-03	7.1	8.2
pH	pH units	2022-02-04	6.7	8.2
pH	pH units	2022-02-05	6.5	8.1
pH	pH units	2022-02-06	6.7	8.6
pH	pH units	2022-02-07	6.4	8.0
pH	pH units	2022-02-08	7.1	8.3
pH	pH units	2022-02-09	6.5	8.5
pH	pH units	2022-02-10	6.7	8.1
pH	pH units	2022-02-11	6.6	8.2
pH	pH units	2022-02-12	6.7	8.3
pH	pH units	2022-02-13	6.6	8.2
pH	pH units	2022-02-14	6.8	8.3
pH	pH units	2022-02-15	6.8	7.8
pH	pH units	2022-02-16	6.5	8.4

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-02-17	6.6	8.3
pH	pH units	2022-02-18	6.6	8.4
pH	pH units	2022-02-19	6.5	8.4
pH	pH units	2022-02-20	6.5	8.4
pH	pH units	2022-02-21	6.5	8.4
pH	pH units	2022-02-22	6.4	8.1
pH	pH units	2022-02-23	6.6	8.4
pH	pH units	2022-02-24	6.5	8.6
pH	pH units	2022-02-25	7.5	8.1
pH	pH units	2022-02-26	6.6	8.6
pH	pH units	2022-02-27	6.6	8.5
pH	pH units	2022-02-28	6.6	8.0
pH	pH units	2022-03-01	6.5	8.5
pH	pH units	2022-03-02	6.7	8.3
pH	pH units	2022-03-03	6.4	8.4
pH	pH units	2022-03-04	6.5	8.4
pH	pH units	2022-03-05	6.7	8.4
pH	pH units	2022-03-06	6.6	8.6
pH	pH units	2022-03-07	6.4	8.5
pH	pH units	2022-03-08	6.6	8.4
pH	pH units	2022-03-09	6.6	8.5
pH	pH units	2022-03-10	6.5	8.6
pH	pH units	2022-03-11	6.6	8.3
pH	pH units	2022-03-12	6.5	8.4
pH	pH units	2022-03-13	6.6	8.4
pH	pH units	2022-03-14	6.5	8.5
pH	pH units	2022-03-15	6.7	8.4
pH	pH units	2022-03-16	6.7	8.5
pH	pH units	2022-03-17	6.6	8.4
pH	pH units	2022-03-18	6.7	8.4
pH	pH units	2022-03-19	6.8	8.2
pH	pH units	2022-03-20	6.7	8.6
pH	pH units	2022-03-21	6.5	8.5
pH	pH units	2022-03-22	6.7	8.3
pH	pH units	2022-03-23	6.7	8.3
pH	pH units	2022-03-24	6.5	8.5
pH	pH units	2022-03-25	6.7	8.3
pH	pH units	2022-03-26	6.7	8.6
pH	pH units	2022-03-27	6.7	8.6
pH	pH units	2022-03-28	6.6	8.6
pH	pH units	2022-03-29	6.7	8.4
pH	pH units	2022-03-30	6.9	8.7

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-03-31	6.6	8.5
pH	pH units	2022-04-01	6.7	8.5
pH	pH units	2022-04-02	6.9	8.5
pH	pH units	2022-04-03	6.6	8.4
pH	pH units	2022-04-04	6.5	8.2
pH	pH units	2022-04-05	6.7	8.4
pH	pH units	2022-04-06	6.6	8.4
pH	pH units	2022-04-07	6.6	8.3
pH	pH units	2022-04-08	6.9	8.7
pH	pH units	2022-04-09	6.7	8.6
pH	pH units	2022-04-10	6.7	8.3
pH	pH units	2022-04-11	6.7	8.0
pH	pH units	2022-04-12	6.8	8.7
pH	pH units	2022-04-13	6.8	8.5
pH	pH units	2022-04-14	6.6	8.5
pH	pH units	2022-04-15	6.0	7.2
pH	pH units	2022-04-16	6.0	7.3
pH	pH units	2022-04-17	6.5	7.8
pH	pH units	2022-04-18	6.8	8.1
pH	pH units	2022-04-19	6.7	8.1
pH	pH units	2022-04-20	6.6	8.5
pH	pH units	2022-04-21	6.7	8.5
pH	pH units	2022-04-22	6.8	8.6
pH	pH units	2022-04-23	6.8	8.7
pH	pH units	2022-04-24	7.2	8.2
pH	pH units	2022-04-25	6.6	7.9
pH	pH units	2022-04-26	6.8	8.4
pH	pH units	2022-04-27	6.7	8.5
pH	pH units	2022-04-28	6.9	8.4
pH	pH units	2022-04-29	6.8	8.3
pH	pH units	2022-04-30	6.8	8.5
pH	pH units	2022-05-01	6.9	8.5
pH	pH units	2022-05-02	6.7	8.5
pH	pH units	2022-05-03	6.8	8.5
pH	pH units	2022-05-04	6.6	8.4
pH	pH units	2022-05-05	6.7	8.4
pH	pH units	2022-05-06	6.8	8.5
pH	pH units	2022-05-07	6.8	8.5
pH	pH units	2022-05-08	6.7	8.5
pH	pH units	2022-05-09	6.8	8.0
pH	pH units	2022-05-10	6.7	8.5
pH	pH units	2022-05-11	6.8	8.5

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-05-13	6.9	8.6
pH	pH units	2022-05-14	7.0	8.5
pH	pH units	2022-05-15	7.1	8.5
pH	pH units	2022-05-16	6.6	8.2
pH	pH units	2022-05-17	6.7	8.6
pH	pH units	2022-05-18	6.7	8.7
pH	pH units	2022-05-19	6.7	8.4
pH	pH units	2022-05-20	6.7	8.4
pH	pH units	2022-05-21	6.8	8.3
pH	pH units	2022-05-22	6.8	8.3
pH	pH units	2022-05-23	6.7	8.3
pH	pH units	2022-05-24	6.7	7.9
pH	pH units	2022-05-25	6.7	8.5
pH	pH units	2022-05-26	6.7	8.4
pH	pH units	2022-05-27	6.8	8.6
pH	pH units	2022-05-28	6.7	8.3
pH	pH units	2022-05-29	6.7	8.3
pH	pH units	2022-05-30	6.7	8.4
pH	pH units	2022-05-31	6.6	8.5
pH	pH units	2022-06-01	6.7	8.3
pH	pH units	2022-06-02	6.6	8.3
pH	pH units	2022-06-03	6.9	8.6
pH	pH units	2022-06-04	6.7	8.4
pH	pH units	2022-06-05	6.9	8.5
pH	pH units	2022-06-06	6.7	7.9
pH	pH units	2022-06-07	6.8	8.6
pH	pH units	2022-06-08	6.8	8.4
pH	pH units	2022-06-09	6.8	8.3
pH	pH units	2022-06-10	6.6	8.5
pH	pH units	2022-06-12	6.6	8.2
pH	pH units	2022-06-13	6.5	8.0
pH	pH units	2022-06-14	6.8	8.5
pH	pH units	2022-06-15	6.7	8.4
pH	pH units	2022-06-16	6.8	8.4
pH	pH units	2022-06-17	6.7	8.3
pH	pH units	2022-06-18	6.7	8.4
pH	pH units	2022-06-19	6.7	8.4
pH	pH units	2022-06-20	6.6	8.4
pH	pH units	2022-06-21	6.7	8.3
pH	pH units	2022-06-22	6.7	8.5
pH	pH units	2022-06-23	6.8	8.5
pH	pH units	2022-06-24	6.8	8.4

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-06-25	6.8	8.3
pH	pH units	2022-06-26	6.8	8.4
pH	pH units	2022-06-27	6.8	8.0
pH	pH units	2022-06-28	6.7	8.3
pH	pH units	2022-06-29	6.8	8.3
pH	pH units	2022-06-30	6.8	8.4
pH	pH units	2022-07-01	6.8	8.2
pH	pH units	2022-07-02	6.8	8.3
pH	pH units	2022-07-03	6.8	8.4
pH	pH units	2022-07-04	6.7	8.5
pH	pH units	2022-07-05	6.7	8.5
pH	pH units	2022-07-06	6.8	8.6
pH	pH units	2022-07-07	6.7	8.4
pH	pH units	2022-07-08	6.8	8.5
pH	pH units	2022-07-09	6.8	8.3
pH	pH units	2022-07-10	6.8	8.4
pH	pH units	2022-07-11	6.8	8.0
pH	pH units	2022-07-12	6.5	8.4
pH	pH units	2022-07-13	6.8	8.4
pH	pH units	2022-07-14	6.8	8.4
pH	pH units	2022-07-15	6.8	8.5
pH	pH units	2022-07-16	6.9	8.3
pH	pH units	2022-07-17	6.8	8.4
pH	pH units	2022-07-18	6.7	8.4
pH	pH units	2022-07-19	6.7	8.3
pH	pH units	2022-07-20	6.6	8.3
pH	pH units	2022-07-21	6.8	8.5
pH	pH units	2022-07-22	7.0	8.8
pH	pH units	2022-07-23	6.9	8.4
pH	pH units	2022-07-24	6.9	8.3
pH	pH units	2022-07-25	6.8	8.5
pH	pH units	2022-07-26	6.8	8.6
pH	pH units	2022-07-27	6.7	8.4
pH	pH units	2022-07-28	6.7	8.5
pH	pH units	2022-07-29	6.9	8.5
pH	pH units	2022-07-30	6.9	8.5
pH	pH units	2022-07-31	7.0	8.4
pH	pH units	2022-08-01	6.9	8.4
pH	pH units	2022-08-02	6.8	8.4
pH	pH units	2022-08-04	6.8	8.5
pH	pH units	2022-08-05	6.7	8.5
pH	pH units	2022-08-06	6.8	8.4

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-08-07	6.9	8.4
pH	pH units	2022-08-08	6.8	8.4
pH	pH units	2022-08-09	6.6	8.4
pH	pH units	2022-08-10	6.8	8.4
pH	pH units	2022-08-11	6.9	8.4
pH	pH units	2022-08-12	6.7	8.5
pH	pH units	2022-08-13	6.8	8.5
pH	pH units	2022-08-14	6.8	8.5
pH	pH units	2022-08-15	6.7	8.1
pH	pH units	2022-08-16	6.8	8.4
pH	pH units	2022-08-17	6.9	8.4
pH	pH units	2022-08-18	6.8	8.4
pH	pH units	2022-08-19	6.9	8.8
pH	pH units	2022-08-20	6.9	8.2
pH	pH units	2022-08-21	6.7	8.4
pH	pH units	2022-08-22	6.9	7.9
pH	pH units	2022-08-23	6.8	8.4
pH	pH units	2022-08-24	6.8	8.3
pH	pH units	2022-08-25	6.8	8.3
pH	pH units	2022-08-26	6.7	8.4
pH	pH units	2022-08-27	7.0	8.4
pH	pH units	2022-08-28	7.0	8.6
pH	pH units	2022-08-29	6.8	8.1
pH	pH units	2022-08-30	6.8	8.5
pH	pH units	2022-08-31	6.8	8.5
pH	pH units	2022-09-01	7.0	8.6
pH	pH units	2022-09-02	6.9	8.6
pH	pH units	2022-09-03	6.9	8.9
pH	pH units	2022-09-04	7.1	8.5
pH	pH units	2022-09-05	7.0	8.6
pH	pH units	2022-09-06	6.8	8.1
pH	pH units	2022-09-07	6.7	8.5
pH	pH units	2022-09-08	6.9	8.6
pH	pH units	2022-09-09	6.7	8.4
pH	pH units	2022-09-10	7.2	8.5
pH	pH units	2022-09-11	7.1	8.5
pH	pH units	2022-09-12	6.7	8.0
pH	pH units	2022-09-13	6.7	8.5
pH	pH units	2022-09-14	6.8	8.4
pH	pH units	2022-09-15	6.7	8.5
pH	pH units	2022-09-16	6.8	8.6
pH	pH units	2022-09-17	7.3	8.6

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-09-18	7.3	8.6
pH	pH units	2022-09-19	7.4	8.8
pH	pH units	2022-09-20	6.8	8.3
pH	pH units	2022-09-21	7.3	8.5
pH	pH units	2022-09-22	6.9	8.7
pH	pH units	2022-09-23	7.0	8.7
pH	pH units	2022-09-24	7.5	8.7
pH	pH units	2022-09-25	7.5	8.6
pH	pH units	2022-09-26	7.6	7.9
pH	pH units	2022-09-27	6.8	8.4
pH	pH units	2022-09-28	7.2	8.4
pH	pH units	2022-09-29	6.9	8.6
pH	pH units	2022-09-30	7.3	8.8
pH	pH units	2022-10-01	7.5	8.7
pH	pH units	2022-10-02	7.5	8.8
pH	pH units	2022-10-03	6.9	8.1
pH	pH units	2022-10-04	6.9	8.6
pH	pH units	2022-10-05	7.0	8.4
pH	pH units	2022-10-06	6.9	8.4
pH	pH units	2022-10-07	7.5	8.5
pH	pH units	2022-10-08	7.6	8.8
pH	pH units	2022-10-09	7.6	8.8
pH	pH units	2022-10-10	7.5	8.8
pH	pH units	2022-10-11	6.7	8.1
pH	pH units	2022-10-12	6.9	8.5
pH	pH units	2022-10-13	6.9	8.6
pH	pH units	2022-10-14	6.9	8.7
pH	pH units	2022-10-15	6.7	9.0
pH	pH units	2022-10-16	6.9	8.4
pH	pH units	2022-10-17	-	7.9
pH	pH units	2022-10-18	6.8	8.7
pH	pH units	2022-10-19	7.1	8.7
pH	pH units	2022-10-20	6.8	8.4
pH	pH units	2022-10-21	6.9	8.6
pH	pH units	2022-10-22	7.5	8.6
pH	pH units	2022-10-23	7.3	8.6
pH	pH units	2022-10-24	6.7	7.9
pH	pH units	2022-10-25	7.0	8.7
pH	pH units	2022-10-27	6.9	8.4
pH	pH units	2022-10-28	6.9	8.6
pH	pH units	2022-10-29	7.4	8.6
pH	pH units	2022-10-30	7.2	8.6

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-10-31	6.8	8.2
pH	pH units	2022-11-01	6.9	8.5
pH	pH units	2022-11-02	7.0	8.4
pH	pH units	2022-11-03	6.9	8.4
pH	pH units	2022-11-04	6.8	8.4
pH	pH units	2022-11-05	7.4	8.5
pH	pH units	2022-11-06	7.3	8.3
pH	pH units	2022-11-07	6.7	7.9
pH	pH units	2022-11-08	6.7	8.3
pH	pH units	2022-11-09	6.9	8.2
pH	pH units	2022-11-10	6.8	8.3
pH	pH units	2022-11-11	6.8	7.4
pH	pH units	2022-11-12	6.5	7.2
pH	pH units	2022-11-13	7.0	8.0
pH	pH units	2022-11-14	6.6	7.9
pH	pH units	2022-11-15	6.9	8.2
pH	pH units	2022-11-16	6.8	8.3
pH	pH units	2022-11-17	6.9	8.3
pH	pH units	2022-11-18	6.9	8.4
pH	pH units	2022-11-19	-	8.3
pH	pH units	2022-11-20	7.7	8.5
pH	pH units	2022-11-21	6.7	7.9
pH	pH units	2022-11-22	6.9	8.3
pH	pH units	2022-11-23	6.6	8.4
pH	pH units	2022-11-24	6.9	8.4
pH	pH units	2022-11-25	6.8	8.4
pH	pH units	2022-11-26	7.7	8.7
pH	pH units	2022-11-27	6.6	8.0
pH	pH units	2022-11-28	6.9	7.9
pH	pH units	2022-11-29	6.8	8.2
pH	pH units	2022-11-30	6.9	8.6
pH	pH units	2022-12-01	6.7	8.2
pH	pH units	2022-12-02	6.8	8.5
pH	pH units	2022-12-03	7.4	8.4
pH	pH units	2022-12-04	7.3	8.3
pH	pH units	2022-12-05	6.5	7.8
pH	pH units	2022-12-06	6.8	8.5
pH	pH units	2022-12-07	6.8	8.4
pH	pH units	2022-12-08	6.7	8.5
pH	pH units	2022-12-09	6.8	8.3
pH	pH units	2022-12-10	7.5	8.1
pH	pH units	2022-12-11	7.5	8.1

Analysis - Seymour	Units	Date Sampled	Source	Treated
pH	pH units	2022-12-12	6.9	7.8
pH	pH units	2022-12-13	6.8	8.5
pH	pH units	2022-12-14	6.7	8.3
pH	pH units	2022-12-15	6.6	8.0
pH	pH units	2022-12-16	6.8	8.5
pH	pH units	2022-12-17	7.1	8.7
pH	pH units	2022-12-18	-	8.4
pH	pH units	2022-12-19	6.6	7.9
pH	pH units	2022-12-20	-	8.4
pH	pH units	2022-12-21	-	8.3
pH	pH units	2022-12-22	-	8.2
pH	pH units	2022-12-23	-	8.3
pH	pH units	2022-12-24	7.1	8.9
pH	pH units	2022-12-26	6.7	8.9
pH	pH units	2022-12-27	5.7	7.0
pH	pH units	2022-12-28	7.3	8.6
pH	pH units	2022-12-29	7.1	8.3
pH	pH units	2022-12-30	7.2	8.3
pH	pH units	2022-12-31	7.0	8.5
Phenol	mg/L	2022-05-02	<0.005	<0.005
Phenol	mg/L	2022-11-07	<0.005	<0.005
Phosphorus Dissolved	µg/L	2022-01-04	<10	<10
Phosphorus Dissolved	µg/L	2022-02-14	<10	<10
Phosphorus Dissolved	µg/L	2022-03-07	<10	<10
Phosphorus Dissolved	µg/L	2022-04-04	<10	<10
Phosphorus Dissolved	µg/L	2022-05-02	<10	<10
Phosphorus Dissolved	µg/L	2022-06-06	<10	<10
Phosphorus Dissolved	µg/L	2022-07-04	<10	<10
Phosphorus Dissolved	µg/L	2022-08-08	-	<10
Phosphorus Dissolved	µg/L	2022-09-12	<10	<10
Phosphorus Dissolved	µg/L	2022-10-11	<10	<10
Phosphorus Dissolved	µg/L	2022-11-07	<10	<10
Phosphorus Dissolved	µg/L	2022-12-05	<10	<10
Phosphorus Total	µg/L	2022-01-04	<10	<10
Phosphorus Total	mg/L	2022-02-07	<0.005	<0.005
Phosphorus Total	µg/L	2022-02-07	<10	<10
Phosphorus Total	µg/L	2022-02-14	<10	<10
Phosphorus Total	µg/L	2022-03-07	<10	<10
Phosphorus Total	µg/L	2022-04-04	<10	<10
Phosphorus Total	µg/L	2022-05-02	<10	<10
Phosphorus Total	µg/L	2022-06-06	<10	<10
Phosphorus Total	µg/L	2022-07-04	<10	<10

Analysis - Seymour	Units	Date Sampled	Source	Treated
Phosphorus Total	µg/L	2022-08-08	-	<10
Phosphorus Total	µg/L	2022-09-12	<10	<10
Phosphorus Total	µg/L	2022-10-11	<10	<10
Phosphorus Total	µg/L	2022-11-07	16	<10
Phosphorus Total	µg/L	2022-12-05	<10	<10
Potassium Total	µg/L	2022-05-02	176	161
Potassium Total	µg/L	2022-05-04	162	158
Potassium Total	µg/L	2022-11-07	49	137
Potassium Total	µg/L	2022-11-08	236	226
Reactive Phosphorus	mg/L	2022-02-07	<0.005	<0.005
Residue Total	mg/L	2022-02-07	14	36
Residue Total	mg/L	2022-04-04	14	31
Residue Total	mg/L	2022-05-02	19	36
Residue Total	mg/L	2022-07-04	14	33
Residue Total	mg/L	2022-09-12	14	34
Residue Total	mg/L	2022-11-07	18	34
Residue Total Dissolved	mg/L	2022-02-07	13	34
Residue Total Dissolved	mg/L	2022-04-04	12	29
Residue Total Dissolved	mg/L	2022-05-02	15	35
Residue Total Dissolved	mg/L	2022-07-04	11	33
Residue Total Dissolved	mg/L	2022-09-12	12	31
Residue Total Dissolved	mg/L	2022-11-07	13	32
Residue Total Fixed	mg/L	2022-02-07	9	30
Residue Total Fixed	mg/L	2022-04-04	10	26
Residue Total Fixed	mg/L	2022-05-02	10	29
Residue Total Fixed	mg/L	2022-07-04	8	25
Residue Total Fixed	mg/L	2022-09-12	8	27
Residue Total Fixed	mg/L	2022-11-07	10	26
Residue Total Volatile	mg/L	2022-02-07	5	7
Residue Total Volatile	mg/L	2022-04-04	4	5
Residue Total Volatile	mg/L	2022-05-02	9	7
Residue Total Volatile	mg/L	2022-07-04	6	8
Residue Total Volatile	mg/L	2022-09-12	6	7
Residue Total Volatile	mg/L	2022-11-07	8	8
Selenium Total	µg/L	2022-05-02	<0.5	<0.5
Selenium Total	µg/L	2022-05-04	<0.5	<0.5
Selenium Total	µg/L	2022-11-07	<0.5	<0.5
Selenium Total	µg/L	2022-11-08	<0.5	<0.5
Silica as SiO ₂	mg/L	2022-02-07	3.2	3.3
Silica as SiO ₂	mg/L	2022-04-04	3.4	3.4
Silica as SiO ₂	mg/L	2022-05-02	3.5	3.6
Silica as SiO ₂	mg/L	2022-07-04	2.7	2.8

Analysis - Seymour	Units	Date Sampled	Source	Treated
Silica as SiO ₂	mg/L	2022-09-12	3.2	3.3
Silica as SiO ₂	mg/L	2022-11-07	3.1	3.2
Silver Total	µg/L	2022-05-02	<0.5	<0.5
Silver Total	µg/L	2022-05-04	<0.5	<0.5
Silver Total	µg/L	2022-11-07	<0.5	<0.5
Silver Total	µg/L	2022-11-08	<0.5	<0.5
Sodium Total	µg/L	2022-02-07	500	1,430
Sodium Total	µg/L	2022-02-14	535	1,390
Sodium Total	µg/L	2022-02-15	-	1,500
Sodium Total	µg/L	2022-02-16	574	-
Sodium Total	µg/L	2022-04-04	576	1,500
Sodium Total	µg/L	2022-05-02	581	1,460
Sodium Total	µg/L	2022-05-04	589	1,540
Sodium Total	µg/L	2022-05-10	606	1,510
Sodium Total	µg/L	2022-07-04	423	1,390
Sodium Total	µg/L	2022-08-23	525	1,600
Sodium Total	µg/L	2022-09-12	535	1,500
Sodium Total	µg/L	2022-11-07	614	1,810
Sodium Total	µg/L	2022-11-08	600	1,790
Sodium Total	µg/L	2022-11-15	590	1,790
Sulphate	mg/L	2022-01-04	1.2	1.1
Sulphate	mg/L	2022-02-07	1.1	0.9
Sulphate	mg/L	2022-03-07	1.4	1.1
Sulphate	mg/L	2022-04-04	1.3	1.0
Sulphate	mg/L	2022-05-02	1.3	1.1
Sulphate	mg/L	2022-06-06	1.0	0.8
Sulphate	mg/L	2022-07-04	0.9	0.8
Sulphate	mg/L	2022-08-08	-	0.7
Sulphate	mg/L	2022-09-12	1.2	0.8
Sulphate	mg/L	2022-10-11	1.1	0.9
Sulphate	mg/L	2022-11-07	1.2	1.1
Sulphate	mg/L	2022-12-05	1.4	1.0
Temperature	°C	2022-01-01	1.8	4.4
Temperature	°C	2022-01-02	4	5
Temperature	°C	2022-01-03	2.2	2.3
Temperature	°C	2022-01-04	2.1	2
Temperature	°C	2022-01-05	2.2	2.4
Temperature	°C	2022-01-06	2.2	2.2
Temperature	°C	2022-01-07	2.0	2.3
Temperature	°C	2022-01-08	2.2	2.4
Temperature	°C	2022-01-09	2.2	2.5
Temperature	°C	2022-01-10	2	2

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-01-11	2.0	1.9
Temperature	°C	2022-01-12	2.5	2.5
Temperature	°C	2022-01-13	2.2	3.9
Temperature	°C	2022-01-14	1.9	2.2
Temperature	°C	2022-01-15	2.3	3.0
Temperature	°C	2022-01-16	2.3	2.6
Temperature	°C	2022-01-17	2	2
Temperature	°C	2022-01-18	2.4	2.6
Temperature	°C	2022-01-19	2.3	2.5
Temperature	°C	2022-01-20	2.4	2.5
Temperature	°C	2022-01-21	2.1	2.5
Temperature	°C	2022-01-22	2.1	2.5
Temperature	°C	2022-01-23	2.7	2.9
Temperature	°C	2022-01-24	3	3
Temperature	°C	2022-01-25	2.7	2.9
Temperature	°C	2022-01-26	2.9	3.1
Temperature	°C	2022-01-27	2.1	2.2
Temperature	°C	2022-01-28	2.7	2.7
Temperature	°C	2022-01-29	2.1	2.1
Temperature	°C	2022-01-30	2.9	3.0
Temperature	°C	2022-01-31	3	2.8
Temperature	°C	2022-02-01	2.7	2.8
Temperature	°C	2022-02-02	2.5	2.5
Temperature	°C	2022-02-03	2.8	2.7
Temperature	°C	2022-02-04	2.9	2.8
Temperature	°C	2022-02-05	2.3	4.2
Temperature	°C	2022-02-06	2.0	3.0
Temperature	°C	2022-02-07	3.1	3
Temperature	°C	2022-02-08	3.0	2.9
Temperature	°C	2022-02-09	3.2	3.1
Temperature	°C	2022-02-10	2.9	3.4
Temperature	°C	2022-02-11	3.0	3.0
Temperature	°C	2022-02-12	2.9	2.9
Temperature	°C	2022-02-13	3.0	3.0
Temperature	°C	2022-02-14	3	3
Temperature	°C	2022-02-15	3.2	3.2
Temperature	°C	2022-02-16	3.0	3.0
Temperature	°C	2022-02-17	3	3
Temperature	°C	2022-02-18	3.2	3.1
Temperature	°C	2022-02-19	3.2	3.2
Temperature	°C	2022-02-20	3.2	3.2
Temperature	°C	2022-02-21	3	3

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-02-22	3	3.2
Temperature	°C	2022-02-23	3.1	3.1
Temperature	°C	2022-02-24	3.0	3.1
Temperature	°C	2022-02-25	2.9	2.7
Temperature	°C	2022-02-26	2.9	2.9
Temperature	°C	2022-02-27	3.0	2.9
Temperature	°C	2022-02-28	3	3
Temperature	°C	2022-03-01	3.1	3.0
Temperature	°C	2022-03-02	3.1	3
Temperature	°C	2022-03-03	3.6	3
Temperature	°C	2022-03-04	3.0	3.1
Temperature	°C	2022-03-05	3.0	3.1
Temperature	°C	2022-03-06	3.0	3.1
Temperature	°C	2022-03-07	3	3
Temperature	°C	2022-03-08	3.5	3.4
Temperature	°C	2022-03-09	3.2	3.4
Temperature	°C	2022-03-10	3.3	3.4
Temperature	°C	2022-03-11	3.5	3.4
Temperature	°C	2022-03-12	3.4	3.4
Temperature	°C	2022-03-13	3.6	3.6
Temperature	°C	2022-03-14	4	3.6
Temperature	°C	2022-03-15	3.6	3.6
Temperature	°C	2022-03-16	3.7	3.7
Temperature	°C	2022-03-17	3.7	3.7
Temperature	°C	2022-03-18	3.7	3.6
Temperature	°C	2022-03-19	3.8	3.7
Temperature	°C	2022-03-20	3.8	3.8
Temperature	°C	2022-03-21	4	3.8
Temperature	°C	2022-03-22	4.0	3.8
Temperature	°C	2022-03-23	4.1	3.9
Temperature	°C	2022-03-24	4.1	4.0
Temperature	°C	2022-03-25	4.2	4.1
Temperature	°C	2022-03-26	4.4	4.4
Temperature	°C	2022-03-27	4.5	4.3
Temperature	°C	2022-03-28	5	5
Temperature	°C	2022-03-29	4.8	4.6
Temperature	°C	2022-03-30	4.9	4.6
Temperature	°C	2022-03-31	5.0	4.8
Temperature	°C	2022-04-01	5.0	4.8
Temperature	°C	2022-04-02	5.3	5.0
Temperature	°C	2022-04-03	5.5	5.3
Temperature	°C	2022-04-04	5.2	5.1

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-04-05	5.1	4.9
Temperature	°C	2022-04-06	5.2	5.1
Temperature	°C	2022-04-07	5.4	5.3
Temperature	°C	2022-04-08	5.8	5.6
Temperature	°C	2022-04-09	5.3	5.0
Temperature	°C	2022-04-10	5.3	5.2
Temperature	°C	2022-04-11	5	5.2
Temperature	°C	2022-04-12	5.6	5.5
Temperature	°C	2022-04-13	5.4	5.3
Temperature	°C	2022-04-14	5.5	5.5
Temperature	°C	2022-04-15	5.5	5.4
Temperature	°C	2022-04-16	5.3	5.2
Temperature	°C	2022-04-17	5.3	5.1
Temperature	°C	2022-04-18	5.7	5.5
Temperature	°C	2022-04-19	6	6
Temperature	°C	2022-04-20	5.6	5.5
Temperature	°C	2022-04-21	5.9	5.6
Temperature	°C	2022-04-22	5.8	5.5
Temperature	°C	2022-04-23	5.9	5.6
Temperature	°C	2022-04-24	6.3	5.7
Temperature	°C	2022-04-25	6	6
Temperature	°C	2022-04-26	6.3	5.7
Temperature	°C	2022-04-27	6.6	6.1
Temperature	°C	2022-04-28	7.1	6.3
Temperature	°C	2022-04-29	6.9	6.3
Temperature	°C	2022-04-30	7.1	6.4
Temperature	°C	2022-05-01	7.0	6.4
Temperature	°C	2022-05-02	7	6.6
Temperature	°C	2022-05-03	6.9	6.8
Temperature	°C	2022-05-04	7.0	6.4
Temperature	°C	2022-05-05	7.4	6.7
Temperature	°C	2022-05-06	6.9	6.9
Temperature	°C	2022-05-07	7.1	6.7
Temperature	°C	2022-05-08	6.8	6.5
Temperature	°C	2022-05-09	7	7
Temperature	°C	2022-05-10	7.0	6.5
Temperature	°C	2022-05-11	7.3	7.1
Temperature	°C	2022-05-12	7.3	7.0
Temperature	°C	2022-05-13	6.9	6.3
Temperature	°C	2022-05-14	7.5	7.3
Temperature	°C	2022-05-15	7.5	7.3
Temperature	°C	2022-05-16	7	7.3

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-05-17	7.3	7.0
Temperature	°C	2022-05-18	6.8	7.0
Temperature	°C	2022-05-19	6.8	6.4
Temperature	°C	2022-05-20	7.0	6.7
Temperature	°C	2022-05-21	7.3	6.7
Temperature	°C	2022-05-22	7.5	6.9
Temperature	°C	2022-05-23	7.7	7.0
Temperature	°C	2022-05-24	8.0	8
Temperature	°C	2022-05-25	7.8	7.2
Temperature	°C	2022-05-26	8.3	7.8
Temperature	°C	2022-05-27	7.7	7.6
Temperature	°C	2022-05-28	8.0	7.6
Temperature	°C	2022-05-29	7.6	7.3
Temperature	°C	2022-05-30	8	7
Temperature	°C	2022-05-31	7.9	7.1
Temperature	°C	2022-06-01	8.4	7.5
Temperature	°C	2022-06-02	8.6	7.7
Temperature	°C	2022-06-03	7.4	7.3
Temperature	°C	2022-06-04	8.4	7.9
Temperature	°C	2022-06-05	8.6	8.2
Temperature	°C	2022-06-06	8	8
Temperature	°C	2022-06-07	8.2	7.8
Temperature	°C	2022-06-08	7.8	7.8
Temperature	°C	2022-06-09	7.8	7.7
Temperature	°C	2022-06-10	7.8	7.7
Temperature	°C	2022-06-11	8	8
Temperature	°C	2022-06-12	8.0	7.9
Temperature	°C	2022-06-13	8	8
Temperature	°C	2022-06-14	8.0	7.8
Temperature	°C	2022-06-15	8.5	7.8
Temperature	°C	2022-06-16	8.5	8.0
Temperature	°C	2022-06-17	8.7	8.3
Temperature	°C	2022-06-18	8.6	8.4
Temperature	°C	2022-06-19	8.7	8.5
Temperature	°C	2022-06-20	8.7	8.5
Temperature	°C	2022-06-21	8.8	8.4
Temperature	°C	2022-06-22	8.6	8.4
Temperature	°C	2022-06-23	8.7	8.3
Temperature	°C	2022-06-24	9.0	8.6
Temperature	°C	2022-06-25	9.0	8.8
Temperature	°C	2022-06-26	9.5	9.0
Temperature	°C	2022-06-27	9.7	10

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-06-28	9.6	9.1
Temperature	°C	2022-06-29	9.6	9.2
Temperature	°C	2022-06-30	9.5	9.1
Temperature	°C	2022-07-01	10.0	8.7
Temperature	°C	2022-07-02	10.0	9.4
Temperature	°C	2022-07-03	10.0	9.9
Temperature	°C	2022-07-04	9.8	10
Temperature	°C	2022-07-05	10.5	9.9
Temperature	°C	2022-07-06	10.3	10.0
Temperature	°C	2022-07-07	10.0	9.7
Temperature	°C	2022-07-08	10.5	10.1
Temperature	°C	2022-07-09	10.3	10.1
Temperature	°C	2022-07-10	10.5	10.1
Temperature	°C	2022-07-11	11.0	11
Temperature	°C	2022-07-12	10.9	10.6
Temperature	°C	2022-07-13	11.0	10.9
Temperature	°C	2022-07-14	11.3	11.0
Temperature	°C	2022-07-15	11.7	11.3
Temperature	°C	2022-07-16	11.5	11.1
Temperature	°C	2022-07-17	11.6	11.2
Temperature	°C	2022-07-18	12	11
Temperature	°C	2022-07-19	11.9	11.5
Temperature	°C	2022-07-20	12.3	11.9
Temperature	°C	2022-07-21	11.9	10.9
Temperature	°C	2022-07-22	12.0	11.2
Temperature	°C	2022-07-23	11.9	11.0
Temperature	°C	2022-07-24	12.5	11.3
Temperature	°C	2022-07-25	12.9	12
Temperature	°C	2022-07-26	12.2	11.1
Temperature	°C	2022-07-27	12.9	8.3
Temperature	°C	2022-07-28	12.3	11.1
Temperature	°C	2022-07-29	13.2	11.2
Temperature	°C	2022-07-30	13.7	12.3
Temperature	°C	2022-07-31	14.4	13.2
Temperature	°C	2022-08-01	14.5	13.5
Temperature	°C	2022-08-02	13	12
Temperature	°C	2022-08-03	14.3	12.5
Temperature	°C	2022-08-04	13.7	12.0
Temperature	°C	2022-08-05	14.8	12.0
Temperature	°C	2022-08-06	14.7	12.1
Temperature	°C	2022-08-07	14.8	12.6
Temperature	°C	2022-08-08	15.1	12.9

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-08-09	14.4	12.0
Temperature	°C	2022-08-10	15.0	12.7
Temperature	°C	2022-08-11	14.8	12.3
Temperature	°C	2022-08-12	15.5	13.0
Temperature	°C	2022-08-13	14.6	12.3
Temperature	°C	2022-08-14	15.6	13.0
Temperature	°C	2022-08-15	16.1	13.4
Temperature	°C	2022-08-16	16.1	12.7
Temperature	°C	2022-08-17	16.7	13.3
Temperature	°C	2022-08-18	16.4	12.9
Temperature	°C	2022-08-19	17.9	15.1
Temperature	°C	2022-08-20	16.6	13.0
Temperature	°C	2022-08-21	17.0	13.5
Temperature	°C	2022-08-22	17.9	14
Temperature	°C	2022-08-23	18.0	13.7
Temperature	°C	2022-08-24	18.1	14.1
Temperature	°C	2022-08-25	18.5	13.9
Temperature	°C	2022-08-26	18.6	14.5
Temperature	°C	2022-08-27	18.1	14.0
Temperature	°C	2022-08-28	18.2	14.4
Temperature	°C	2022-08-29	18.4	14.8
Temperature	°C	2022-08-30	18.1	14.0
Temperature	°C	2022-08-31	18.1	14.5
Temperature	°C	2022-09-01	18.2	14.3
Temperature	°C	2022-09-02	18.3	14.7
Temperature	°C	2022-09-03	17.7	14.2
Temperature	°C	2022-09-04	17.7	14.7
Temperature	°C	2022-09-05	17.4	15.0
Temperature	°C	2022-09-06	17.5	15
Temperature	°C	2022-09-07	17.4	15.0
Temperature	°C	2022-09-08	17.0	14.3
Temperature	°C	2022-09-09	17.2	15.0
Temperature	°C	2022-09-10	17.0	14.9
Temperature	°C	2022-09-11	16.9	15.3
Temperature	°C	2022-09-12	17	16
Temperature	°C	2022-09-13	16.5	14.6
Temperature	°C	2022-09-14	16.4	15.1
Temperature	°C	2022-09-15	16.2	14.7
Temperature	°C	2022-09-16	15.9	15.0
Temperature	°C	2022-09-17	15.8	15.0
Temperature	°C	2022-09-18	15.7	15.1
Temperature	°C	2022-09-19	15.3	15.1

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-09-20	15.2	15
Temperature	°C	2022-09-21	15.3	15.2
Temperature	°C	2022-09-22	15.0	14.8
Temperature	°C	2022-09-23	14.8	14.7
Temperature	°C	2022-09-24	14.9	14.7
Temperature	°C	2022-09-25	14.9	14.7
Temperature	°C	2022-09-26	14.8	15
Temperature	°C	2022-09-27	15.0	14.7
Temperature	°C	2022-09-28	14.7	14.7
Temperature	°C	2022-09-29	14.8	14.6
Temperature	°C	2022-09-30	14.7	14.9
Temperature	°C	2022-10-01	14.9	14.6
Temperature	°C	2022-10-02	15.0	15.1
Temperature	°C	2022-10-03	14.9	15.0
Temperature	°C	2022-10-04	14.8	15.0
Temperature	°C	2022-10-05	14.6	15.0
Temperature	°C	2022-10-06	14.8	14.8
Temperature	°C	2022-10-07	15.0	15.2
Temperature	°C	2022-10-08	14.9	14.9
Temperature	°C	2022-10-09	14.7	15.0
Temperature	°C	2022-10-10	14.5	15.0
Temperature	°C	2022-10-11	14.5	14.8
Temperature	°C	2022-10-12	14.3	14.6
Temperature	°C	2022-10-13	14.5	14.5
Temperature	°C	2022-10-14	14.4	14.7
Temperature	°C	2022-10-15	14.3	14.5
Temperature	°C	2022-10-16	14.0	14.5
Temperature	°C	2022-10-17	14	15
Temperature	°C	2022-10-18	13.9	14.3
Temperature	°C	2022-10-19	13.8	14.2
Temperature	°C	2022-10-20	13.5	13.9
Temperature	°C	2022-10-21	13.3	13.6
Temperature	°C	2022-10-22	13.2	13.8
Temperature	°C	2022-10-23	13.0	13.8
Temperature	°C	2022-10-24	12.4	13.4
Temperature	°C	2022-10-25	12.4	13.1
Temperature	°C	2022-10-26	12	13
Temperature	°C	2022-10-27	12	12
Temperature	°C	2022-10-28	11	12
Temperature	°C	2022-10-29	11	11
Temperature	°C	2022-10-30	11	11
Temperature	°C	2022-10-31	10	10

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-11-01	10	10
Temperature	°C	2022-11-02	9	9
Temperature	°C	2022-11-03	9	9
Temperature	°C	2022-11-04	9	9
Temperature	°C	2022-11-05	8	9
Temperature	°C	2022-11-06	8	8
Temperature	°C	2022-11-07	8	8
Temperature	°C	2022-11-08	7	8
Temperature	°C	2022-11-09	7	8
Temperature	°C	2022-11-10	7	8
Temperature	°C	2022-11-11	7	7
Temperature	°C	2022-11-12	7	7
Temperature	°C	2022-11-13	7	7
Temperature	°C	2022-11-14	6	7
Temperature	°C	2022-11-15	7	7
Temperature	°C	2022-11-16	7	7
Temperature	°C	2022-11-17	6	7
Temperature	°C	2022-11-18	6	7
Temperature	°C	2022-11-19	-	6
Temperature	°C	2022-11-20	6	7
Temperature	°C	2022-11-21	5	6
Temperature	°C	2022-11-22	6	6
Temperature	°C	2022-11-23	6	6
Temperature	°C	2022-11-24	6	6
Temperature	°C	2022-11-25	6	6
Temperature	°C	2022-11-26	5	6
Temperature	°C	2022-11-27	5	6
Temperature	°C	2022-11-28	5	6
Temperature	°C	2022-11-29	4	6
Temperature	°C	2022-11-30	4	5
Temperature	°C	2022-12-01	4	6
Temperature	°C	2022-12-02	4	5
Temperature	°C	2022-12-03	4	5
Temperature	°C	2022-12-04	3	5
Temperature	°C	2022-12-05	3	5
Temperature	°C	2022-12-06	3	5
Temperature	°C	2022-12-07	3	4
Temperature	°C	2022-12-08	3	4
Temperature	°C	2022-12-09	3	4
Temperature	°C	2022-12-10	3	4
Temperature	°C	2022-12-11	3	4
Temperature	°C	2022-12-12	3	4

Analysis - Seymour	Units	Date Sampled	Source	Treated
Temperature	°C	2022-12-13	3	4
Temperature	°C	2022-12-14	2	4
Temperature	°C	2022-12-15	2	4
Temperature	°C	2022-12-16	2	4
Temperature	°C	2022-12-17	3	4
Temperature	°C	2022-12-18	-	4
Temperature	°C	2022-12-19	2	4
Temperature	°C	2022-12-20	-	4
Temperature	°C	2022-12-21	-	4
Temperature	°C	2022-12-22	2	4
Temperature	°C	2022-12-23	2	4
Temperature	°C	2022-12-24	2	3
Temperature	°C	2022-12-26	2	2
Temperature	°C	2022-12-27	2	2
Temperature	°C	2022-12-28	2	2
Temperature	°C	2022-12-29	2	3
Temperature	°C	2022-12-30	2	3
Temperature	°C	2022-12-31	2	3
Trichloroacetic Acid	µg/L	2022-02-15	-	3.2
Trichloroacetic Acid	µg/L	2022-02-16	<0.5	-
Trichloroacetic Acid	µg/L	2022-05-10	<0.5	2.1
Trichloroacetic Acid	µg/L	2022-08-23	<0.5	2.1
Trichloroacetic Acid	µg/L	2022-11-15	<0.5	3.3
Turbidity	NTU	2022-01-01	0.67	0.13
Turbidity	NTU	2022-01-02	1.0	0.13
Turbidity	NTU	2022-01-03	0.90	0.13
Turbidity	NTU	2022-01-04	1.0	0.12
Turbidity	NTU	2022-01-05	0.77	0.12
Turbidity	NTU	2022-01-06	0.86	0.23
Turbidity	NTU	2022-01-07	0.72	0.17
Turbidity	NTU	2022-01-08	0.71	0.21
Turbidity	NTU	2022-01-09	0.63	0.14
Turbidity	NTU	2022-01-10	0.71	0.13
Turbidity	NTU	2022-01-11	0.69	0.12
Turbidity	NTU	2022-01-12	0.63	0.13
Turbidity	NTU	2022-01-13	0.76	0.13
Turbidity	NTU	2022-01-14	0.74	0.14
Turbidity	NTU	2022-01-15	0.96	0.16
Turbidity	NTU	2022-01-16	0.82	0.17
Turbidity	NTU	2022-01-17	0.83	0.16
Turbidity	NTU	2022-01-18	1.2	0.14
Turbidity	NTU	2022-01-19	1.0	0.28

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-01-20	0.95	0.15
Turbidity	NTU	2022-01-21	0.81	0.14
Turbidity	NTU	2022-01-22	0.68	0.15
Turbidity	NTU	2022-01-23	0.68	0.13
Turbidity	NTU	2022-01-24	0.78	0.14
Turbidity	NTU	2022-01-25	0.77	0.17
Turbidity	NTU	2022-01-26	0.76	0.16
Turbidity	NTU	2022-01-27	0.72	0.15
Turbidity	NTU	2022-01-28	0.72	0.15
Turbidity	NTU	2022-01-29	0.71	0.22
Turbidity	NTU	2022-01-30	0.71	0.18
Turbidity	NTU	2022-01-31	0.64	0.17
Turbidity	NTU	2022-02-01	0.63	0.14
Turbidity	NTU	2022-02-02	0.66	0.16
Turbidity	NTU	2022-02-03	0.61	0.15
Turbidity	NTU	2022-02-04	0.63	0.23
Turbidity	NTU	2022-02-05	0.61	0.19
Turbidity	NTU	2022-02-06	0.50	0.12
Turbidity	NTU	2022-02-07	0.57	0.14
Turbidity	NTU	2022-02-08	0.58	0.17
Turbidity	NTU	2022-02-09	0.56	0.19
Turbidity	NTU	2022-02-10	0.63	0.19
Turbidity	NTU	2022-02-11	0.53	0.19
Turbidity	NTU	2022-02-12	0.57	0.20
Turbidity	NTU	2022-02-13	0.49	0.16
Turbidity	NTU	2022-02-14	0.57	0.13
Turbidity	NTU	2022-02-15	0.54	0.15
Turbidity	NTU	2022-02-16	0.54	0.14
Turbidity	NTU	2022-02-17	0.47	0.15
Turbidity	NTU	2022-02-18	0.52	0.14
Turbidity	NTU	2022-02-19	0.44	0.11
Turbidity	NTU	2022-02-20	0.42	0.12
Turbidity	NTU	2022-02-21	0.43	0.11
Turbidity	NTU	2022-02-22	0.45	0.14
Turbidity	NTU	2022-02-23	0.49	0.12
Turbidity	NTU	2022-02-24	0.38	0.12
Turbidity	NTU	2022-02-25	0.39	0.12
Turbidity	NTU	2022-02-26	0.38	0.17
Turbidity	NTU	2022-02-27	0.40	0.12
Turbidity	NTU	2022-02-28	0.39	0.15
Turbidity	NTU	2022-03-01	0.40	0.15
Turbidity	NTU	2022-03-02	0.40	0.12

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-03-03	0.37	0.13
Turbidity	NTU	2022-03-04	0.51	0.16
Turbidity	NTU	2022-03-05	0.43	0.12
Turbidity	NTU	2022-03-06	0.40	0.10
Turbidity	NTU	2022-03-07	0.43	0.14
Turbidity	NTU	2022-03-08	0.47	0.12
Turbidity	NTU	2022-03-09	0.54	0.17
Turbidity	NTU	2022-03-10	0.48	0.16
Turbidity	NTU	2022-03-11	0.51	0.15
Turbidity	NTU	2022-03-12	0.49	0.14
Turbidity	NTU	2022-03-13	0.45	0.11
Turbidity	NTU	2022-03-14	0.48	0.12
Turbidity	NTU	2022-03-15	0.53	0.12
Turbidity	NTU	2022-03-16	0.52	0.14
Turbidity	NTU	2022-03-17	0.49	0.11
Turbidity	NTU	2022-03-18	0.53	0.15
Turbidity	NTU	2022-03-19	0.57	0.14
Turbidity	NTU	2022-03-20	0.49	0.14
Turbidity	NTU	2022-03-21	0.52	0.13
Turbidity	NTU	2022-03-22	0.56	0.11
Turbidity	NTU	2022-03-23	0.48	0.14
Turbidity	NTU	2022-03-24	0.49	0.12
Turbidity	NTU	2022-03-25	0.51	0.13
Turbidity	NTU	2022-03-26	0.55	0.13
Turbidity	NTU	2022-03-27	0.53	0.11
Turbidity	NTU	2022-03-28	0.51	0.13
Turbidity	NTU	2022-03-29	0.45	0.13
Turbidity	NTU	2022-03-30	0.49	0.13
Turbidity	NTU	2022-03-31	0.54	0.13
Turbidity	NTU	2022-04-01	0.61	0.14
Turbidity	NTU	2022-04-02	0.59	0.11
Turbidity	NTU	2022-04-03	0.51	0.12
Turbidity	NTU	2022-04-04	0.53	0.11
Turbidity	NTU	2022-04-05	0.54	0.14
Turbidity	NTU	2022-04-06	0.53	0.11
Turbidity	NTU	2022-04-07	0.61	0.12
Turbidity	NTU	2022-04-08	0.59	0.16
Turbidity	NTU	2022-04-09	0.55	0.16
Turbidity	NTU	2022-04-10	0.53	0.10
Turbidity	NTU	2022-04-11	0.57	0.09
Turbidity	NTU	2022-04-12	0.60	0.09
Turbidity	NTU	2022-04-13	0.58	0.09

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-04-14	0.57	0.10
Turbidity	NTU	2022-04-15	0.61	0.12
Turbidity	NTU	2022-04-16	0.57	0.12
Turbidity	NTU	2022-04-17	0.54	0.07
Turbidity	NTU	2022-04-18	0.55	0.09
Turbidity	NTU	2022-04-19	0.52	0.09
Turbidity	NTU	2022-04-20	0.57	0.11
Turbidity	NTU	2022-04-21	0.55	0.13
Turbidity	NTU	2022-04-22	0.56	0.15
Turbidity	NTU	2022-04-23	0.50	0.12
Turbidity	NTU	2022-04-24	0.56	0.10
Turbidity	NTU	2022-04-25	0.48	0.11
Turbidity	NTU	2022-04-26	0.43	0.09
Turbidity	NTU	2022-04-27	0.46	0.11
Turbidity	NTU	2022-04-28	0.42	0.09
Turbidity	NTU	2022-04-29	0.51	0.11
Turbidity	NTU	2022-04-30	0.43	0.11
Turbidity	NTU	2022-05-01	0.41	0.10
Turbidity	NTU	2022-05-02	0.53	0.11
Turbidity	NTU	2022-05-03	0.43	0.12
Turbidity	NTU	2022-05-04	0.41	0.12
Turbidity	NTU	2022-05-05	0.40	0.11
Turbidity	NTU	2022-05-06	0.39	0.17
Turbidity	NTU	2022-05-07	0.37	0.16
Turbidity	NTU	2022-05-08	0.34	0.15
Turbidity	NTU	2022-05-09	0.35	0.19
Turbidity	NTU	2022-05-10	0.41	0.13
Turbidity	NTU	2022-05-11	0.34	0.11
Turbidity	NTU	2022-05-12	0.34	0.13
Turbidity	NTU	2022-05-13	0.32	0.11
Turbidity	NTU	2022-05-14	0.31	0.11
Turbidity	NTU	2022-05-15	0.33	0.11
Turbidity	NTU	2022-05-16	0.35	0.14
Turbidity	NTU	2022-05-17	0.30	0.10
Turbidity	NTU	2022-05-18	0.37	0.13
Turbidity	NTU	2022-05-19	0.46	0.11
Turbidity	NTU	2022-05-20	0.43	0.12
Turbidity	NTU	2022-05-21	0.41	0.12
Turbidity	NTU	2022-05-22	0.41	0.11
Turbidity	NTU	2022-05-23	0.42	0.15
Turbidity	NTU	2022-05-24	0.45	0.12
Turbidity	NTU	2022-05-25	0.42	0.13

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-05-26	0.47	0.15
Turbidity	NTU	2022-05-27	0.46	0.15
Turbidity	NTU	2022-05-28	0.36	0.13
Turbidity	NTU	2022-05-29	0.38	0.13
Turbidity	NTU	2022-05-30	0.39	0.15
Turbidity	NTU	2022-05-31	0.37	0.12
Turbidity	NTU	2022-06-01	0.43	0.14
Turbidity	NTU	2022-06-02	0.39	0.15
Turbidity	NTU	2022-06-03	0.43	0.19
Turbidity	NTU	2022-06-04	0.40	0.13
Turbidity	NTU	2022-06-05	0.35	0.13
Turbidity	NTU	2022-06-06	0.43	0.13
Turbidity	NTU	2022-06-07	0.59	0.15
Turbidity	NTU	2022-06-08	0.44	0.18
Turbidity	NTU	2022-06-09	0.51	0.22
Turbidity	NTU	2022-06-10	0.53	0.22
Turbidity	NTU	2022-06-11	0.51	0.16
Turbidity	NTU	2022-06-12	0.52	0.17
Turbidity	NTU	2022-06-13	0.41	0.22
Turbidity	NTU	2022-06-14	0.49	0.25
Turbidity	NTU	2022-06-15	0.42	0.20
Turbidity	NTU	2022-06-16	0.37	0.24
Turbidity	NTU	2022-06-17	0.38	0.21
Turbidity	NTU	2022-06-18	0.39	0.14
Turbidity	NTU	2022-06-19	0.36	0.13
Turbidity	NTU	2022-06-20	0.35	0.15
Turbidity	NTU	2022-06-21	0.34	0.14
Turbidity	NTU	2022-06-22	0.31	0.12
Turbidity	NTU	2022-06-23	0.31	0.18
Turbidity	NTU	2022-06-24	0.31	0.17
Turbidity	NTU	2022-06-25	0.29	0.13
Turbidity	NTU	2022-06-26	0.29	0.16
Turbidity	NTU	2022-06-27	0.32	0.14
Turbidity	NTU	2022-06-28	0.35	0.15
Turbidity	NTU	2022-06-29	0.33	0.22
Turbidity	NTU	2022-06-30	0.27	0.25
Turbidity	NTU	2022-07-01	0.24	0.16
Turbidity	NTU	2022-07-02	0.28	0.18
Turbidity	NTU	2022-07-03	0.27	0.15
Turbidity	NTU	2022-07-04	0.27	0.17
Turbidity	NTU	2022-07-05	0.30	0.19
Turbidity	NTU	2022-07-06	0.31	0.16

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-07-07	0.27	0.12
Turbidity	NTU	2022-07-08	0.28	0.18
Turbidity	NTU	2022-07-09	0.24	0.20
Turbidity	NTU	2022-07-10	0.25	0.17
Turbidity	NTU	2022-07-11	0.29	0.16
Turbidity	NTU	2022-07-12	0.26	0.15
Turbidity	NTU	2022-07-13	0.26	0.18
Turbidity	NTU	2022-07-14	0.25	0.19
Turbidity	NTU	2022-07-15	0.25	0.19
Turbidity	NTU	2022-07-16	0.28	0.12
Turbidity	NTU	2022-07-17	0.23	0.08
Turbidity	NTU	2022-07-18	0.41	0.16
Turbidity	NTU	2022-07-19	0.34	0.13
Turbidity	NTU	2022-07-20	0.26	0.15
Turbidity	NTU	2022-07-21	0.24	0.10
Turbidity	NTU	2022-07-22	0.36	0.17
Turbidity	NTU	2022-07-23	0.27	0.13
Turbidity	NTU	2022-07-24	0.27	0.10
Turbidity	NTU	2022-07-25	0.29	0.12
Turbidity	NTU	2022-07-26	0.28	0.13
Turbidity	NTU	2022-07-27	0.30	0.14
Turbidity	NTU	2022-07-28	0.27	0.11
Turbidity	NTU	2022-07-29	0.32	0.12
Turbidity	NTU	2022-07-30	0.27	0.11
Turbidity	NTU	2022-07-31	0.28	0.13
Turbidity	NTU	2022-08-01	0.27	0.14
Turbidity	NTU	2022-08-02	0.30	0.12
Turbidity	NTU	2022-08-03	0.28	0.12
Turbidity	NTU	2022-08-04	0.28	0.16
Turbidity	NTU	2022-08-05	0.32	0.17
Turbidity	NTU	2022-08-06	0.32	0.13
Turbidity	NTU	2022-08-07	0.29	0.09
Turbidity	NTU	2022-08-08	0.40	0.14
Turbidity	NTU	2022-08-09	0.31	0.10
Turbidity	NTU	2022-08-10	0.34	0.13
Turbidity	NTU	2022-08-11	0.35	0.17
Turbidity	NTU	2022-08-12	0.32	0.12
Turbidity	NTU	2022-08-13	0.36	0.10
Turbidity	NTU	2022-08-14	0.35	0.10
Turbidity	NTU	2022-08-15	0.40	0.14
Turbidity	NTU	2022-08-16	0.35	0.15
Turbidity	NTU	2022-08-17	0.36	0.17

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-08-18	0.37	0.12
Turbidity	NTU	2022-08-19	0.41	0.10
Turbidity	NTU	2022-08-20	0.38	0.09
Turbidity	NTU	2022-08-21	0.38	0.12
Turbidity	NTU	2022-08-22	0.41	0.10
Turbidity	NTU	2022-08-23	0.42	0.17
Turbidity	NTU	2022-08-24	0.52	0.17
Turbidity	NTU	2022-08-25	0.43	0.16
Turbidity	NTU	2022-08-26	0.44	0.13
Turbidity	NTU	2022-08-27	0.52	0.09
Turbidity	NTU	2022-08-28	0.44	0.08
Turbidity	NTU	2022-08-29	0.42	0.12
Turbidity	NTU	2022-08-30	0.46	0.13
Turbidity	NTU	2022-08-31	0.43	0.13
Turbidity	NTU	2022-09-01	0.51	0.13
Turbidity	NTU	2022-09-02	0.51	0.18
Turbidity	NTU	2022-09-03	0.53	0.11
Turbidity	NTU	2022-09-04	0.50	0.14
Turbidity	NTU	2022-09-05	0.48	0.11
Turbidity	NTU	2022-09-06	0.52	0.13
Turbidity	NTU	2022-09-07	0.50	0.13
Turbidity	NTU	2022-09-08	0.45	0.14
Turbidity	NTU	2022-09-09	0.47	0.16
Turbidity	NTU	2022-09-10	0.44	0.13
Turbidity	NTU	2022-09-11	0.43	0.11
Turbidity	NTU	2022-09-12	0.44	0.12
Turbidity	NTU	2022-09-13	0.43	0.12
Turbidity	NTU	2022-09-14	0.44	0.11
Turbidity	NTU	2022-09-15	0.46	0.13
Turbidity	NTU	2022-09-16	0.54	0.18
Turbidity	NTU	2022-09-17	0.48	0.12
Turbidity	NTU	2022-09-18	0.45	0.12
Turbidity	NTU	2022-09-19	0.45	0.10
Turbidity	NTU	2022-09-20	0.45	0.12
Turbidity	NTU	2022-09-21	0.47	0.12
Turbidity	NTU	2022-09-22	0.51	0.13
Turbidity	NTU	2022-09-23	0.45	0.16
Turbidity	NTU	2022-09-24	0.50	0.13
Turbidity	NTU	2022-09-25	0.46	0.13
Turbidity	NTU	2022-09-26	0.47	0.16
Turbidity	NTU	2022-09-27	0.47	0.13
Turbidity	NTU	2022-09-28	0.48	0.21

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-09-29	0.55	0.15
Turbidity	NTU	2022-09-30	0.46	0.12
Turbidity	NTU	2022-10-01	0.46	0.13
Turbidity	NTU	2022-10-02	0.49	0.11
Turbidity	NTU	2022-10-03	0.43	0.13
Turbidity	NTU	2022-10-04	0.46	0.15
Turbidity	NTU	2022-10-05	0.45	0.12
Turbidity	NTU	2022-10-06	0.46	0.15
Turbidity	NTU	2022-10-07	0.46	0.16
Turbidity	NTU	2022-10-08	0.44	0.14
Turbidity	NTU	2022-10-09	0.43	0.13
Turbidity	NTU	2022-10-10	0.46	0.10
Turbidity	NTU	2022-10-11	0.48	0.18
Turbidity	NTU	2022-10-12	0.46	0.13
Turbidity	NTU	2022-10-13	0.49	0.12
Turbidity	NTU	2022-10-14	0.47	0.12
Turbidity	NTU	2022-10-15	0.46	0.12
Turbidity	NTU	2022-10-16	0.45	0.12
Turbidity	NTU	2022-10-17	0.60	0.19
Turbidity	NTU	2022-10-18	0.47	0.14
Turbidity	NTU	2022-10-19	0.48	0.11
Turbidity	NTU	2022-10-20	0.47	0.14
Turbidity	NTU	2022-10-21	0.54	0.12
Turbidity	NTU	2022-10-22	0.55	0.14
Turbidity	NTU	2022-10-23	0.56	0.10
Turbidity	NTU	2022-10-24	0.58	0.15
Turbidity	NTU	2022-10-25	0.56	0.17
Turbidity	NTU	2022-10-26	0.67	0.20
Turbidity	NTU	2022-10-27	0.65	0.14
Turbidity	NTU	2022-10-28	0.68	0.14
Turbidity	NTU	2022-10-29	1.5	0.15
Turbidity	NTU	2022-10-30	2.1	0.13
Turbidity	NTU	2022-10-31	2.7	0.20
Turbidity	NTU	2022-11-01	2.1	0.27
Turbidity	NTU	2022-11-02	1.3	0.14
Turbidity	NTU	2022-11-03	1.3	0.19
Turbidity	NTU	2022-11-04	1.4	0.19
Turbidity	NTU	2022-11-05	1.4	0.12
Turbidity	NTU	2022-11-06	1.2	0.14
Turbidity	NTU	2022-11-07	1.3	0.14
Turbidity	NTU	2022-11-08	1.2	0.16
Turbidity	NTU	2022-11-09	1.1	0.15

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-11-10	1.0	0.18
Turbidity	NTU	2022-11-11	0.91	0.11
Turbidity	NTU	2022-11-12	0.98	0.15
Turbidity	NTU	2022-11-13	0.93	0.13
Turbidity	NTU	2022-11-14	0.88	0.19
Turbidity	NTU	2022-11-15	0.85	0.18
Turbidity	NTU	2022-11-16	1.1	0.22
Turbidity	NTU	2022-11-17	0.76	0.13
Turbidity	NTU	2022-11-18	0.74	0.20
Turbidity	NTU	2022-11-19	-	0.10
Turbidity	NTU	2022-11-20	0.67	0.11
Turbidity	NTU	2022-11-21	0.71	0.14
Turbidity	NTU	2022-11-22	0.75	0.18
Turbidity	NTU	2022-11-23	0.66	0.15
Turbidity	NTU	2022-11-24	0.62	0.18
Turbidity	NTU	2022-11-25	0.66	0.16
Turbidity	NTU	2022-11-26	0.63	0.15
Turbidity	NTU	2022-11-27	0.59	0.11
Turbidity	NTU	2022-11-28	0.54	0.14
Turbidity	NTU	2022-11-29	0.58	0.18
Turbidity	NTU	2022-11-30	0.53	0.15
Turbidity	NTU	2022-12-01	0.56	0.12
Turbidity	NTU	2022-12-02	0.54	0.10
Turbidity	NTU	2022-12-03	0.54	0.16
Turbidity	NTU	2022-12-04	0.46	0.16
Turbidity	NTU	2022-12-05	0.47	0.19
Turbidity	NTU	2022-12-06	0.47	0.18
Turbidity	NTU	2022-12-07	0.46	0.20
Turbidity	NTU	2022-12-08	0.48	0.16
Turbidity	NTU	2022-12-09	0.45	0.19
Turbidity	NTU	2022-12-10	0.46	0.17
Turbidity	NTU	2022-12-11	0.42	0.15
Turbidity	NTU	2022-12-12	0.45	0.20
Turbidity	NTU	2022-12-13	0.42	0.19
Turbidity	NTU	2022-12-14	0.44	0.22
Turbidity	NTU	2022-12-15	0.47	0.22
Turbidity	NTU	2022-12-16	0.46	0.18
Turbidity	NTU	2022-12-17	0.41	0.16
Turbidity	NTU	2022-12-18	-	0.19
Turbidity	NTU	2022-12-19	0.43	0.20
Turbidity	NTU	2022-12-20	-	0.27
Turbidity	NTU	2022-12-21	-	0.22

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-12-22	0.39	0.27
Turbidity	NTU	2022-12-23	0.46	0.17
Turbidity	NTU	2022-12-24	0.42	0.23
Turbidity	NTU	2022-12-26	0.46	0.19
Turbidity	NTU	2022-12-27	2.1	0.13
Turbidity	NTU	2022-12-28	3.6	0.20
Turbidity	NTU	2022-12-29	4.9	0.14
Turbidity	NTU	2022-12-30	5.4	0.22
Turbidity	NTU	2022-12-31	4.5	0.17
UV Absorbance 254 nm	Abs/cm	2022-01-04	0.064	0.011
UV Absorbance 254 nm	Abs/cm	2022-01-10	0.061	0.011
UV Absorbance 254 nm	Abs/cm	2022-01-17	0.064	0.011
UV Absorbance 254 nm	Abs/cm	2022-01-24	0.067	0.011
UV Absorbance 254 nm	Abs/cm	2022-01-31	0.062	0.010
UV Absorbance 254 nm	Abs/cm	2022-02-07	0.062	0.011
UV Absorbance 254 nm	Abs/cm	2022-02-14	0.058	0.010
UV Absorbance 254 nm	Abs/cm	2022-02-22	0.052	0.010
UV Absorbance 254 nm	Abs/cm	2022-02-28	0.048	0.010
UV Absorbance 254 nm	Abs/cm	2022-03-07	0.051	0.010
UV Absorbance 254 nm	Abs/cm	2022-03-14	0.050	0.011
UV Absorbance 254 nm	Abs/cm	2022-03-21	0.051	0.011
UV Absorbance 254 nm	Abs/cm	2022-03-28	0.050	0.011
UV Absorbance 254 nm	Abs/cm	2022-04-04	0.055	0.010
UV Absorbance 254 nm	Abs/cm	2022-04-11	0.057	0.009
UV Absorbance 254 nm	Abs/cm	2022-04-19	0.057	0.011
UV Absorbance 254 nm	Abs/cm	2022-04-25	0.054	0.011
UV Absorbance 254 nm	Abs/cm	2022-05-02	0.051	0.012
UV Absorbance 254 nm	Abs/cm	2022-05-09	0.053	0.010
UV Absorbance 254 nm	Abs/cm	2022-05-16	0.054	0.010
UV Absorbance 254 nm	Abs/cm	2022-05-24	0.064	0.010
UV Absorbance 254 nm	Abs/cm	2022-05-30	0.063	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-06	0.069	0.008
UV Absorbance 254 nm	Abs/cm	2022-06-13	0.073	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-20	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-27	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-07-04	0.062	0.009
UV Absorbance 254 nm	Abs/cm	2022-07-11	-	0.008
UV Absorbance 254 nm	Abs/cm	2022-07-18	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-07-25	-	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-02	0.053	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-08	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-08-15	-	0.009

Analysis - Seymour	Units	Date Sampled	Source	Treated
UV Absorbance 254 nm	Abs/cm	2022-08-22	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-08-29	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-06	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-12	0.052	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-20	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-26	-	0.010
UV Absorbance 254 nm	Abs/cm	2022-10-03	-	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-11	0.046	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-17	-	0.010
UV Absorbance 254 nm	Abs/cm	2022-10-24	-	0.010
UV Absorbance 254 nm	Abs/cm	2022-10-31	-	0.011
UV Absorbance 254 nm	Abs/cm	2022-11-07	0.072	0.012
UV Absorbance 254 nm	Abs/cm	2022-11-14	0.068	0.013
UV Absorbance 254 nm	Abs/cm	2022-11-21	-	0.010
UV Absorbance 254 nm	Abs/cm	2022-11-28	-	0.013
UV Absorbance 254 nm	Abs/cm	2022-12-05	0.062	0.013
UV Absorbance 254 nm	Abs/cm	2022-12-12	-	0.015
UV Absorbance 254 nm	Abs/cm	2022-12-19	0.056	0.011
Zinc Total	µg/L	2022-05-02	<3.0	<3.0
Zinc Total	µg/L	2022-05-04	3.0	<3.0
Zinc Total	µg/L	2022-11-07	8.2	3.1
Zinc Total	µg/L	2022-11-08	5.2	<3.0
Turbidity	NTU	2022-11-28	0.84	0.14
Turbidity	NTU	2022-11-29	0.92	0.16
Turbidity	NTU	2022-11-30	1.8	0.13
Turbidity	NTU	2022-12-01	0.95	0.16
Turbidity	NTU	2022-12-02	0.85	0.13
Turbidity	NTU	2022-12-03	1.0	0.17
Turbidity	NTU	2022-12-04	1.0	0.14
Turbidity	NTU	2022-12-05	1.0	0.81
Turbidity	NTU	2022-12-06	0.94	0.11
Turbidity	NTU	2022-12-07	1.0	1.0
Turbidity	NTU	2022-12-08	0.89	0.16
Turbidity	NTU	2022-12-09	0.93	0.16
Turbidity	NTU	2022-12-10	0.89	0.15
Turbidity	NTU	2022-12-11	0.90	0.15
Turbidity	NTU	2022-12-12	0.88	0.21
Turbidity	NTU	2022-12-13	0.89	0.16
Turbidity	NTU	2022-12-14	0.91	0.36
Turbidity	NTU	2022-12-15	0.88	0.22
Turbidity	NTU	2022-12-16	0.83	0.20
Turbidity	NTU	2022-12-17	0.85	0.14

Analysis - Seymour	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-12-18	-	0.15
Turbidity	NTU	2022-12-19	0.86	0.20
Turbidity	NTU	2022-12-20	0.75	0.15
Turbidity	NTU	2022-12-21	0.75	0.17
Turbidity	NTU	2022-12-22	0.70	0.18
Turbidity	NTU	2022-12-23	0.68	0.21
Turbidity	NTU	2022-12-24	0.73	0.24
Turbidity	NTU	2022-12-26	5.1	0.20
Turbidity	NTU	2022-12-27	3.6	0.14
Turbidity	NTU	2022-12-28	5.0	0.18
Turbidity	NTU	2022-12-29	5.0	0.15
Turbidity	NTU	2022-12-30	4.6	0.23
Turbidity	NTU	2022-12-31	4.9	0.16
UV Absorbance 254 nm	Abs/cm	2022-01-04	0.075	0.011
UV Absorbance 254 nm	Abs/cm	2022-01-10	0.069	0.010
UV Absorbance 254 nm	Abs/cm	2022-01-17	0.079	0.011
UV Absorbance 254 nm	Abs/cm	2022-01-24	0.075	0.010
UV Absorbance 254 nm	Abs/cm	2022-01-31	0.069	0.011
UV Absorbance 254 nm	Abs/cm	2022-02-07	0.068	0.011
UV Absorbance 254 nm	Abs/cm	2022-02-14	0.066	0.010
UV Absorbance 254 nm	Abs/cm	2022-02-22	0.062	0.010
UV Absorbance 254 nm	Abs/cm	2022-02-28	0.060	0.010
UV Absorbance 254 nm	Abs/cm	2022-03-07	0.065	0.010
UV Absorbance 254 nm	Abs/cm	2022-03-14	0.064	0.011
UV Absorbance 254 nm	Abs/cm	2022-03-21	0.064	0.011
UV Absorbance 254 nm	Abs/cm	2022-03-28	0.065	0.011
UV Absorbance 254 nm	Abs/cm	2022-04-04	0.065	0.011
UV Absorbance 254 nm	Abs/cm	2022-04-11	0.062	0.009
UV Absorbance 254 nm	Abs/cm	2022-04-19	0.063	0.010
UV Absorbance 254 nm	Abs/cm	2022-04-25	0.063	0.011
UV Absorbance 254 nm	Abs/cm	2022-05-02	0.060	0.011
UV Absorbance 254 nm	Abs/cm	2022-05-09	0.060	0.009
UV Absorbance 254 nm	Abs/cm	2022-05-16	0.063	0.010
UV Absorbance 254 nm	Abs/cm	2022-05-24	0.064	0.010
UV Absorbance 254 nm	Abs/cm	2022-05-30	0.068	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-06	0.070	0.008
UV Absorbance 254 nm	Abs/cm	2022-06-13	0.076	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-20	0.072	0.009
UV Absorbance 254 nm	Abs/cm	2022-06-27	0.066	0.009
UV Absorbance 254 nm	Abs/cm	2022-07-04	0.064	0.009
UV Absorbance 254 nm	Abs/cm	2022-07-11	0.062	0.008
UV Absorbance 254 nm	Abs/cm	2022-07-18	0.060	0.009

Analysis - Seymour	Units	Date Sampled	Source	Treated
UV Absorbance 254 nm	Abs/cm	2022-07-25	0.059	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-02	0.057	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-08	0.056	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-15	0.056	0.009
UV Absorbance 254 nm	Abs/cm	2022-08-22	0.054	0.008
UV Absorbance 254 nm	Abs/cm	2022-08-29	0.054	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-06	0.052	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-12	0.055	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-20	0.050	0.009
UV Absorbance 254 nm	Abs/cm	2022-09-26	0.049	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-03	0.046	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-11	0.046	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-17	0.046	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-24	0.039	0.009
UV Absorbance 254 nm	Abs/cm	2022-10-31	0.072	0.011
UV Absorbance 254 nm	Abs/cm	2022-11-07	0.068	0.012
UV Absorbance 254 nm	Abs/cm	2022-11-14	0.066	0.013
UV Absorbance 254 nm	Abs/cm	2022-11-21	0.063	0.009
UV Absorbance 254 nm	Abs/cm	2022-11-28	0.063	0.012
UV Absorbance 254 nm	Abs/cm	2022-12-05	0.066	0.013
UV Absorbance 254 nm	Abs/cm	2022-12-12	0.064	0.012
UV Absorbance 254 nm	Abs/cm	2022-12-19	0.061	0.011
Zinc Total	µg/L	2022-02-17	-	<3.0
Zinc Total	µg/L	2022-05-02	<3.0	<3.0
Zinc Total	µg/L	2022-05-04	<3.0	<3.0
Zinc Total	µg/L	2022-05-10	-	<3.0
Zinc Total	µg/L	2022-08-23	-	<3.0
Zinc Total	µg/L	2022-11-07	<3.0	<3.0
Zinc Total	µg/L	2022-11-08	<3.0	5.4
Zinc Total	µg/L	2022-11-15	-	<3.0

COQUITLAM SOURCE

This page has intentionally been left blank

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-01-04	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-01-10	1.5	18
Alkalinity as CaCO ₃	mg/L	2022-01-12	1.5	17
Alkalinity as CaCO ₃	mg/L	2022-01-14	1.3	20
Alkalinity as CaCO ₃	mg/L	2022-01-17	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-01-19	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-01-24	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-01-26	1.5	21
Alkalinity as CaCO ₃	mg/L	2022-01-28	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-01-31	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-02-02	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-02-04	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-02-07	1.7	19
Alkalinity as CaCO ₃	mg/L	2022-02-09	1.5	23
Alkalinity as CaCO ₃	mg/L	2022-02-11	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-02-14	2.0	21
Alkalinity as CaCO ₃	mg/L	2022-02-16	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-02-18	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-02-22	2.0	26
Alkalinity as CaCO ₃	mg/L	2022-02-23	1.8	24
Alkalinity as CaCO ₃	mg/L	2022-02-25	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-02-28	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-03-02	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-03-04	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-03-07	1.9	22
Alkalinity as CaCO ₃	mg/L	2022-03-09	1.6	24
Alkalinity as CaCO ₃	mg/L	2022-03-14	1.9	21
Alkalinity as CaCO ₃	mg/L	2022-03-16	1.4	22
Alkalinity as CaCO ₃	mg/L	2022-03-18	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-03-21	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-03-24	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-03-28	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-03-30	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-04-04	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-04-06	1.7	19
Alkalinity as CaCO ₃	mg/L	2022-04-08	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-04-11	1.7	23
Alkalinity as CaCO ₃	mg/L	2022-04-13	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-04-19	1.9	21
Alkalinity as CaCO ₃	mg/L	2022-04-20	1.7	19
Alkalinity as CaCO ₃	mg/L	2022-04-21	1.7	19
Alkalinity as CaCO ₃	mg/L	2022-04-25	1.7	19

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-04-27	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-04-29	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-05-02	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-05-03	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-05-04	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-05-05	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-05-06	1.8	22
Alkalinity as CaCO ₃	mg/L	2022-05-09	1.8	22
Alkalinity as CaCO ₃	mg/L	2022-05-10	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-05-11	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-05-12	1.7	22
Alkalinity as CaCO ₃	mg/L	2022-05-13	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-05-16	2.0	19
Alkalinity as CaCO ₃	mg/L	2022-05-17	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-05-18	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-05-19	1.5	22
Alkalinity as CaCO ₃	mg/L	2022-05-20	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-05-24	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-05-25	1.7	22
Alkalinity as CaCO ₃	mg/L	2022-05-26	1.7	22
Alkalinity as CaCO ₃	mg/L	2022-05-27	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-05-30	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-05-31	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-06-01	1.7	19
Alkalinity as CaCO ₃	mg/L	2022-06-02	1.8	19
Alkalinity as CaCO ₃	mg/L	2022-06-03	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-06-06	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-06-07	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-06-08	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-06-09	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-06-10	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-06-13	1.5	20
Alkalinity as CaCO ₃	mg/L	2022-06-14	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-06-15	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-06-16	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-06-17	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-06-20	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-06-21	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-06-22	1.7	22
Alkalinity as CaCO ₃	mg/L	2022-06-23	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-06-27	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-06-28	1.6	19

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-06-29	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-07-04	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-07-05	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-07-06	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-07-07	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-07-08	1.7	19
Alkalinity as CaCO ₃	mg/L	2022-07-11	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-07-12	1.7	22
Alkalinity as CaCO ₃	mg/L	2022-07-14	1.6	22
Alkalinity as CaCO ₃	mg/L	2022-07-15	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-07-18	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-07-19	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-07-20	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-07-22	1.7	22
Alkalinity as CaCO ₃	mg/L	2022-07-25	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-07-27	1.8	19
Alkalinity as CaCO ₃	mg/L	2022-07-28	1.7	22
Alkalinity as CaCO ₃	mg/L	2022-08-02	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-08-03	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-08-04	1.6	19
Alkalinity as CaCO ₃	mg/L	2022-08-05	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-08-08	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-08-10	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-08-12	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-08-15	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-08-16	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-08-17	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-08-18	1.8	22
Alkalinity as CaCO ₃	mg/L	2022-08-19	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-08-22	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-08-23	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-08-24	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-08-25	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-08-26	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-08-29	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-08-30	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-08-31	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-09-01	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-09-02	1.7	19
Alkalinity as CaCO ₃	mg/L	2022-09-06	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-09-08	1.8	19
Alkalinity as CaCO ₃	mg/L	2022-09-09	1.8	20

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-09-12	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-09-14	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-09-15	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-09-20	2.1	20
Alkalinity as CaCO ₃	mg/L	2022-09-21	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-09-22	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-09-26	2.0	20
Alkalinity as CaCO ₃	mg/L	2022-09-27	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-09-28	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-09-29	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-10-03	2.0	21
Alkalinity as CaCO ₃	mg/L	2022-10-05	2.0	21
Alkalinity as CaCO ₃	mg/L	2022-10-06	2.0	21
Alkalinity as CaCO ₃	mg/L	2022-10-07	2.0	21
Alkalinity as CaCO ₃	mg/L	2022-10-11	2.0	21
Alkalinity as CaCO ₃	mg/L	2022-10-13	2.1	21
Alkalinity as CaCO ₃	mg/L	2022-10-17	2.0	21
Alkalinity as CaCO ₃	mg/L	2022-10-19	2.0	20
Alkalinity as CaCO ₃	mg/L	2022-10-21	2.1	21
Alkalinity as CaCO ₃	mg/L	2022-10-24	2.2	20
Alkalinity as CaCO ₃	mg/L	2022-10-25	2.0	20
Alkalinity as CaCO ₃	mg/L	2022-10-26	2.2	21
Alkalinity as CaCO ₃	mg/L	2022-10-27	2.2	21
Alkalinity as CaCO ₃	mg/L	2022-10-28	2.0	21
Alkalinity as CaCO ₃	mg/L	2022-10-31	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-11-01	1.5	21
Alkalinity as CaCO ₃	mg/L	2022-11-02	1.7	9.2
Alkalinity as CaCO ₃	mg/L	2022-11-03	1.6	21
Alkalinity as CaCO ₃	mg/L	2022-11-04	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-11-07	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-11-08	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-11-09	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-11-10	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-11-14	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-11-15	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-11-16	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-11-17	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-11-18	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-11-21	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-11-23	1.6	20
Alkalinity as CaCO ₃	mg/L	2022-11-25	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-11-28	1.8	21

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Alkalinity as CaCO ₃	mg/L	2022-12-02	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-12-05	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-12-06	1.7	20
Alkalinity as CaCO ₃	mg/L	2022-12-07	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-12-08	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-12-09	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-12-12	1.9	21
Alkalinity as CaCO ₃	mg/L	2022-12-13	1.8	21
Alkalinity as CaCO ₃	mg/L	2022-12-14	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-12-15	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-12-16	1.7	21
Alkalinity as CaCO ₃	mg/L	2022-12-19	1.9	20
Alkalinity as CaCO ₃	mg/L	2022-12-21	1.8	20
Alkalinity as CaCO ₃	mg/L	2022-12-28	1.4	22
Alkalinity as CaCO ₃	mg/L	2022-12-30	1.5	20
Aluminum Dissolved	µg/L	2022-02-14	65	70
Aluminum Dissolved	µg/L	2022-04-04	64	69
Aluminum Dissolved	µg/L	2022-05-02	61	85
Aluminum Dissolved	µg/L	2022-07-04	66	70
Aluminum Dissolved	µg/L	2022-09-12	44	51
Aluminum Dissolved	µg/L	2022-11-07	53	63
Aluminum Total	µg/L	2022-02-07	88	83
Aluminum Total	µg/L	2022-02-14	81	83
Aluminum Total	µg/L	2022-04-04	88	87
Aluminum Total	µg/L	2022-05-02	89	106
Aluminum Total	µg/L	2022-05-04	87	85
Aluminum Total	µg/L	2022-07-04	81	81
Aluminum Total	µg/L	2022-09-12	59	61
Aluminum Total	µg/L	2022-11-07	81	81
Aluminum Total	µg/L	2022-11-08	78	83
Antimony Total	µg/L	2022-05-02	<0.5	<0.5
Antimony Total	µg/L	2022-05-04	<0.5	<0.5
Antimony Total	µg/L	2022-11-07	<0.5	<0.5
Antimony Total	µg/L	2022-11-08	<0.5	<0.5
Arsenic Total	µg/L	2022-05-02	<0.5	<0.5
Arsenic Total	µg/L	2022-05-04	<0.5	<0.5
Arsenic Total	µg/L	2022-11-07	<0.5	<0.5
Arsenic Total	µg/L	2022-11-08	<0.5	<0.5
Barium Total	µg/L	2022-05-02	2.1	1.7
Barium Total	µg/L	2022-05-04	2.1	2.1
Barium Total	µg/L	2022-11-07	3.9	3.6
Barium Total	µg/L	2022-11-08	2.5	2.4

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Boron Total	µg/L	2022-05-02	<10	<10
Boron Total	µg/L	2022-05-04	<10	<10
Boron Total	µg/L	2022-11-07	<10	<10
Boron Total	µg/L	2022-11-08	<10	<10
Bromate	µg/L	2022-02-15	<10.0	<10.0
Bromate	µg/L	2022-05-10	<10.0	<10.0
Bromate	µg/L	2022-08-23	<10.0	-
Bromate	µg/L	2022-08-24	-	<10.0
Bromate	µg/L	2022-11-15	<10.0	<10.0
Bromide	µg/L	2022-02-15	<10.0	<10.0
Bromide	µg/L	2022-05-10	<10.0	<10.0
Bromide	µg/L	2022-08-23	<10.0	-
Bromide	µg/L	2022-08-24	-	<10.0
Bromide	µg/L	2022-11-15	<10.0	<10.0
Bromodichloromethane	µg/L	2022-02-15	<1	<1
Bromodichloromethane	µg/L	2022-05-10	<1	<1
Bromodichloromethane	µg/L	2022-11-15	<1	<1
Bromoform	µg/L	2022-02-15	<1	<1
Bromoform	µg/L	2022-05-10	<1	<1
Bromoform	µg/L	2022-11-15	<1	<1
Cadmium Total	µg/L	2022-05-02	<0.2	<0.2
Cadmium Total	µg/L	2022-05-04	<0.2	<0.2
Cadmium Total	µg/L	2022-11-07	<0.2	<0.2
Cadmium Total	µg/L	2022-11-08	<0.2	<0.2
Calcium Total	µg/L	2022-01-04	761	729
Calcium Total	µg/L	2022-02-07	807	836
Calcium Total	µg/L	2022-02-14	814	800
Calcium Total	µg/L	2022-03-07	806	809
Calcium Total	µg/L	2022-04-04	815	810
Calcium Total	µg/L	2022-05-02	789	706
Calcium Total	µg/L	2022-05-04	807	812
Calcium Total	µg/L	2022-06-06	812	907
Calcium Total	µg/L	2022-07-04	772	2,300
Calcium Total	µg/L	2022-08-08	736	750
Calcium Total	µg/L	2022-09-12	757	772
Calcium Total	µg/L	2022-11-07	895	846
Calcium Total	µg/L	2022-11-08	863	823
Calcium Total	µg/L	2022-12-05	862	849
Carbon Organic - Dissolved	mg/L	2022-01-04	1.7	1.5
Carbon Organic - Dissolved	mg/L	2022-01-10	1.7	-
Carbon Organic - Dissolved	mg/L	2022-01-17	1.6	1.5
Carbon Organic - Dissolved	mg/L	2022-01-24	1.6	-

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Carbon Organic - Dissolved	mg/L	2022-01-31	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-02-07	1.6	1.6
Carbon Organic - Dissolved	mg/L	2022-02-14	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-02-22	1.6	1.6
Carbon Organic - Dissolved	mg/L	2022-02-28	1.7	1.6
Carbon Organic - Dissolved	mg/L	2022-03-07	1.5	1.5
Carbon Organic - Dissolved	mg/L	2022-03-14	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-03-21	1.7	-
Carbon Organic - Dissolved	mg/L	2022-03-28	1.6	-
Carbon Organic - Dissolved	mg/L	2022-04-04	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-04-11	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-04-19	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-04-25	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-04-27	1.7	-
Carbon Organic - Dissolved	mg/L	2022-05-02	1.5	1.5
Carbon Organic - Dissolved	mg/L	2022-05-09	1.6	1.4
Carbon Organic - Dissolved	mg/L	2022-05-16	1.6	1.5
Carbon Organic - Dissolved	mg/L	2022-05-18	1.7	-
Carbon Organic - Dissolved	mg/L	2022-05-24	1.6	1.6
Carbon Organic - Dissolved	mg/L	2022-05-30	1.6	1.5
Carbon Organic - Dissolved	mg/L	2022-06-06	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-06-13	1.5	1.5
Carbon Organic - Dissolved	mg/L	2022-06-20	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-06-22	1.7	-
Carbon Organic - Dissolved	mg/L	2022-06-27	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-07-04	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-07-11	1.5	-
Carbon Organic - Dissolved	mg/L	2022-07-18	1.5	1.4
Carbon Organic - Dissolved	mg/L	2022-07-20	1.6	-
Carbon Organic - Dissolved	mg/L	2022-07-25	1.4	1.4
Carbon Organic - Dissolved	mg/L	2022-08-02	1.3	1.3
Carbon Organic - Dissolved	mg/L	2022-08-08	1.4	1.3
Carbon Organic - Dissolved	mg/L	2022-08-15	1.3	1.3
Carbon Organic - Dissolved	mg/L	2022-08-22	1.2	1.3
Carbon Organic - Dissolved	mg/L	2022-08-24	1.4	-
Carbon Organic - Dissolved	mg/L	2022-08-29	1.2	1.3
Carbon Organic - Dissolved	mg/L	2022-09-06	1.3	1.2
Carbon Organic - Dissolved	mg/L	2022-09-12	1.2	1.3
Carbon Organic - Dissolved	mg/L	2022-09-20	1.2	1.2
Carbon Organic - Dissolved	mg/L	2022-09-21	1.3	-
Carbon Organic - Dissolved	mg/L	2022-09-26	1.2	1.3
Carbon Organic - Dissolved	mg/L	2022-10-03	1.1	1.1

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Carbon Organic - Dissolved	mg/L	2022-10-11	1.1	1.2
Carbon Organic - Dissolved	mg/L	2022-10-17	1.1	1.2
Carbon Organic - Dissolved	mg/L	2022-10-19	1.1	-
Carbon Organic - Dissolved	mg/L	2022-10-24	1.4	1.3
Carbon Organic - Dissolved	mg/L	2022-10-31	2.0	2.0
Carbon Organic - Dissolved	mg/L	2022-11-07	1.5	1.5
Carbon Organic - Dissolved	mg/L	2022-11-14	1.4	1.4
Carbon Organic - Dissolved	mg/L	2022-11-21	1.3	1.3
Carbon Organic - Dissolved	mg/L	2022-11-23	1.7	-
Carbon Organic - Dissolved	mg/L	2022-11-28	1.9	1.8
Carbon Organic - Dissolved	mg/L	2022-12-05	1.4	1.3
Carbon Organic - Dissolved	mg/L	2022-12-12	1.4	1.4
Carbon Organic - Dissolved	mg/L	2022-12-19	1.3	1.4
Carbon Organic - Total	mg/L	2022-01-04	1.7	1.6
Carbon Organic - Total	mg/L	2022-01-10	1.86	-
Carbon Organic - Total	mg/L	2022-01-12	2.03	-
Carbon Organic - Total	mg/L	2022-01-14	1.99	-
Carbon Organic - Total	mg/L	2022-01-17	1.6	1.5
Carbon Organic - Total	mg/L	2022-01-19	1.79	-
Carbon Organic - Total	mg/L	2022-01-24	1.64	-
Carbon Organic - Total	mg/L	2022-01-26	1.66	-
Carbon Organic - Total	mg/L	2022-01-28	1.70	-
Carbon Organic - Total	mg/L	2022-01-31	1.89	1.4
Carbon Organic - Total	mg/L	2022-02-02	1.75	-
Carbon Organic - Total	mg/L	2022-02-04	1.68	-
Carbon Organic - Total	mg/L	2022-02-07	1.76	1.6
Carbon Organic - Total	mg/L	2022-02-09	1.87	-
Carbon Organic - Total	mg/L	2022-02-11	1.72	-
Carbon Organic - Total	mg/L	2022-02-14	1.5	1.5
Carbon Organic - Total	mg/L	2022-02-16	1.70	-
Carbon Organic - Total	mg/L	2022-02-18	1.72	-
Carbon Organic - Total	mg/L	2022-02-22	1.6	1.6
Carbon Organic - Total	mg/L	2022-02-23	1.56	-
Carbon Organic - Total	mg/L	2022-02-25	1.57	-
Carbon Organic - Total	mg/L	2022-02-28	1.7	1.5
Carbon Organic - Total	mg/L	2022-03-02	1.86	-
Carbon Organic - Total	mg/L	2022-03-04	1.76	-
Carbon Organic - Total	mg/L	2022-03-07	1.69	1.5
Carbon Organic - Total	mg/L	2022-03-09	1.65	-
Carbon Organic - Total	mg/L	2022-03-14	1.58	1.4
Carbon Organic - Total	mg/L	2022-03-16	1.97	-
Carbon Organic - Total	mg/L	2022-03-18	1.82	-

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Carbon Organic - Total	mg/L	2022-03-21	1.7	-
Carbon Organic - Total	mg/L	2022-03-24	1.74	-
Carbon Organic - Total	mg/L	2022-03-28	1.5	-
Carbon Organic - Total	mg/L	2022-03-30	1.60	-
Carbon Organic - Total	mg/L	2022-04-04	1.66	1.4
Carbon Organic - Total	mg/L	2022-04-06	1.76	-
Carbon Organic - Total	mg/L	2022-04-08	1.69	-
Carbon Organic - Total	mg/L	2022-04-11	1.67	1.4
Carbon Organic - Total	mg/L	2022-04-13	1.66	-
Carbon Organic - Total	mg/L	2022-04-19	1.5	1.4
Carbon Organic - Total	mg/L	2022-04-20	1.60	-
Carbon Organic - Total	mg/L	2022-04-21	1.64	-
Carbon Organic - Total	mg/L	2022-04-25	1.63	1.5
Carbon Organic - Total	mg/L	2022-04-27	1.63	-
Carbon Organic - Total	mg/L	2022-04-29	1.64	-
Carbon Organic - Total	mg/L	2022-05-02	1.70	1.6
Carbon Organic - Total	mg/L	2022-05-04	1.68	-
Carbon Organic - Total	mg/L	2022-05-06	1.57	-
Carbon Organic - Total	mg/L	2022-05-09	1.6	1.4
Carbon Organic - Total	mg/L	2022-05-11	1.62	-
Carbon Organic - Total	mg/L	2022-05-13	1.61	-
Carbon Organic - Total	mg/L	2022-05-16	1.66	1.5
Carbon Organic - Total	mg/L	2022-05-18	1.74	-
Carbon Organic - Total	mg/L	2022-05-20	1.69	-
Carbon Organic - Total	mg/L	2022-05-24	1.6	1.6
Carbon Organic - Total	mg/L	2022-05-25	1.67	-
Carbon Organic - Total	mg/L	2022-05-27	1.67	-
Carbon Organic - Total	mg/L	2022-05-30	1.5	1.5
Carbon Organic - Total	mg/L	2022-06-01	1.69	-
Carbon Organic - Total	mg/L	2022-06-03	1.58	-
Carbon Organic - Total	mg/L	2022-06-06	1.5	1.4
Carbon Organic - Total	mg/L	2022-06-08	1.75	-
Carbon Organic - Total	mg/L	2022-06-10	1.74	-
Carbon Organic - Total	mg/L	2022-06-13	1.6	1.5
Carbon Organic - Total	mg/L	2022-06-15	1.60	-
Carbon Organic - Total	mg/L	2022-06-17	1.51	-
Carbon Organic - Total	mg/L	2022-06-20	1.6	1.5
Carbon Organic - Total	mg/L	2022-06-22	1.61	-
Carbon Organic - Total	mg/L	2022-06-23	1.64	-
Carbon Organic - Total	mg/L	2022-06-27	1.5	1.4
Carbon Organic - Total	mg/L	2022-06-29	1.65	-
Carbon Organic - Total	mg/L	2022-07-04	1.68	1.4

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Carbon Organic - Total	mg/L	2022-07-06	1.59	-
Carbon Organic - Total	mg/L	2022-07-08	1.63	-
Carbon Organic - Total	mg/L	2022-07-11	1.61	-
Carbon Organic - Total	mg/L	2022-07-13	1.59	-
Carbon Organic - Total	mg/L	2022-07-14	1.57	-
Carbon Organic - Total	mg/L	2022-07-18	1.5	1.4
Carbon Organic - Total	mg/L	2022-07-20	1.53	-
Carbon Organic - Total	mg/L	2022-07-22	1.59	-
Carbon Organic - Total	mg/L	2022-07-25	1.4	1.3
Carbon Organic - Total	mg/L	2022-07-27	1.58	-
Carbon Organic - Total	mg/L	2022-07-28	1.53	-
Carbon Organic - Total	mg/L	2022-08-02	1.4	1.3
Carbon Organic - Total	mg/L	2022-08-03	1.49	-
Carbon Organic - Total	mg/L	2022-08-05	1.54	-
Carbon Organic - Total	mg/L	2022-08-08	1.47	1.4
Carbon Organic - Total	mg/L	2022-08-10	1.58	-
Carbon Organic - Total	mg/L	2022-08-12	1.51	-
Carbon Organic - Total	mg/L	2022-08-15	1.49	1.3
Carbon Organic - Total	mg/L	2022-08-17	1.51	-
Carbon Organic - Total	mg/L	2022-08-19	1.50	-
Carbon Organic - Total	mg/L	2022-08-22	1.3	1.2
Carbon Organic - Total	mg/L	2022-08-24	1.48	-
Carbon Organic - Total	mg/L	2022-08-26	1.46	-
Carbon Organic - Total	mg/L	2022-08-29	1.47	1.3
Carbon Organic - Total	mg/L	2022-08-31	1.40	-
Carbon Organic - Total	mg/L	2022-09-02	1.44	-
Carbon Organic - Total	mg/L	2022-09-06	1.50	1.2
Carbon Organic - Total	mg/L	2022-09-08	1.49	-
Carbon Organic - Total	mg/L	2022-09-09	1.45	-
Carbon Organic - Total	mg/L	2022-09-12	1.38	1.2
Carbon Organic - Total	mg/L	2022-09-14	1.46	-
Carbon Organic - Total	mg/L	2022-09-15	1.46	-
Carbon Organic - Total	mg/L	2022-09-20	1.2	1.2
Carbon Organic - Total	mg/L	2022-09-21	1.30	-
Carbon Organic - Total	mg/L	2022-09-22	1.37	-
Carbon Organic - Total	mg/L	2022-09-26	1.2	1.3
Carbon Organic - Total	mg/L	2022-09-27	1.28	-
Carbon Organic - Total	mg/L	2022-09-28	1.39	-
Carbon Organic - Total	mg/L	2022-10-03	1.20	1.2
Carbon Organic - Total	mg/L	2022-10-05	1.32	-
Carbon Organic - Total	mg/L	2022-10-07	1.29	-
Carbon Organic - Total	mg/L	2022-10-11	1.23	1.2

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Carbon Organic - Total	mg/L	2022-10-13	1.34	-
Carbon Organic - Total	mg/L	2022-10-17	1.1	1.4
Carbon Organic - Total	mg/L	2022-10-19	1.30	-
Carbon Organic - Total	mg/L	2022-10-21	1.30	-
Carbon Organic - Total	mg/L	2022-10-24	1.26	1.4
Carbon Organic - Total	mg/L	2022-10-26	1.41	-
Carbon Organic - Total	mg/L	2022-10-28	1.62	-
Carbon Organic - Total	mg/L	2022-10-31	2.14	2.1
Carbon Organic - Total	mg/L	2022-11-02	1.84	-
Carbon Organic - Total	mg/L	2022-11-04	1.72	-
Carbon Organic - Total	mg/L	2022-11-07	1.5	1.5
Carbon Organic - Total	mg/L	2022-11-09	1.63	-
Carbon Organic - Total	mg/L	2022-11-14	1.4	1.4
Carbon Organic - Total	mg/L	2022-11-16	1.50	-
Carbon Organic - Total	mg/L	2022-11-18	1.54	-
Carbon Organic - Total	mg/L	2022-11-21	1.51	1.3
Carbon Organic - Total	mg/L	2022-11-23	1.66	-
Carbon Organic - Total	mg/L	2022-11-25	1.52	-
Carbon Organic - Total	mg/L	2022-11-28	1.8	1.8
Carbon Organic - Total	mg/L	2022-12-02	1.44	-
Carbon Organic - Total	mg/L	2022-12-05	1.50	1.4
Carbon Organic - Total	mg/L	2022-12-07	1.48	-
Carbon Organic - Total	mg/L	2022-12-09	1.50	-
Carbon Organic - Total	mg/L	2022-12-12	1.4	1.4
Carbon Organic - Total	mg/L	2022-12-14	1.44	-
Carbon Organic - Total	mg/L	2022-12-16	1.49	-
Carbon Organic - Total	mg/L	2022-12-19	1.4	1.3
Carbon Organic - Total	mg/L	2022-12-21	1.42	-
Carbon Organic - Total	mg/L	2022-12-28	2.01	-
Carbon Organic - Total	mg/L	2022-12-30	1.65	-
Chlorate	µg/L	2022-02-15	<10.0	38.4
Chlorate	µg/L	2022-05-10	<10.0	85.4
Chlorate	µg/L	2022-08-23	<10.0	-
Chlorate	µg/L	2022-08-24	-	51.4
Chlorate	µg/L	2022-11-15	<10.0	31.5
Chloride	mg/L	2022-01-04	<0.5	1.9
Chloride	mg/L	2022-02-07	<0.5	2.1
Chloride	mg/L	2022-02-15	<0.5	1.9
Chloride	mg/L	2022-03-07	<0.5	2.0
Chloride	mg/L	2022-04-04	<0.5	2.1
Chloride	mg/L	2022-05-02	<0.5	1.9
Chloride	mg/L	2022-05-10	<0.5	2.3

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chloride	mg/L	2022-06-06	<0.5	2.2
Chloride	mg/L	2022-07-04	<0.5	2.0
Chloride	mg/L	2022-08-08	<0.5	2.2
Chloride	mg/L	2022-08-23	<0.5	-
Chloride	mg/L	2022-08-24	-	2.0
Chloride	mg/L	2022-09-12	<0.5	2.0
Chloride	mg/L	2022-11-07	0.5	2.2
Chloride	mg/L	2022-11-15	<0.5	2.2
Chloride	mg/L	2022-12-05	<0.5	2.1
Chlorine Free	mg/L	2022-01-01	-	1.33
Chlorine Free	mg/L	2022-01-02	-	1.2
Chlorine Free	mg/L	2022-01-03	-	1.12
Chlorine Free	mg/L	2022-01-04	-	1.24
Chlorine Free	mg/L	2022-01-05	-	1.37
Chlorine Free	mg/L	2022-01-06	-	1.54
Chlorine Free	mg/L	2022-01-07	-	1.36
Chlorine Free	mg/L	2022-01-08	-	1.69
Chlorine Free	mg/L	2022-01-09	-	1.62
Chlorine Free	mg/L	2022-01-10	-	1.6
Chlorine Free	mg/L	2022-01-11	-	1.41
Chlorine Free	mg/L	2022-01-12	-	1.6
Chlorine Free	mg/L	2022-01-13	-	1.52
Chlorine Free	mg/L	2022-01-14	-	1.55
Chlorine Free	mg/L	2022-01-15	-	1.69
Chlorine Free	mg/L	2022-01-16	-	1.74
Chlorine Free	mg/L	2022-01-17	-	1.6
Chlorine Free	mg/L	2022-01-18	-	1.68
Chlorine Free	mg/L	2022-01-19	-	1.4
Chlorine Free	mg/L	2022-01-20	-	1.38
Chlorine Free	mg/L	2022-01-21	-	1.71
Chlorine Free	mg/L	2022-01-22	-	1.73
Chlorine Free	mg/L	2022-01-23	-	1.62
Chlorine Free	mg/L	2022-01-24	-	1.6
Chlorine Free	mg/L	2022-01-25	-	1.23
Chlorine Free	mg/L	2022-01-26	-	1.21
Chlorine Free	mg/L	2022-01-27	-	1.44
Chlorine Free	mg/L	2022-01-28	-	1.3
Chlorine Free	mg/L	2022-01-29	-	1.77
Chlorine Free	mg/L	2022-01-30	-	1.45
Chlorine Free	mg/L	2022-01-31	-	1.4
Chlorine Free	mg/L	2022-02-01	-	1.34
Chlorine Free	mg/L	2022-02-02	-	1.65

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-02-03	-	1.31
Chlorine Free	mg/L	2022-02-04	-	1.2
Chlorine Free	mg/L	2022-02-05	-	1.29
Chlorine Free	mg/L	2022-02-06	-	1.25
Chlorine Free	mg/L	2022-02-07	-	1.27
Chlorine Free	mg/L	2022-02-08	-	1.13
Chlorine Free	mg/L	2022-02-09	-	1.2
Chlorine Free	mg/L	2022-02-10	-	1.35
Chlorine Free	mg/L	2022-02-11	-	1.42
Chlorine Free	mg/L	2022-02-12	-	1.54
Chlorine Free	mg/L	2022-02-13	-	1.36
Chlorine Free	mg/L	2022-02-14	-	1.2
Chlorine Free	mg/L	2022-02-15	-	1.14
Chlorine Free	mg/L	2022-02-16	-	1.4
Chlorine Free	mg/L	2022-02-17	-	1.2
Chlorine Free	mg/L	2022-02-18	-	1.32
Chlorine Free	mg/L	2022-02-19	-	1.28
Chlorine Free	mg/L	2022-02-20	-	1.27
Chlorine Free	mg/L	2022-02-21	-	1.2
Chlorine Free	mg/L	2022-02-22	-	1.24
Chlorine Free	mg/L	2022-02-23	-	1.4
Chlorine Free	mg/L	2022-02-24	-	1.24
Chlorine Free	mg/L	2022-02-25	-	1.37
Chlorine Free	mg/L	2022-02-26	-	1.22
Chlorine Free	mg/L	2022-02-27	-	1.22
Chlorine Free	mg/L	2022-02-28	-	1.3
Chlorine Free	mg/L	2022-03-01	-	1.49
Chlorine Free	mg/L	2022-03-02	-	1.4
Chlorine Free	mg/L	2022-03-03	-	1.52
Chlorine Free	mg/L	2022-03-04	-	1.35
Chlorine Free	mg/L	2022-03-05	-	1.27
Chlorine Free	mg/L	2022-03-06	-	1.24
Chlorine Free	mg/L	2022-03-07	-	1.2
Chlorine Free	mg/L	2022-03-08	-	1.28
Chlorine Free	mg/L	2022-03-09	-	1.2
Chlorine Free	mg/L	2022-03-10	-	1.34
Chlorine Free	mg/L	2022-03-11	-	1.23
Chlorine Free	mg/L	2022-03-12	-	1.11
Chlorine Free	mg/L	2022-03-13	-	1.28
Chlorine Free	mg/L	2022-03-14	-	1.3
Chlorine Free	mg/L	2022-03-15	-	1.37
Chlorine Free	mg/L	2022-03-16	-	1.6

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-03-17	-	1.41
Chlorine Free	mg/L	2022-03-18	-	1.6
Chlorine Free	mg/L	2022-03-19	-	1.61
Chlorine Free	mg/L	2022-03-20	-	1.44
Chlorine Free	mg/L	2022-03-21	-	1.42
Chlorine Free	mg/L	2022-03-22	-	1.26
Chlorine Free	mg/L	2022-03-23	-	1.31
Chlorine Free	mg/L	2022-03-24	-	1.54
Chlorine Free	mg/L	2022-03-25	-	1.28
Chlorine Free	mg/L	2022-03-26	-	1.28
Chlorine Free	mg/L	2022-03-27	-	1.33
Chlorine Free	mg/L	2022-03-28	-	1.4
Chlorine Free	mg/L	2022-03-29	-	1.35
Chlorine Free	mg/L	2022-03-30	-	1.3
Chlorine Free	mg/L	2022-03-31	-	1.29
Chlorine Free	mg/L	2022-04-01	-	1.31
Chlorine Free	mg/L	2022-04-02	-	1.61
Chlorine Free	mg/L	2022-04-03	-	1.41
Chlorine Free	mg/L	2022-04-04	-	1.3
Chlorine Free	mg/L	2022-04-05	-	1.29
Chlorine Free	mg/L	2022-04-06	-	1.3
Chlorine Free	mg/L	2022-04-07	-	1.39
Chlorine Free	mg/L	2022-04-08	-	1.34
Chlorine Free	mg/L	2022-04-09	-	1.34
Chlorine Free	mg/L	2022-04-10	-	1.46
Chlorine Free	mg/L	2022-04-11	-	1.28
Chlorine Free	mg/L	2022-04-12	-	1.52
Chlorine Free	mg/L	2022-04-13	-	1.4
Chlorine Free	mg/L	2022-04-14	-	1.26
Chlorine Free	mg/L	2022-04-15	-	1.29
Chlorine Free	mg/L	2022-04-16	-	1.11
Chlorine Free	mg/L	2022-04-17	-	1.15
Chlorine Free	mg/L	2022-04-18	-	1.64
Chlorine Free	mg/L	2022-04-19	-	1.41
Chlorine Free	mg/L	2022-04-20	-	1.1
Chlorine Free	mg/L	2022-04-21	-	1.3
Chlorine Free	mg/L	2022-04-22	-	1.30
Chlorine Free	mg/L	2022-04-23	-	1.52
Chlorine Free	mg/L	2022-04-24	-	1.14
Chlorine Free	mg/L	2022-04-25	-	1.32
Chlorine Free	mg/L	2022-04-26	-	1.34
Chlorine Free	mg/L	2022-04-27	-	1.3

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-04-28	-	1.16
Chlorine Free	mg/L	2022-04-29	-	1.1
Chlorine Free	mg/L	2022-04-30	-	1.34
Chlorine Free	mg/L	2022-05-01	-	1.30
Chlorine Free	mg/L	2022-05-02	-	1.2
Chlorine Free	mg/L	2022-05-03	-	1.4
Chlorine Free	mg/L	2022-05-04	-	1.5
Chlorine Free	mg/L	2022-05-05	-	1.2
Chlorine Free	mg/L	2022-05-06	-	1.2
Chlorine Free	mg/L	2022-05-07	-	1.18
Chlorine Free	mg/L	2022-05-08	-	1.19
Chlorine Free	mg/L	2022-05-09	-	1.32
Chlorine Free	mg/L	2022-05-10	-	1.49
Chlorine Free	mg/L	2022-05-11	-	1.3
Chlorine Free	mg/L	2022-05-12	-	1.2
Chlorine Free	mg/L	2022-05-13	-	1.20
Chlorine Free	mg/L	2022-05-14	-	1.36
Chlorine Free	mg/L	2022-05-15	-	1.21
Chlorine Free	mg/L	2022-05-16	-	1.2
Chlorine Free	mg/L	2022-05-17	-	1.09
Chlorine Free	mg/L	2022-05-18	-	1.2
Chlorine Free	mg/L	2022-05-19	-	1.4
Chlorine Free	mg/L	2022-05-20	-	1.3
Chlorine Free	mg/L	2022-05-21	-	1.18
Chlorine Free	mg/L	2022-05-22	-	1.36
Chlorine Free	mg/L	2022-05-23	-	1.33
Chlorine Free	mg/L	2022-05-24	-	1.3
Chlorine Free	mg/L	2022-05-25	-	1.2
Chlorine Free	mg/L	2022-05-26	-	1.4
Chlorine Free	mg/L	2022-05-27	-	1.2
Chlorine Free	mg/L	2022-05-28	-	1.52
Chlorine Free	mg/L	2022-05-29	-	1.12
Chlorine Free	mg/L	2022-05-30	-	1.3
Chlorine Free	mg/L	2022-05-31	-	1.3
Chlorine Free	mg/L	2022-06-01	-	1.4
Chlorine Free	mg/L	2022-06-02	-	1.32
Chlorine Free	mg/L	2022-06-03	-	1.2
Chlorine Free	mg/L	2022-06-04	-	1.03
Chlorine Free	mg/L	2022-06-05	-	1.01
Chlorine Free	mg/L	2022-06-06	-	1.3
Chlorine Free	mg/L	2022-06-07	-	1.39
Chlorine Free	mg/L	2022-06-08	-	1.2

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-06-09	-	1.34
Chlorine Free	mg/L	2022-06-10	-	1.22
Chlorine Free	mg/L	2022-06-11	-	0.97
Chlorine Free	mg/L	2022-06-12	-	1.39
Chlorine Free	mg/L	2022-06-13	-	1.29
Chlorine Free	mg/L	2022-06-14	-	1.2
Chlorine Free	mg/L	2022-06-15	-	1.16
Chlorine Free	mg/L	2022-06-16	-	1.33
Chlorine Free	mg/L	2022-06-17	-	1.3
Chlorine Free	mg/L	2022-06-18	-	1.25
Chlorine Free	mg/L	2022-06-19	-	1.70
Chlorine Free	mg/L	2022-06-20	-	1.3
Chlorine Free	mg/L	2022-06-21	-	1.30
Chlorine Free	mg/L	2022-06-22	-	1.3
Chlorine Free	mg/L	2022-06-23	-	1.3
Chlorine Free	mg/L	2022-06-24	-	1.4
Chlorine Free	mg/L	2022-06-25	-	1.25
Chlorine Free	mg/L	2022-06-26	-	1.29
Chlorine Free	mg/L	2022-06-27	-	1.3
Chlorine Free	mg/L	2022-06-28	-	1.30
Chlorine Free	mg/L	2022-06-29	-	1.3
Chlorine Free	mg/L	2022-06-30	-	1.29
Chlorine Free	mg/L	2022-07-01	-	1.25
Chlorine Free	mg/L	2022-07-02	-	1.32
Chlorine Free	mg/L	2022-07-03	-	1.38
Chlorine Free	mg/L	2022-07-04	-	1.3
Chlorine Free	mg/L	2022-07-05	-	1.3
Chlorine Free	mg/L	2022-07-06	-	1.3
Chlorine Free	mg/L	2022-07-07	-	1.2
Chlorine Free	mg/L	2022-07-08	-	1.3
Chlorine Free	mg/L	2022-07-09	-	1.48
Chlorine Free	mg/L	2022-07-10	-	1.18
Chlorine Free	mg/L	2022-07-11	-	1.2
Chlorine Free	mg/L	2022-07-12	-	1.3
Chlorine Free	mg/L	2022-07-13	-	1.44
Chlorine Free	mg/L	2022-07-14	-	1.3
Chlorine Free	mg/L	2022-07-15	-	1.31
Chlorine Free	mg/L	2022-07-16	-	1.38
Chlorine Free	mg/L	2022-07-17	-	1.28
Chlorine Free	mg/L	2022-07-18	-	1.2
Chlorine Free	mg/L	2022-07-19	-	1.18
Chlorine Free	mg/L	2022-07-20	-	1.3

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-07-21	-	1.30
Chlorine Free	mg/L	2022-07-22	-	1.28
Chlorine Free	mg/L	2022-07-23	-	1.21
Chlorine Free	mg/L	2022-07-24	-	1.24
Chlorine Free	mg/L	2022-07-25	-	1.4
Chlorine Free	mg/L	2022-07-26	-	1.33
Chlorine Free	mg/L	2022-07-27	-	1.4
Chlorine Free	mg/L	2022-07-28	-	1.2
Chlorine Free	mg/L	2022-07-29	-	1.37
Chlorine Free	mg/L	2022-07-30	-	1.32
Chlorine Free	mg/L	2022-07-31	-	1.34
Chlorine Free	mg/L	2022-08-01	-	1.28
Chlorine Free	mg/L	2022-08-02	-	1.32
Chlorine Free	mg/L	2022-08-03	-	1.3
Chlorine Free	mg/L	2022-08-04	-	1.38
Chlorine Free	mg/L	2022-08-05	-	1.2
Chlorine Free	mg/L	2022-08-06	-	1.36
Chlorine Free	mg/L	2022-08-07	-	1.40
Chlorine Free	mg/L	2022-08-08	-	1.2
Chlorine Free	mg/L	2022-08-09	-	1.23
Chlorine Free	mg/L	2022-08-10	-	1.2
Chlorine Free	mg/L	2022-08-11	-	1.31
Chlorine Free	mg/L	2022-08-12	-	1.3
Chlorine Free	mg/L	2022-08-13	-	1.28
Chlorine Free	mg/L	2022-08-14	-	1.26
Chlorine Free	mg/L	2022-08-15	-	1.3
Chlorine Free	mg/L	2022-08-16	-	1.3
Chlorine Free	mg/L	2022-08-17	-	1.49
Chlorine Free	mg/L	2022-08-18	-	1.2
Chlorine Free	mg/L	2022-08-19	-	1.38
Chlorine Free	mg/L	2022-08-20	-	1.17
Chlorine Free	mg/L	2022-08-21	-	1.41
Chlorine Free	mg/L	2022-08-22	-	1.29
Chlorine Free	mg/L	2022-08-23	-	1.2
Chlorine Free	mg/L	2022-08-24	-	1.21
Chlorine Free	mg/L	2022-08-25	-	1.3
Chlorine Free	mg/L	2022-08-26	-	1.30
Chlorine Free	mg/L	2022-08-27	-	1.37
Chlorine Free	mg/L	2022-08-28	-	1.23
Chlorine Free	mg/L	2022-08-29	-	1.3
Chlorine Free	mg/L	2022-08-30	-	1.4
Chlorine Free	mg/L	2022-08-31	-	1.3

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-09-01	-	1.3
Chlorine Free	mg/L	2022-09-02	-	1.3
Chlorine Free	mg/L	2022-09-03	-	1.31
Chlorine Free	mg/L	2022-09-04	-	1.30
Chlorine Free	mg/L	2022-09-05	-	1.25
Chlorine Free	mg/L	2022-09-06	-	1.4
Chlorine Free	mg/L	2022-09-07	-	1.34
Chlorine Free	mg/L	2022-09-08	-	1.20
Chlorine Free	mg/L	2022-09-09	-	1.3
Chlorine Free	mg/L	2022-09-10	-	1.43
Chlorine Free	mg/L	2022-09-11	-	1.26
Chlorine Free	mg/L	2022-09-12	-	1.2
Chlorine Free	mg/L	2022-09-13	-	1.25
Chlorine Free	mg/L	2022-09-14	-	1.29
Chlorine Free	mg/L	2022-09-15	-	1.37
Chlorine Free	mg/L	2022-09-16	-	1.28
Chlorine Free	mg/L	2022-09-17	-	1.45
Chlorine Free	mg/L	2022-09-18	-	1.35
Chlorine Free	mg/L	2022-09-19	-	1.29
Chlorine Free	mg/L	2022-09-20	-	1.55
Chlorine Free	mg/L	2022-09-21	-	1.36
Chlorine Free	mg/L	2022-09-22	-	1.4
Chlorine Free	mg/L	2022-09-23	-	1.3
Chlorine Free	mg/L	2022-09-24	-	1.35
Chlorine Free	mg/L	2022-09-25	-	1.36
Chlorine Free	mg/L	2022-09-26	-	1.3
Chlorine Free	mg/L	2022-09-27	-	1.4
Chlorine Free	mg/L	2022-09-28	-	1.2
Chlorine Free	mg/L	2022-09-29	-	1.3
Chlorine Free	mg/L	2022-09-30	-	1.31
Chlorine Free	mg/L	2022-10-01	-	1.46
Chlorine Free	mg/L	2022-10-02	-	1.23
Chlorine Free	mg/L	2022-10-03	-	1.30
Chlorine Free	mg/L	2022-10-04	-	1.30
Chlorine Free	mg/L	2022-10-05	-	1.2
Chlorine Free	mg/L	2022-10-06	-	1.3
Chlorine Free	mg/L	2022-10-07	-	1.3
Chlorine Free	mg/L	2022-10-08	-	1.33
Chlorine Free	mg/L	2022-10-09	-	1.38
Chlorine Free	mg/L	2022-10-10	-	1.32
Chlorine Free	mg/L	2022-10-11	-	1.2
Chlorine Free	mg/L	2022-10-12	-	1.33

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-10-13	-	1.3
Chlorine Free	mg/L	2022-10-14	-	1.38
Chlorine Free	mg/L	2022-10-15	-	1.25
Chlorine Free	mg/L	2022-10-16	-	1.33
Chlorine Free	mg/L	2022-10-17	-	1.3
Chlorine Free	mg/L	2022-10-18	-	1.25
Chlorine Free	mg/L	2022-10-19	-	1.29
Chlorine Free	mg/L	2022-10-20	-	1.27
Chlorine Free	mg/L	2022-10-21	-	1.47
Chlorine Free	mg/L	2022-10-22	-	1.26
Chlorine Free	mg/L	2022-10-23	-	1.46
Chlorine Free	mg/L	2022-10-24	-	1.2
Chlorine Free	mg/L	2022-10-25	-	1.2
Chlorine Free	mg/L	2022-10-26	-	1.3
Chlorine Free	mg/L	2022-10-27	-	1.41
Chlorine Free	mg/L	2022-10-28	-	1.30
Chlorine Free	mg/L	2022-10-29	-	1.54
Chlorine Free	mg/L	2022-10-30	-	1.97
Chlorine Free	mg/L	2022-10-31	-	1.6
Chlorine Free	mg/L	2022-11-01	-	1.48
Chlorine Free	mg/L	2022-11-02	-	1.5
Chlorine Free	mg/L	2022-11-03	-	1.2
Chlorine Free	mg/L	2022-11-04	-	1.3
Chlorine Free	mg/L	2022-11-05	-	1.49
Chlorine Free	mg/L	2022-11-06	-	1.44
Chlorine Free	mg/L	2022-11-07	-	1.4
Chlorine Free	mg/L	2022-11-08	-	1.4
Chlorine Free	mg/L	2022-11-09	-	1.09
Chlorine Free	mg/L	2022-11-10	-	1.3
Chlorine Free	mg/L	2022-11-11	-	1.22
Chlorine Free	mg/L	2022-11-12	-	1.36
Chlorine Free	mg/L	2022-11-13	-	1.47
Chlorine Free	mg/L	2022-11-14	-	1.31
Chlorine Free	mg/L	2022-11-15	-	1.3
Chlorine Free	mg/L	2022-11-16	-	1.15
Chlorine Free	mg/L	2022-11-17	-	1.4
Chlorine Free	mg/L	2022-11-18	-	1.2
Chlorine Free	mg/L	2022-11-19	-	1.46
Chlorine Free	mg/L	2022-11-20	-	1.64
Chlorine Free	mg/L	2022-11-21	-	1.3
Chlorine Free	mg/L	2022-11-22	-	1.45
Chlorine Free	mg/L	2022-11-23	-	1.4

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Free	mg/L	2022-11-24	-	1.35
Chlorine Free	mg/L	2022-11-25	-	1.3
Chlorine Free	mg/L	2022-11-26	-	1.14
Chlorine Free	mg/L	2022-11-27	-	1.20
Chlorine Free	mg/L	2022-11-28	-	1.2
Chlorine Free	mg/L	2022-11-29	-	1.37
Chlorine Free	mg/L	2022-11-30	-	1.42
Chlorine Free	mg/L	2022-12-01	-	1.45
Chlorine Free	mg/L	2022-12-02	-	1.44
Chlorine Free	mg/L	2022-12-03	-	1.41
Chlorine Free	mg/L	2022-12-04	-	1.31
Chlorine Free	mg/L	2022-12-05	-	1.3
Chlorine Free	mg/L	2022-12-06	-	1.2
Chlorine Free	mg/L	2022-12-07	-	1.2
Chlorine Free	mg/L	2022-12-08	-	1.3
Chlorine Free	mg/L	2022-12-09	-	1.18
Chlorine Free	mg/L	2022-12-10	-	1.36
Chlorine Free	mg/L	2022-12-11	-	1.78
Chlorine Free	mg/L	2022-12-12	-	1.3
Chlorine Free	mg/L	2022-12-13	-	1.3
Chlorine Free	mg/L	2022-12-14	-	1.3
Chlorine Free	mg/L	2022-12-15	-	1.3
Chlorine Free	mg/L	2022-12-16	-	1.2
Chlorine Free	mg/L	2022-12-17	-	1.30
Chlorine Free	mg/L	2022-12-18	-	1.30
Chlorine Free	mg/L	2022-12-19	-	1.3
Chlorine Free	mg/L	2022-12-20	-	1.25
Chlorine Free	mg/L	2022-12-21	-	1.25
Chlorine Free	mg/L	2022-12-22	-	1.43
Chlorine Free	mg/L	2022-12-23	-	1.35
Chlorine Free	mg/L	2022-12-24	-	1.15
Chlorine Free	mg/L	2022-12-26	-	1.44
Chlorine Free	mg/L	2022-12-27	-	1.50
Chlorine Free	mg/L	2022-12-28	-	1.49
Chlorine Free	mg/L	2022-12-29	-	1.46
Chlorine Free	mg/L	2022-12-30	-	1.5
Chlorine Free	mg/L	2022-12-31	-	1.76
Chlorine Total	mg/L	2022-01-01	-	-
Chlorine Total	mg/L	2022-01-02	-	1.23
Chlorine Total	mg/L	2022-01-03	-	1.14
Chlorine Total	mg/L	2022-01-04	-	1.25
Chlorine Total	mg/L	2022-01-05	-	1.37

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-01-06	-	1.59
Chlorine Total	mg/L	2022-01-07	-	1.53
Chlorine Total	mg/L	2022-01-08	-	1.72
Chlorine Total	mg/L	2022-01-09	-	1.63
Chlorine Total	mg/L	2022-01-10	-	-
Chlorine Total	mg/L	2022-01-11	-	1.44
Chlorine Total	mg/L	2022-01-12	-	1.55
Chlorine Total	mg/L	2022-01-13	-	1.52
Chlorine Total	mg/L	2022-01-14	-	1.60
Chlorine Total	mg/L	2022-01-15	-	1.71
Chlorine Total	mg/L	2022-01-16	-	1.74
Chlorine Total	mg/L	2022-01-17	-	1.45
Chlorine Total	mg/L	2022-01-18	-	1.70
Chlorine Total	mg/L	2022-01-19	-	1.46
Chlorine Total	mg/L	2022-01-20	-	1.40
Chlorine Total	mg/L	2022-01-21	-	1.75
Chlorine Total	mg/L	2022-01-22	-	1.81
Chlorine Total	mg/L	2022-01-23	-	1.62
Chlorine Total	mg/L	2022-01-24	-	1.60
Chlorine Total	mg/L	2022-01-25	-	1.23
Chlorine Total	mg/L	2022-01-26	-	1.21
Chlorine Total	mg/L	2022-01-27	-	1.48
Chlorine Total	mg/L	2022-01-28	-	1.35
Chlorine Total	mg/L	2022-01-29	-	1.79
Chlorine Total	mg/L	2022-01-30	-	1.45
Chlorine Total	mg/L	2022-01-31	-	1.34
Chlorine Total	mg/L	2022-02-01	-	1.37
Chlorine Total	mg/L	2022-02-02	-	1.69
Chlorine Total	mg/L	2022-02-03	-	1.33
Chlorine Total	mg/L	2022-02-04	-	1.39
Chlorine Total	mg/L	2022-02-05	-	1.32
Chlorine Total	mg/L	2022-02-06	-	1.27
Chlorine Total	mg/L	2022-02-07	-	1.33
Chlorine Total	mg/L	2022-02-08	-	1.24
Chlorine Total	mg/L	2022-02-09	-	1.30
Chlorine Total	mg/L	2022-02-10	-	1.43
Chlorine Total	mg/L	2022-02-11	-	1.56
Chlorine Total	mg/L	2022-02-12	-	1.58
Chlorine Total	mg/L	2022-02-13	-	1.36
Chlorine Total	mg/L	2022-02-14	-	1.36
Chlorine Total	mg/L	2022-02-15	-	1.23
Chlorine Total	mg/L	2022-02-16	-	1.60

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-02-17	-	-
Chlorine Total	mg/L	2022-02-18	-	1.37
Chlorine Total	mg/L	2022-02-19	-	1.34
Chlorine Total	mg/L	2022-02-20	-	1.27
Chlorine Total	mg/L	2022-02-21	-	-
Chlorine Total	mg/L	2022-02-22	-	1.24
Chlorine Total	mg/L	2022-02-23	-	1.56
Chlorine Total	mg/L	2022-02-24	-	1.36
Chlorine Total	mg/L	2022-02-25	-	1.37
Chlorine Total	mg/L	2022-02-26	-	1.24
Chlorine Total	mg/L	2022-02-27	-	1.22
Chlorine Total	mg/L	2022-02-28	-	-
Chlorine Total	mg/L	2022-03-01	-	1.49
Chlorine Total	mg/L	2022-03-02	-	1.47
Chlorine Total	mg/L	2022-03-03	-	1.55
Chlorine Total	mg/L	2022-03-04	-	1.37
Chlorine Total	mg/L	2022-03-05	-	1.33
Chlorine Total	mg/L	2022-03-06	-	1.24
Chlorine Total	mg/L	2022-03-07	-	1.32
Chlorine Total	mg/L	2022-03-08	-	1.34
Chlorine Total	mg/L	2022-03-09	-	1.49
Chlorine Total	mg/L	2022-03-10	-	1.34
Chlorine Total	mg/L	2022-03-11	-	1.35
Chlorine Total	mg/L	2022-03-12	-	1.19
Chlorine Total	mg/L	2022-03-13	-	1.33
Chlorine Total	mg/L	2022-03-14	-	1.35
Chlorine Total	mg/L	2022-03-15	-	1.45
Chlorine Total	mg/L	2022-03-16	-	1.43
Chlorine Total	mg/L	2022-03-17	-	1.41
Chlorine Total	mg/L	2022-03-18	-	1.47
Chlorine Total	mg/L	2022-03-19	-	1.69
Chlorine Total	mg/L	2022-03-20	-	1.49
Chlorine Total	mg/L	2022-03-21	-	1.42
Chlorine Total	mg/L	2022-03-22	-	1.35
Chlorine Total	mg/L	2022-03-23	-	1.38
Chlorine Total	mg/L	2022-03-24	-	1.59
Chlorine Total	mg/L	2022-03-25	-	1.30
Chlorine Total	mg/L	2022-03-26	-	1.34
Chlorine Total	mg/L	2022-03-27	-	1.33
Chlorine Total	mg/L	2022-03-28	-	1.49
Chlorine Total	mg/L	2022-03-29	-	1.38
Chlorine Total	mg/L	2022-03-30	-	1.68

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-03-31	-	1.29
Chlorine Total	mg/L	2022-04-01	-	1.36
Chlorine Total	mg/L	2022-04-02	-	1.69
Chlorine Total	mg/L	2022-04-03	-	1.44
Chlorine Total	mg/L	2022-04-04	-	1.43
Chlorine Total	mg/L	2022-04-05	-	1.38
Chlorine Total	mg/L	2022-04-06	-	1.28
Chlorine Total	mg/L	2022-04-07	-	1.44
Chlorine Total	mg/L	2022-04-08	-	1.37
Chlorine Total	mg/L	2022-04-09	-	1.34
Chlorine Total	mg/L	2022-04-10	-	1.46
Chlorine Total	mg/L	2022-04-11	-	1.31
Chlorine Total	mg/L	2022-04-12	-	1.57
Chlorine Total	mg/L	2022-04-13	-	1.39
Chlorine Total	mg/L	2022-04-14	-	1.26
Chlorine Total	mg/L	2022-04-15	-	1.29
Chlorine Total	mg/L	2022-04-16	-	1.24
Chlorine Total	mg/L	2022-04-17	-	1.19
Chlorine Total	mg/L	2022-04-18	-	1.73
Chlorine Total	mg/L	2022-04-19	-	1.41
Chlorine Total	mg/L	2022-04-20	-	1.17
Chlorine Total	mg/L	2022-04-21	-	1.36
Chlorine Total	mg/L	2022-04-22	-	1.33
Chlorine Total	mg/L	2022-04-23	-	1.59
Chlorine Total	mg/L	2022-04-24	-	1.21
Chlorine Total	mg/L	2022-04-25	-	1.32
Chlorine Total	mg/L	2022-04-26	-	1.38
Chlorine Total	mg/L	2022-04-27	-	1.41
Chlorine Total	mg/L	2022-04-28	-	1.16
Chlorine Total	mg/L	2022-04-29	-	1.41
Chlorine Total	mg/L	2022-04-30	-	1.35
Chlorine Total	mg/L	2022-05-01	-	1.33
Chlorine Total	mg/L	2022-05-02	-	1.21
Chlorine Total	mg/L	2022-05-03	-	1.34
Chlorine Total	mg/L	2022-05-04	-	1.51
Chlorine Total	mg/L	2022-05-05	-	1.23
Chlorine Total	mg/L	2022-05-06	-	1.32
Chlorine Total	mg/L	2022-05-07	-	1.18
Chlorine Total	mg/L	2022-05-08	-	1.25
Chlorine Total	mg/L	2022-05-09	-	1.32
Chlorine Total	mg/L	2022-05-10	-	1.49
Chlorine Total	mg/L	2022-05-11	-	1.27

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-05-12	-	1.23
Chlorine Total	mg/L	2022-05-13	-	1.22
Chlorine Total	mg/L	2022-05-14	-	1.38
Chlorine Total	mg/L	2022-05-15	-	1.27
Chlorine Total	mg/L	2022-05-16	-	1.21
Chlorine Total	mg/L	2022-05-17	-	1.09
Chlorine Total	mg/L	2022-05-18	-	1.36
Chlorine Total	mg/L	2022-05-19	-	1.44
Chlorine Total	mg/L	2022-05-20	-	1.33
Chlorine Total	mg/L	2022-05-21	-	1.23
Chlorine Total	mg/L	2022-05-22	-	1.44
Chlorine Total	mg/L	2022-05-23	-	1.39
Chlorine Total	mg/L	2022-05-24	-	1.37
Chlorine Total	mg/L	2022-05-25	-	1.31
Chlorine Total	mg/L	2022-05-26	-	1.62
Chlorine Total	mg/L	2022-05-27	-	1.63
Chlorine Total	mg/L	2022-05-28	-	1.53
Chlorine Total	mg/L	2022-05-29	-	1.23
Chlorine Total	mg/L	2022-05-30	-	1.34
Chlorine Total	mg/L	2022-05-31	-	1.31
Chlorine Total	mg/L	2022-06-01	-	1.36
Chlorine Total	mg/L	2022-06-02	-	1.34
Chlorine Total	mg/L	2022-06-03	-	1.33
Chlorine Total	mg/L	2022-06-04	-	1.25
Chlorine Total	mg/L	2022-06-05	-	1.34
Chlorine Total	mg/L	2022-06-06	-	1.31
Chlorine Total	mg/L	2022-06-07	-	1.42
Chlorine Total	mg/L	2022-06-08	-	-
Chlorine Total	mg/L	2022-06-09	-	1.41
Chlorine Total	mg/L	2022-06-10	-	1.24
Chlorine Total	mg/L	2022-06-11	-	-
Chlorine Total	mg/L	2022-06-12	-	1.49
Chlorine Total	mg/L	2022-06-13	-	1.29
Chlorine Total	mg/L	2022-06-14	-	1.44
Chlorine Total	mg/L	2022-06-15	-	1.16
Chlorine Total	mg/L	2022-06-16	-	1.34
Chlorine Total	mg/L	2022-06-17	-	1.33
Chlorine Total	mg/L	2022-06-18	-	1.27
Chlorine Total	mg/L	2022-06-19	-	1.70
Chlorine Total	mg/L	2022-06-20	-	1.40
Chlorine Total	mg/L	2022-06-21	-	1.30
Chlorine Total	mg/L	2022-06-22	-	1.38

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-06-23	-	1.29
Chlorine Total	mg/L	2022-06-24	-	1.48
Chlorine Total	mg/L	2022-06-25	-	1.27
Chlorine Total	mg/L	2022-06-26	-	1.35
Chlorine Total	mg/L	2022-06-27	-	1.46
Chlorine Total	mg/L	2022-06-28	-	1.32
Chlorine Total	mg/L	2022-06-29	-	1.35
Chlorine Total	mg/L	2022-06-30	-	1.38
Chlorine Total	mg/L	2022-07-01	-	1.29
Chlorine Total	mg/L	2022-07-02	-	1.35
Chlorine Total	mg/L	2022-07-03	-	1.38
Chlorine Total	mg/L	2022-07-04	-	1.39
Chlorine Total	mg/L	2022-07-05	-	1.33
Chlorine Total	mg/L	2022-07-06	-	1.35
Chlorine Total	mg/L	2022-07-07	-	1.36
Chlorine Total	mg/L	2022-07-08	-	1.48
Chlorine Total	mg/L	2022-07-09	-	1.50
Chlorine Total	mg/L	2022-07-10	-	1.20
Chlorine Total	mg/L	2022-07-11	-	1.32
Chlorine Total	mg/L	2022-07-12	-	1.40
Chlorine Total	mg/L	2022-07-13	-	1.47
Chlorine Total	mg/L	2022-07-14	-	1.34
Chlorine Total	mg/L	2022-07-15	-	1.37
Chlorine Total	mg/L	2022-07-16	-	1.40
Chlorine Total	mg/L	2022-07-17	-	1.34
Chlorine Total	mg/L	2022-07-18	-	-
Chlorine Total	mg/L	2022-07-19	-	1.21
Chlorine Total	mg/L	2022-07-20	-	1.26
Chlorine Total	mg/L	2022-07-21	-	1.39
Chlorine Total	mg/L	2022-07-22	-	1.33
Chlorine Total	mg/L	2022-07-23	-	1.23
Chlorine Total	mg/L	2022-07-24	-	1.25
Chlorine Total	mg/L	2022-07-25	-	1.47
Chlorine Total	mg/L	2022-07-26	-	1.37
Chlorine Total	mg/L	2022-07-27	-	1.42
Chlorine Total	mg/L	2022-07-28	-	1.27
Chlorine Total	mg/L	2022-07-29	-	1.39
Chlorine Total	mg/L	2022-07-30	-	1.34
Chlorine Total	mg/L	2022-07-31	-	1.34
Chlorine Total	mg/L	2022-08-01	-	1.32
Chlorine Total	mg/L	2022-08-02	-	1.35
Chlorine Total	mg/L	2022-08-03	-	1.21

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-08-04	-	1.41
Chlorine Total	mg/L	2022-08-05	-	1.44
Chlorine Total	mg/L	2022-08-06	-	1.37
Chlorine Total	mg/L	2022-08-07	-	1.44
Chlorine Total	mg/L	2022-08-08	-	1.29
Chlorine Total	mg/L	2022-08-09	-	1.28
Chlorine Total	mg/L	2022-08-10	-	1.25
Chlorine Total	mg/L	2022-08-11	-	1.35
Chlorine Total	mg/L	2022-08-12	-	1.39
Chlorine Total	mg/L	2022-08-13	-	1.32
Chlorine Total	mg/L	2022-08-14	-	1.28
Chlorine Total	mg/L	2022-08-15	-	1.35
Chlorine Total	mg/L	2022-08-16	-	1.34
Chlorine Total	mg/L	2022-08-17	-	1.51
Chlorine Total	mg/L	2022-08-18	-	1.24
Chlorine Total	mg/L	2022-08-19	-	1.40
Chlorine Total	mg/L	2022-08-20	-	1.23
Chlorine Total	mg/L	2022-08-21	-	1.46
Chlorine Total	mg/L	2022-08-22	-	1.34
Chlorine Total	mg/L	2022-08-23	-	1.38
Chlorine Total	mg/L	2022-08-24	-	1.21
Chlorine Total	mg/L	2022-08-25	-	1.36
Chlorine Total	mg/L	2022-08-26	-	1.33
Chlorine Total	mg/L	2022-08-27	-	1.40
Chlorine Total	mg/L	2022-08-28	-	1.23
Chlorine Total	mg/L	2022-08-29	-	1.39
Chlorine Total	mg/L	2022-08-30	-	1.46
Chlorine Total	mg/L	2022-08-31	-	1.36
Chlorine Total	mg/L	2022-09-01	-	1.21
Chlorine Total	mg/L	2022-09-02	-	1.26
Chlorine Total	mg/L	2022-09-03	-	1.33
Chlorine Total	mg/L	2022-09-04	-	1.43
Chlorine Total	mg/L	2022-09-05	-	1.28
Chlorine Total	mg/L	2022-09-06	-	1.45
Chlorine Total	mg/L	2022-09-07	-	1.34
Chlorine Total	mg/L	2022-09-08	-	1.22
Chlorine Total	mg/L	2022-09-09	-	1.37
Chlorine Total	mg/L	2022-09-10	-	1.43
Chlorine Total	mg/L	2022-09-11	-	1.29
Chlorine Total	mg/L	2022-09-12	-	1.36
Chlorine Total	mg/L	2022-09-13	-	1.25
Chlorine Total	mg/L	2022-09-14	-	1.39

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-09-15	-	1.47
Chlorine Total	mg/L	2022-09-16	-	1.28
Chlorine Total	mg/L	2022-09-17	-	1.51
Chlorine Total	mg/L	2022-09-18	-	1.35
Chlorine Total	mg/L	2022-09-19	-	1.29
Chlorine Total	mg/L	2022-09-20	-	1.55
Chlorine Total	mg/L	2022-09-21	-	1.36
Chlorine Total	mg/L	2022-09-22	-	1.35
Chlorine Total	mg/L	2022-09-23	-	-
Chlorine Total	mg/L	2022-09-24	-	1.39
Chlorine Total	mg/L	2022-09-25	-	1.45
Chlorine Total	mg/L	2022-09-26	-	1.44
Chlorine Total	mg/L	2022-09-27	-	1.40
Chlorine Total	mg/L	2022-09-28	-	1.47
Chlorine Total	mg/L	2022-09-29	-	1.37
Chlorine Total	mg/L	2022-09-30	-	1.31
Chlorine Total	mg/L	2022-10-01	-	1.47
Chlorine Total	mg/L	2022-10-02	-	1.23
Chlorine Total	mg/L	2022-10-03	-	1.37
Chlorine Total	mg/L	2022-10-04	-	1.51
Chlorine Total	mg/L	2022-10-05	-	1.44
Chlorine Total	mg/L	2022-10-06	-	1.55
Chlorine Total	mg/L	2022-10-07	-	1.33
Chlorine Total	mg/L	2022-10-08	-	1.35
Chlorine Total	mg/L	2022-10-09	-	1.39
Chlorine Total	mg/L	2022-10-10	-	1.32
Chlorine Total	mg/L	2022-10-11	-	1.42
Chlorine Total	mg/L	2022-10-12	-	1.41
Chlorine Total	mg/L	2022-10-13	-	1.41
Chlorine Total	mg/L	2022-10-14	-	1.44
Chlorine Total	mg/L	2022-10-15	-	1.25
Chlorine Total	mg/L	2022-10-16	-	1.47
Chlorine Total	mg/L	2022-10-17	-	-
Chlorine Total	mg/L	2022-10-18	-	1.29
Chlorine Total	mg/L	2022-10-19	-	1.35
Chlorine Total	mg/L	2022-10-20	-	1.49
Chlorine Total	mg/L	2022-10-21	-	1.47
Chlorine Total	mg/L	2022-10-22	-	1.38
Chlorine Total	mg/L	2022-10-23	-	1.46
Chlorine Total	mg/L	2022-10-24	-	1.33
Chlorine Total	mg/L	2022-10-25	-	1.20
Chlorine Total	mg/L	2022-10-26	-	1.24

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-10-27	-	1.41
Chlorine Total	mg/L	2022-10-28	-	1.31
Chlorine Total	mg/L	2022-10-29	-	1.63
Chlorine Total	mg/L	2022-10-30	-	1.97
Chlorine Total	mg/L	2022-10-31	-	1.60
Chlorine Total	mg/L	2022-11-01	-	1.54
Chlorine Total	mg/L	2022-11-02	-	1.39
Chlorine Total	mg/L	2022-11-03	-	1.33
Chlorine Total	mg/L	2022-11-04	-	1.37
Chlorine Total	mg/L	2022-11-05	-	1.49
Chlorine Total	mg/L	2022-11-06	-	1.44
Chlorine Total	mg/L	2022-11-07	-	1.28
Chlorine Total	mg/L	2022-11-08	-	1.40
Chlorine Total	mg/L	2022-11-09	-	1.12
Chlorine Total	mg/L	2022-11-10	-	1.41
Chlorine Total	mg/L	2022-11-11	-	1.26
Chlorine Total	mg/L	2022-11-12	-	1.44
Chlorine Total	mg/L	2022-11-13	-	1.52
Chlorine Total	mg/L	2022-11-14	-	1.53
Chlorine Total	mg/L	2022-11-15	-	1.54
Chlorine Total	mg/L	2022-11-16	-	1.40
Chlorine Total	mg/L	2022-11-17	-	1.36
Chlorine Total	mg/L	2022-11-18	-	1.62
Chlorine Total	mg/L	2022-11-19	-	1.46
Chlorine Total	mg/L	2022-11-20	-	1.88
Chlorine Total	mg/L	2022-11-21	-	1.43
Chlorine Total	mg/L	2022-11-22	-	1.49
Chlorine Total	mg/L	2022-11-23	-	1.55
Chlorine Total	mg/L	2022-11-24	-	1.55
Chlorine Total	mg/L	2022-11-25	-	1.23
Chlorine Total	mg/L	2022-11-26	-	1.25
Chlorine Total	mg/L	2022-11-27	-	1.53
Chlorine Total	mg/L	2022-11-28	-	1.27
Chlorine Total	mg/L	2022-11-29	-	1.48
Chlorine Total	mg/L	2022-11-30	-	1.42
Chlorine Total	mg/L	2022-12-01	-	1.45
Chlorine Total	mg/L	2022-12-02	-	1.46
Chlorine Total	mg/L	2022-12-03	-	1.49
Chlorine Total	mg/L	2022-12-04	-	1.33
Chlorine Total	mg/L	2022-12-05	-	1.43
Chlorine Total	mg/L	2022-12-06	-	1.23
Chlorine Total	mg/L	2022-12-07	-	1.41

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Chlorine Total	mg/L	2022-12-08	-	1.26
Chlorine Total	mg/L	2022-12-09	-	1.29
Chlorine Total	mg/L	2022-12-10	-	1.36
Chlorine Total	mg/L	2022-12-11	-	1.78
Chlorine Total	mg/L	2022-12-12	-	1.42
Chlorine Total	mg/L	2022-12-13	-	1.35
Chlorine Total	mg/L	2022-12-14	-	1.34
Chlorine Total	mg/L	2022-12-15	-	1.28
Chlorine Total	mg/L	2022-12-16	-	1.29
Chlorine Total	mg/L	2022-12-17	-	1.34
Chlorine Total	mg/L	2022-12-18	-	1.33
Chlorine Total	mg/L	2022-12-19	-	1.40
Chlorine Total	mg/L	2022-12-20	-	1.25
Chlorine Total	mg/L	2022-12-21	-	1.25
Chlorine Total	mg/L	2022-12-22	-	1.47
Chlorine Total	mg/L	2022-12-23	-	1.41
Chlorine Total	mg/L	2022-12-24	-	1.21
Chlorine Total	mg/L	2022-12-26	-	1.48
Chlorine Total	mg/L	2022-12-27	-	1.54
Chlorine Total	mg/L	2022-12-28	-	1.56
Chlorine Total	mg/L	2022-12-29	-	1.46
Chlorine Total	mg/L	2022-12-30	-	1.56
Chlorine Total	mg/L	2022-12-31	-	1.82
Chlorodibromomethane	µg/L	2022-02-15	<1	<1
Chlorodibromomethane	µg/L	2022-05-10	<1	<1
Chlorodibromomethane	µg/L	2022-11-15	<1	<1
Chloroform	µg/L	2022-02-15	<1	11
Chloroform	µg/L	2022-05-10	<1	6
Chloroform	µg/L	2022-11-15	<1	6
Chromium Total	µg/L	2022-05-02	<0.05	<0.05
Chromium Total	µg/L	2022-05-04	<0.05	<0.05
Chromium Total	µg/L	2022-11-07	0.10	<0.05
Chromium Total	µg/L	2022-11-08	0.06	0.05
Cobalt Total	µg/L	2022-05-04	<0.5	<0.5
Cobalt Total	µg/L	2022-11-08	<0.5	<0.5
Colour - Apparent	ACU	2022-01-04	16	2
Colour - Apparent	ACU	2022-01-10	13	-
Colour - Apparent	ACU	2022-01-17	13	2
Colour - Apparent	ACU	2022-01-24	13	-
Colour - Apparent	ACU	2022-01-31	14	<2
Colour - Apparent	ACU	2022-02-07	12	2
Colour - Apparent	ACU	2022-02-14	12	<2

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Colour - Apparent	ACU	2022-02-22	12	2
Colour - Apparent	ACU	2022-02-28	13	2
Colour - Apparent	ACU	2022-03-07	12	<2
Colour - Apparent	ACU	2022-03-14	12	2
Colour - Apparent	ACU	2022-03-21	14	-
Colour - Apparent	ACU	2022-03-28	13	-
Colour - Apparent	ACU	2022-04-04	11	<2
Colour - Apparent	ACU	2022-04-11	13	<2
Colour - Apparent	ACU	2022-04-19	11	<2
Colour - Apparent	ACU	2022-04-25	11	<2
Colour - Apparent	ACU	2022-05-02	10	7
Colour - Apparent	ACU	2022-05-09	12	2
Colour - Apparent	ACU	2022-05-16	12	2
Colour - Apparent	ACU	2022-05-24	10	4
Colour - Apparent	ACU	2022-05-30	12	2
Colour - Apparent	ACU	2022-06-06	10	2
Colour - Apparent	ACU	2022-06-13	11	2
Colour - Apparent	ACU	2022-06-20	10	<2
Colour - Apparent	ACU	2022-06-27	13	2
Colour - Apparent	ACU	2022-07-04	20	5
Colour - Apparent	ACU	2022-07-11	13	-
Colour - Apparent	ACU	2022-07-18	11	2
Colour - Apparent	ACU	2022-07-25	10	2
Colour - Apparent	ACU	2022-08-02	14	2
Colour - Apparent	ACU	2022-08-08	13	3
Colour - Apparent	ACU	2022-08-15	10	<2
Colour - Apparent	ACU	2022-08-22	16	<2
Colour - Apparent	ACU	2022-08-29	14	8
Colour - Apparent	ACU	2022-09-06	12	5
Colour - Apparent	ACU	2022-09-12	12	2
Colour - Apparent	ACU	2022-09-20	9	3
Colour - Apparent	ACU	2022-09-26	9	5
Colour - Apparent	ACU	2022-10-03	7	4
Colour - Apparent	ACU	2022-10-11	6	<2
Colour - Apparent	ACU	2022-10-17	9	3
Colour - Apparent	ACU	2022-10-24	8	3
Colour - Apparent	ACU	2022-10-31	18	3
Colour - Apparent	ACU	2022-11-07	11	3
Colour - Apparent	ACU	2022-11-14	12	3
Colour - Apparent	ACU	2022-11-21	9	3
Colour - Apparent	ACU	2022-11-28	15	4
Colour - Apparent	ACU	2022-12-05	11	2

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Colour - Apparent	ACU	2022-12-12	11	3
Colour - Apparent	ACU	2022-12-19	10	2
Colour - True	TCU	2022-01-04	11	<1
Colour - True	TCU	2022-01-10	11	-
Colour - True	TCU	2022-01-17	10	<1
Colour - True	TCU	2022-01-24	10	-
Colour - True	TCU	2022-01-31	10	1
Colour - True	TCU	2022-02-07	10	<1
Colour - True	TCU	2022-02-14	8	<1
Colour - True	TCU	2022-02-22	12	<1
Colour - True	TCU	2022-02-28	11	<1
Colour - True	TCU	2022-03-07	10	<1
Colour - True	TCU	2022-03-14	9	1
Colour - True	TCU	2022-03-21	11	-
Colour - True	TCU	2022-03-28	11	-
Colour - True	TCU	2022-04-04	9	<1
Colour - True	TCU	2022-04-11	9	<1
Colour - True	TCU	2022-04-19	9	<1
Colour - True	TCU	2022-04-25	9	1
Colour - True	TCU	2022-05-02	8	6
Colour - True	TCU	2022-05-09	9	<1
Colour - True	TCU	2022-05-16	9	2
Colour - True	TCU	2022-05-24	9	4
Colour - True	TCU	2022-05-30	8	<1
Colour - True	TCU	2022-06-06	9	1
Colour - True	TCU	2022-06-13	9	<1
Colour - True	TCU	2022-06-20	9	<1
Colour - True	TCU	2022-06-27	9	<1
Colour - True	TCU	2022-07-04	9	<1
Colour - True	TCU	2022-07-11	8	-
Colour - True	TCU	2022-07-18	7	<1
Colour - True	TCU	2022-07-25	9	<1
Colour - True	TCU	2022-08-02	8	<1
Colour - True	TCU	2022-08-08	9	<1
Colour - True	TCU	2022-08-15	8	<1
Colour - True	TCU	2022-08-22	8	<1
Colour - True	TCU	2022-08-29	7	<1
Colour - True	TCU	2022-09-06	6	<1
Colour - True	TCU	2022-09-12	8	<1
Colour - True	TCU	2022-09-20	6	<1
Colour - True	TCU	2022-09-26	6	<1
Colour - True	TCU	2022-10-03	5	<1

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Colour - True	TCU	2022-10-11	5	<1
Colour - True	TCU	2022-10-17	5	<1
Colour - True	TCU	2022-10-24	5	<1
Colour - True	TCU	2022-10-31	12	<1
Colour - True	TCU	2022-11-07	8	<1
Colour - True	TCU	2022-11-14	7	<1
Colour - True	TCU	2022-11-21	7	<1
Colour - True	TCU	2022-11-28	11	<1
Colour - True	TCU	2022-12-05	7	<1
Colour - True	TCU	2022-12-12	8	<1
Colour - True	TCU	2022-12-19	8	<1
Conductivity	µmhos/cm	2022-01-04	8	46
Conductivity	µmhos/cm	2022-01-10	8	-
Conductivity	µmhos/cm	2022-01-17	8	48
Conductivity	µmhos/cm	2022-01-24	8	-
Conductivity	µmhos/cm	2022-01-31	8	45
Conductivity	µmhos/cm	2022-02-07	8	42
Conductivity	µmhos/cm	2022-02-14	8	47
Conductivity	µmhos/cm	2022-02-22	8	53
Conductivity	µmhos/cm	2022-02-28	8	47
Conductivity	µmhos/cm	2022-03-07	8	51
Conductivity	µmhos/cm	2022-03-14	7	42
Conductivity	µmhos/cm	2022-03-21	8	-
Conductivity	µmhos/cm	2022-03-28	8	-
Conductivity	µmhos/cm	2022-04-04	8	47
Conductivity	µmhos/cm	2022-04-11	8	47
Conductivity	µmhos/cm	2022-04-19	8	46
Conductivity	µmhos/cm	2022-04-25	8	45
Conductivity	µmhos/cm	2022-05-02	8	47
Conductivity	µmhos/cm	2022-05-09	8	48
Conductivity	µmhos/cm	2022-05-16	7	42
Conductivity	µmhos/cm	2022-05-24	8	46
Conductivity	µmhos/cm	2022-05-30	7	43
Conductivity	µmhos/cm	2022-06-06	8	49
Conductivity	µmhos/cm	2022-06-13	8	50
Conductivity	µmhos/cm	2022-06-20	7	41
Conductivity	µmhos/cm	2022-06-27	7	45
Conductivity	µmhos/cm	2022-07-04	7	44
Conductivity	µmhos/cm	2022-07-11	6	-
Conductivity	µmhos/cm	2022-07-18	7	45
Conductivity	µmhos/cm	2022-07-25	7	52
Conductivity	µmhos/cm	2022-08-02	7	45

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Conductivity	µmhos/cm	2022-08-08	7	45
Conductivity	µmhos/cm	2022-08-15	6	43
Conductivity	µmhos/cm	2022-08-22	7	45
Conductivity	µmhos/cm	2022-08-29	7	47
Conductivity	µmhos/cm	2022-09-06	7	44
Conductivity	µmhos/cm	2022-09-12	7	44
Conductivity	µmhos/cm	2022-09-20	7	43
Conductivity	µmhos/cm	2022-09-26	6	40
Conductivity	µmhos/cm	2022-10-03	6	40
Conductivity	µmhos/cm	2022-10-11	7	44
Conductivity	µmhos/cm	2022-10-17	7	44
Conductivity	µmhos/cm	2022-10-24	7	42
Conductivity	µmhos/cm	2022-10-31	9	48
Conductivity	µmhos/cm	2022-11-07	8	47
Conductivity	µmhos/cm	2022-11-14	8	43
Conductivity	µmhos/cm	2022-11-21	8	42
Conductivity	µmhos/cm	2022-11-28	8	45
Conductivity	µmhos/cm	2022-12-05	8	45
Conductivity	µmhos/cm	2022-12-12	8	46
Conductivity	µmhos/cm	2022-12-19	8	45
Copper Total	µg/L	2022-05-02	5.0	<0.5
Copper Total	µg/L	2022-05-04	4.7	<0.5
Copper Total	µg/L	2022-11-07	2.8	<0.5
Copper Total	µg/L	2022-11-08	4.9	<0.5
Cyanide Total	mg/L	2022-05-02	<0.02	<0.02
Cyanide Total	mg/L	2022-11-07	<0.02	<0.02
Dibromoacetic Acid	µg/L	2022-02-15	<0.5	<0.5
Dibromoacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Dibromoacetic Acid	µg/L	2022-08-23	<5.0	-
Dibromoacetic Acid	µg/L	2022-08-24	-	<0.5
Dibromoacetic Acid	µg/L	2022-11-15	<0.5	<0.5
Dichloroacetic Acid	µg/L	2022-02-15	<0.5	9.5
Dichloroacetic Acid	µg/L	2022-05-10	<0.5	3.5
Dichloroacetic Acid	µg/L	2022-08-23	<5.0	-
Dichloroacetic Acid	µg/L	2022-08-24	-	6.8
Dichloroacetic Acid	µg/L	2022-11-15	<0.5	3.9
Fluoride	mg/L	2022-01-04	<0.05	<0.05
Fluoride	mg/L	2022-02-07	<0.05	<0.05
Fluoride	mg/L	2022-03-07	<0.05	<0.05
Fluoride	mg/L	2022-04-04	<0.05	<0.05
Fluoride	mg/L	2022-05-02	<0.05	<0.05
Fluoride	mg/L	2022-06-06	<0.05	<0.05

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Fluoride	mg/L	2022-07-04	<0.05	<0.05
Fluoride	mg/L	2022-08-08	<0.05	<0.05
Fluoride	mg/L	2022-09-12	<0.05	<0.05
Fluoride	mg/L	2022-11-07	<0.05	<0.05
Fluoride	mg/L	2022-12-05	<0.05	<0.05
Hardness as CaCO ₃	mg/L	2022-01-04	2.3	2.2
Hardness as CaCO ₃	mg/L	2022-02-07	2.4	2.5
Hardness as CaCO ₃	mg/L	2022-02-14	2.4	2.4
Hardness as CaCO ₃	mg/L	2022-03-07	2.4	2.4
Hardness as CaCO ₃	mg/L	2022-04-04	2.4	2.4
Hardness as CaCO ₃	mg/L	2022-05-02	2.4	2.1
Hardness as CaCO ₃	mg/L	2022-06-06	2.4	2.7
Hardness as CaCO ₃	mg/L	2022-07-04	2.3	6.2
Hardness as CaCO ₃	mg/L	2022-08-08	2.2	2.2
Hardness as CaCO ₃	mg/L	2022-09-12	2.2	2.2
Hardness as CaCO ₃	mg/L	2022-11-07	2.7	2.5
Hardness as CaCO ₃	mg/L	2022-12-05	2.6	2.5
Iron Dissolved	µg/L	2022-01-04	25	27
Iron Dissolved	µg/L	2022-01-10	30	-
Iron Dissolved	µg/L	2022-01-17	29	29
Iron Dissolved	µg/L	2022-01-24	28	-
Iron Dissolved	µg/L	2022-01-31	29	32
Iron Dissolved	µg/L	2022-02-14	29	30
Iron Dissolved	µg/L	2022-02-22	33	35
Iron Dissolved	µg/L	2022-02-28	34	33
Iron Dissolved	µg/L	2022-03-07	23	25
Iron Dissolved	µg/L	2022-03-14	24	26
Iron Dissolved	µg/L	2022-03-21	23	-
Iron Dissolved	µg/L	2022-03-28	16	-
Iron Dissolved	µg/L	2022-04-04	21	23
Iron Dissolved	µg/L	2022-04-11	31	25
Iron Dissolved	µg/L	2022-04-19	21	23
Iron Dissolved	µg/L	2022-04-25	19	21
Iron Dissolved	µg/L	2022-05-02	21	22
Iron Dissolved	µg/L	2022-05-09	18	19
Iron Dissolved	µg/L	2022-05-16	20	22
Iron Dissolved	µg/L	2022-05-24	15	17
Iron Dissolved	µg/L	2022-05-30	16	16
Iron Dissolved	µg/L	2022-06-06	14	17
Iron Dissolved	µg/L	2022-06-13	12	15
Iron Dissolved	µg/L	2022-06-20	13	14
Iron Dissolved	µg/L	2022-06-27	12	14

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Iron Dissolved	µg/L	2022-07-04	11	13
Iron Dissolved	µg/L	2022-07-11	11	-
Iron Dissolved	µg/L	2022-07-18	12	13
Iron Dissolved	µg/L	2022-07-25	12	13
Iron Dissolved	µg/L	2022-08-02	13	14
Iron Dissolved	µg/L	2022-08-08	11	12
Iron Dissolved	µg/L	2022-08-15	11	12
Iron Dissolved	µg/L	2022-08-22	12	12
Iron Dissolved	µg/L	2022-08-29	13	13
Iron Dissolved	µg/L	2022-09-06	13	13
Iron Dissolved	µg/L	2022-09-12	12	14
Iron Dissolved	µg/L	2022-09-20	14	15
Iron Dissolved	µg/L	2022-09-26	15	19
Iron Dissolved	µg/L	2022-10-03	15	16
Iron Dissolved	µg/L	2022-10-17	17	20
Iron Dissolved	µg/L	2022-10-24	27	24
Iron Dissolved	µg/L	2022-10-31	26	31
Iron Dissolved	µg/L	2022-11-07	18	20
Iron Dissolved	µg/L	2022-11-14	14	17
Iron Dissolved	µg/L	2022-11-21	13	17
Iron Dissolved	µg/L	2022-11-28	17	19
Iron Dissolved	µg/L	2022-12-05	12	15
Iron Dissolved	µg/L	2022-12-12	13	14
Iron Dissolved	µg/L	2022-12-19	14	15
Iron Total	µg/L	2022-01-04	52	56
Iron Total	µg/L	2022-01-10	66	-
Iron Total	µg/L	2022-01-17	61	61
Iron Total	µg/L	2022-01-24	60	-
Iron Total	µg/L	2022-01-31	62	62
Iron Total	µg/L	2022-02-07	63	61
Iron Total	µg/L	2022-02-14	56	55
Iron Total	µg/L	2022-02-22	70	69
Iron Total	µg/L	2022-02-28	70	65
Iron Total	µg/L	2022-03-07	58	59
Iron Total	µg/L	2022-03-14	50	56
Iron Total	µg/L	2022-03-21	54	-
Iron Total	µg/L	2022-03-28	53	-
Iron Total	µg/L	2022-04-04	53	52
Iron Total	µg/L	2022-04-11	52	54
Iron Total	µg/L	2022-04-19	51	73
Iron Total	µg/L	2022-04-25	48	49
Iron Total	µg/L	2022-05-02	58	59

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Iron Total	µg/L	2022-05-04	59	63
Iron Total	µg/L	2022-05-09	44	47
Iron Total	µg/L	2022-05-16	60	61
Iron Total	µg/L	2022-05-24	45	45
Iron Total	µg/L	2022-05-30	44	47
Iron Total	µg/L	2022-06-06	41	42
Iron Total	µg/L	2022-06-13	39	38
Iron Total	µg/L	2022-06-20	33	34
Iron Total	µg/L	2022-06-27	29	38
Iron Total	µg/L	2022-07-04	31	31
Iron Total	µg/L	2022-07-11	31	-
Iron Total	µg/L	2022-07-18	29	29
Iron Total	µg/L	2022-07-25	31	27
Iron Total	µg/L	2022-08-02	27	26
Iron Total	µg/L	2022-08-08	26	25
Iron Total	µg/L	2022-08-15	27	27
Iron Total	µg/L	2022-08-22	30	31
Iron Total	µg/L	2022-08-29	32	33
Iron Total	µg/L	2022-09-06	38	37
Iron Total	µg/L	2022-09-12	34	34
Iron Total	µg/L	2022-09-20	42	40
Iron Total	µg/L	2022-09-26	48	69
Iron Total	µg/L	2022-10-03	45	44
Iron Total	µg/L	2022-10-17	55	56
Iron Total	µg/L	2022-10-24	78	76
Iron Total	µg/L	2022-10-31	72	76
Iron Total	µg/L	2022-11-07	65	62
Iron Total	µg/L	2022-11-08	65	65
Iron Total	µg/L	2022-11-14	54	53
Iron Total	µg/L	2022-11-21	47	48
Iron Total	µg/L	2022-11-28	50	47
Iron Total	µg/L	2022-12-05	37	38
Iron Total	µg/L	2022-12-12	37	36
Iron Total	µg/L	2022-12-19	39	39
Lead Total	µg/L	2022-05-02	<0.5	<0.5
Lead Total	µg/L	2022-05-04	<0.5	<0.5
Lead Total	µg/L	2022-11-07	<0.5	<0.5
Lead Total	µg/L	2022-11-08	<0.5	<0.5
Magnesium Total	µg/L	2022-01-04	91	88
Magnesium Total	µg/L	2022-02-07	98	100
Magnesium Total	µg/L	2022-02-14	94	94
Magnesium Total	µg/L	2022-03-07	92	93

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Magnesium Total	µg/L	2022-04-04	96	95
Magnesium Total	µg/L	2022-05-02	92	84
Magnesium Total	µg/L	2022-05-04	96	97
Magnesium Total	µg/L	2022-06-06	93	98
Magnesium Total	µg/L	2022-07-04	82	110
Magnesium Total	µg/L	2022-08-08	77	77
Magnesium Total	µg/L	2022-09-12	75	77
Magnesium Total	µg/L	2022-11-07	110	105
Magnesium Total	µg/L	2022-11-08	104	103
Magnesium Total	µg/L	2022-12-05	101	99
Manganese Dissolved	µg/L	2022-01-04	4.2	3.1
Manganese Dissolved	µg/L	2022-02-14	5.1	3.7
Manganese Dissolved	µg/L	2022-03-07	4.5	3.4
Manganese Dissolved	µg/L	2022-04-04	4.7	3.4
Manganese Dissolved	µg/L	2022-05-02	4.7	2.3
Manganese Dissolved	µg/L	2022-06-06	3.6	2.4
Manganese Dissolved	µg/L	2022-07-04	2.9	2.3
Manganese Dissolved	µg/L	2022-08-08	2.5	1.6
Manganese Dissolved	µg/L	2022-09-12	3.2	1.9
Manganese Dissolved	µg/L	2022-11-07	4.1	2.8
Manganese Dissolved	µg/L	2022-12-05	3.6	2.7
Manganese Total	µg/L	2022-01-04	4.7	3.8
Manganese Total	µg/L	2022-02-07	5.4	4.1
Manganese Total	µg/L	2022-02-14	5.3	4.1
Manganese Total	µg/L	2022-03-07	4.8	3.9
Manganese Total	µg/L	2022-04-04	5.0	4.3
Manganese Total	µg/L	2022-05-02	5.0	4.0
Manganese Total	µg/L	2022-05-04	5.2	4.1
Manganese Total	µg/L	2022-06-06	3.9	3.1
Manganese Total	µg/L	2022-07-04	3.1	4.8
Manganese Total	µg/L	2022-08-08	2.7	2.0
Manganese Total	µg/L	2022-09-12	3.4	2.3
Manganese Total	µg/L	2022-11-07	4.5	3.6
Manganese Total	µg/L	2022-11-08	4.5	3.8
Manganese Total	µg/L	2022-12-05	3.8	3.0
Mercury Total	µg/L	2022-05-02	<0.05	<0.05
Mercury Total	µg/L	2022-05-04	<0.05	<0.05
Mercury Total	µg/L	2022-11-07	<0.05	<0.05
Mercury Total	µg/L	2022-11-08	<0.05	<0.05
Molybdenum Total	µg/L	2022-05-04	<0.5	<0.5
Molybdenum Total	µg/L	2022-11-08	<0.5	<0.5
Monobromoacetic Acid	µg/L	2022-02-15	<5.0	<0.5

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Monobromoacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Monobromoacetic Acid	µg/L	2022-08-23	<5.0	-
Monobromoacetic Acid	µg/L	2022-08-24	-	<0.5
Monobromoacetic Acid	µg/L	2022-11-15	<0.5	<0.5
Monochloroacetic Acid	µg/L	2022-02-15	<5.0	<5.0
Monochloroacetic Acid	µg/L	2022-05-10	<0.5	<0.5
Monochloroacetic Acid	µg/L	2022-08-23	<5.0	-
Monochloroacetic Acid	µg/L	2022-08-24	-	<5.0
Monochloroacetic Acid	µg/L	2022-11-15	<0.5	0.5
Nickel Total	µg/L	2022-05-02	<0.5	<0.5
Nickel Total	µg/L	2022-05-04	<0.5	<0.5
Nickel Total	µg/L	2022-11-07	<0.5	<0.5
Nickel Total	µg/L	2022-11-08	<0.5	<0.5
Nitrogen - Ammonia as N	mg/L	2022-01-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-10	<0.02	-
Nitrogen - Ammonia as N	mg/L	2022-01-17	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-01-24	<0.02	-
Nitrogen - Ammonia as N	mg/L	2022-01-31	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-07	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-14	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-22	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-02-28	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-07	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-14	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-03-21	<0.02	-
Nitrogen - Ammonia as N	mg/L	2022-03-28	<0.02	-
Nitrogen - Ammonia as N	mg/L	2022-04-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-11	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-19	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-04-25	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-02	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-09	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-16	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-24	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-05-30	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-06	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-13	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-20	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-06-27	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-04	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-07-11	<0.02	-
Nitrogen - Ammonia as N	mg/L	2022-07-18	<0.02	<0.02

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Nitrogen - Ammonia as N	mg/L	2022-07-25	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-02	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-08	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-15	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-22	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-08-29	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-06	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-12	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-20	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-09-26	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-03	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-11	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-17	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-24	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-10-31	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-07	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-14	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-21	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-11-28	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-12-05	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-12-12	<0.02	<0.02
Nitrogen - Ammonia as N	mg/L	2022-12-19	<0.02	<0.02
Nitrogen - Nitrate as N	mg/L	2022-01-04	0.08	0.07
Nitrogen - Nitrate as N	mg/L	2022-02-07	0.09	0.08
Nitrogen - Nitrate as N	mg/L	2022-03-07	0.08	0.08
Nitrogen - Nitrate as N	mg/L	2022-04-04	0.08	0.08
Nitrogen - Nitrate as N	mg/L	2022-05-02	0.07	0.07
Nitrogen - Nitrate as N	mg/L	2022-06-06	0.07	0.07
Nitrogen - Nitrate as N	mg/L	2022-07-04	0.06	0.07
Nitrogen - Nitrate as N	mg/L	2022-08-08	0.05	0.06
Nitrogen - Nitrate as N	mg/L	2022-09-12	0.03	0.04
Nitrogen - Nitrate as N	mg/L	2022-11-07	0.11	0.11
Nitrogen - Nitrate as N	mg/L	2022-12-05	0.10	0.10
Nitrogen - Nitrite as N	mg/L	2022-01-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-02-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-03-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-04-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-05-02	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-06-06	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-07-04	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-08-08	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-09-12	<0.01	<0.01

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Nitrogen - Nitrite as N	mg/L	2022-11-07	<0.01	<0.01
Nitrogen - Nitrite as N	mg/L	2022-12-05	<0.01	<0.01
pH	pH units	2022-01-01	7.1	8.3
pH	pH units	2022-01-03	6.5	8.3
pH	pH units	2022-01-04	6.2	7.8
pH	pH units	2022-01-05	7.1	8.1
pH	pH units	2022-01-06	6.8	8.5
pH	pH units	2022-01-07	6.9	8.0
pH	pH units	2022-01-08	6.6	8.4
pH	pH units	2022-01-09	6.6	8.1
pH	pH units	2022-01-10	6.3	8.1
pH	pH units	2022-01-11	6.7	8.4
pH	pH units	2022-01-12	6.2	8.0
pH	pH units	2022-01-13	7.1	8.1
pH	pH units	2022-01-14	6.6	8.3
pH	pH units	2022-01-15	6.7	8.4
pH	pH units	2022-01-16	6.5	8.2
pH	pH units	2022-01-17	6.2	7.7
pH	pH units	2022-01-18	6.5	8.3
pH	pH units	2022-01-19	6.3	8.1
pH	pH units	2022-01-20	6.6	8.3
pH	pH units	2022-01-21	6.6	8.5
pH	pH units	2022-01-22	6.6	8.3
pH	pH units	2022-01-23	6.5	8.4
pH	pH units	2022-01-24	6.4	8.4
pH	pH units	2022-01-25	6.7	8.0
pH	pH units	2022-01-26	6.2	8.2
pH	pH units	2022-01-27	6.5	8.4
pH	pH units	2022-01-28	6.2	8.4
pH	pH units	2022-01-29	6.9	8.4
pH	pH units	2022-01-30	6.5	8.1
pH	pH units	2022-01-31	6.3	8.3
pH	pH units	2022-02-01	6.6	8.3
pH	pH units	2022-02-02	6.8	8.4
pH	pH units	2022-02-03	6.8	8.1
pH	pH units	2022-02-04	6.9	8.5
pH	pH units	2022-02-05	6.7	8.5
pH	pH units	2022-02-06	6.4	8.5
pH	pH units	2022-02-07	6.2	8.3
pH	pH units	2022-02-08	6.5	8.5
pH	pH units	2022-02-09	6.2	8.8
pH	pH units	2022-02-10	6.6	8.7

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
pH	pH units	2022-02-11	6.6	8.3
pH	pH units	2022-02-12	6.7	8.2
pH	pH units	2022-02-13	6.5	8.5
pH	pH units	2022-02-14	6.3	8.5
pH	pH units	2022-02-15	6.3	8.1
pH	pH units	2022-02-16	6.6	8.4
pH	pH units	2022-02-17	6.5	8.5
pH	pH units	2022-02-18	6.2	8.5
pH	pH units	2022-02-19	6.5	8.4
pH	pH units	2022-02-20	6.5	8.6
pH	pH units	2022-02-21	6.5	8.5
pH	pH units	2022-02-22	6.2	7.8
pH	pH units	2022-02-23	6.3	8.5
pH	pH units	2022-02-24	6.6	8.3
pH	pH units	2022-02-25	6.3	8.4
pH	pH units	2022-02-26	6.6	8.4
pH	pH units	2022-02-27	6.5	8.4
pH	pH units	2022-02-28	6.2	7.8
pH	pH units	2022-03-01	6.5	8.5
pH	pH units	2022-03-02	6.6	8.4
pH	pH units	2022-03-03	6.5	8.4
pH	pH units	2022-03-04	6.6	8.4
pH	pH units	2022-03-05	6.5	8.5
pH	pH units	2022-03-06	6.6	8.4
pH	pH units	2022-03-07	6.2	7.7
pH	pH units	2022-03-08	6.6	8.3
pH	pH units	2022-03-09	6.2	8.5
pH	pH units	2022-03-10	6.5	8.4
pH	pH units	2022-03-11	6.6	8.4
pH	pH units	2022-03-12	6.6	8.4
pH	pH units	2022-03-13	6.5	8.3
pH	pH units	2022-03-14	6.3	7.7
pH	pH units	2022-03-15	6.6	8.4
pH	pH units	2022-03-16	6.5	8.0
pH	pH units	2022-03-17	6.5	8.2
pH	pH units	2022-03-18	6.3	8.2
pH	pH units	2022-03-19	6.5	8.5
pH	pH units	2022-03-20	6.5	8.4
pH	pH units	2022-03-21	6.3	8.3
pH	pH units	2022-03-22	6.6	8.4
pH	pH units	2022-03-23	6.6	8.4
pH	pH units	2022-03-24	6.6	8.2

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
pH	pH units	2022-03-25	6.6	8.3
pH	pH units	2022-03-26	6.7	8.5
pH	pH units	2022-03-27	6.6	8.3
pH	pH units	2022-03-28	6.3	8.4
pH	pH units	2022-03-29	6.6	8.4
pH	pH units	2022-03-30	6.8	8.2
pH	pH units	2022-03-31	6.5	8.1
pH	pH units	2022-04-01	6.8	8.6
pH	pH units	2022-04-02	6.7	8.6
pH	pH units	2022-04-03	6.6	8.4
pH	pH units	2022-04-04	6.3	8.2
pH	pH units	2022-04-05	6.7	8.5
pH	pH units	2022-04-06	6.3	8.2
pH	pH units	2022-04-07	6.6	8.2
pH	pH units	2022-04-08	6.3	8.1
pH	pH units	2022-04-09	6.7	8.4
pH	pH units	2022-04-10	6.7	8.1
pH	pH units	2022-04-11	6.4	8.2
pH	pH units	2022-04-12	6.8	8.8
pH	pH units	2022-04-13	6.3	8.4
pH	pH units	2022-04-14	6.5	8.5
pH	pH units	2022-04-15	7.7	8.4
pH	pH units	2022-04-16	6.8	8.2
pH	pH units	2022-04-17	7.2	7.6
pH	pH units	2022-04-18	6.8	8.7
pH	pH units	2022-04-19	6.6	7.8
pH	pH units	2022-04-20	6.5	8.3
pH	pH units	2022-04-21	6.8	8.4
pH	pH units	2022-04-22	6.8	8.8
pH	pH units	2022-04-23	6.9	8.6
pH	pH units	2022-04-24	7.6	8.0
pH	pH units	2022-04-25	6.3	7.8
pH	pH units	2022-04-26	6.8	8.4
pH	pH units	2022-04-27	6.6	8.5
pH	pH units	2022-04-28	6.8	8.6
pH	pH units	2022-04-29	6.2	8.3
pH	pH units	2022-04-30	6.8	8.6
pH	pH units	2022-05-01	7.0	8.4
pH	pH units	2022-05-02	6.4	9.0
pH	pH units	2022-05-03	6.3	8.6
pH	pH units	2022-05-04	6.3	8.3
pH	pH units	2022-05-05	6.7	8.7

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
pH	pH units	2022-05-06	6.4	8.3
pH	pH units	2022-05-07	6.2	8.3
pH	pH units	2022-05-08	6.6	8.4
pH	pH units	2022-05-09	6.3	7.8
pH	pH units	2022-05-10	6.4	8.3
pH	pH units	2022-05-11	6.4	8.6
pH	pH units	2022-05-12	6.5	8.5
pH	pH units	2022-05-13	6.3	8.5
pH	pH units	2022-05-14	6.4	8.3
pH	pH units	2022-05-15	6.7	8.2
pH	pH units	2022-05-16	6.3	8.4
pH	pH units	2022-05-17	6.5	8.3
pH	pH units	2022-05-18	6.4	8.2
pH	pH units	2022-05-19	6.3	8.5
pH	pH units	2022-05-20	6.3	8.3
pH	pH units	2022-05-21	6.6	8.4
pH	pH units	2022-05-22	6.7	8.4
pH	pH units	2022-05-23	6.6	8.3
pH	pH units	2022-05-24	6.3	7.8
pH	pH units	2022-05-25	6.8	8.5
pH	pH units	2022-05-26	6.4	8.3
pH	pH units	2022-05-27	6.3	8.4
pH	pH units	2022-05-28	6.5	8.1
pH	pH units	2022-05-29	6.6	8.2
pH	pH units	2022-05-30	6.4	7.7
pH	pH units	2022-05-31	6.8	8.2
pH	pH units	2022-06-01	6.4	8.2
pH	pH units	2022-06-02	6.4	8.2
pH	pH units	2022-06-03	6.4	8.2
pH	pH units	2022-06-04	6.6	8.2
pH	pH units	2022-06-05	6.6	8.1
pH	pH units	2022-06-06	6.3	7.7
pH	pH units	2022-06-07	6.4	8.8
pH	pH units	2022-06-08	6.3	8.1
pH	pH units	2022-06-09	6.4	8.1
pH	pH units	2022-06-10	6.3	8.6
pH	pH units	2022-06-12	6.6	8.1
pH	pH units	2022-06-13	6.3	8.5
pH	pH units	2022-06-14	6.9	8.9
pH	pH units	2022-06-15	6.4	8.4
pH	pH units	2022-06-16	6.8	8.4
pH	pH units	2022-06-17	6.8	8.4

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
pH	pH units	2022-06-18	6.6	8.2
pH	pH units	2022-06-19	6.7	8.1
pH	pH units	2022-06-20	6.3	8.2
pH	pH units	2022-06-21	6.9	8.2
pH	pH units	2022-06-22	6.3	8.2
pH	pH units	2022-06-23	6.4	8.2
pH	pH units	2022-06-24	6.4	8.5
pH	pH units	2022-06-25	6.8	8.1
pH	pH units	2022-06-26	6.8	8.1
pH	pH units	2022-06-27	6.4	8.4
pH	pH units	2022-06-28	6.3	8.2
pH	pH units	2022-06-29	6.3	8.1
pH	pH units	2022-06-30	6.8	8.4
pH	pH units	2022-07-01	6.8	8.1
pH	pH units	2022-07-02	6.8	8.1
pH	pH units	2022-07-03	6.9	8.2
pH	pH units	2022-07-04	6.3	8.2
pH	pH units	2022-07-05	6.4	8.3
pH	pH units	2022-07-06	6.3	8.4
pH	pH units	2022-07-07	6.3	8.4
pH	pH units	2022-07-08	6.4	8.4
pH	pH units	2022-07-09	6.8	8.3
pH	pH units	2022-07-10	6.7	8.3
pH	pH units	2022-07-11	6.3	8.1
pH	pH units	2022-07-12	6.3	8.3
pH	pH units	2022-07-13	6.7	9.0
pH	pH units	2022-07-14	6.4	8.3
pH	pH units	2022-07-15	6.4	8.8
pH	pH units	2022-07-16	6.8	8.0
pH	pH units	2022-07-17	6.8	8.0
pH	pH units	2022-07-18	6.3	7.7
pH	pH units	2022-07-19	6.4	8.1
pH	pH units	2022-07-20	6.3	8.1
pH	pH units	2022-07-21	6.7	8.5
pH	pH units	2022-07-22	6.4	8.2
pH	pH units	2022-07-23	6.8	8.3
pH	pH units	2022-07-24	6.9	8.4
pH	pH units	2022-07-25	6.3	7.9
pH	pH units	2022-07-26	6.5	9.0
pH	pH units	2022-07-27	6.7	8.3
pH	pH units	2022-07-28	6.4	8.2
pH	pH units	2022-07-29	6.9	8.9

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
pH	pH units	2022-07-30	6.9	8.5
pH	pH units	2022-07-31	7.3	8.1
pH	pH units	2022-08-01	7.0	8.1
pH	pH units	2022-08-02	6.4	8.1
pH	pH units	2022-08-03	6.4	8.1
pH	pH units	2022-08-04	6.7	8.0
pH	pH units	2022-08-05	6.3	8.4
pH	pH units	2022-08-06	6.7	8.3
pH	pH units	2022-08-07	6.8	8.2
pH	pH units	2022-08-08	6.3	8.3
pH	pH units	2022-08-09	6.7	8.3
pH	pH units	2022-08-10	6.8	8.3
pH	pH units	2022-08-11	6.8	8.8
pH	pH units	2022-08-12	6.7	8.4
pH	pH units	2022-08-13	6.9	8.4
pH	pH units	2022-08-14	6.8	8.3
pH	pH units	2022-08-15	6.4	7.9
pH	pH units	2022-08-16	6.3	8.3
pH	pH units	2022-08-17	6.4	8.4
pH	pH units	2022-08-18	6.3	8.2
pH	pH units	2022-08-19	6.8	8.7
pH	pH units	2022-08-20	6.9	8.2
pH	pH units	2022-08-21	7.0	8.4
pH	pH units	2022-08-22	6.4	7.9
pH	pH units	2022-08-23	6.8	8.3
pH	pH units	2022-08-24	6.4	7.8
pH	pH units	2022-08-25	6.8	8.2
pH	pH units	2022-08-26	6.7	8.5
pH	pH units	2022-08-27	7.2	8.1
pH	pH units	2022-08-28	7.1	8.0
pH	pH units	2022-08-29	6.4	8.1
pH	pH units	2022-08-30	6.4	8.1
pH	pH units	2022-08-31	6.4	8.1
pH	pH units	2022-09-01	7.0	8.0
pH	pH units	2022-09-02	7.2	8.1
pH	pH units	2022-09-03	6.9	8.2
pH	pH units	2022-09-04	7.3	8.2
pH	pH units	2022-09-05	7.2	8.2
pH	pH units	2022-09-06	6.4	8.1
pH	pH units	2022-09-07	6.7	8.2
pH	pH units	2022-09-08	6.8	8.0
pH	pH units	2022-09-09	6.7	8.0

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
pH	pH units	2022-09-10	7.3	8.1
pH	pH units	2022-09-11	7.3	8.1
pH	pH units	2022-09-12	6.4	7.7
pH	pH units	2022-09-13	6.8	8.2
pH	pH units	2022-09-14	6.8	8.2
pH	pH units	2022-09-15	6.5	8.1
pH	pH units	2022-09-16	6.8	8.2
pH	pH units	2022-09-17	7.2	8.2
pH	pH units	2022-09-18	7.3	8.2
pH	pH units	2022-09-19	7.3	8.5
pH	pH units	2022-09-20	6.4	7.9
pH	pH units	2022-09-21	6.5	8.4
pH	pH units	2022-09-22	6.5	8.4
pH	pH units	2022-09-24	7.3	8.5
pH	pH units	2022-09-25	7.4	7.6
pH	pH units	2022-09-26	6.5	8.4
pH	pH units	2022-09-27	6.5	8.4
pH	pH units	2022-09-28	6.4	8.2
pH	pH units	2022-09-29	6.5	8.2
pH	pH units	2022-09-30	7.4	8.6
pH	pH units	2022-10-01	7.3	8.4
pH	pH units	2022-10-02	7.4	8.4
pH	pH units	2022-10-03	7.0	8.2
pH	pH units	2022-10-04	7.0	8.2
pH	pH units	2022-10-05	6.5	8.3
pH	pH units	2022-10-06	6.9	8.2
pH	pH units	2022-10-07	6.4	8.3
pH	pH units	2022-10-08	7.4	8.4
pH	pH units	2022-10-09	7.5	8.5
pH	pH units	2022-10-10	7.4	8.5
pH	pH units	2022-10-11	6.4	8.3
pH	pH units	2022-10-12	6.9	8.3
pH	pH units	2022-10-13	6.4	8.3
pH	pH units	2022-10-14	7.0	8.4
pH	pH units	2022-10-15	7.1	8.5
pH	pH units	2022-10-16	6.9	8.3
pH	pH units	2022-10-17	6.4	8.3
pH	pH units	2022-10-18	6.8	8.5
pH	pH units	2022-10-19	6.3	8.4
pH	pH units	2022-10-20	6.9	8.3
pH	pH units	2022-10-21	6.5	8.2
pH	pH units	2022-10-22	7.1	8.4

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
pH	pH units	2022-10-23	7.4	8.3
pH	pH units	2022-10-24	6.5	8.2
pH	pH units	2022-10-25	6.4	8.5
pH	pH units	2022-10-26	6.6	8.2
pH	pH units	2022-10-27	6.6	8.2
pH	pH units	2022-10-28	6.9	8.2
pH	pH units	2022-10-29	7.3	8.4
pH	pH units	2022-10-30	7.4	8.3
pH	pH units	2022-10-31	6.3	8.1
pH	pH units	2022-11-01	6.9	8.2
pH	pH units	2022-11-02	6.3	7.8
pH	pH units	2022-11-03	6.9	8.4
pH	pH units	2022-11-04	6.4	8.4
pH	pH units	2022-11-05	-	8.7
pH	pH units	2022-11-06	7.4	7.9
pH	pH units	2022-11-07	6.5	7.9
pH	pH units	2022-11-08	6.5	8.5
pH	pH units	2022-11-09	6.4	8.4
pH	pH units	2022-11-10	6.5	8.2
pH	pH units	2022-11-11	6.7	7.3
pH	pH units	2022-11-12	6.0	8.4
pH	pH units	2022-11-13	6.7	8.3
pH	pH units	2022-11-14	6.4	8.6
pH	pH units	2022-11-15	6.5	8.4
pH	pH units	2022-11-16	6.9	8.8
pH	pH units	2022-11-17	6.7	8.5
pH	pH units	2022-11-18	6.8	8.2
pH	pH units	2022-11-19	-	8.6
pH	pH units	2022-11-20	7.4	8.4
pH	pH units	2022-11-21	6.4	8.5
pH	pH units	2022-11-22	6.8	8.5
pH	pH units	2022-11-23	6.7	8.3
pH	pH units	2022-11-24	6.7	8.2
pH	pH units	2022-11-25	6.4	8.1
pH	pH units	2022-11-26	7.4	8.6
pH	pH units	2022-11-27	6.6	8.3
pH	pH units	2022-11-28	6.3	7.7
pH	pH units	2022-11-29	6.8	8.2
pH	pH units	2022-11-30	6.8	8.4
pH	pH units	2022-12-01	6.0	8.3
pH	pH units	2022-12-02	6.8	8.4
pH	pH units	2022-12-03	6.8	8.4

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
pH	pH units	2022-12-04	7.5	8.3
pH	pH units	2022-12-05	6.4	8.3
pH	pH units	2022-12-06	6.4	8.1
pH	pH units	2022-12-07	6.4	8.4
pH	pH units	2022-12-08	6.4	8.4
pH	pH units	2022-12-09	6.4	8.3
pH	pH units	2022-12-10	7.5	8.2
pH	pH units	2022-12-11	7.3	8.2
pH	pH units	2022-12-12	6.5	7.7
pH	pH units	2022-12-13	6.7	8.4
pH	pH units	2022-12-14	6.6	8.4
pH	pH units	2022-12-15	6.9	8.2
pH	pH units	2022-12-16	6.4	8.4
pH	pH units	2022-12-17	7.3	8.5
pH	pH units	2022-12-18	-	8.2
pH	pH units	2022-12-19	6.8	8.2
pH	pH units	2022-12-20	6.5	8.2
pH	pH units	2022-12-21	6.4	8.4
pH	pH units	2022-12-22	-	8.4
pH	pH units	2022-12-23	-	8.3
pH	pH units	2022-12-24	7.0	8.5
pH	pH units	2022-12-26	6.6	8.6
pH	pH units	2022-12-27	5.8	8.4
pH	pH units	2022-12-28	6.3	8.2
pH	pH units	2022-12-29	7.3	8.2
pH	pH units	2022-12-30	6.3	8.2
pH	pH units	2022-12-31	7.4	8.1
Phenol	mg/L	2022-05-02	<0.005	<0.005
Phenol	mg/L	2022-11-07	<0.005	<0.005
Phosphorus Dissolved	µg/L	2022-01-04	<10	<10
Phosphorus Dissolved	µg/L	2022-02-14	<10	<10
Phosphorus Dissolved	µg/L	2022-03-07	<10	<10
Phosphorus Dissolved	µg/L	2022-04-04	<10	<10
Phosphorus Dissolved	µg/L	2022-05-02	<10	<10
Phosphorus Dissolved	µg/L	2022-06-06	<10	<10
Phosphorus Dissolved	µg/L	2022-07-04	<10	<10
Phosphorus Dissolved	µg/L	2022-08-08	<10	<10
Phosphorus Dissolved	µg/L	2022-09-12	<10	<10
Phosphorus Dissolved	µg/L	2022-11-07	<10	<10
Phosphorus Dissolved	µg/L	2022-12-05	<10	<10
Phosphorus Total	µg/L	2022-01-04	<10	<10
Phosphorus Total	mg/L	2022-02-07	<0.005	<0.005

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Phosphorus Total	µg/L	2022-02-07	<10	<10
Phosphorus Total	µg/L	2022-02-14	<10	<10
Phosphorus Total	µg/L	2022-03-07	<10	<10
Phosphorus Total	µg/L	2022-04-04	<10	<10
Phosphorus Total	µg/L	2022-05-02	<10	<10
Phosphorus Total	µg/L	2022-06-06	<10	<10
Phosphorus Total	µg/L	2022-07-04	<10	11
Phosphorus Total	µg/L	2022-08-08	<10	<10
Phosphorus Total	µg/L	2022-09-12	<10	<10
Phosphorus Total	µg/L	2022-11-07	<10	<10
Phosphorus Total	µg/L	2022-12-05	<10	<10
Potassium Total	µg/L	2022-05-02	106	106
Potassium Total	µg/L	2022-05-04	102	102
Potassium Total	µg/L	2022-11-07	245	234
Potassium Total	µg/L	2022-11-08	134	133
Reactive Phosphorus	mg/L	2022-02-07	<0.005	<0.005
Residue Total	mg/L	2022-02-07	12	33
Residue Total	mg/L	2022-04-04	11	35
Residue Total	mg/L	2022-05-02	14	37
Residue Total	mg/L	2022-07-04	13	34
Residue Total	mg/L	2022-09-12	10	34
Residue Total	mg/L	2022-11-07	13	37
Residue Total Dissolved	mg/L	2022-02-07	10	30
Residue Total Dissolved	mg/L	2022-04-04	9	30
Residue Total Dissolved	mg/L	2022-05-02	12	34
Residue Total Dissolved	mg/L	2022-07-04	9	32
Residue Total Dissolved	mg/L	2022-09-12	7	31
Residue Total Dissolved	mg/L	2022-11-07	9	32
Residue Total Fixed	mg/L	2022-02-07	8	24
Residue Total Fixed	mg/L	2022-04-04	7	24
Residue Total Fixed	mg/L	2022-05-02	7	24
Residue Total Fixed	mg/L	2022-07-04	5	20
Residue Total Fixed	mg/L	2022-09-12	4	22
Residue Total Fixed	mg/L	2022-11-07	6	24
Residue Total Volatile	mg/L	2022-02-07	4	9
Residue Total Volatile	mg/L	2022-04-04	4	10
Residue Total Volatile	mg/L	2022-05-02	7	13
Residue Total Volatile	mg/L	2022-07-04	7	14
Residue Total Volatile	mg/L	2022-09-12	6	12
Residue Total Volatile	mg/L	2022-11-07	7	13
Selenium Total	µg/L	2022-05-02	<0.5	<0.5
Selenium Total	µg/L	2022-05-04	<0.5	<0.5

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Selenium Total	µg/L	2022-11-07	<0.5	<0.5
Selenium Total	µg/L	2022-11-08	<0.5	<0.5
Silica as SiO ₂	mg/L	2022-02-07	2.5	2.5
Silica as SiO ₂	mg/L	2022-04-04	2.4	2.4
Silica as SiO ₂	mg/L	2022-05-02	2.5	2.5
Silica as SiO ₂	mg/L	2022-07-04	2.3	2.3
Silica as SiO ₂	mg/L	2022-09-12	2.2	2.2
Silica as SiO ₂	mg/L	2022-11-07	2.4	2.4
Silver Total	µg/L	2022-05-02	<0.5	<0.5
Silver Total	µg/L	2022-05-04	<0.5	<0.5
Silver Total	µg/L	2022-11-07	<0.5	<0.5
Silver Total	µg/L	2022-11-08	<0.5	<0.5
Sodium Total	µg/L	2022-02-07	436	9,000
Sodium Total	µg/L	2022-02-14	452	10,400
Sodium Total	µg/L	2022-02-15	476	11,100
Sodium Total	µg/L	2022-04-04	444	10,800
Sodium Total	µg/L	2022-05-02	429	10,200
Sodium Total	µg/L	2022-05-04	451	9,810
Sodium Total	µg/L	2022-05-10	466	10,000
Sodium Total	µg/L	2022-07-04	398	10,100
Sodium Total	µg/L	2022-08-23	377	-
Sodium Total	µg/L	2022-08-24	-	10,700
Sodium Total	µg/L	2022-09-12	393	9,860
Sodium Total	µg/L	2022-11-07	516	10,800
Sodium Total	µg/L	2022-11-08	505	10,700
Sodium Total	µg/L	2022-11-15	482	10,100
Strontium Total	µg/L	2022-05-02	3.5	-
Strontium Total	µg/L	2022-11-07	7.3	-
Sulphate	mg/L	2022-01-04	0.5	0.5
Sulphate	mg/L	2022-02-07	0.5	0.5
Sulphate	mg/L	2022-03-07	0.5	0.6
Sulphate	mg/L	2022-04-04	<0.5	<0.5
Sulphate	mg/L	2022-05-02	0.5	0.5
Sulphate	mg/L	2022-06-06	0.5	0.5
Sulphate	mg/L	2022-07-04	<0.5	<0.5
Sulphate	mg/L	2022-08-08	<0.5	<0.5
Sulphate	mg/L	2022-09-12	<0.5	<0.5
Sulphate	mg/L	2022-11-07	0.5	0.5
Sulphate	mg/L	2022-12-05	<0.5	<0.5
Temperature	°C	2022-01-01	1.7	3.3
Temperature	°C	2022-01-02	4	4
Temperature	°C	2022-01-03	4.0	3.8

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-01-04	4	4
Temperature	°C	2022-01-05	4.4	3.7
Temperature	°C	2022-01-06	3.6	3.4
Temperature	°C	2022-01-07	2.9	3.0
Temperature	°C	2022-01-08	3.4	3.4
Temperature	°C	2022-01-09	3.5	3.5
Temperature	°C	2022-01-10	4	4
Temperature	°C	2022-01-11	3.6	3.6
Temperature	°C	2022-01-12	3.8	3.9
Temperature	°C	2022-01-13	3.6	3.8
Temperature	°C	2022-01-14	3.8	3.8
Temperature	°C	2022-01-15	3.4	4.7
Temperature	°C	2022-01-16	4.2	4.3
Temperature	°C	2022-01-17	4	4
Temperature	°C	2022-01-18	4.5	4.6
Temperature	°C	2022-01-19	4.2	4.4
Temperature	°C	2022-01-20	4.4	4.6
Temperature	°C	2022-01-21	4.2	4.8
Temperature	°C	2022-01-22	4.3	4.7
Temperature	°C	2022-01-23	4.5	4.7
Temperature	°C	2022-01-24	5	4.7
Temperature	°C	2022-01-25	4.3	4.5
Temperature	°C	2022-01-26	4.5	4.6
Temperature	°C	2022-01-27	4.2	4.4
Temperature	°C	2022-01-28	4.2	4.5
Temperature	°C	2022-01-29	4.2	4.5
Temperature	°C	2022-01-30	4.4	4.5
Temperature	°C	2022-01-31	4.0	4
Temperature	°C	2022-02-01	4.0	4.1
Temperature	°C	2022-02-02	4.0	4.0
Temperature	°C	2022-02-03	4.0	4.1
Temperature	°C	2022-02-04	4.0	4.2
Temperature	°C	2022-02-05	4.2	4.3
Temperature	°C	2022-02-06	4.3	4.5
Temperature	°C	2022-02-07	4	5
Temperature	°C	2022-02-08	4.2	4.4
Temperature	°C	2022-02-09	4.5	4.7
Temperature	°C	2022-02-10	4.7	4.9
Temperature	°C	2022-02-11	4.4	4.7
Temperature	°C	2022-02-12	4.2	4.5
Temperature	°C	2022-02-13	4.4	4.6
Temperature	°C	2022-02-14	5	4.7

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-02-15	4.5	4.8
Temperature	°C	2022-02-16	4.5	4.9
Temperature	°C	2022-02-17	5	5
Temperature	°C	2022-02-18	4.6	5.1
Temperature	°C	2022-02-19	4.8	5.1
Temperature	°C	2022-02-20	4.1	5.0
Temperature	°C	2022-02-21	5	5
Temperature	°C	2022-02-22	4	5
Temperature	°C	2022-02-23	4.1	4.2
Temperature	°C	2022-02-24	4.1	4.2
Temperature	°C	2022-02-25	4.1	4.2
Temperature	°C	2022-02-26	4.0	4.2
Temperature	°C	2022-02-27	4.0	4.3
Temperature	°C	2022-02-28	4	5
Temperature	°C	2022-03-01	4.2	4.5
Temperature	°C	2022-03-02	4.3	4.7
Temperature	°C	2022-03-03	4.5	4.9
Temperature	°C	2022-03-04	4.5	5.0
Temperature	°C	2022-03-05	4.9	5.1
Temperature	°C	2022-03-06	4.6	4.9
Temperature	°C	2022-03-07	5	4.9
Temperature	°C	2022-03-08	4.9	5.3
Temperature	°C	2022-03-09	4.8	5.1
Temperature	°C	2022-03-10	5.0	5.3
Temperature	°C	2022-03-11	5.0	5.3
Temperature	°C	2022-03-12	4.9	5.4
Temperature	°C	2022-03-13	5.0	5.4
Temperature	°C	2022-03-14	5	6
Temperature	°C	2022-03-15	4.8	5.4
Temperature	°C	2022-03-16	4.9	5.3
Temperature	°C	2022-03-17	5.0	5.3
Temperature	°C	2022-03-18	5.0	5.3
Temperature	°C	2022-03-19	5.0	5.5
Temperature	°C	2022-03-20	5.0	5.5
Temperature	°C	2022-03-21	5	5.3
Temperature	°C	2022-03-22	4.9	5.3
Temperature	°C	2022-03-23	5.0	5.6
Temperature	°C	2022-03-24	4.9	5.3
Temperature	°C	2022-03-25	5.3	5.3
Temperature	°C	2022-03-26	5.6	5.9
Temperature	°C	2022-03-27	5.7	6.2
Temperature	°C	2022-03-28	6	6.2

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-03-29	5.5	6.1
Temperature	°C	2022-03-30	4.9	5.7
Temperature	°C	2022-03-31	4.9	5.6
Temperature	°C	2022-04-01	4.9	5.5
Temperature	°C	2022-04-02	5.3	6.0
Temperature	°C	2022-04-03	6.0	6.5
Temperature	°C	2022-04-04	5	6
Temperature	°C	2022-04-05	4.6	5.0
Temperature	°C	2022-04-06	5.0	5.4
Temperature	°C	2022-04-07	4.9	5.7
Temperature	°C	2022-04-08	5.0	6.0
Temperature	°C	2022-04-09	4.9	5.6
Temperature	°C	2022-04-10	4.9	5.7
Temperature	°C	2022-04-11	5	5.5
Temperature	°C	2022-04-12	5.3	6.0
Temperature	°C	2022-04-13	5.5	6.1
Temperature	°C	2022-04-14	5.5	6.1
Temperature	°C	2022-04-15	5.5	6.0
Temperature	°C	2022-04-16	5.5	6.0
Temperature	°C	2022-04-17	5.3	5.9
Temperature	°C	2022-04-18	5.7	6.3
Temperature	°C	2022-04-19	6	6.3
Temperature	°C	2022-04-20	5.5	6.0
Temperature	°C	2022-04-21	5.6	6.7
Temperature	°C	2022-04-22	5.9	6.5
Temperature	°C	2022-04-23	5.9	6.5
Temperature	°C	2022-04-24	5.8	6.5
Temperature	°C	2022-04-25	5.8	7.0
Temperature	°C	2022-04-26	5.4	6.4
Temperature	°C	2022-04-27	5.9	6.5
Temperature	°C	2022-04-28	6.5	7.2
Temperature	°C	2022-04-29	5.9	6.8
Temperature	°C	2022-04-30	6.0	6.9
Temperature	°C	2022-05-01	6.3	7.2
Temperature	°C	2022-05-02	7	7.5
Temperature	°C	2022-05-03	6.4	7.3
Temperature	°C	2022-05-04	5.5	6.7
Temperature	°C	2022-05-05	7.3	7.9
Temperature	°C	2022-05-06	6.2	7.3
Temperature	°C	2022-05-07	5.5	6.5
Temperature	°C	2022-05-08	5.3	6.4
Temperature	°C	2022-05-09	7	7

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-05-10	6.6	7.5
Temperature	°C	2022-05-11	7.0	7.7
Temperature	°C	2022-05-12	7.9	8.4
Temperature	°C	2022-05-13	5.6	6.9
Temperature	°C	2022-05-14	6.8	7.5
Temperature	°C	2022-05-15	7.8	8.7
Temperature	°C	2022-05-16	6.7	8.4
Temperature	°C	2022-05-17	5.5	6.8
Temperature	°C	2022-05-18	7.2	8.0
Temperature	°C	2022-05-19	5.7	7.3
Temperature	°C	2022-05-20	6.0	7.1
Temperature	°C	2022-05-21	6.3	7.5
Temperature	°C	2022-05-22	6.0	7.4
Temperature	°C	2022-05-23	6.7	8.2
Temperature	°C	2022-05-24	7	9
Temperature	°C	2022-05-25	7.1	8.5
Temperature	°C	2022-05-26	7.7	9.2
Temperature	°C	2022-05-27	6.8	9.3
Temperature	°C	2022-05-28	6.6	8.2
Temperature	°C	2022-05-29	7.4	9.0
Temperature	°C	2022-05-30	8	9
Temperature	°C	2022-05-31	7.6	8.9
Temperature	°C	2022-06-01	7.8	9.1
Temperature	°C	2022-06-02	8.1	9.9
Temperature	°C	2022-06-03	7.8	9.7
Temperature	°C	2022-06-04	7.7	9.8
Temperature	°C	2022-06-05	7.9	10.2
Temperature	°C	2022-06-06	7	9.3
Temperature	°C	2022-06-07	8.4	9.6
Temperature	°C	2022-06-08	8.0	10
Temperature	°C	2022-06-09	7.8	9.5
Temperature	°C	2022-06-10	7.4	9.3
Temperature	°C	2022-06-11	8	9
Temperature	°C	2022-06-12	8.0	9.9
Temperature	°C	2022-06-13	7.2	9
Temperature	°C	2022-06-14	8.7	9.3
Temperature	°C	2022-06-15	7.6	9.3
Temperature	°C	2022-06-16	7.0	9.0
Temperature	°C	2022-06-17	7.3	9.0
Temperature	°C	2022-06-18	7.3	9.4
Temperature	°C	2022-06-19	8.0	9.9
Temperature	°C	2022-06-20	8	9

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-06-21	7.6	9.5
Temperature	°C	2022-06-22	7.4	9.6
Temperature	°C	2022-06-23	8.1	9.5
Temperature	°C	2022-06-24	8.7	10.1
Temperature	°C	2022-06-25	7.8	9.7
Temperature	°C	2022-06-26	7.8	10.1
Temperature	°C	2022-06-27	7.9	10.5
Temperature	°C	2022-06-28	7.6	10.5
Temperature	°C	2022-06-29	8.7	11.2
Temperature	°C	2022-06-30	8.1	10.4
Temperature	°C	2022-07-01	8.0	10.2
Temperature	°C	2022-07-02	8.7	10.8
Temperature	°C	2022-07-03	8.2	11.0
Temperature	°C	2022-07-04	8	10.5
Temperature	°C	2022-07-05	8.5	10.6
Temperature	°C	2022-07-06	7.8	10.5
Temperature	°C	2022-07-07	8.0	10.7
Temperature	°C	2022-07-08	9.1	11.5
Temperature	°C	2022-07-09	7.8	10.5
Temperature	°C	2022-07-10	8.4	11.0
Temperature	°C	2022-07-11	10	11.6
Temperature	°C	2022-07-12	8.7	11.2
Temperature	°C	2022-07-13	9.9	12.0
Temperature	°C	2022-07-14	11.0	12.8
Temperature	°C	2022-07-15	10.7	12.5
Temperature	°C	2022-07-16	9.1	12.0
Temperature	°C	2022-07-17	9.5	11.7
Temperature	°C	2022-07-18	10	12
Temperature	°C	2022-07-19	10.4	12.0
Temperature	°C	2022-07-20	10.5	12.2
Temperature	°C	2022-07-21	10.0	13.0
Temperature	°C	2022-07-22	10.2	12.6
Temperature	°C	2022-07-23	11.1	12.9
Temperature	°C	2022-07-24	12.0	13.7
Temperature	°C	2022-07-25	10	13
Temperature	°C	2022-07-26	10.0	13.5
Temperature	°C	2022-07-27	10.0	13.5
Temperature	°C	2022-07-28	11.7	14.0
Temperature	°C	2022-07-29	10.2	13.4
Temperature	°C	2022-07-30	10.7	14.1
Temperature	°C	2022-07-31	11.5	14.0
Temperature	°C	2022-08-01	10.9	13.7

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-08-02	11.7	11
Temperature	°C	2022-08-03	11.1	14.1
Temperature	°C	2022-08-04	10.3	13.2
Temperature	°C	2022-08-05	10.0	12.7
Temperature	°C	2022-08-06	11.3	13.4
Temperature	°C	2022-08-07	12.1	13.9
Temperature	°C	2022-08-08	11	13.3
Temperature	°C	2022-08-09	11.0	13.7
Temperature	°C	2022-08-10	11.0	13.4
Temperature	°C	2022-08-11	13.0	14.3
Temperature	°C	2022-08-12	11.5	13.5
Temperature	°C	2022-08-13	12.2	14.0
Temperature	°C	2022-08-14	11.8	13.6
Temperature	°C	2022-08-15	13	14.0
Temperature	°C	2022-08-16	11.7	14.0
Temperature	°C	2022-08-17	12.8	14.5
Temperature	°C	2022-08-18	11.7	14.1
Temperature	°C	2022-08-19	12.7	15.1
Temperature	°C	2022-08-20	12.3	14.4
Temperature	°C	2022-08-21	13.0	15.0
Temperature	°C	2022-08-22	12	14.2
Temperature	°C	2022-08-23	12.7	14.5
Temperature	°C	2022-08-24	11.7	14.0
Temperature	°C	2022-08-25	13.0	14.9
Temperature	°C	2022-08-26	13.0	14.8
Temperature	°C	2022-08-27	13.0	14.5
Temperature	°C	2022-08-28	13.4	14.5
Temperature	°C	2022-08-29	12.8	14.4
Temperature	°C	2022-08-30	13.2	14.8
Temperature	°C	2022-08-31	13.5	14.9
Temperature	°C	2022-09-01	13.8	15.2
Temperature	°C	2022-09-02	13.3	15.1
Temperature	°C	2022-09-03	12.9	14.5
Temperature	°C	2022-09-04	14.0	15.1
Temperature	°C	2022-09-05	13.2	14.5
Temperature	°C	2022-09-06	14.1	14.9
Temperature	°C	2022-09-07	13.9	14.7
Temperature	°C	2022-09-08	14.1	14.8
Temperature	°C	2022-09-09	14.2	14.9
Temperature	°C	2022-09-10	14.4	15.0
Temperature	°C	2022-09-11	13.7	14.6
Temperature	°C	2022-09-12	14.0	15

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-09-13	13.5	14.5
Temperature	°C	2022-09-14	14.4	15.2
Temperature	°C	2022-09-15	13.3	14.2
Temperature	°C	2022-09-16	14.3	14.6
Temperature	°C	2022-09-17	14.0	14.4
Temperature	°C	2022-09-18	14.2	14.5
Temperature	°C	2022-09-19	13.5	14.0
Temperature	°C	2022-09-20	14	14.6
Temperature	°C	2022-09-21	14.1	14.7
Temperature	°C	2022-09-22	14.2	14.6
Temperature	°C	2022-09-23	14	15
Temperature	°C	2022-09-24	13.8	14.3
Temperature	°C	2022-09-25	15.0	15.1
Temperature	°C	2022-09-26	14.5	14.6
Temperature	°C	2022-09-27	14.5	14.8
Temperature	°C	2022-09-28	14.2	1.49
Temperature	°C	2022-09-29	14.8	15
Temperature	°C	2022-09-30	14.3	15.0
Temperature	°C	2022-10-01	14.3	14.8
Temperature	°C	2022-10-02	14.5	14.9
Temperature	°C	2022-10-03	14.7	15.0
Temperature	°C	2022-10-04	14.9	15.1
Temperature	°C	2022-10-05	15.1	15.2
Temperature	°C	2022-10-06	14.8	14.9
Temperature	°C	2022-10-07	15.0	15.3
Temperature	°C	2022-10-08	14.8	15.0
Temperature	°C	2022-10-09	15.0	15.1
Temperature	°C	2022-10-10	14.9	15.1
Temperature	°C	2022-10-11	15	15.0
Temperature	°C	2022-10-12	15.	15.1
Temperature	°C	2022-10-13	14.9	14.5
Temperature	°C	2022-10-14	14.5	14.5
Temperature	°C	2022-10-15	14.5	14.5
Temperature	°C	2022-10-16	14.5	14.5
Temperature	°C	2022-10-17	14	14
Temperature	°C	2022-10-18	14.5	14.3
Temperature	°C	2022-10-19	14.3	14.2
Temperature	°C	2022-10-20	14.3	14.0
Temperature	°C	2022-10-21	14.7	14.4
Temperature	°C	2022-10-22	14.0	13.8
Temperature	°C	2022-10-23	13.4	13.5
Temperature	°C	2022-10-24	13.3	12.6

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-10-25	12.1	12.0
Temperature	°C	2022-10-26	13	13
Temperature	°C	2022-10-27	13	12
Temperature	°C	2022-10-28	10	10
Temperature	°C	2022-10-29	10	10
Temperature	°C	2022-10-30	11	11
Temperature	°C	2022-10-31	10	11
Temperature	°C	2022-11-01	10	10
Temperature	°C	2022-11-02	11	10
Temperature	°C	2022-11-03	10	10
Temperature	°C	2022-11-04	10	9
Temperature	°C	2022-11-05	-	8
Temperature	°C	2022-11-06	9	9
Temperature	°C	2022-11-07	9	8
Temperature	°C	2022-11-08	9	8
Temperature	°C	2022-11-09	8	8
Temperature	°C	2022-11-10	8	8
Temperature	°C	2022-11-11	8	8
Temperature	°C	2022-11-12	8	8
Temperature	°C	2022-11-13	8	8
Temperature	°C	2022-11-14	8	8
Temperature	°C	2022-11-15	8	8
Temperature	°C	2022-11-16	8	7
Temperature	°C	2022-11-17	8	8
Temperature	°C	2022-11-18	7	7
Temperature	°C	2022-11-19	-	7
Temperature	°C	2022-11-20	7	7
Temperature	°C	2022-11-21	7	7
Temperature	°C	2022-11-22	7	7
Temperature	°C	2022-11-23	7	7
Temperature	°C	2022-11-24	8	7
Temperature	°C	2022-11-25	8	7
Temperature	°C	2022-11-26	7	7
Temperature	°C	2022-11-27	7	7
Temperature	°C	2022-11-28	7	6
Temperature	°C	2022-11-29	6	6
Temperature	°C	2022-11-30	6	6
Temperature	°C	2022-12-01	6	5
Temperature	°C	2022-12-02	6	5
Temperature	°C	2022-12-03	6	5
Temperature	°C	2022-12-04	5	5
Temperature	°C	2022-12-05	6	5

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Temperature	°C	2022-12-06	5	5
Temperature	°C	2022-12-07	6	5
Temperature	°C	2022-12-08	6	5
Temperature	°C	2022-12-09	6	5
Temperature	°C	2022-12-10	5	5
Temperature	°C	2022-12-11	6	5
Temperature	°C	2022-12-12	5	5
Temperature	°C	2022-12-13	5	5
Temperature	°C	2022-12-14	5	5
Temperature	°C	2022-12-15	5	5
Temperature	°C	2022-12-16	5	5
Temperature	°C	2022-12-17	5	5
Temperature	°C	2022-12-18	-	5
Temperature	°C	2022-12-19	5	5
Temperature	°C	2022-12-20	4	4
Temperature	°C	2022-12-21	4	4
Temperature	°C	2022-12-22	4	4
Temperature	°C	2022-12-23	4	4
Temperature	°C	2022-12-24	4	3
Temperature	°C	2022-12-26	4	4
Temperature	°C	2022-12-27	4	4
Temperature	°C	2022-12-28	4	4
Temperature	°C	2022-12-29	4	4
Temperature	°C	2022-12-30	4	4
Temperature	°C	2022-12-31	4	5
Total Suspended Solids	mg/L	2022-04-27	<2	-
Total Suspended Solids	mg/L	2022-05-18	<2	-
Total Suspended Solids	mg/L	2022-06-22	<2	-
Total Suspended Solids	mg/L	2022-07-20	<2	-
Total Suspended Solids	mg/L	2022-08-24	<2	-
Total Suspended Solids	mg/L	2022-09-21	<2	-
Total Suspended Solids	mg/L	2022-10-19	<2	-
Total Suspended Solids	mg/L	2022-11-23	<2	-
Trichloroacetic Acid	µg/L	2022-02-15	<0.5	2.8
Trichloroacetic Acid	µg/L	2022-05-10	<0.5	0.9
Trichloroacetic Acid	µg/L	2022-08-23	<5.0	-
Trichloroacetic Acid	µg/L	2022-08-24	-	1.2
Trichloroacetic Acid	µg/L	2022-11-15	<0.5	1.2
Turbidity	NTU	2022-01-01	0.49	0.42
Turbidity	NTU	2022-01-02	0.47	0.48
Turbidity	NTU	2022-01-03	0.48	0.47
Turbidity	NTU	2022-01-04	0.50	0.46

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-01-05	0.56	0.46
Turbidity	NTU	2022-01-06	0.59	0.56
Turbidity	NTU	2022-01-07	2.5	1.8
Turbidity	NTU	2022-01-08	1.3	0.99
Turbidity	NTU	2022-01-09	0.95	0.77
Turbidity	NTU	2022-01-10	0.64	0.60
Turbidity	NTU	2022-01-11	0.68	0.56
Turbidity	NTU	2022-01-12	1.4	1.3
Turbidity	NTU	2022-01-13	4.7	4.5
Turbidity	NTU	2022-01-14	2.1	1.8
Turbidity	NTU	2022-01-15	0.75	0.81
Turbidity	NTU	2022-01-16	0.95	0.92
Turbidity	NTU	2022-01-17	0.67	0.49
Turbidity	NTU	2022-01-18	0.50	0.48
Turbidity	NTU	2022-01-19	0.62	0.58
Turbidity	NTU	2022-01-20	0.40	0.37
Turbidity	NTU	2022-01-21	0.93	0.93
Turbidity	NTU	2022-01-22	0.79	0.66
Turbidity	NTU	2022-01-23	0.41	0.37
Turbidity	NTU	2022-01-24	0.55	0.53
Turbidity	NTU	2022-01-25	0.44	0.38
Turbidity	NTU	2022-01-26	0.44	0.44
Turbidity	NTU	2022-01-27	0.45	0.44
Turbidity	NTU	2022-01-28	0.40	0.35
Turbidity	NTU	2022-01-29	0.45	0.32
Turbidity	NTU	2022-01-30	0.46	0.32
Turbidity	NTU	2022-01-31	0.50	0.39
Turbidity	NTU	2022-02-01	0.55	0.39
Turbidity	NTU	2022-02-02	0.42	0.37
Turbidity	NTU	2022-02-03	0.54	0.36
Turbidity	NTU	2022-02-04	0.39	0.31
Turbidity	NTU	2022-02-05	0.82	0.61
Turbidity	NTU	2022-02-06	0.51	0.46
Turbidity	NTU	2022-02-07	0.43	0.42
Turbidity	NTU	2022-02-08	0.50	0.43
Turbidity	NTU	2022-02-09	0.41	0.33
Turbidity	NTU	2022-02-10	0.44	0.36
Turbidity	NTU	2022-02-11	0.43	0.32
Turbidity	NTU	2022-02-12	0.45	0.34
Turbidity	NTU	2022-02-13	0.34	0.32
Turbidity	NTU	2022-02-14	0.37	0.32
Turbidity	NTU	2022-02-15	0.38	0.36

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-02-16	0.41	0.37
Turbidity	NTU	2022-02-17	0.40	0.37
Turbidity	NTU	2022-02-18	0.43	0.29
Turbidity	NTU	2022-02-19	0.32	0.28
Turbidity	NTU	2022-02-20	0.31	0.27
Turbidity	NTU	2022-02-21	0.34	0.28
Turbidity	NTU	2022-02-22	0.79	0.49
Turbidity	NTU	2022-02-23	0.42	0.89
Turbidity	NTU	2022-02-24	0.47	0.32
Turbidity	NTU	2022-02-25	0.37	0.31
Turbidity	NTU	2022-02-26	0.36	0.34
Turbidity	NTU	2022-02-27	0.33	0.29
Turbidity	NTU	2022-02-28	0.64	0.44
Turbidity	NTU	2022-03-01	0.94	0.91
Turbidity	NTU	2022-03-02	0.99	0.90
Turbidity	NTU	2022-03-03	0.79	0.77
Turbidity	NTU	2022-03-04	0.86	0.77
Turbidity	NTU	2022-03-05	0.58	0.52
Turbidity	NTU	2022-03-06	0.44	0.39
Turbidity	NTU	2022-03-07	0.49	0.48
Turbidity	NTU	2022-03-08	0.52	0.40
Turbidity	NTU	2022-03-09	0.53	0.34
Turbidity	NTU	2022-03-10	0.45	0.38
Turbidity	NTU	2022-03-11	0.41	0.41
Turbidity	NTU	2022-03-12	0.42	0.32
Turbidity	NTU	2022-03-13	0.37	0.36
Turbidity	NTU	2022-03-14	0.37	0.35
Turbidity	NTU	2022-03-15	0.75	0.74
Turbidity	NTU	2022-03-16	0.80	0.65
Turbidity	NTU	2022-03-17	0.73	0.64
Turbidity	NTU	2022-03-18	0.56	0.46
Turbidity	NTU	2022-03-19	0.62	0.51
Turbidity	NTU	2022-03-20	0.52	0.51
Turbidity	NTU	2022-03-21	0.53	0.44
Turbidity	NTU	2022-03-22	0.53	0.49
Turbidity	NTU	2022-03-23	0.45	0.40
Turbidity	NTU	2022-03-24	0.42	0.38
Turbidity	NTU	2022-03-25	0.46	0.42
Turbidity	NTU	2022-03-26	0.37	0.31
Turbidity	NTU	2022-03-27	0.45	0.40
Turbidity	NTU	2022-03-28	0.41	0.42
Turbidity	NTU	2022-03-29	0.38	0.37

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-03-30	0.43	0.38
Turbidity	NTU	2022-03-31	0.42	0.37
Turbidity	NTU	2022-04-01	0.41	0.36
Turbidity	NTU	2022-04-02	0.42	0.34
Turbidity	NTU	2022-04-03	0.44	0.34
Turbidity	NTU	2022-04-04	0.44	0.36
Turbidity	NTU	2022-04-05	0.50	0.36
Turbidity	NTU	2022-04-06	0.43	0.41
Turbidity	NTU	2022-04-07	0.50	0.46
Turbidity	NTU	2022-04-08	0.40	0.34
Turbidity	NTU	2022-04-09	0.41	0.30
Turbidity	NTU	2022-04-10	0.34	0.30
Turbidity	NTU	2022-04-11	0.38	0.32
Turbidity	NTU	2022-04-12	0.39	0.27
Turbidity	NTU	2022-04-13	0.30	0.31
Turbidity	NTU	2022-04-14	0.33	0.27
Turbidity	NTU	2022-04-15	<0.06	0.32
Turbidity	NTU	2022-04-16	0.43	0.32
Turbidity	NTU	2022-04-17	0.29	0.22
Turbidity	NTU	2022-04-18	0.32	0.23
Turbidity	NTU	2022-04-19	0.33	0.29
Turbidity	NTU	2022-04-20	0.37	0.31
Turbidity	NTU	2022-04-21	0.29	0.29
Turbidity	NTU	2022-04-22	0.32	0.26
Turbidity	NTU	2022-04-23	0.37	0.24
Turbidity	NTU	2022-04-24	0.30	0.26
Turbidity	NTU	2022-04-25	0.38	0.31
Turbidity	NTU	2022-04-26	0.32	0.23
Turbidity	NTU	2022-04-27	0.33	0.27
Turbidity	NTU	2022-04-28	0.31	0.25
Turbidity	NTU	2022-04-29	0.40	0.31
Turbidity	NTU	2022-04-30	0.35	0.26
Turbidity	NTU	2022-05-01	0.36	0.24
Turbidity	NTU	2022-05-02	0.43	0.47
Turbidity	NTU	2022-05-03	0.43	0.34
Turbidity	NTU	2022-05-04	0.36	0.37
Turbidity	NTU	2022-05-05	0.33	0.35
Turbidity	NTU	2022-05-06	0.42	0.27
Turbidity	NTU	2022-05-07	0.30	0.30
Turbidity	NTU	2022-05-08	0.30	0.21
Turbidity	NTU	2022-05-09	0.31	0.30
Turbidity	NTU	2022-05-10	0.31	0.27

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-05-11	0.34	0.24
Turbidity	NTU	2022-05-12	0.36	0.23
Turbidity	NTU	2022-05-13	0.37	0.36
Turbidity	NTU	2022-05-14	0.33	0.26
Turbidity	NTU	2022-05-15	0.34	0.24
Turbidity	NTU	2022-05-16	0.57	0.46
Turbidity	NTU	2022-05-17	0.38	0.34
Turbidity	NTU	2022-05-18	0.38	0.37
Turbidity	NTU	2022-05-19	0.48	0.38
Turbidity	NTU	2022-05-20	0.39	0.33
Turbidity	NTU	2022-05-21	0.33	0.24
Turbidity	NTU	2022-05-22	0.32	0.24
Turbidity	NTU	2022-05-23	0.27	0.21
Turbidity	NTU	2022-05-24	0.35	0.34
Turbidity	NTU	2022-05-25	0.42	0.37
Turbidity	NTU	2022-05-26	0.42	0.40
Turbidity	NTU	2022-05-27	0.55	0.36
Turbidity	NTU	2022-05-28	0.36	0.28
Turbidity	NTU	2022-05-29	0.31	0.27
Turbidity	NTU	2022-05-30	0.36	0.35
Turbidity	NTU	2022-05-31	0.35	0.30
Turbidity	NTU	2022-06-01	0.43	0.27
Turbidity	NTU	2022-06-02	0.31	0.28
Turbidity	NTU	2022-06-03	0.35	0.30
Turbidity	NTU	2022-06-04	0.38	0.30
Turbidity	NTU	2022-06-05	0.39	0.24
Turbidity	NTU	2022-06-06	0.37	0.32
Turbidity	NTU	2022-06-07	0.32	0.27
Turbidity	NTU	2022-06-08	0.36	0.30
Turbidity	NTU	2022-06-09	0.34	0.29
Turbidity	NTU	2022-06-10	0.34	0.24
Turbidity	NTU	2022-06-11	0.33	0.21
Turbidity	NTU	2022-06-12	0.28	0.21
Turbidity	NTU	2022-06-13	0.38	0.29
Turbidity	NTU	2022-06-14	0.34	0.29
Turbidity	NTU	2022-06-15	0.36	0.32
Turbidity	NTU	2022-06-16	0.30	0.26
Turbidity	NTU	2022-06-17	0.31	0.27
Turbidity	NTU	2022-06-18	0.31	0.24
Turbidity	NTU	2022-06-19	0.30	0.22
Turbidity	NTU	2022-06-20	0.33	0.25
Turbidity	NTU	2022-06-21	0.33	0.25

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-06-22	0.33	0.25
Turbidity	NTU	2022-06-23	0.34	0.25
Turbidity	NTU	2022-06-24	0.32	0.26
Turbidity	NTU	2022-06-25	0.34	0.27
Turbidity	NTU	2022-06-26	0.35	0.25
Turbidity	NTU	2022-06-27	0.32	0.32
Turbidity	NTU	2022-06-28	0.34	0.30
Turbidity	NTU	2022-06-29	0.37	0.26
Turbidity	NTU	2022-06-30	0.30	0.27
Turbidity	NTU	2022-07-01	0.28	0.19
Turbidity	NTU	2022-07-02	0.30	0.27
Turbidity	NTU	2022-07-03	0.32	0.22
Turbidity	NTU	2022-07-04	0.32	0.24
Turbidity	NTU	2022-07-05	0.33	0.22
Turbidity	NTU	2022-07-06	0.30	0.23
Turbidity	NTU	2022-07-07	0.31	0.29
Turbidity	NTU	2022-07-08	0.32	0.29
Turbidity	NTU	2022-07-09	0.29	0.21
Turbidity	NTU	2022-07-10	0.31	0.20
Turbidity	NTU	2022-07-11	0.30	0.23
Turbidity	NTU	2022-07-12	0.37	0.21
Turbidity	NTU	2022-07-13	0.32	0.26
Turbidity	NTU	2022-07-14	0.31	0.23
Turbidity	NTU	2022-07-15	0.30	0.21
Turbidity	NTU	2022-07-16	0.35	0.24
Turbidity	NTU	2022-07-17	0.22	0.16
Turbidity	NTU	2022-07-18	0.33	0.24
Turbidity	NTU	2022-07-19	0.34	0.20
Turbidity	NTU	2022-07-20	0.30	0.25
Turbidity	NTU	2022-07-21	0.27	0.26
Turbidity	NTU	2022-07-22	0.31	0.27
Turbidity	NTU	2022-07-23	0.34	0.30
Turbidity	NTU	2022-07-24	0.29	0.22
Turbidity	NTU	2022-07-25	0.33	0.25
Turbidity	NTU	2022-07-26	0.27	0.19
Turbidity	NTU	2022-07-27	0.35	0.24
Turbidity	NTU	2022-07-28	0.32	0.27
Turbidity	NTU	2022-07-29	0.30	0.21
Turbidity	NTU	2022-07-30	0.31	0.22
Turbidity	NTU	2022-07-31	0.26	0.21
Turbidity	NTU	2022-08-01	0.26	0.20
Turbidity	NTU	2022-08-02	0.35	0.24

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-08-03	0.34	0.24
Turbidity	NTU	2022-08-04	0.32	0.23
Turbidity	NTU	2022-08-05	0.35	0.22
Turbidity	NTU	2022-08-06	0.25	0.19
Turbidity	NTU	2022-08-07	0.26	0.20
Turbidity	NTU	2022-08-08	0.31	0.23
Turbidity	NTU	2022-08-09	0.31	0.22
Turbidity	NTU	2022-08-10	0.30	0.28
Turbidity	NTU	2022-08-11	0.35	0.25
Turbidity	NTU	2022-08-12	0.28	0.24
Turbidity	NTU	2022-08-13	0.25	0.18
Turbidity	NTU	2022-08-14	0.24	0.17
Turbidity	NTU	2022-08-15	0.35	0.25
Turbidity	NTU	2022-08-16	0.30	0.25
Turbidity	NTU	2022-08-17	0.29	0.27
Turbidity	NTU	2022-08-18	0.34	0.25
Turbidity	NTU	2022-08-19	0.32	0.27
Turbidity	NTU	2022-08-20	0.27	0.20
Turbidity	NTU	2022-08-21	0.28	0.22
Turbidity	NTU	2022-08-22	0.36	0.26
Turbidity	NTU	2022-08-23	0.27	0.30
Turbidity	NTU	2022-08-24	0.38	0.28
Turbidity	NTU	2022-08-25	0.41	0.28
Turbidity	NTU	2022-08-26	0.31	0.29
Turbidity	NTU	2022-08-27	0.37	0.29
Turbidity	NTU	2022-08-28	0.26	0.22
Turbidity	NTU	2022-08-29	0.40	0.28
Turbidity	NTU	2022-08-30	0.29	0.30
Turbidity	NTU	2022-08-31	0.35	0.26
Turbidity	NTU	2022-09-01	0.31	0.28
Turbidity	NTU	2022-09-02	0.30	0.27
Turbidity	NTU	2022-09-03	0.34	0.26
Turbidity	NTU	2022-09-04	0.37	0.26
Turbidity	NTU	2022-09-05	0.25	0.22
Turbidity	NTU	2022-09-06	0.38	0.28
Turbidity	NTU	2022-09-07	0.32	0.29
Turbidity	NTU	2022-09-08	0.35	0.35
Turbidity	NTU	2022-09-09	0.34	0.29
Turbidity	NTU	2022-09-10	0.30	0.21
Turbidity	NTU	2022-09-11	0.30	0.25
Turbidity	NTU	2022-09-12	0.30	0.26
Turbidity	NTU	2022-09-13	0.28	0.22

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-09-14	0.29	0.30
Turbidity	NTU	2022-09-15	0.37	0.21
Turbidity	NTU	2022-09-16	0.40	0.43
Turbidity	NTU	2022-09-17	0.32	0.24
Turbidity	NTU	2022-09-18	0.31	0.26
Turbidity	NTU	2022-09-19	0.27	0.21
Turbidity	NTU	2022-09-20	0.28	0.23
Turbidity	NTU	2022-09-21	0.37	0.25
Turbidity	NTU	2022-09-22	0.34	0.34
Turbidity	NTU	2022-09-23	0.40	0.29
Turbidity	NTU	2022-09-24	0.34	0.26
Turbidity	NTU	2022-09-25	0.31	0.23
Turbidity	NTU	2022-09-26	0.42	0.27
Turbidity	NTU	2022-09-27	0.30	0.25
Turbidity	NTU	2022-09-28	0.35	0.22
Turbidity	NTU	2022-09-29	0.41	0.31
Turbidity	NTU	2022-09-30	0.35	0.27
Turbidity	NTU	2022-10-01	0.31	0.28
Turbidity	NTU	2022-10-02	0.27	0.27
Turbidity	NTU	2022-10-03	0.35	0.29
Turbidity	NTU	2022-10-04	0.28	0.29
Turbidity	NTU	2022-10-05	0.31	0.30
Turbidity	NTU	2022-10-06	0.32	0.28
Turbidity	NTU	2022-10-07	0.33	0.25
Turbidity	NTU	2022-10-08	0.36	0.22
Turbidity	NTU	2022-10-09	0.33	0.21
Turbidity	NTU	2022-10-10	0.28	0.19
Turbidity	NTU	2022-10-11	0.44	0.33
Turbidity	NTU	2022-10-12	0.43	0.27
Turbidity	NTU	2022-10-13	0.34	0.33
Turbidity	NTU	2022-10-14	0.37	0.31
Turbidity	NTU	2022-10-15	0.36	0.27
Turbidity	NTU	2022-10-16	0.36	0.24
Turbidity	NTU	2022-10-17	0.32	0.29
Turbidity	NTU	2022-10-18	0.35	0.28
Turbidity	NTU	2022-10-19	0.38	0.28
Turbidity	NTU	2022-10-20	0.36	0.31
Turbidity	NTU	2022-10-21	0.38	0.39
Turbidity	NTU	2022-10-22	0.44	0.31
Turbidity	NTU	2022-10-23	0.32	0.29
Turbidity	NTU	2022-10-24	0.44	0.40
Turbidity	NTU	2022-10-25	0.50	0.45

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-10-26	0.53	0.43
Turbidity	NTU	2022-10-27	0.50	0.46
Turbidity	NTU	2022-10-28	0.79	0.79
Turbidity	NTU	2022-10-29	0.80	0.61
Turbidity	NTU	2022-10-30	0.79	0.48
Turbidity	NTU	2022-10-31	0.90	0.88
Turbidity	NTU	2022-11-01	0.75	0.66
Turbidity	NTU	2022-11-02	0.66	0.57
Turbidity	NTU	2022-11-03	0.58	0.45
Turbidity	NTU	2022-11-04	0.64	0.61
Turbidity	NTU	2022-11-05	-	0.37
Turbidity	NTU	2022-11-06	0.50	0.35
Turbidity	NTU	2022-11-07	0.54	0.43
Turbidity	NTU	2022-11-08	0.47	0.45
Turbidity	NTU	2022-11-09	0.50	0.46
Turbidity	NTU	2022-11-10	0.43	0.42
Turbidity	NTU	2022-11-11	0.34	0.28
Turbidity	NTU	2022-11-12	0.38	0.33
Turbidity	NTU	2022-11-13	0.37	0.13
Turbidity	NTU	2022-11-14	0.46	0.39
Turbidity	NTU	2022-11-15	0.45	0.38
Turbidity	NTU	2022-11-16	0.40	0.36
Turbidity	NTU	2022-11-17	0.44	0.35
Turbidity	NTU	2022-11-18	0.54	0.45
Turbidity	NTU	2022-11-19	-	0.29
Turbidity	NTU	2022-11-20	0.42	0.30
Turbidity	NTU	2022-11-21	0.42	0.36
Turbidity	NTU	2022-11-22	0.39	0.31
Turbidity	NTU	2022-11-23	0.37	0.34
Turbidity	NTU	2022-11-24	0.33	0.29
Turbidity	NTU	2022-11-25	0.30	0.28
Turbidity	NTU	2022-11-26	0.33	0.31
Turbidity	NTU	2022-11-27	0.41	0.31
Turbidity	NTU	2022-11-28	0.37	0.30
Turbidity	NTU	2022-11-29	0.39	0.32
Turbidity	NTU	2022-11-30	0.40	0.27
Turbidity	NTU	2022-12-01	0.32	0.29
Turbidity	NTU	2022-12-02	0.28	0.30
Turbidity	NTU	2022-12-03	0.31	0.25
Turbidity	NTU	2022-12-04	0.28	0.24
Turbidity	NTU	2022-12-05	0.33	0.25
Turbidity	NTU	2022-12-06	0.32	0.23

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
Turbidity	NTU	2022-12-07	0.30	0.25
Turbidity	NTU	2022-12-08	0.30	0.26
Turbidity	NTU	2022-12-09	0.29	0.23
Turbidity	NTU	2022-12-10	0.29	0.22
Turbidity	NTU	2022-12-11	0.28	0.27
Turbidity	NTU	2022-12-12	0.30	0.25
Turbidity	NTU	2022-12-13	0.25	0.25
Turbidity	NTU	2022-12-14	0.24	0.23
Turbidity	NTU	2022-12-15	0.25	0.26
Turbidity	NTU	2022-12-16	0.28	0.25
Turbidity	NTU	2022-12-17	0.23	0.20
Turbidity	NTU	2022-12-18	-	0.21
Turbidity	NTU	2022-12-19	0.32	0.29
Turbidity	NTU	2022-12-20	0.35	0.21
Turbidity	NTU	2022-12-21	0.30	0.20
Turbidity	NTU	2022-12-22	0.24	0.18
Turbidity	NTU	2022-12-23	0.29	0.26
Turbidity	NTU	2022-12-24	0.27	0.25
Turbidity	NTU	2022-12-26	1.5	1.1
Turbidity	NTU	2022-12-27	1.1	1.0
Turbidity	NTU	2022-12-28	1.2	1.2
Turbidity	NTU	2022-12-29	1.1	0.99
Turbidity	NTU	2022-12-30	0.76	0.66
Turbidity	NTU	2022-12-31	0.53	0.46
UV 254 - Apparent	Abs/cm	2022-01-04	0.076	0.023
UV 254 - Apparent	Abs/cm	2022-01-10	0.078	0.024
UV 254 - Apparent	Abs/cm	2022-01-12	0.081	0.029
UV 254 - Apparent	Abs/cm	2022-01-14	0.087	0.029
UV 254 - Apparent	Abs/cm	2022-01-17	0.074	0.026
UV 254 - Apparent	Abs/cm	2022-01-19	0.074	0.025
UV 254 - Apparent	Abs/cm	2022-01-24	0.072	0.025
UV 254 - Apparent	Abs/cm	2022-01-26	0.070	0.024
UV 254 - Apparent	Abs/cm	2022-01-28	0.071	0.026
UV 254 - Apparent	Abs/cm	2022-01-31	0.078	0.024
UV 254 - Apparent	Abs/cm	2022-02-02	0.070	0.025
UV 254 - Apparent	Abs/cm	2022-02-04	0.069	0.025
UV 254 - Apparent	Abs/cm	2022-02-07	0.070	0.026
UV 254 - Apparent	Abs/cm	2022-02-09	0.073	0.024
UV 254 - Apparent	Abs/cm	2022-02-11	0.071	0.026
UV 254 - Apparent	Abs/cm	2022-02-14	0.068	0.025
UV 254 - Apparent	Abs/cm	2022-02-16	0.068	0.023
UV 254 - Apparent	Abs/cm	2022-02-18	0.069	0.024

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Apparent	Abs/cm	2022-02-22	0.073	0.024
UV 254 - Apparent	Abs/cm	2022-02-23	0.069	0.026
UV 254 - Apparent	Abs/cm	2022-02-25	0.069	0.023
UV 254 - Apparent	Abs/cm	2022-02-28	0.078	0.028
UV 254 - Apparent	Abs/cm	2022-03-02	0.080	0.025
UV 254 - Apparent	Abs/cm	2022-03-04	0.077	0.024
UV 254 - Apparent	Abs/cm	2022-03-07	0.072	0.023
UV 254 - Apparent	Abs/cm	2022-03-09	0.070	0.022
UV 254 - Apparent	Abs/cm	2022-03-14	0.067	0.022
UV 254 - Apparent	Abs/cm	2022-03-16	0.085	0.021
UV 254 - Apparent	Abs/cm	2022-03-18	0.076	0.021
UV 254 - Apparent	Abs/cm	2022-03-21	0.077	0.020
UV 254 - Apparent	Abs/cm	2022-03-24	0.073	0.022
UV 254 - Apparent	Abs/cm	2022-03-28	0.070	0.021
UV 254 - Apparent	Abs/cm	2022-03-30	0.067	0.022
UV 254 - Apparent	Abs/cm	2022-04-04	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-04-06	0.073	0.025
UV 254 - Apparent	Abs/cm	2022-04-08	0.071	0.022
UV 254 - Apparent	Abs/cm	2022-04-11	0.069	0.023
UV 254 - Apparent	Abs/cm	2022-04-13	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-04-19	0.067	0.023
UV 254 - Apparent	Abs/cm	2022-04-20	0.068	0.023
UV 254 - Apparent	Abs/cm	2022-04-21	0.070	0.025
UV 254 - Apparent	Abs/cm	2022-04-25	0.068	0.024
UV 254 - Apparent	Abs/cm	2022-04-27	0.068	0.024
UV 254 - Apparent	Abs/cm	2022-04-29	0.068	0.024
UV 254 - Apparent	Abs/cm	2022-05-02	0.068	0.056
UV 254 - Apparent	Abs/cm	2022-05-03	0.067	0.022
UV 254 - Apparent	Abs/cm	2022-05-04	0.068	0.025
UV 254 - Apparent	Abs/cm	2022-05-05	0.067	0.023
UV 254 - Apparent	Abs/cm	2022-05-06	0.068	0.022
UV 254 - Apparent	Abs/cm	2022-05-09	0.069	0.023
UV 254 - Apparent	Abs/cm	2022-05-10	0.070	0.023
UV 254 - Apparent	Abs/cm	2022-05-11	0.068	0.023
UV 254 - Apparent	Abs/cm	2022-05-12	0.070	0.022
UV 254 - Apparent	Abs/cm	2022-05-13	0.068	0.023
UV 254 - Apparent	Abs/cm	2022-05-16	0.072	0.023
UV 254 - Apparent	Abs/cm	2022-05-17	0.068	0.022
UV 254 - Apparent	Abs/cm	2022-05-18	0.075	0.023
UV 254 - Apparent	Abs/cm	2022-05-19	0.070	0.024
UV 254 - Apparent	Abs/cm	2022-05-20	0.070	0.024
UV 254 - Apparent	Abs/cm	2022-05-24	0.070	0.052

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Apparent	Abs/cm	2022-05-25	0.070	0.024
UV 254 - Apparent	Abs/cm	2022-05-26	0.070	0.025
UV 254 - Apparent	Abs/cm	2022-05-27	0.069	0.025
UV 254 - Apparent	Abs/cm	2022-05-30	0.072	0.026
UV 254 - Apparent	Abs/cm	2022-05-31	0.069	0.025
UV 254 - Apparent	Abs/cm	2022-06-01	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-06-02	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-06-03	0.071	0.025
UV 254 - Apparent	Abs/cm	2022-06-06	0.068	0.026
UV 254 - Apparent	Abs/cm	2022-06-07	0.071	0.025
UV 254 - Apparent	Abs/cm	2022-06-08	0.070	0.025
UV 254 - Apparent	Abs/cm	2022-06-09	0.070	0.025
UV 254 - Apparent	Abs/cm	2022-06-10	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-06-13	0.068	0.022
UV 254 - Apparent	Abs/cm	2022-06-14	0.071	0.025
UV 254 - Apparent	Abs/cm	2022-06-15	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-06-16	0.069	0.023
UV 254 - Apparent	Abs/cm	2022-06-17	0.069	0.022
UV 254 - Apparent	Abs/cm	2022-06-20	0.068	0.021
UV 254 - Apparent	Abs/cm	2022-06-21	0.069	0.023
UV 254 - Apparent	Abs/cm	2022-06-22	0.069	0.023
UV 254 - Apparent	Abs/cm	2022-06-23	0.070	0.024
UV 254 - Apparent	Abs/cm	2022-06-24	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-06-27	0.069	0.025
UV 254 - Apparent	Abs/cm	2022-06-28	0.069	0.025
UV 254 - Apparent	Abs/cm	2022-06-29	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-07-04	0.068	0.022
UV 254 - Apparent	Abs/cm	2022-07-05	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-07-06	0.069	0.024
UV 254 - Apparent	Abs/cm	2022-07-07	0.070	0.022
UV 254 - Apparent	Abs/cm	2022-07-08	0.068	0.024
UV 254 - Apparent	Abs/cm	2022-07-11	0.067	0.023
UV 254 - Apparent	Abs/cm	2022-07-12	0.068	0.024
UV 254 - Apparent	Abs/cm	2022-07-13	0.065	0.024
UV 254 - Apparent	Abs/cm	2022-07-14	0.065	0.023
UV 254 - Apparent	Abs/cm	2022-07-15	0.067	0.025
UV 254 - Apparent	Abs/cm	2022-07-18	0.067	0.023
UV 254 - Apparent	Abs/cm	2022-07-19	0.066	0.023
UV 254 - Apparent	Abs/cm	2022-07-20	0.065	0.025
UV 254 - Apparent	Abs/cm	2022-07-22	0.064	0.024
UV 254 - Apparent	Abs/cm	2022-07-25	0.065	0.023
UV 254 - Apparent	Abs/cm	2022-07-27	0.066	0.026

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Apparent	Abs/cm	2022-07-28	0.061	0.023
UV 254 - Apparent	Abs/cm	2022-08-02	0.062	0.023
UV 254 - Apparent	Abs/cm	2022-08-03	0.062	0.024
UV 254 - Apparent	Abs/cm	2022-08-04	0.063	0.025
UV 254 - Apparent	Abs/cm	2022-08-05	0.064	0.025
UV 254 - Apparent	Abs/cm	2022-08-08	0.059	0.024
UV 254 - Apparent	Abs/cm	2022-08-10	0.062	0.025
UV 254 - Apparent	Abs/cm	2022-08-12	0.062	0.024
UV 254 - Apparent	Abs/cm	2022-08-15	0.061	0.024
UV 254 - Apparent	Abs/cm	2022-08-16	0.061	0.022
UV 254 - Apparent	Abs/cm	2022-08-17	0.061	0.023
UV 254 - Apparent	Abs/cm	2022-08-18	0.060	0.022
UV 254 - Apparent	Abs/cm	2022-08-19	0.059	0.022
UV 254 - Apparent	Abs/cm	2022-08-22	0.062	0.020
UV 254 - Apparent	Abs/cm	2022-08-23	0.060	0.023
UV 254 - Apparent	Abs/cm	2022-08-24	0.061	0.023
UV 254 - Apparent	Abs/cm	2022-08-25	0.060	0.023
UV 254 - Apparent	Abs/cm	2022-08-26	0.060	0.022
UV 254 - Apparent	Abs/cm	2022-08-29	0.058	0.021
UV 254 - Apparent	Abs/cm	2022-08-30	0.058	0.020
UV 254 - Apparent	Abs/cm	2022-08-31	0.057	0.022
UV 254 - Apparent	Abs/cm	2022-09-01	0.057	0.020
UV 254 - Apparent	Abs/cm	2022-09-02	0.059	0.021
UV 254 - Apparent	Abs/cm	2022-09-06	0.056	0.020
UV 254 - Apparent	Abs/cm	2022-09-08	0.056	0.022
UV 254 - Apparent	Abs/cm	2022-09-09	0.054	0.019
UV 254 - Apparent	Abs/cm	2022-09-12	0.055	0.021
UV 254 - Apparent	Abs/cm	2022-09-14	0.051	0.020
UV 254 - Apparent	Abs/cm	2022-09-15	0.053	0.020
UV 254 - Apparent	Abs/cm	2022-09-20	0.051	0.018
UV 254 - Apparent	Abs/cm	2022-09-21	0.051	0.018
UV 254 - Apparent	Abs/cm	2022-09-22	0.048	0.018
UV 254 - Apparent	Abs/cm	2022-09-26	0.048	0.017
UV 254 - Apparent	Abs/cm	2022-09-27	0.050	0.018
UV 254 - Apparent	Abs/cm	2022-09-28	0.051	0.019
UV 254 - Apparent	Abs/cm	2022-09-29	0.049	0.019
UV 254 - Apparent	Abs/cm	2022-10-03	0.048	0.016
UV 254 - Apparent	Abs/cm	2022-10-05	0.047	0.040
UV 254 - Apparent	Abs/cm	2022-10-06	0.046	0.016
UV 254 - Apparent	Abs/cm	2022-10-07	0.047	0.018
UV 254 - Apparent	Abs/cm	2022-10-11	0.046	0.017
UV 254 - Apparent	Abs/cm	2022-10-13	0.047	0.018

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Apparent	Abs/cm	2022-10-17	0.048	0.018
UV 254 - Apparent	Abs/cm	2022-10-19	0.045	0.016
UV 254 - Apparent	Abs/cm	2022-10-21	0.046	0.017
UV 254 - Apparent	Abs/cm	2022-10-24	0.043	0.017
UV 254 - Apparent	Abs/cm	2022-10-25	0.052	0.019
UV 254 - Apparent	Abs/cm	2022-10-26	0.044	0.020
UV 254 - Apparent	Abs/cm	2022-10-27	0.049	0.021
UV 254 - Apparent	Abs/cm	2022-10-28	0.067	0.025
UV 254 - Apparent	Abs/cm	2022-10-31	0.087	0.029
UV 254 - Apparent	Abs/cm	2022-11-01	0.080	0.029
UV 254 - Apparent	Abs/cm	2022-11-02	0.073	0.026
UV 254 - Apparent	Abs/cm	2022-11-03	0.070	0.026
UV 254 - Apparent	Abs/cm	2022-11-04	0.068	0.025
UV 254 - Apparent	Abs/cm	2022-11-07	0.067	0.023
UV 254 - Apparent	Abs/cm	2022-11-08	0.061	0.024
UV 254 - Apparent	Abs/cm	2022-11-09	0.061	0.026
UV 254 - Apparent	Abs/cm	2022-11-10	0.061	0.024
UV 254 - Apparent	Abs/cm	2022-11-14	0.059	0.023
UV 254 - Apparent	Abs/cm	2022-11-15	0.058	0.023
UV 254 - Apparent	Abs/cm	2022-11-16	0.058	0.023
UV 254 - Apparent	Abs/cm	2022-11-17	0.056	0.020
UV 254 - Apparent	Abs/cm	2022-11-18	0.059	0.022
UV 254 - Apparent	Abs/cm	2022-11-21	0.054	0.017
UV 254 - Apparent	Abs/cm	2022-11-23	0.063	0.023
UV 254 - Apparent	Abs/cm	2022-11-25	0.058	0.022
UV 254 - Apparent	Abs/cm	2022-11-28	0.082	0.030
UV 254 - Apparent	Abs/cm	2022-12-02	0.062	0.023
UV 254 - Apparent	Abs/cm	2022-12-05	0.060	0.022
UV 254 - Apparent	Abs/cm	2022-12-06	0.060	0.022
UV 254 - Apparent	Abs/cm	2022-12-07	0.060	0.022
UV 254 - Apparent	Abs/cm	2022-12-08	0.061	0.023
UV 254 - Apparent	Abs/cm	2022-12-09	0.057	0.023
UV 254 - Apparent	Abs/cm	2022-12-12	0.061	0.023
UV 254 - Apparent	Abs/cm	2022-12-13	0.062	0.022
UV 254 - Apparent	Abs/cm	2022-12-14	0.061	0.022
UV 254 - Apparent	Abs/cm	2022-12-15	0.060	0.022
UV 254 - Apparent	Abs/cm	2022-12-16	0.059	0.023
UV 254 - Apparent	Abs/cm	2022-12-19	0.058	0.020
UV 254 - Apparent	Abs/cm	2022-12-21	0.060	0.023
UV 254 - Apparent	Abs/cm	2022-12-28	0.090	0.031
UV 254 - Apparent	Abs/cm	2022-12-30	0.073	0.026
UV 254 - Transmittance	%	2022-01-10	83.6	94.6

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Transmittance	%	2022-01-12	82.9	93.6
UV 254 - Transmittance	%	2022-01-14	81.9	93.5
UV 254 - Transmittance	%	2022-01-17	84.7	94.5
UV 254 - Transmittance	%	2022-01-19	84.4	94.4
UV 254 - Transmittance	%	2022-01-24	84.6	94.4
UV 254 - Transmittance	%	2022-01-26	85.2	94.7
UV 254 - Transmittance	%	2022-01-28	85.0	94.2
UV 254 - Transmittance	%	2022-01-31	83.6	94.6
UV 254 - Transmittance	%	2022-02-02	85.2	94.5
UV 254 - Transmittance	%	2022-02-04	85.3	94.4
UV 254 - Transmittance	%	2022-02-07	85.1	94.3
UV 254 - Transmittance	%	2022-02-09	84.5	94.6
UV 254 - Transmittance	%	2022-02-11	85.0	94.3
UV 254 - Transmittance	%	2022-02-14	85.4	94.3
UV 254 - Transmittance	%	2022-02-16	85.4	94.8
UV 254 - Transmittance	%	2022-02-18	85.2	94.5
UV 254 - Transmittance	%	2022-02-23	85.3	94.3
UV 254 - Transmittance	%	2022-02-25	85.3	94.8
UV 254 - Transmittance	%	2022-02-28	83.6	93.8
UV 254 - Transmittance	%	2022-03-02	83.2	94.4
UV 254 - Transmittance	%	2022-03-04	83.7	94.6
UV 254 - Transmittance	%	2022-03-07	85.0	94.9
UV 254 - Transmittance	%	2022-03-09	85.1	95.1
UV 254 - Transmittance	%	2022-03-14	85.8	95.1
UV 254 - Transmittance	%	2022-03-16	82.2	95.4
UV 254 - Transmittance	%	2022-03-18	83.9	95.4
UV 254 - Transmittance	%	2022-03-21	84.1	95.4
UV 254 - Transmittance	%	2022-03-24	84.4	95.1
UV 254 - Transmittance	%	2022-03-28	85.2	95.2
UV 254 - Transmittance	%	2022-03-30	85.8	95.1
UV 254 - Transmittance	%	2022-04-04	85.3	94.7
UV 254 - Transmittance	%	2022-04-06	84.5	94.3
UV 254 - Transmittance	%	2022-04-08	84.9	95.0
UV 254 - Transmittance	%	2022-04-11	85.3	94.9
UV 254 - Transmittance	%	2022-04-13	85.4	94.5
UV 254 - Transmittance	%	2022-04-20	85.5	94.8
UV 254 - Transmittance	%	2022-04-21	85.1	94.3
UV 254 - Transmittance	%	2022-04-25	85.5	94.7
UV 254 - Transmittance	%	2022-04-27	85.5	94.7
UV 254 - Transmittance	%	2022-04-29	85.4	94.7
UV 254 - Transmittance	%	2022-05-02	85.4	87.6
UV 254 - Transmittance	%	2022-05-03	85.7	95.0

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Transmittance	%	2022-05-04	85.4	94.5
UV 254 - Transmittance	%	2022-05-05	85.7	94.9
UV 254 - Transmittance	%	2022-05-06	85.5	95.1
UV 254 - Transmittance	%	2022-05-09	85.0	94.8
UV 254 - Transmittance	%	2022-05-10	85.1	94.9
UV 254 - Transmittance	%	2022-05-11	85.4	94.8
UV 254 - Transmittance	%	2022-05-12	85.1	95.0
UV 254 - Transmittance	%	2022-05-13	85.6	94.9
UV 254 - Transmittance	%	2022-05-16	84.6	94.9
UV 254 - Transmittance	%	2022-05-17	85.4	95.1
UV 254 - Transmittance	%	2022-05-18	84.1	94.8
UV 254 - Transmittance	%	2022-05-19	85.1	94.6
UV 254 - Transmittance	%	2022-05-20	85.1	94.6
UV 254 - Transmittance	%	2022-05-24	85.2	87.6
UV 254 - Transmittance	%	2022-05-25	85.2	94.5
UV 254 - Transmittance	%	2022-05-26	85.1	94.5
UV 254 - Transmittance	%	2022-05-27	85.4	94.5
UV 254 - Transmittance	%	2022-05-30	85.0	94.1
UV 254 - Transmittance	%	2022-05-31	85.3	94.5
UV 254 - Transmittance	%	2022-06-01	85.2	94.6
UV 254 - Transmittance	%	2022-06-02	85.3	94.6
UV 254 - Transmittance	%	2022-06-03	84.9	94.4
UV 254 - Transmittance	%	2022-06-06	85.1	94.3
UV 254 - Transmittance	%	2022-06-07	85.0	94.5
UV 254 - Transmittance	%	2022-06-08	85.1	94.5
UV 254 - Transmittance	%	2022-06-09	85.1	94.4
UV 254 - Transmittance	%	2022-06-10	85.3	94.7
UV 254 - Transmittance	%	2022-06-13	85.5	94.7
UV 254 - Transmittance	%	2022-06-14	85.0	94.5
UV 254 - Transmittance	%	2022-06-15	85.3	94.7
UV 254 - Transmittance	%	2022-06-16	85.3	94.8
UV 254 - Transmittance	%	2022-06-17	85.3	95.1
UV 254 - Transmittance	%	2022-06-20	85.4	95.2
UV 254 - Transmittance	%	2022-06-21	85.3	94.9
UV 254 - Transmittance	%	2022-06-22	85.3	94.8
UV 254 - Transmittance	%	2022-06-23	85.2	94.7
UV 254 - Transmittance	%	2022-06-24	85.2	94.6
UV 254 - Transmittance	%	2022-06-27	85.4	94.5
UV 254 - Transmittance	%	2022-06-28	85.2	94.5
UV 254 - Transmittance	%	2022-06-29	85.3	94.6
UV 254 - Transmittance	%	2022-07-04	85.1	94.8
UV 254 - Transmittance	%	2022-07-05	85.3	94.7

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Transmittance	%	2022-07-06	85.4	94.7
UV 254 - Transmittance	%	2022-07-07	85.1	95.1
UV 254 - Transmittance	%	2022-07-08	85.4	94.7
UV 254 - Transmittance	%	2022-07-11	85.7	94.8
UV 254 - Transmittance	%	2022-07-12	85.6	94.7
UV 254 - Transmittance	%	2022-07-13	86.0	94.7
UV 254 - Transmittance	%	2022-07-14	86.1	94.9
UV 254 - Transmittance	%	2022-07-15	85.8	94.5
UV 254 - Transmittance	%	2022-07-18	85.7	94.9
UV 254 - Transmittance	%	2022-07-19	86.0	94.8
UV 254 - Transmittance	%	2022-07-20	86.1	94.3
UV 254 - Transmittance	%	2022-07-22	86.3	94.6
UV 254 - Transmittance	%	2022-07-25	86.1	94.5
UV 254 - Transmittance	%	2022-07-27	86.0	94.1
UV 254 - Transmittance	%	2022-07-28	86.9	94.9
UV 254 - Transmittance	%	2022-08-02	86.8	94.9
UV 254 - Transmittance	%	2022-08-03	86.6	94.6
UV 254 - Transmittance	%	2022-08-04	86.5	94.5
UV 254 - Transmittance	%	2022-08-05	86.3	94.4
UV 254 - Transmittance	%	2022-08-08	87.2	94.6
UV 254 - Transmittance	%	2022-08-10	86.6	94.5
UV 254 - Transmittance	%	2022-08-12	86.6	94.7
UV 254 - Transmittance	%	2022-08-15	87.1	94.7
UV 254 - Transmittance	%	2022-08-16	87.0	95.1
UV 254 - Transmittance	%	2022-08-17	87.0	94.8
UV 254 - Transmittance	%	2022-08-18	87.1	95.0
UV 254 - Transmittance	%	2022-08-19	87.4	95.1
UV 254 - Transmittance	%	2022-08-22	87.2	95.1
UV 254 - Transmittance	%	2022-08-23	87.1	94.9
UV 254 - Transmittance	%	2022-08-24	87.0	94.9
UV 254 - Transmittance	%	2022-08-25	87.1	94.8
UV 254 - Transmittance	%	2022-08-26	87.2	95.0
UV 254 - Transmittance	%	2022-08-29	87.3	95.2
UV 254 - Transmittance	%	2022-08-30	87.5	95.4
UV 254 - Transmittance	%	2022-08-31	87.6	95.0
UV 254 - Transmittance	%	2022-09-01	87.7	95.5
UV 254 - Transmittance	%	2022-09-02	87.3	95.4
UV 254 - Transmittance	%	2022-09-06	87.9	95.4
UV 254 - Transmittance	%	2022-09-08	87.8	95.1
UV 254 - Transmittance	%	2022-09-09	88.4	95.6
UV 254 - Transmittance	%	2022-09-12	88.2	95.4
UV 254 - Transmittance	%	2022-09-14	88.9	95.6


Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Transmittance	%	2022-09-15	88.4	95.5
UV 254 - Transmittance	%	2022-09-21	88.9	95.9
UV 254 - Transmittance	%	2022-09-22	89.5	95.8
UV 254 - Transmittance	%	2022-09-26	89.5	96.1
UV 254 - Transmittance	%	2022-09-27	89.1	95.9
UV 254 - Transmittance	%	2022-09-28	89.0	95.6
UV 254 - Transmittance	%	2022-09-29	89.2	95.8
UV 254 - Transmittance	%	2022-10-03	89.4	95.9
UV 254 - Transmittance	%	2022-10-05	89.7	91.3
UV 254 - Transmittance	%	2022-10-06	89.9	96.4
UV 254 - Transmittance	%	2022-10-07	89.2	95.9
UV 254 - Transmittance	%	2022-10-11	89.9	96.0
UV 254 - Transmittance	%	2022-10-13	89.9	95.8
UV 254 - Transmittance	%	2022-10-17	89.8	95.9
UV 254 - Transmittance	%	2022-10-19	90.1	96.3
UV 254 - Transmittance	%	2022-10-21	90.0	96.2
UV 254 - Transmittance	%	2022-10-24	90.5	96.1
UV 254 - Transmittance	%	2022-10-25	88.8	95.7
UV 254 - Transmittance	%	2022-10-26	90.3	95.4
UV 254 - Transmittance	%	2022-10-27	89.3	95.3
UV 254 - Transmittance	%	2022-10-28	85.6	94.4
UV 254 - Transmittance	%	2022-10-31	81.8	93.5
UV 254 - Transmittance	%	2022-11-01	83.2	93.6
UV 254 - Transmittance	%	2022-11-02	84.6	94.3
UV 254 - Transmittance	%	2022-11-03	85.1	94.2
UV 254 - Transmittance	%	2022-11-04	85.5	94.3
UV 254 - Transmittance	%	2022-11-07	85.7	94.6
UV 254 - Transmittance	%	2022-11-08	86.9	94.6
UV 254 - Transmittance	%	2022-11-09	86.8	94.2
UV 254 - Transmittance	%	2022-11-10	86.9	94.6
UV 254 - Transmittance	%	2022-11-14	87.2	94.9
UV 254 - Transmittance	%	2022-11-15	87.5	94.8
UV 254 - Transmittance	%	2022-11-16	87.6	94.9
UV 254 - Transmittance	%	2022-11-17	87.9	95.4
UV 254 - Transmittance	%	2022-11-18	87.4	95.2
UV 254 - Transmittance	%	2022-11-21	87.6	95.0
UV 254 - Transmittance	%	2022-11-23	86.4	94.8
UV 254 - Transmittance	%	2022-11-25	87.6	95.2
UV 254 - Transmittance	%	2022-11-28	83.6	93.3
UV 254 - Transmittance	%	2022-12-02	86.8	94.8
UV 254 - Transmittance	%	2022-12-05	87.2	95.0
UV 254 - Transmittance	%	2022-12-06	87.1	95.0

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV 254 - Transmittance	%	2022-12-07	87.1	95.0
UV 254 - Transmittance	%	2022-12-08	86.9	94.9
UV 254 - Transmittance	%	2022-12-09	86.8	94.8
UV 254 - Transmittance	%	2022-12-12	86.6	94.8
UV 254 - Transmittance	%	2022-12-13	86.7	95.0
UV 254 - Transmittance	%	2022-12-14	86.8	95.0
UV 254 - Transmittance	%	2022-12-15	87.1	95.0
UV 254 - Transmittance	%	2022-12-16	87.3	94.8
UV 254 - Transmittance	%	2022-12-19	87.1	95.1
UV 254 - Transmittance	%	2022-12-21	87.0	94.8
UV 254 - Transmittance	%	2022-12-28	81.4	93.2
UV 254 - Transmittance	%	2022-12-30	84.6	94.3
UV Absorbance 254 nm	Abs/cm	2022-01-04	0.070	0.019
UV Absorbance 254 nm	Abs/cm	2022-01-10	0.071	-
UV Absorbance 254 nm	Abs/cm	2022-01-17	0.067	0.021
UV Absorbance 254 nm	Abs/cm	2022-01-24	0.067	-
UV Absorbance 254 nm	Abs/cm	2022-01-31	0.065	0.021
UV Absorbance 254 nm	Abs/cm	2022-02-07	0.065	0.021
UV Absorbance 254 nm	Abs/cm	2022-02-14	0.063	0.020
UV Absorbance 254 nm	Abs/cm	2022-02-22	0.066	0.020
UV Absorbance 254 nm	Abs/cm	2022-02-28	0.071	0.023
UV Absorbance 254 nm	Abs/cm	2022-03-07	0.066	0.019
UV Absorbance 254 nm	Abs/cm	2022-03-14	0.062	0.018
UV Absorbance 254 nm	Abs/cm	2022-03-21	0.070	-
UV Absorbance 254 nm	Abs/cm	2022-03-28	0.063	-
UV Absorbance 254 nm	Abs/cm	2022-04-04	0.062	0.020
UV Absorbance 254 nm	Abs/cm	2022-04-11	0.060	0.017
UV Absorbance 254 nm	Abs/cm	2022-04-19	0.062	0.019
UV Absorbance 254 nm	Abs/cm	2022-04-25	0.062	0.020
UV Absorbance 254 nm	Abs/cm	2022-05-02	0.061	0.050
UV Absorbance 254 nm	Abs/cm	2022-05-09	0.064	0.018
UV Absorbance 254 nm	Abs/cm	2022-05-16	0.064	0.019
UV Absorbance 254 nm	Abs/cm	2022-05-24	0.063	0.047
UV Absorbance 254 nm	Abs/cm	2022-05-30	0.063	0.019
UV Absorbance 254 nm	Abs/cm	2022-06-06	0.062	0.019
UV Absorbance 254 nm	Abs/cm	2022-06-13	0.063	0.020
UV Absorbance 254 nm	Abs/cm	2022-06-20	0.063	0.018
UV Absorbance 254 nm	Abs/cm	2022-06-27	0.063	0.018
UV Absorbance 254 nm	Abs/cm	2022-07-04	0.063	0.020
UV Absorbance 254 nm	Abs/cm	2022-07-11	0.062	-
UV Absorbance 254 nm	Abs/cm	2022-07-18	0.060	0.019
UV Absorbance 254 nm	Abs/cm	2022-07-25	0.059	0.020

Analysis - Coquitlam	Units	Date Sampled	Source	Treated
UV Absorbance 254 nm	Abs/cm	2022-08-02	0.056	0.019
UV Absorbance 254 nm	Abs/cm	2022-08-08	0.057	0.019
UV Absorbance 254 nm	Abs/cm	2022-08-15	0.054	0.018
UV Absorbance 254 nm	Abs/cm	2022-08-22	0.054	0.017
UV Absorbance 254 nm	Abs/cm	2022-08-29	0.053	0.017
UV Absorbance 254 nm	Abs/cm	2022-09-06	0.050	0.016
UV Absorbance 254 nm	Abs/cm	2022-09-12	0.053	0.020
UV Absorbance 254 nm	Abs/cm	2022-09-20	0.046	0.015
UV Absorbance 254 nm	Abs/cm	2022-09-26	0.044	0.014
UV Absorbance 254 nm	Abs/cm	2022-10-03	0.042	0.013
UV Absorbance 254 nm	Abs/cm	2022-10-11	0.041	0.013
UV Absorbance 254 nm	Abs/cm	2022-10-17	0.042	0.013
UV Absorbance 254 nm	Abs/cm	2022-10-24	0.038	0.013
UV Absorbance 254 nm	Abs/cm	2022-10-31	0.081	0.019
UV Absorbance 254 nm	Abs/cm	2022-11-07	0.057	0.018
UV Absorbance 254 nm	Abs/cm	2022-11-14	0.052	0.017
UV Absorbance 254 nm	Abs/cm	2022-11-21	0.048	0.013
UV Absorbance 254 nm	Abs/cm	2022-11-28	0.076	0.023
UV Absorbance 254 nm	Abs/cm	2022-12-05	0.055	0.020
UV Absorbance 254 nm	Abs/cm	2022-12-12	0.056	0.021
UV Absorbance 254 nm	Abs/cm	2022-12-19	0.054	0.018
Zinc Total	µg/L	2022-05-02	<3.0	<3.0
Zinc Total	µg/L	2022-05-04	<3.0	<3.0
Zinc Total	µg/L	2022-11-07	<3.0	4.8
Zinc Total	µg/L	2022-11-08	3.5	<3.0

This page has intentionally been left blank

GVWD TRANSMISSION SYSTEM

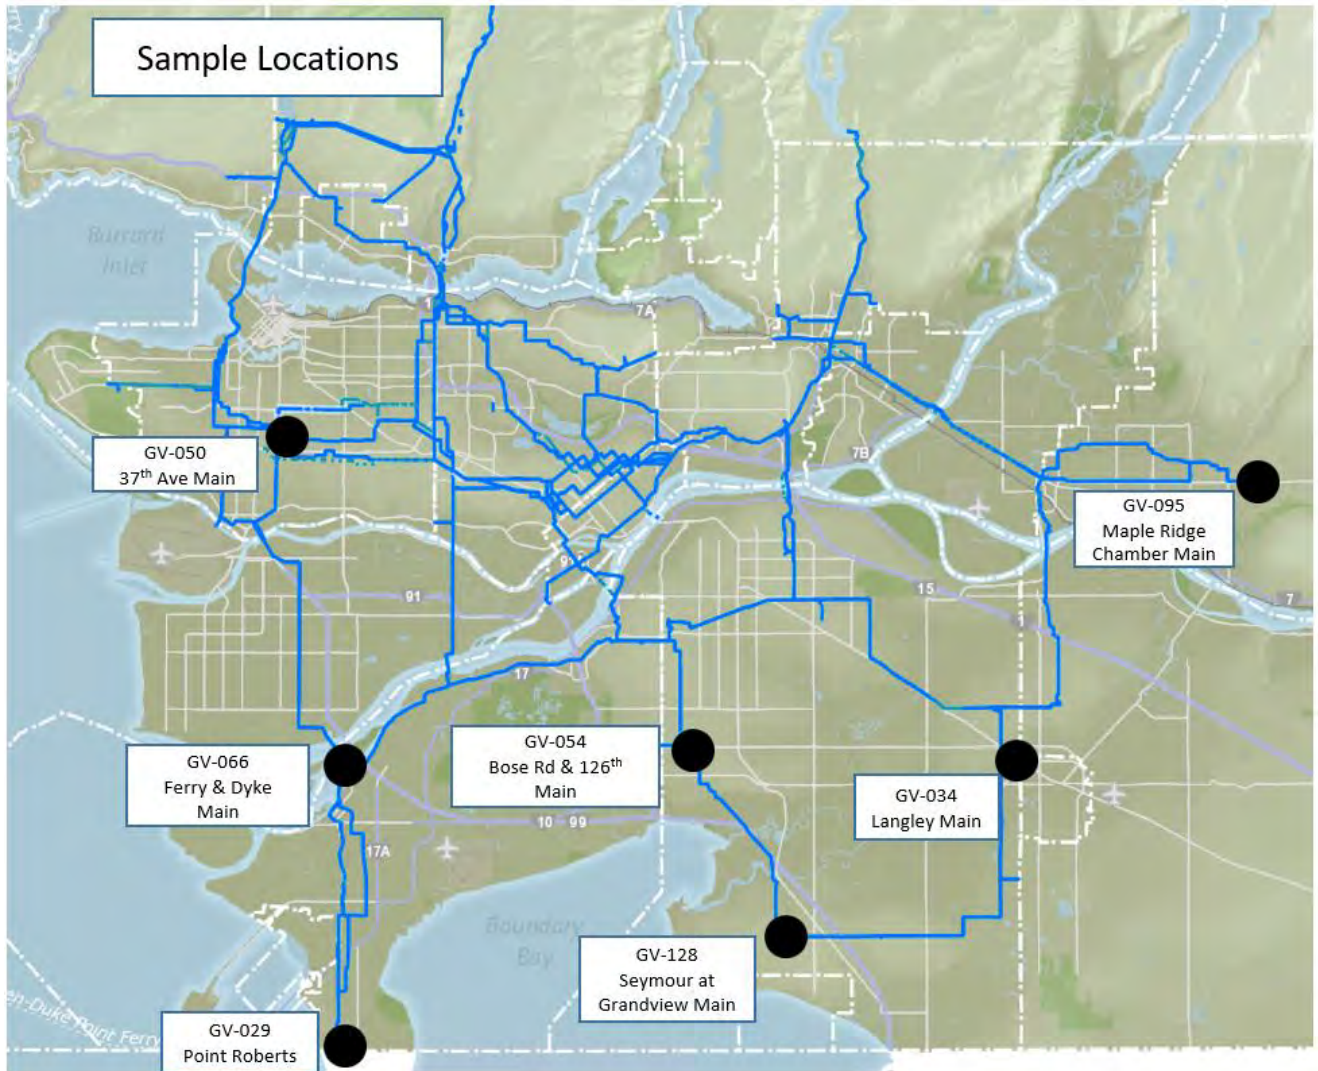

Analysis	Units	Date Sampled	Treated
Point Roberts Main GV-029			
Alkalinity as CaCO ₃	mg/L	2022-02-16	23
Alkalinity as CaCO ₃	mg/L	2022-05-10	23
Alkalinity as CaCO ₃	mg/L	2022-08-22	20
Alkalinity as CaCO ₃	mg/L	2022-11-16	21
Aluminum Total	µg/L	2022-02-16	48
Aluminum Total	µg/L	2022-05-10	30
Aluminum Total	µg/L	2022-08-22	35
Aluminum Total	µg/L	2022-11-16	34
Aluminum Total	µg/L	2022-02-16	<0.5
Aluminum Total	µg/L	2022-05-10	<0.5
Aluminum Total	µg/L	2022-08-22	<0.5
Aluminum Total	µg/L	2022-11-16	<0.5
Arsenic Total	µg/L	2022-02-16	<0.5
Arsenic Total	µg/L	2022-05-10	<0.5
Arsenic Total	µg/L	2022-08-22	<0.5
Arsenic Total	µg/L	2022-11-16	<0.5
Barium Total	µg/L	2022-02-16	2.4
Barium Total	µg/L	2022-05-10	2.4
Barium Total	µg/L	2022-08-22	2.7
Barium Total	µg/L	2022-11-16	3.1
Boron Total	µg/L	2022-02-16	<10
Boron Total	µg/L	2022-05-10	<10
Boron Total	µg/L	2022-08-22	<10
Boron Total	µg/L	2022-11-16	<10
Bromate	µg/L	2022-02-16	<10.0
Bromate	µg/L	2022-05-10	<10.0
Bromate	µg/L	2022-08-22	<10.0
Bromate	µg/L	2022-11-16	<10.0
Bromate	µg/L	2022-02-16	<10.0
Bromate	µg/L	2022-05-10	<10.0
Bromate	µg/L	2022-08-22	<10.0
Bromate	µg/L	2022-11-16	<10.0
Bromodichloromethane	µg/L	2022-02-16	<1
Bromodichloromethane	µg/L	2022-05-10	<1
Bromodichloromethane	µg/L	2022-11-16	2
Bromoform	µg/L	2022-02-16	<1
Bromoform	µg/L	2022-05-10	<1
Bromoform	µg/L	2022-11-16	<1
Cadmium Total	µg/L	2022-02-16	<0.2
Cadmium Total	µg/L	2022-05-10	<0.2
Cadmium Total	µg/L	2022-08-22	<0.2

Analysis	Units	Date Sampled	Treated
Cadmium Total	µg/L	2022-11-16	<0.2
Cadmium Total	µg/L	2022-02-16	8,740
Cadmium Total	µg/L	2022-05-10	8,560
Cadmium Total	µg/L	2022-08-22	7,860
Cadmium Total	µg/L	2022-11-16	8,540
Chlorate	µg/L	2022-02-16	21.6
Chlorate	µg/L	2022-05-10	25.0
Chlorate	µg/L	2022-08-22	46.0
Chlorate	µg/L	2022-11-16	36.0
Chloride	mg/L	2022-02-16	2.5
Chloride	mg/L	2022-05-10	2.2
Chloride	mg/L	2022-08-22	2.4
Chloride	mg/L	2022-11-16	3.2
Chlorodibromomethane	µg/L	2022-02-16	<1
Chlorodibromomethane	µg/L	2022-05-10	<1
Chlorodibromomethane	µg/L	2022-11-16	<1
Chloroform	µg/L	2022-02-16	26
Chloroform	µg/L	2022-05-10	30
Chloroform	µg/L	2022-11-16	29
Chromium Total	µg/L	2022-02-16	0.05
Chromium Total	µg/L	2022-05-10	<0.05
Chromium Total	µg/L	2022-08-22	<0.05
Chromium Total	µg/L	2022-11-16	0.06
Cobalt Total	µg/L	2022-02-16	<0.5
Cobalt Total	µg/L	2022-05-10	<0.5
Cobalt Total	µg/L	2022-08-22	<0.5
Cobalt Total	µg/L	2022-11-16	<0.5
Copper Total	µg/L	2022-02-16	0.9
Copper Total	µg/L	2022-05-10	1.1
Copper Total	µg/L	2022-08-22	0.9
Copper Total	µg/L	2022-11-16	1.0
Dibromoacetic Acid	µg/L	2022-02-16	<0.5
Dibromoacetic Acid	µg/L	2022-05-10	<0.5
Dibromoacetic Acid	µg/L	2022-08-22	<0.5
Dibromoacetic Acid	µg/L	2022-11-16	<0.5
Dibromoacetic Acid	µg/L	2022-02-16	12
Dibromoacetic Acid	µg/L	2022-05-10	13
Dibromoacetic Acid	µg/L	2022-08-22	9.7
Dibromoacetic Acid	µg/L	2022-11-16	9.8
Iron Total	µg/L	2022-02-16	8
Iron Total	µg/L	2022-05-10	<5
Iron Total	µg/L	2022-08-22	<5

Analysis	Units	Date Sampled	Treated
Iron Total	µg/L	2022-11-16	6
Lead Total	µg/L	2022-02-16	<0.5
Lead Total	µg/L	2022-05-10	<0.5
Lead Total	µg/L	2022-08-22	<0.5
Lead Total	µg/L	2022-11-16	<0.5
Magnesium Total	µg/L	2022-02-16	204
Magnesium Total	µg/L	2022-05-10	209
Magnesium Total	µg/L	2022-08-22	203
Magnesium Total	µg/L	2022-11-16	211
Manganese Total	µg/L	2022-02-16	3.0
Manganese Total	µg/L	2022-05-10	2.5
Manganese Total	µg/L	2022-08-22	4.5
Manganese Total	µg/L	2022-11-16	6.6
Mercury Total	µg/L	2022-02-16	<0.05
Mercury Total	µg/L	2022-05-10	<0.05
Mercury Total	µg/L	2022-08-22	<0.05
Mercury Total	µg/L	2022-11-16	<0.05
Molybdenum Total	µg/L	2022-02-16	<0.5
Molybdenum Total	µg/L	2022-05-10	<0.5
Molybdenum Total	µg/L	2022-08-22	<0.5
Molybdenum Total	µg/L	2022-11-16	<0.5
Monobromoacetic Acid	µg/L	2022-02-16	<5.0
Monobromoacetic Acid	µg/L	2022-05-10	<0.5
Monobromoacetic Acid	µg/L	2022-08-22	<0.5
Monobromoacetic Acid	µg/L	2022-11-16	<0.5
Monochloroacetic Acid	µg/L	2022-02-16	<5.0
Monochloroacetic Acid	µg/L	2022-05-10	1.3
Monochloroacetic Acid	µg/L	2022-08-22	<5.0
Monochloroacetic Acid	µg/L	2022-11-16	<5.0
Nickel Total	µg/L	2022-02-16	<0.5
Nickel Total	µg/L	2022-05-10	<0.5
Nickel Total	µg/L	2022-08-22	<0.5
Nickel Total	µg/L	2022-11-16	<0.5
pH	pH units	2022-02-16	8.0
pH	pH units	2022-05-10	7.9
pH	pH units	2022-08-22	7.9
pH	pH units	2022-11-16	7.8
Potassium Total	µg/L	2022-02-16	153
Potassium Total	µg/L	2022-05-10	158
Potassium Total	µg/L	2022-08-22	155
Potassium Total	µg/L	2022-11-16	228
Selenium Total	µg/L	2022-02-16	<0.5

Analysis	Units	Date Sampled	Treated
Selenium Total	µg/L	2022-05-10	<0.5
Selenium Total	µg/L	2022-08-22	<0.5
Selenium Total	µg/L	2022-11-16	<0.5
Silver Total	µg/L	2022-02-16	<0.5
Silver Total	µg/L	2022-05-10	<0.5
Silver Total	µg/L	2022-08-22	<0.5
Silver Total	µg/L	2022-11-16	<0.5
Sodium Total	µg/L	2022-02-16	1,650
Sodium Total	µg/L	2022-05-10	1,560
Sodium Total	µg/L	2022-08-22	1,780
Sodium Total	µg/L	2022-11-16	1,970
Trichloroacetic Acid	µg/L	2022-02-16	10
Trichloroacetic Acid	µg/L	2022-05-10	9.2
Trichloroacetic Acid	µg/L	2022-08-22	5.6
Trichloroacetic Acid	µg/L	2022-11-16	9.1
Turbidity	NTU	2022-01-07	0.25
Turbidity	NTU	2022-01-12	0.14
Turbidity	NTU	2022-01-19	0.17
Turbidity	NTU	2022-01-25	0.16
Turbidity	NTU	2022-02-01	0.19
Turbidity	NTU	2022-02-07	0.16
Turbidity	NTU	2022-02-16	0.13
Turbidity	NTU	2022-03-03	0.34
Turbidity	NTU	2022-03-09	0.10
Turbidity	NTU	2022-03-17	0.11
Turbidity	NTU	2022-03-23	0.15
Turbidity	NTU	2022-03-29	0.13
Turbidity	NTU	2022-04-01	0.18
Turbidity	NTU	2022-04-04	0.19
Turbidity	NTU	2022-04-14	0.42
Turbidity	NTU	2022-04-20	0.08
Turbidity	NTU	2022-04-27	0.09
Turbidity	NTU	2022-05-04	0.09
Turbidity	NTU	2022-05-10	0.09
Turbidity	NTU	2022-05-17	0.07
Turbidity	NTU	2022-05-26	0.25
Turbidity	NTU	2022-06-01	0.12
Turbidity	NTU	2022-06-03	0.15
Turbidity	NTU	2022-06-07	0.11
Turbidity	NTU	2022-06-14	0.15
Turbidity	NTU	2022-06-21	0.08
Turbidity	NTU	2022-06-29	0.08

Analysis	Units	Date Sampled	Treated
Turbidity	NTU	2022-07-05	0.12
Turbidity	NTU	2022-07-12	0.08
Turbidity	NTU	2022-07-20	0.10
Turbidity	NTU	2022-07-27	0.15
Turbidity	NTU	2022-08-03	0.21
Turbidity	NTU	2022-08-09	0.09
Turbidity	NTU	2022-08-17	0.16
Turbidity	NTU	2022-08-22	0.10
Turbidity	NTU	2022-08-30	0.13
Turbidity	NTU	2022-09-08	0.08
Turbidity	NTU	2022-09-13	0.07
Turbidity	NTU	2022-09-22	0.13
Turbidity	NTU	2022-09-28	0.23
Turbidity	NTU	2022-10-05	0.14
Turbidity	NTU	2022-10-20	0.11
Turbidity	NTU	2022-10-24	0.12
Turbidity	NTU	2022-11-02	0.17
Turbidity	NTU	2022-11-16	0.17
Turbidity	NTU	2022-11-22	0.23
Turbidity	NTU	2022-11-29	0.11
Turbidity	NTU	2022-12-06	0.13
Turbidity	NTU	2022-12-13	0.11
Zinc Total	NTU	2022-02-16	<3.0
Zinc Total	NTU	2022-05-10	<3.0
Zinc Total	NTU	2022-08-22	<3.0
Zinc Total	NTU	2022-11-16	<3.0

Analysis	Units	Date Sampled	Treated
Langley Main GV-034			
Bromate	µg/L	2022-02-15	<10.0
Bromate	µg/L	2022-05-10	<10.0
Bromate	µg/L	2022-08-24	<10.0
Bromate	µg/L	2022-11-15	<10.0
Bromide	µg/L	2022-02-15	<10.0
Bromide	µg/L	2022-05-10	<10.0
Bromide	µg/L	2022-08-24	<10.0
Bromide	µg/L	2022-11-15	<10.0
Bromodichloromethane	µg/L	2022-02-15	<1
Bromodichloromethane	µg/L	2022-05-10	<1
Bromodichloromethane	µg/L	2022-11-15	<1
Bromoform	µg/L	2022-02-15	<1
Bromoform	µg/L	2022-05-10	<1
Bromoform	µg/L	2022-11-15	<1
Chlorate	µg/L	2022-02-15	28.2
Chlorate	µg/L	2022-05-10	81.5
Chlorate	µg/L	2022-08-24	88.3
Chlorate	µg/L	2022-11-15	64.8
Chloride	mg/L	2022-02-15	2.8
Chloride	mg/L	2022-05-10	2.7
Chloride	mg/L	2022-08-24	2.7
Chloride	mg/L	2022-11-15	2.9
Chlorodibromomethane	µg/L	2022-02-15	<1
Chlorodibromomethane	µg/L	2022-05-10	<1
Chlorodibromomethane	µg/L	2022-11-15	<1
Chloroform	µg/L	2022-02-15	21
Chloroform	µg/L	2022-05-10	34
Chloroform	µg/L	2022-11-15	28
Dibromoacetic Acid	µg/L	2022-02-15	<0.5
Dibromoacetic Acid	µg/L	2022-05-10	<0.5
Dibromoacetic Acid	µg/L	2022-08-24	<0.5
Dibromoacetic Acid	µg/L	2022-11-15	<0.5
Dibromoacetic Acid	µg/L	2022-02-15	9.7
Dibromoacetic Acid	µg/L	2022-05-10	17
Dibromoacetic Acid	µg/L	2022-08-24	25
Dibromoacetic Acid	µg/L	2022-11-15	17
Monobromoacetic Acid	µg/L	2022-02-15	<5.0
Monobromoacetic Acid	µg/L	2022-05-10	<0.5
Monobromoacetic Acid	µg/L	2022-08-24	<0.5
Monobromoacetic Acid	µg/L	2022-11-15	<0.5
Monobromoacetic Acid	µg/L	2022-02-15	<5.0

Analysis	Units	Date Sampled	Treated
Monobromoacetic Acid	µg/L	2022-05-10	<5.0
Monobromoacetic Acid	µg/L	2022-08-24	1.5
Monobromoacetic Acid	µg/L	2022-11-15	<5.0
pH	pH units	2022-02-15	8.0
pH	pH units	2022-05-10	7.9
pH	pH units	2022-08-24	7.8
pH	pH units	2022-11-15	7.8
Sodium Total	µg/L	2022-02-15	2590
Sodium Total	µg/L	2022-05-10	11,800
Sodium Total	µg/L	2022-08-24	11,300
Sodium Total	µg/L	2022-11-15	11,000
Trichloroacetic Acid	µg/L	2022-02-15	8.7
Trichloroacetic Acid	µg/L	2022-05-10	27
Trichloroacetic Acid	µg/L	2022-08-24	29
Trichloroacetic Acid	µg/L	2022-11-15	25
Turbidity	NTU	2022-01-05	0.78
Turbidity	NTU	2022-01-11	0.72
Turbidity	NTU	2022-01-18	0.61
Turbidity	NTU	2022-01-25	0.24
Turbidity	NTU	2022-02-02	0.33
Turbidity	NTU	2022-02-08	0.18
Turbidity	NTU	2022-02-15	0.12
Turbidity	NTU	2022-03-01	0.18
Turbidity	NTU	2022-03-08	0.22
Turbidity	NTU	2022-03-16	0.28
Turbidity	NTU	2022-03-24	0.35
Turbidity	NTU	2022-03-29	0.22
Turbidity	NTU	2022-04-06	0.38
Turbidity	NTU	2022-04-13	0.33
Turbidity	NTU	2022-04-17	0.28
Turbidity	NTU	2022-04-26	0.25
Turbidity	NTU	2022-04-29	0.31
Turbidity	NTU	2022-05-03	0.34
Turbidity	NTU	2022-05-10	0.28
Turbidity	NTU	2022-05-17	0.34
Turbidity	NTU	2022-05-26	0.33
Turbidity	NTU	2022-05-31	0.29
Turbidity	NTU	2022-06-10	0.38
Turbidity	NTU	2022-06-16	0.29
Turbidity	NTU	2022-06-22	0.34
Turbidity	NTU	2022-06-25	0.27
Turbidity	NTU	2022-06-28	0.34

Analysis	Units	Date Sampled	Treated
Turbidity	NTU	2022-07-08	0.33
Turbidity	NTU	2022-07-12	0.30
Turbidity	NTU	2022-07-23	0.33
Turbidity	NTU	2022-07-28	0.29
Turbidity	NTU	2022-08-03	0.23
Turbidity	NTU	2022-08-09	0.23
Turbidity	NTU	2022-08-18	0.30
Turbidity	NTU	2022-08-24	0.24
Turbidity	NTU	2022-08-31	0.26
Turbidity	NTU	2022-09-07	0.30
Turbidity	NTU	2022-09-16	0.23
Turbidity	NTU	2022-09-23	0.38
Turbidity	NTU	2022-09-29	0.25
Turbidity	NTU	2022-10-06	0.33
Turbidity	NTU	2022-10-17	0.45
Turbidity	NTU	2022-10-26	0.32
Turbidity	NTU	2022-11-01	0.55
Turbidity	NTU	2022-11-09	0.25
Turbidity	NTU	2022-11-15	0.38
Turbidity	NTU	2022-11-24	0.35
Turbidity	NTU	2022-12-01	0.31
Turbidity	NTU	2022-12-08	0.23
Turbidity	NTU	2022-12-15	0.29

Analysis	Units	Date Sampled	Treated
37th Ave Main GV-050			
Alkalinity as CaCO ₃	mg/L	2022-02-14	22
Alkalinity as CaCO ₃	mg/L	2022-05-10	23
Alkalinity as CaCO ₃	mg/L	2022-08-23	20
Alkalinity as CaCO ₃	mg/L	2022-11-16	20
Aluminum Total	µg/L	2022-02-14	39
Aluminum Total	µg/L	2022-05-10	22
Aluminum Total	µg/L	2022-08-23	49
Aluminum Total	µg/L	2022-11-16	32
Antimony Total	µg/L	2022-02-14	<0.5
Antimony Total	µg/L	2022-05-10	<0.5
Antimony Total	µg/L	2022-08-23	<0.5
Antimony Total	µg/L	2022-11-16	<0.5
Arsenic Total	µg/L	2022-02-14	<0.5
Arsenic Total	µg/L	2022-05-10	<0.5
Arsenic Total	µg/L	2022-08-23	<0.5
Arsenic Total	µg/L	2022-11-16	<0.5
Barium Total	µg/L	2022-02-14	2.3
Barium Total	µg/L	2022-05-10	2.6
Barium Total	µg/L	2022-08-23	2.2
Barium Total	µg/L	2022-11-16	3.1
Boron Total	µg/L	2022-02-14	<10
Boron Total	µg/L	2022-05-10	<10
Boron Total	µg/L	2022-08-23	<10
Boron Total	µg/L	2022-11-16	<10
Bromate	µg/L	2022-02-14	<10.0
Bromate	µg/L	2022-05-10	<10.0
Bromate	µg/L	2022-08-23	<10.0
Bromate	µg/L	2022-11-16	<10.0
Bromide	µg/L	2022-02-14	<10.0
Bromide	µg/L	2022-05-10	<10.0
Bromide	µg/L	2022-08-23	<10.0
Bromide	µg/L	2022-11-16	<10.0
Bromodichloromethane	µg/L	2022-02-14	<1
Bromodichloromethane	µg/L	2022-05-10	<1
Bromodichloromethane	µg/L	2022-11-16	1
Bromoform	µg/L	2022-02-14	<1
Bromoform	µg/L	2022-05-10	<1
Bromoform	µg/L	2022-11-16	<1
Cadmium Total	µg/L	2022-02-14	<0.2
Cadmium Total	µg/L	2022-05-10	<0.2
Cadmium Total	µg/L	2022-08-23	<0.2

Analysis	Units	Date Sampled	Treated
Cadmium Total	µg/L	2022-11-16	<0.2
Calcium Total	µg/L	2022-02-14	8,120
Calcium Total	µg/L	2022-05-10	8,580
Calcium Total	µg/L	2022-08-23	4,810
Calcium Total	µg/L	2022-11-16	8,300
Chlorate	µg/L	2022-02-14	13.4
Chlorate	µg/L	2022-05-10	22.1
Chlorate	µg/L	2022-08-23	52.9
Chlorate	µg/L	2022-11-16	23.1
Chloride	mg/L	2022-02-14	2.3
Chloride	mg/L	2022-05-10	2.2
Chloride	mg/L	2022-08-23	2.5
Chloride	mg/L	2022-11-16	2.9
Chlorodibromomethane	µg/L	2022-02-14	<1
Chlorodibromomethane	µg/L	2022-05-10	<1
Chlorodibromomethane	µg/L	2022-11-16	<1
Chloroform	µg/L	2022-02-14	17
Chloroform	µg/L	2022-05-10	21
Chloroform	µg/L	2022-11-16	22
Chromium Total	µg/L	2022-02-14	<0.05
Chromium Total	µg/L	2022-05-10	<0.05
Chromium Total	µg/L	2022-08-23	<0.05
Chromium Total	µg/L	2022-11-16	<0.05
Cobalt Total	µg/L	2022-02-14	<0.5
Cobalt Total	µg/L	2022-05-10	<0.5
Cobalt Total	µg/L	2022-08-23	<0.5
Cobalt Total	µg/L	2022-11-16	<0.5
Copper Total	µg/L	2022-02-14	5.6
Copper Total	µg/L	2022-05-10	6.8
Copper Total	µg/L	2022-08-23	9.7
Copper Total	µg/L	2022-11-16	9.1
Dibromoacetic Acid	µg/L	2022-05-10	<0.5
Dibromoacetic Acid	µg/L	2022-08-23	<0.5
Dibromoacetic Acid	µg/L	2022-11-16	<0.5
Dibromoacetic Acid	µg/L	2022-02-14	<0.5
Dichloroacetic Acid	µg/L	2022-02-14	7.5
Dichloroacetic Acid	µg/L	2022-05-10	8.0
Dichloroacetic Acid	µg/L	2022-08-23	13
Dichloroacetic Acid	µg/L	2022-11-16	7.5
Iron Total	µg/L	2022-02-14	6
Iron Total	µg/L	2022-05-10	6
Iron Total	µg/L	2022-08-23	15

Analysis	Units	Date Sampled	Treated
Iron Total	µg/L	2022-11-16	5
Lead Total	µg/L	2022-02-14	<0.5
Lead Total	µg/L	2022-05-10	<0.5
Lead Total	µg/L	2022-08-23	<0.5
Lead Total	µg/L	2022-11-16	<0.5
Magnesium Total	µg/L	2022-02-14	193
Magnesium Total	µg/L	2022-05-10	234
Magnesium Total	µg/L	2022-08-23	139
Magnesium Total	µg/L	2022-11-16	235
Manganese Total	µg/L	2022-02-14	3.5
Manganese Total	µg/L	2022-05-10	5.7
Manganese Total	µg/L	2022-08-23	3.3
Manganese Total	µg/L	2022-11-16	6.9
Mercury Total	µg/L	2022-02-14	<0.05
Mercury Total	µg/L	2022-05-10	<0.05
Mercury Total	µg/L	2022-08-23	<0.05
Mercury Total	µg/L	2022-11-16	<0.05
Molybdenum Total	µg/L	2022-02-14	<0.5
Molybdenum Total	µg/L	2022-05-10	<0.5
Molybdenum Total	µg/L	2022-08-23	<0.5
Molybdenum Total	µg/L	2022-11-16	<0.5
Monobromoacetic Acid	µg/L	2022-02-14	<5.0
Monobromoacetic Acid	µg/L	2022-05-10	<0.5
Monobromoacetic Acid	µg/L	2022-08-23	<0.5
Monobromoacetic Acid	µg/L	2022-11-16	<0.5
Monochloroacetic Acid	µg/L	2022-02-14	<0.5
Monochloroacetic Acid	µg/L	2022-05-10	<0.5
Monochloroacetic Acid	µg/L	2022-08-23	0.9
Monochloroacetic Acid	µg/L	2022-11-16	<5.0
Nickel Total	µg/L	2022-02-14	<0.5
Nickel Total	µg/L	2022-05-10	<0.5
Nickel Total	µg/L	2022-08-23	<0.5
Nickel Total	µg/L	2022-11-16	<0.5
pH	pH units	2022-02-14	7.8
pH	pH units	2022-05-10	8.0
pH	pH units	2022-08-23	7.7
pH	pH units	2022-11-16	7.8
Potassium Total	µg/L	2022-02-14	148
Potassium Total	µg/L	2022-05-10	157
Potassium Total	µg/L	2022-08-23	123
Potassium Total	µg/L	2022-11-16	231
Selenium Total	µg/L	2022-02-14	<0.5

Analysis	Units	Date Sampled	Treated
Selenium Total	µg/L	2022-05-10	<0.5
Selenium Total	µg/L	2022-08-23	<0.5
Selenium Total	µg/L	2022-11-16	<0.5
Silver Total	µg/L	2022-02-14	<0.5
Silver Total	µg/L	2022-05-10	<0.5
Silver Total	µg/L	2022-08-23	<0.5
Silver Total	µg/L	2022-11-16	<0.5
Sodium Total	µg/L	2022-02-14	1,430
Sodium Total	µg/L	2022-05-10	1,550
Sodium Total	µg/L	2022-08-23	5,230
Sodium Total	µg/L	2022-11-16	1,790
Trichloroacetic Acid	µg/L	2022-02-14	5.3
Trichloroacetic Acid	µg/L	2022-05-10	4.4
Trichloroacetic Acid	µg/L	2022-08-23	9.3
Trichloroacetic Acid	µg/L	2022-11-16	4.5
Turbidity	NTU	2022-01-03	0.25
Turbidity	NTU	2022-01-12	0.18
Turbidity	NTU	2022-01-17	0.16
Turbidity	NTU	2022-01-26	0.14
Turbidity	NTU	2022-02-01	0.21
Turbidity	NTU	2022-02-09	0.17
Turbidity	NTU	2022-02-14	0.23
Turbidity	NTU	2022-02-20	0.11
Turbidity	NTU	2022-02-27	0.12
Turbidity	NTU	2022-03-06	0.12
Turbidity	NTU	2022-03-16	0.14
Turbidity	NTU	2022-03-25	0.16
Turbidity	NTU	2022-03-31	0.19
Turbidity	NTU	2022-04-03	0.17
Turbidity	NTU	2022-04-14	0.11
Turbidity	NTU	2022-04-30	0.11
Turbidity	NTU	2022-05-04	0.12
Turbidity	NTU	2022-05-10	0.14
Turbidity	NTU	2022-05-12	0.14
Turbidity	NTU	2022-05-18	0.11
Turbidity	NTU	2022-05-26	0.13
Turbidity	NTU	2022-05-31	0.15
Turbidity	NTU	2022-06-05	0.12
Turbidity	NTU	2022-06-08	0.17
Turbidity	NTU	2022-06-15	0.22
Turbidity	NTU	2022-06-20	0.15
Turbidity	NTU	2022-06-21	0.13

Analysis	Units	Date Sampled	Treated
Turbidity	NTU	2022-06-28	0.19
Turbidity	NTU	2022-07-05	0.15
Turbidity	NTU	2022-07-15	0.12
Turbidity	NTU	2022-07-18	0.17
Turbidity	NTU	2022-07-20	0.15
Turbidity	NTU	2022-07-28	0.12
Turbidity	NTU	2022-08-05	0.12
Turbidity	NTU	2022-08-09	0.18
Turbidity	NTU	2022-08-18	0.17
Turbidity	NTU	2022-08-22	0.16
Turbidity	NTU	2022-08-31	0.21
Turbidity	NTU	2022-09-08	0.13
Turbidity	NTU	2022-09-16	0.14
Turbidity	NTU	2022-09-25	0.41
Turbidity	NTU	2022-09-26	0.26
Turbidity	NTU	2022-10-05	0.25
Turbidity	NTU	2022-10-12	0.20
Turbidity	NTU	2022-10-18	0.17
Turbidity	NTU	2022-10-25	0.11
Turbidity	NTU	2022-11-02	0.14
Turbidity	NTU	2022-11-10	0.20
Turbidity	NTU	2022-11-16	0.17
Turbidity	NTU	2022-11-23	0.14
Turbidity	NTU	2022-12-01	0.14
Turbidity	NTU	2022-12-07	0.15
Zinc Total	µg/L	2022-02-14	<3.0
Zinc Total	µg/L	2022-05-10	<3.0
Zinc Total	µg/L	2022-08-23	<3.0
Zinc Total	µg/L	2022-11-16	<3.0

Analysis	Units	Date Sampled	Treated
Bose Rd & 126th Main GV-054			
Bromate	µg/L	2022-02-18	<10.0
Bromate	µg/L	2022-05-10	<10.0
Bromate	µg/L	2022-08-23	<10.0
Bromate	µg/L	2022-11-15	<10.0
Bromide	µg/L	2022-02-18	<10.0
Bromide	µg/L	2022-05-10	<10.0
Bromide	µg/L	2022-08-23	<10.0
Bromide	µg/L	2022-11-15	<10.0
Bromodichloromethane	µg/L	2022-02-18	<1
Bromodichloromethane	µg/L	2022-05-10	<1
Bromodichloromethane	µg/L	2022-11-15	1
Bromoform	µg/L	2022-02-18	<1
Bromoform	µg/L	2022-05-10	<1
Bromoform	µg/L	2022-11-15	<1
Chlorate	µg/L	2022-02-18	24.3
Chlorate	µg/L	2022-05-10	27.4
Chlorate	µg/L	2022-08-23	60.2
Chlorate	µg/L	2022-11-15	25.3
Chloride	µg/L	2022-02-18	2.4
Chloride	µg/L	2022-05-10	2.2
Chloride	µg/L	2022-08-23	2.4
Chloride	µg/L	2022-11-15	2.7
Chlorodibromomethane	µg/L	2022-02-18	<1
Chlorodibromomethane	µg/L	2022-05-10	<1
Chlorodibromomethane	µg/L	2022-11-15	<1
Chloroform	µg/L	2022-02-18	19
Chloroform	µg/L	2022-05-10	26
Chloroform	µg/L	2022-11-15	27
Dibromoacetic Acid	µg/L	2022-02-18	<0.5
Dibromoacetic Acid	µg/L	2022-05-10	<0.5
Dibromoacetic Acid	µg/L	2022-08-23	<0.5
Dibromoacetic Acid	µg/L	2022-11-15	<0.5
Dichloroacetic Acid	µg/L	2022-02-18	9.2
Dichloroacetic Acid	µg/L	2022-05-10	9.5
Dichloroacetic Acid	µg/L	2022-08-23	14
Dichloroacetic Acid	µg/L	2022-11-15	11
Monobromoacetic Acid	µg/L	2022-02-18	<0.5
Monobromoacetic Acid	µg/L	2022-05-10	<0.5
Monobromoacetic Acid	µg/L	2022-08-23	<0.5
Monobromoacetic Acid	µg/L	2022-11-15	<0.5
Monochloroacetic Acid	µg/L	2022-02-18	0.6

Analysis	Units	Date Sampled	Treated
Monochloroacetic Acid	µg/L	2022-05-10	0.5
Monochloroacetic Acid	µg/L	2022-08-23	<5.0
Monochloroacetic Acid	µg/L	2022-11-15	0.8
pH	pH units	2022-02-18	7.7
pH	pH units	2022-05-10	8.0
pH	pH units	2022-08-23	7.9
pH	pH units	2022-11-15	7.7
Sodium Total	µg/L	2022-02-18	1,600
Sodium Total	µg/L	2022-05-10	1,540
Sodium Total	µg/L	2022-08-23	7,110
Sodium Total	µg/L	2022-11-15	3,120
Trichloroacetic Acid	µg/L	2022-02-18	6.8
Trichloroacetic Acid	µg/L	2022-05-10	5.3
Trichloroacetic Acid	µg/L	2022-08-23	13
Trichloroacetic Acid	µg/L	2022-11-15	9.0
Turbidity	NTU	2022-01-13	0.37
Turbidity	NTU	2022-01-18	0.31
Turbidity	NTU	2022-01-24	0.18
Turbidity	NTU	2022-01-31	0.16
Turbidity	NTU	2022-02-03	0.22
Turbidity	NTU	2022-02-08	0.60
Turbidity	NTU	2022-02-18	0.25
Turbidity	NTU	2022-02-23	0.20
Turbidity	NTU	2022-03-03	0.14
Turbidity	NTU	2022-03-09	0.34
Turbidity	NTU	2022-03-17	0.10
Turbidity	NTU	2022-03-22	0.15
Turbidity	NTU	2022-03-30	0.25
Turbidity	NTU	2022-04-19	0.08
Turbidity	NTU	2022-04-25	0.11
Turbidity	NTU	2022-05-04	0.45
Turbidity	NTU	2022-05-10	0.23
Turbidity	NTU	2022-05-17	0.53
Turbidity	NTU	2022-05-25	7.3
Turbidity	NTU	2022-05-26	0.22
Turbidity	NTU	2022-05-31	0.42
Turbidity	NTU	2022-06-07	0.12
Turbidity	NTU	2022-06-14	0.32
Turbidity	NTU	2022-06-21	0.16
Turbidity	NTU	2022-06-28	0.19
Turbidity	NTU	2022-07-04	0.17
Turbidity	NTU	2022-07-12	0.28

Analysis	Units	Date Sampled	Treated
Turbidity	NTU	2022-07-21	0.54
Turbidity	NTU	2022-07-29	0.19
Turbidity	NTU	2022-08-04	0.38
Turbidity	NTU	2022-08-10	0.43
Turbidity	NTU	2022-08-16	0.20
Turbidity	NTU	2022-08-23	0.87
Turbidity	NTU	2022-09-01	0.60
Turbidity	NTU	2022-09-07	0.20
Turbidity	NTU	2022-09-13	0.17
Turbidity	NTU	2022-09-21	0.59
Turbidity	NTU	2022-09-26	0.26
Turbidity	NTU	2022-10-05	0.26
Turbidity	NTU	2022-10-13	0.34
Turbidity	NTU	2022-10-25	0.39
Turbidity	NTU	2022-11-02	0.21
Turbidity	NTU	2022-11-15	0.17
Turbidity	NTU	2022-11-22	0.31
Turbidity	NTU	2022-11-30	0.15
Turbidity	NTU	2022-12-06	0.26
Turbidity	NTU	2022-12-13	0.15
Turbidity	NTU	2022-12-21	0.17

Analysis	Units	Date Sampled	Treated
Ferry & Dyke Main GV-066			
Alkalinity as CaCO ₃	mg/L	2022-02-16	23
Alkalinity as CaCO ₃	mg/L	2022-05-10	23
Alkalinity as CaCO ₃	mg/L	2022-11-16	21
Aluminum Total	µg/L	2022-02-16	39
Aluminum Total	µg/L	2022-05-10	29
Aluminum Total	µg/L	2022-11-16	32
Antimony Total	µg/L	2022-02-16	<0.5
Antimony Total	µg/L	2022-05-10	<0.5
Antimony Total	µg/L	2022-11-16	<0.5
Arsenic Total	µg/L	2022-02-16	<0.5
Arsenic Total	µg/L	2022-05-10	<0.5
Arsenic Total	µg/L	2022-11-16	<0.5
Barium Total	µg/L	2022-02-16	2.5
Barium Total	µg/L	2022-05-10	2.5
Barium Total	µg/L	2022-11-16	3.2
Boron Total	µg/L	2022-02-16	<10
Boron Total	µg/L	2022-05-10	<10
Boron Total	µg/L	2022-11-16	<10
Bromate	µg/L	2022-02-16	<10.0
Bromate	µg/L	2022-05-10	<10.0
Bromate	µg/L	2022-08-22	<10.0
Bromate	µg/L	2022-11-16	<10.0
Bromide	µg/L	2022-02-16	<10.0
Bromide	µg/L	2022-05-10	<10.0
Bromide	µg/L	2022-08-22	<10.0
Bromide	µg/L	2022-11-16	<10.0
Bromodichloromethane	µg/L	2022-02-16	<1
Bromodichloromethane	µg/L	2022-05-10	<1
Bromodichloromethane	µg/L	2022-11-16	2
Bromoform	µg/L	2022-02-16	<1
Bromoform	µg/L	2022-05-10	<1
Bromoform	µg/L	2022-11-16	<1
Cadmium Total	µg/L	2022-02-16	<0.2
Cadmium Total	µg/L	2022-05-10	<0.2
Cadmium Total	µg/L	2022-11-16	<0.2
Calcium Total	µg/L	2022-02-16	8,600
Calcium Total	µg/L	2022-05-10	8,660
Calcium Total	µg/L	2022-11-16	8,500
Chlorate	µg/L	2022-02-16	21.5
Chlorate	µg/L	2022-05-10	27.9
Chlorate	µg/L	2022-08-22	54.4

Analysis	Units	Date Sampled	Treated
Chlorate	µg/L	2022-11-16	40.1
Chloride	mg/L	2022-02-16	2.5
Chloride	mg/L	2022-05-10	2.3
Chloride	mg/L	2022-08-22	2.7
Chloride	mg/L	2022-11-16	3.1
Chlorodibromomethane	µg/L	2022-02-16	<1
Chlorodibromomethane	µg/L	2022-05-10	<1
Chlorodibromomethane	µg/L	2022-11-16	<1
Chloroform	µg/L	2022-02-16	20
Chloroform	µg/L	2022-05-10	25
Chloroform	µg/L	2022-11-16	27
Chromium Total	µg/L	2022-02-16	<0.05
Chromium Total	µg/L	2022-05-10	<0.05
Chromium Total	µg/L	2022-11-16	0.06
Cobalt Total	µg/L	2022-02-16	<0.5
Cobalt Total	µg/L	2022-05-10	<0.5
Cobalt Total	µg/L	2022-11-16	<0.5
Copper Total	µg/L	2022-02-16	0.7
Copper Total	µg/L	2022-05-10	0.7
Copper Total	µg/L	2022-11-16	0.7
Dibromoacetic Acid	µg/L	2022-02-16	<0.5
Dibromoacetic Acid	µg/L	2022-05-10	<0.5
Dibromoacetic Acid	µg/L	2022-08-22	<0.5
Dibromoacetic Acid	µg/L	2022-11-16	<0.5
Dichloroacetic Acid	µg/L	2022-02-16	9.3
Dichloroacetic Acid	µg/L	2022-05-10	10
Dichloroacetic Acid	µg/L	2022-08-22	11
Dichloroacetic Acid	µg/L	2022-11-16	9.8
Iron Total	µg/L	2022-02-16	5
Iron Total	µg/L	2022-05-10	8
Iron Total	µg/L	2022-11-16	<5
Lead Total	µg/L	2022-02-16	<0.5
Lead Total	µg/L	2022-05-10	<0.5
Lead Total	µg/L	2022-11-16	<0.5
Magnesium Total	µg/L	2022-02-16	200
Magnesium Total	µg/L	2022-05-10	240
Magnesium Total	µg/L	2022-11-16	221
Manganese Total	µg/L	2022-02-16	2.9
Manganese Total	µg/L	2022-05-10	7.2
Manganese Total	µg/L	2022-11-16	7.2
Mercury Total	µg/L	2022-02-16	<0.05
Mercury Total	µg/L	2022-05-10	<0.05

Analysis	Units	Date Sampled	Treated
Mercury Total	µg/L	2022-11-16	<0.05
Molybdenum Total	µg/L	2022-02-16	<0.5
Molybdenum Total	µg/L	2022-05-10	<0.5
Molybdenum Total	µg/L	2022-11-16	<0.5
Monobromoacetic Acid	µg/L	2022-02-16	<0.5
Monobromoacetic Acid	µg/L	2022-05-10	<0.5
Monobromoacetic Acid	µg/L	2022-08-22	<0.5
Monobromoacetic Acid	µg/L	2022-11-16	<0.5
Monochloroacetic Acid	µg/L	2022-02-16	<5.0
Monochloroacetic Acid	µg/L	2022-05-10	0.6
Monochloroacetic Acid	µg/L	2022-08-22	<5.0
Monochloroacetic Acid	µg/L	2022-11-16	0.7
Nickel Total	µg/L	2022-02-16	<0.5
Nickel Total	µg/L	2022-05-10	<0.5
Nickel Total	µg/L	2022-11-16	<0.5
pH	pH units	2022-02-16	7.9
pH	pH units	2022-05-10	8.0
pH	pH units	2022-08-22	7.8
pH	pH units	2022-11-16	7.9
Potassium Total	µg/L	2022-02-16	152
Potassium Total	µg/L	2022-05-10	159
Potassium Total	µg/L	2022-11-16	235
Selenium Total	µg/L	2022-02-16	<0.5
Selenium Total	µg/L	2022-05-10	<0.5
Selenium Total	µg/L	2022-11-16	<0.5
Silver Total	µg/L	2022-02-16	<0.5
Silver Total	µg/L	2022-05-10	<0.5
Silver Total	µg/L	2022-11-16	<0.5
Sodium Total	µg/L	2022-02-16	1,760
Sodium Total	µg/L	2022-05-10	1,620
Sodium Total	µg/L	2022-08-22	2,510
Sodium Total	µg/L	2022-11-16	2,050
Trichloroacetic Acid	µg/L	2022-02-16	7.7
Trichloroacetic Acid	µg/L	2022-05-10	7.3
Trichloroacetic Acid	µg/L	2022-08-22	8.1
Trichloroacetic Acid	µg/L	2022-11-16	7.3
Turbidity	NTU	2022-01-07	0.15
Turbidity	NTU	2022-01-12	0.15
Turbidity	NTU	2022-01-19	0.14
Turbidity	NTU	2022-01-25	0.12
Turbidity	NTU	2022-02-01	0.19
Turbidity	NTU	2022-02-07	0.20

Analysis	Units	Date Sampled	Treated
Turbidity	NTU	2022-02-16	0.14
Turbidity	NTU	2022-02-22	0.12
Turbidity	NTU	2022-03-03	0.19
Turbidity	NTU	2022-03-09	0.43
Turbidity	NTU	2022-03-17	0.16
Turbidity	NTU	2022-03-23	0.17
Turbidity	NTU	2022-03-29	0.24
Turbidity	NTU	2022-04-04	0.13
Turbidity	NTU	2022-04-14	0.13
Turbidity	NTU	2022-04-20	0.10
Turbidity	NTU	2022-04-27	0.10
Turbidity	NTU	2022-05-04	0.14
Turbidity	NTU	2022-05-10	0.15
Turbidity	NTU	2022-05-17	0.09
Turbidity	NTU	2022-05-26	0.13
Turbidity	NTU	2022-06-01	0.14
Turbidity	NTU	2022-06-03	0.13
Turbidity	NTU	2022-06-07	0.17
Turbidity	NTU	2022-06-14	0.19
Turbidity	NTU	2022-06-21	0.13
Turbidity	NTU	2022-06-29	0.13
Turbidity	NTU	2022-07-05	0.13
Turbidity	NTU	2022-07-12	0.12
Turbidity	NTU	2022-07-20	0.11
Turbidity	NTU	2022-07-27	0.22
Turbidity	NTU	2022-08-03	0.12
Turbidity	NTU	2022-08-09	0.10
Turbidity	NTU	2022-08-17	0.10
Turbidity	NTU	2022-08-22	0.13
Turbidity	NTU	2022-08-30	0.14
Turbidity	NTU	2022-09-08	0.11
Turbidity	NTU	2022-09-13	0.11
Turbidity	NTU	2022-09-22	0.27
Turbidity	NTU	2022-09-28	0.51
Turbidity	NTU	2022-10-05	0.16
Turbidity	NTU	2022-10-20	0.19
Turbidity	NTU	2022-10-24	0.14
Turbidity	NTU	2022-11-02	0.24
Turbidity	NTU	2022-11-09	0.13
Turbidity	NTU	2022-11-16	0.16
Turbidity	NTU	2022-11-22	0.14
Turbidity	NTU	2022-11-29	0.15

Analysis	Units	Date Sampled	Treated
Turbidity	NTU	2022-12-06	0.13
Turbidity	NTU	2022-12-13	0.14
Zinc Total	µg/L	2022-02-16	<3.0
Zinc Total	µg/L	2022-05-10	<3.0
Zinc Total	µg/L	2022-11-16	<3.0

Analysis	Units	Date Sampled	Treated
Maple Ridge Chamber Main GV-098			
Alkalinity as CaCO ₃	mg/L	2022-02-14	23
Alkalinity as CaCO ₃	mg/L	2022-05-13	23
Alkalinity as CaCO ₃	mg/L	2022-08-23	21
Alkalinity as CaCO ₃	mg/L	2022-11-17	21
Aluminum Total	µg/L	2022-02-14	89
Aluminum Total	µg/L	2022-05-13	88
Aluminum Total	µg/L	2022-08-23	81
Aluminum Total	µg/L	2022-11-17	74
Antimony Total	µg/L	2022-02-14	<0.5
Antimony Total	µg/L	2022-05-13	<0.5
Antimony Total	µg/L	2022-08-23	<0.5
Antimony Total	µg/L	2022-11-17	<0.5
Arsenic Total	µg/L	2022-02-14	<0.5
Arsenic Total	µg/L	2022-05-13	<0.5
Arsenic Total	µg/L	2022-08-23	<0.5
Arsenic Total	µg/L	2022-11-17	<0.5
Barium Total	µg/L	2022-02-14	2.1
Barium Total	µg/L	2022-05-13	2.0
Barium Total	µg/L	2022-08-23	2.0
Barium Total	µg/L	2022-11-17	2.3
Benzene	µg/L	2022-05-16	<0.5
Benzene	µg/L	2022-12-01	<0.5
Boron Total	µg/L	2022-02-14	<10
Boron Total	µg/L	2022-05-13	<10
Boron Total	µg/L	2022-08-23	<10
Boron Total	µg/L	2022-11-17	<10
Bromate	µg/L	2022-02-14	<10.0
Bromate	µg/L	2022-05-13	<10.0
Bromate	µg/L	2022-08-23	<10.0
Bromate	µg/L	2022-11-17	<10.0
Bromide	µg/L	2022-02-14	<10.0
Bromide	µg/L	2022-05-13	<10.0
Bromide	µg/L	2022-08-23	<10.0
Bromide	µg/L	2022-11-17	<10.0
Bromodichloromethane	µg/L	2022-02-14	<1
Bromodichloromethane	µg/L	2022-05-13	<1
Bromodichloromethane	µg/L	2022-11-17	2
Bromoform	µg/L	2022-02-14	<1
Bromoform	µg/L	2022-05-13	<1
Bromoform	µg/L	2022-11-17	<1
BTEX	µg/L	2022-05-16	<1

Analysis	Units	Date Sampled	Treated
BTEX	µg/L	2022-12-01	2
Cadmium Total	µg/L	2022-02-14	<0.2
Cadmium Total	µg/L	2022-05-13	<0.2
Cadmium Total	µg/L	2022-08-23	<0.2
Cadmium Total	µg/L	2022-11-17	<0.2
Calcium Total	µg/L	2022-02-14	839
Calcium Total	µg/L	2022-05-13	849
Calcium Total	µg/L	2022-08-23	757
Calcium Total	µg/L	2022-11-17	903
Chlorate	µg/L	2022-02-14	58.4
Chlorate	µg/L	2022-05-13	84.3
Chlorate	µg/L	2022-08-23	72.9
Chlorate	µg/L	2022-11-17	40.7
Chloride	µg/L	2022-02-14	2.4
Chloride	µg/L	2022-05-13	2.4
Chloride	µg/L	2022-08-23	2.5
Chloride	µg/L	2022-11-17	2.5
Chlorodibromomethane	µg/L	2022-02-14	<1
Chlorodibromomethane	µg/L	2022-05-13	<1
Chlorodibromomethane	µg/L	2022-11-17	<1
Chloroform	µg/L	2022-02-14	29
Chloroform	µg/L	2022-05-13	35
Chloroform	µg/L	2022-11-17	37
Chromium Total	µg/L	2022-02-14	<0.05
Chromium Total	µg/L	2022-05-13	<0.05
Chromium Total	µg/L	2022-08-23	<0.05
Chromium Total	µg/L	2022-11-17	0.05
Cobalt Total	µg/L	2022-02-14	<0.5
Cobalt Total	µg/L	2022-05-13	<0.5
Cobalt Total	µg/L	2022-08-23	<0.5
Cobalt Total	µg/L	2022-11-17	<0.5
Copper Total	µg/L	2022-02-14	<0.5
Copper Total	µg/L	2022-05-13	<0.5
Copper Total	µg/L	2022-08-23	<0.5
Copper Total	µg/L	2022-11-17	<0.5
Dibromoacetic Acid	µg/L	2022-02-14	<0.5
Dibromoacetic Acid	µg/L	2022-05-13	<0.5
Dibromoacetic Acid	µg/L	2022-08-23	<0.5
Dibromoacetic Acid	µg/L	2022-11-17	<0.5
Dichloroacetic Acid	µg/L	2022-02-14	16
Dichloroacetic Acid	µg/L	2022-05-13	20
Dichloroacetic Acid	µg/L	2022-08-23	21

Analysis	Units	Date Sampled	Treated
Dichloroacetic Acid	µg/L	2022-11-17	11
Ethyl Benzene	µg/L	2022-05-16	<0.5
Ethyl Benzene	µg/L	2022-12-01	<0.5
Iron Total	µg/L	2022-02-14	60
Iron Total	µg/L	2022-05-13	48
Iron Total	µg/L	2022-08-23	34
Iron Total	µg/L	2022-11-17	50
Lead Total	µg/L	2022-02-14	<0.5
Lead Total	µg/L	2022-05-13	<0.5
Lead Total	µg/L	2022-08-23	<0.5
Lead Total	µg/L	2022-11-17	<0.5
Magnesium Total	µg/L	2022-02-14	99
Magnesium Total	µg/L	2022-05-13	93
Magnesium Total	µg/L	2022-08-23	76
Magnesium Total	µg/L	2022-11-17	99
Manganese Total	µg/L	2022-02-14	3.3
Manganese Total	µg/L	2022-05-13	4.4
Manganese Total	µg/L	2022-08-23	3.4
Manganese Total	µg/L	2022-11-17	2.4
Mercury Total	µg/L	2022-02-14	<0.05
Mercury Total	µg/L	2022-05-13	<0.05
Mercury Total	µg/L	2022-08-23	<0.05
Mercury Total	µg/L	2022-11-17	<0.05
Molybdenum Total	µg/L	2022-02-14	<0.5
Molybdenum Total	µg/L	2022-05-13	<0.5
Molybdenum Total	µg/L	2022-08-23	<0.5
Molybdenum Total	µg/L	2022-11-17	<0.5
Monobromoacetic Acid	µg/L	2022-02-14	<5.0
Monobromoacetic Acid	µg/L	2022-05-13	<0.5
Monobromoacetic Acid	µg/L	2022-08-23	<0.5
Monobromoacetic Acid	µg/L	2022-11-17	<0.5
Monochloroacetic Acid	µg/L	2022-02-14	<5.0
Monochloroacetic Acid	µg/L	2022-05-13	<5.0
Monochloroacetic Acid	µg/L	2022-08-23	1.5
Monochloroacetic Acid	µg/L	2022-11-17	1.1
Nickel Total	µg/L	2022-02-14	<0.5
Nickel Total	µg/L	2022-05-13	<0.5
Nickel Total	µg/L	2022-08-23	<0.5
Nickel Total	µg/L	2022-11-17	<0.5
pH	pH units	2022-02-14	7.8
pH	pH units	2022-05-13	7.9
pH	pH units	2022-08-23	7.7

Analysis	Units	Date Sampled	Treated
pH	pH units	2022-11-17	7.8
Potassium Total	µg/L	2022-02-14	110
Potassium Total	µg/L	2022-05-13	104
Potassium Total	µg/L	2022-08-23	96
Potassium Total	µg/L	2022-11-17	140
Selenium Total	µg/L	2022-02-14	<0.5
Selenium Total	µg/L	2022-05-13	<0.5
Selenium Total	µg/L	2022-08-23	<0.5
Selenium Total	µg/L	2022-11-17	<0.5
Silver Total	µg/L	2022-02-14	<0.5
Silver Total	µg/L	2022-05-13	<0.5
Silver Total	µg/L	2022-08-23	<0.5
Silver Total	µg/L	2022-11-17	<0.5
Sodium Total	µg/L	2022-02-14	11,600
Sodium Total	µg/L	2022-05-13	11,000
Sodium Total	µg/L	2022-08-23	10,700
Sodium Total	µg/L	2022-11-17	10,700
Toluene	µg/L	2022-05-16	<0.5
Toluene	µg/L	2022-12-01	<0.5
Trichloroacetic Acid	µg/L	2022-02-14	24
Trichloroacetic Acid	µg/L	2022-05-13	31
Trichloroacetic Acid	µg/L	2022-08-23	27
Trichloroacetic Acid	µg/L	2022-11-17	17
Turbidity	NTU	2022-01-07	0.53
Turbidity	NTU	2022-01-10	0.80
Turbidity	NTU	2022-01-17	1.1
Turbidity	NTU	2022-01-25	0.52
Turbidity	NTU	2022-02-03	0.40
Turbidity	NTU	2022-02-07	0.59
Turbidity	NTU	2022-02-14	0.34
Turbidity	NTU	2022-02-22	0.38
Turbidity	NTU	2022-03-03	0.52
Turbidity	NTU	2022-03-11	0.41
Turbidity	NTU	2022-03-14	0.37
Turbidity	NTU	2022-03-21	0.53
Turbidity	NTU	2022-03-31	0.45
Turbidity	NTU	2022-04-12	0.26
Turbidity	NTU	2022-04-19	0.26
Turbidity	NTU	2022-04-25	0.37
Turbidity	NTU	2022-05-06	0.26
Turbidity	NTU	2022-05-12	0.27
Turbidity	NTU	2022-05-13	0.26

Analysis	Units	Date Sampled	Treated
Turbidity	NTU	2022-05-15	0.26
Turbidity	NTU	2022-05-16	0.27
Turbidity	NTU	2022-05-17	0.22
Turbidity	NTU	2022-05-24	0.27
Turbidity	NTU	2022-06-03	0.27
Turbidity	NTU	2022-06-08	0.25
Turbidity	NTU	2022-06-13	0.21
Turbidity	NTU	2022-06-23	0.20
Turbidity	NTU	2022-06-27	0.71
Turbidity	NTU	2022-07-07	0.24
Turbidity	NTU	2022-07-13	0.28
Turbidity	NTU	2022-07-20	0.31
Turbidity	NTU	2022-07-26	0.44
Turbidity	NTU	2022-08-05	0.28
Turbidity	NTU	2022-08-12	0.18
Turbidity	NTU	2022-08-15	0.33
Turbidity	NTU	2022-08-23	0.24
Turbidity	NTU	2022-09-09	0.27
Turbidity	NTU	2022-09-16	0.26
Turbidity	NTU	2022-09-23	0.23
Turbidity	NTU	2022-09-29	0.21
Turbidity	NTU	2022-10-03	0.34
Turbidity	NTU	2022-10-12	0.25
Turbidity	NTU	2022-10-21	0.26
Turbidity	NTU	2022-10-28	0.31
Turbidity	NTU	2022-11-04	0.51
Turbidity	NTU	2022-11-07	0.41
Turbidity	NTU	2022-11-17	0.31
Turbidity	NTU	2022-11-23	0.33
Turbidity	NTU	2022-12-01	0.37
Turbidity	NTU	2022-12-07	0.30
Turbidity	NTU	2022-12-16	0.30
xylene meta para	µg/L	2022-05-16	<1
xylene meta para	µg/L	2022-12-01	<1
xylene ortho	µg/L	2022-05-16	<0.5
xylene ortho	µg/L	2022-12-01	<0.5
Xylene Total	µg/L	2022-05-16	<1
Xylene Total	µg/L	2022-12-01	1
Zinc Total	µg/L	2022-02-14	<3.0
Zinc Total	µg/L	2022-05-13	<3.0
Zinc Total	µg/L	2022-08-23	<3.0
Zinc Total	µg/L	2022-11-17	<3.0

Analysis	Units	Date Sampled	Treated
Seymour at Grandview Main GV-128			
Bromate	µg/L	2022-02-16	<10.0
Bromate	µg/L	2022-05-12	<10.0
Bromate	µg/L	2022-08-25	<10.0
Bromate	µg/L	2022-11-17	<10.0
Bromide	µg/L	2022-02-16	<10.0
Bromide	µg/L	2022-05-12	<10.0
Bromide	µg/L	2022-08-25	<10.0
Bromide	µg/L	2022-11-17	<10.0
Bromodichloromethane	µg/L	2022-02-16	<1
Bromodichloromethane	µg/L	2022-05-12	<1
Bromodichloromethane	µg/L	2022-11-17	2
Bromoform	µg/L	2022-02-16	<1
Bromoform	µg/L	2022-05-12	<1
Bromoform	µg/L	2022-11-17	<1
Chlorate	µg/L	2022-02-16	52.7
Chlorate	µg/L	2022-05-12	98.4
Chlorate	µg/L	2022-08-25	81.6
Chlorate	µg/L	2022-11-17	27.5
Chloride	mg/L	2022-02-16	2.5
Chloride	mg/L	2022-05-12	2.6
Chloride	mg/L	2022-08-25	2.6
Chloride	mg/L	2022-11-17	3.2
Chlorodibromomethane	µg/L	2022-02-16	<1
Chlorodibromomethane	µg/L	2022-05-12	<1
Chlorodibromomethane	µg/L	2022-11-17	<1
Chloroform	µg/L	2022-02-16	28
Chloroform	µg/L	2022-05-12	31
Chloroform	µg/L	2022-11-17	38
Dibromoacetic Acid	µg/L	2022-02-16	<0.5
Dibromoacetic Acid	µg/L	2022-05-12	<0.5
Dibromoacetic Acid	µg/L	2022-08-25	<0.5
Dibromoacetic Acid	µg/L	2022-11-17	<0.5
Dichloroacetic Acid	µg/L	2022-02-16	14
Dichloroacetic Acid	µg/L	2022-05-12	15
Dichloroacetic Acid	µg/L	2022-08-25	16
Dichloroacetic Acid	µg/L	2022-11-17	9.5
Monobromoacetic Acid	µg/L	2022-02-16	<0.5
Monobromoacetic Acid	µg/L	2022-05-12	<0.5
Monobromoacetic Acid	µg/L	2022-08-25	<0.5
Monobromoacetic Acid	µg/L	2022-11-17	<0.5

Analysis	Units	Date Sampled	Treated
Monochloroacetic Acid	µg/L	2022-02-16	1.2
Monochloroacetic Acid	µg/L	2022-05-12	1.8
Monochloroacetic Acid	µg/L	2022-08-25	<5.0
Monochloroacetic Acid	µg/L	2022-11-17	1.1
pH	pH units	2022-02-16	7.8
pH	pH units	2022-05-12	7.9
pH	pH units	2022-08-25	7.9
pH	pH units	2022-11-17	7.9
Sodium Total	µg/L	2022-02-16	10,300
Sodium Total	µg/L	2022-05-12	11,200
Sodium Total	µg/L	2022-08-25	10,900
Sodium Total	µg/L	2022-11-17	2,190
Trichloroacetic Acid	µg/L	2022-02-16	18
Trichloroacetic Acid	µg/L	2022-05-12	21
Trichloroacetic Acid	µg/L	2022-08-25	16
Trichloroacetic Acid	µg/L	2022-11-17	8.1
Turbidity	NTU	2022-01-07	2.4
Turbidity	NTU	2022-01-11	0.64
Turbidity	NTU	2022-01-19	0.42
Turbidity	NTU	2022-01-24	0.44
Turbidity	NTU	2022-02-04	0.62
Turbidity	NTU	2022-02-09	0.44
Turbidity	NTU	2022-02-16	0.93
Turbidity	NTU	2022-02-23	0.33
Turbidity	NTU	2022-03-01	0.30
Turbidity	NTU	2022-03-07	0.39
Turbidity	NTU	2022-03-11	0.45
Turbidity	NTU	2022-03-15	0.32
Turbidity	NTU	2022-03-23	0.41
Turbidity	NTU	2022-03-30	0.38
Turbidity	NTU	2022-04-05	0.24
Turbidity	NTU	2022-04-12	0.32
Turbidity	NTU	2022-04-22	0.29
Turbidity	NTU	2022-04-24	0.34
Turbidity	NTU	2022-05-01	0.27
Turbidity	NTU	2022-05-12	0.29
Turbidity	NTU	2022-05-17	0.34
Turbidity	NTU	2022-05-25	0.36
Turbidity	NTU	2022-05-31	0.28
Turbidity	NTU	2022-06-08	0.12
Turbidity	NTU	2022-06-13	0.83
Turbidity	NTU	2022-06-21	0.22

Analysis	Units	Date Sampled	Treated
Turbidity	NTU	2022-06-27	0.66
Turbidity	NTU	2022-07-05	0.28
Turbidity	NTU	2022-07-11	0.17
Turbidity	NTU	2022-07-19	0.09
Turbidity	NTU	2022-07-26	0.31
Turbidity	NTU	2022-08-03	0.30
Turbidity	NTU	2022-08-08	0.24
Turbidity	NTU	2022-08-10	0.16
Turbidity	NTU	2022-08-16	0.13
Turbidity	NTU	2022-08-25	0.27
Turbidity	NTU	2022-09-01	0.25
Turbidity	NTU	2022-09-06	0.11
Turbidity	NTU	2022-09-15	0.22
Turbidity	NTU	2022-09-21	0.34
Turbidity	NTU	2022-09-26	0.19
Turbidity	NTU	2022-10-04	0.18
Turbidity	NTU	2022-10-11	0.19
Turbidity	NTU	2022-10-25	0.13
Turbidity	NTU	2022-11-04	0.10
Turbidity	NTU	2022-11-08	0.11
Turbidity	NTU	2022-11-17	0.09
Turbidity	NTU	2022-11-21	0.10
Turbidity	NTU	2022-12-02	0.16
Turbidity	NTU	2022-12-05	0.12
Turbidity	NTU	2022-12-12	0.14

